


CURRENT IN AMPERES

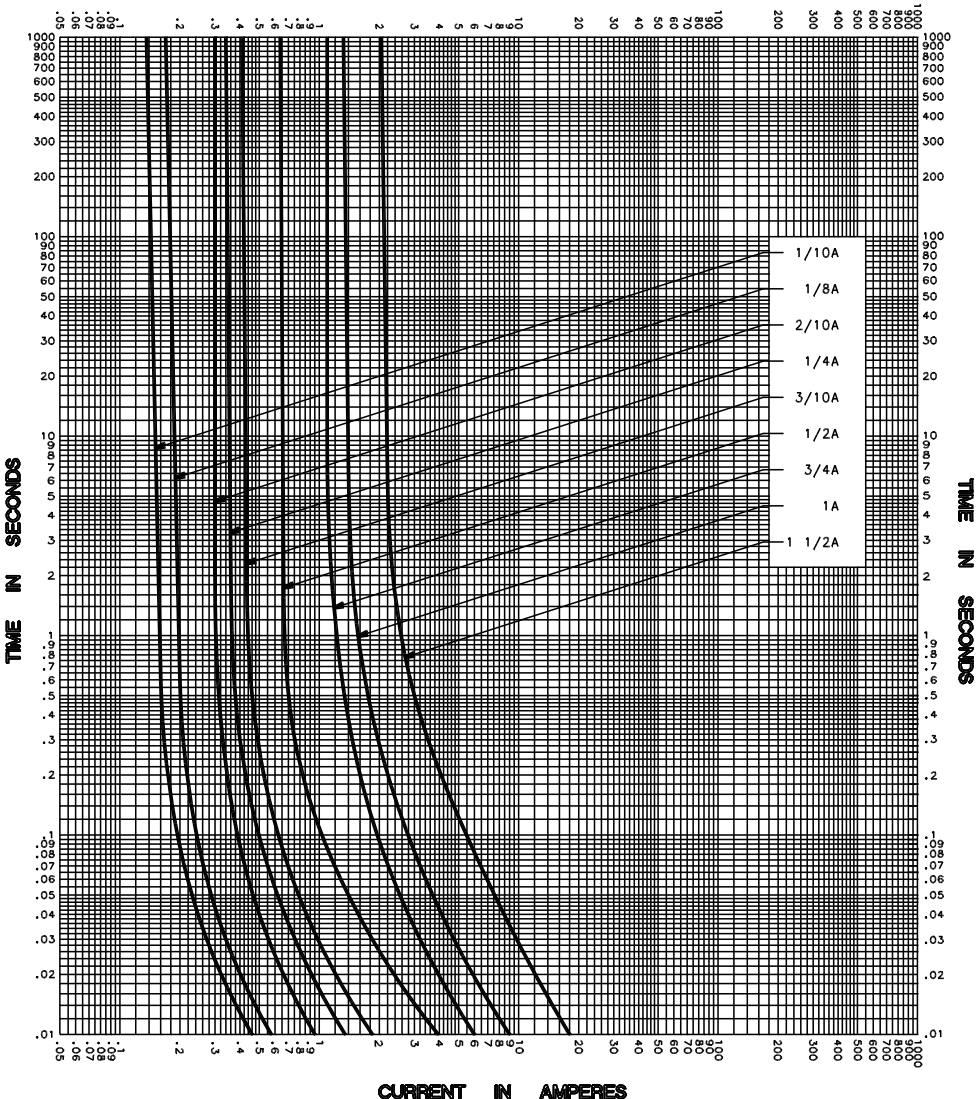


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		KLK (1/10A - 1-1/2A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY MRD DATE 02/17/03 CHECKED BY TN
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. C-FCC017

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

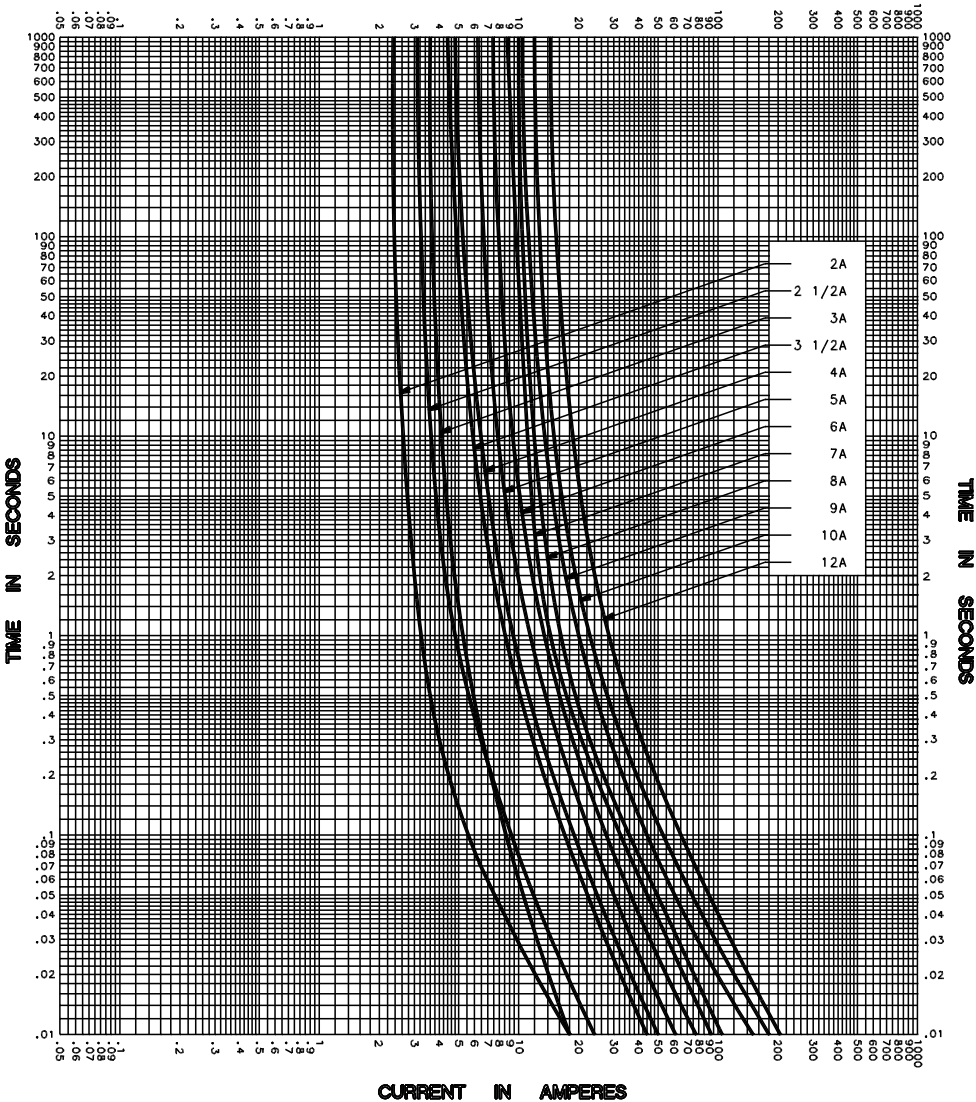


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	KLK (2A - 12A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/08/05</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A-FCC012</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

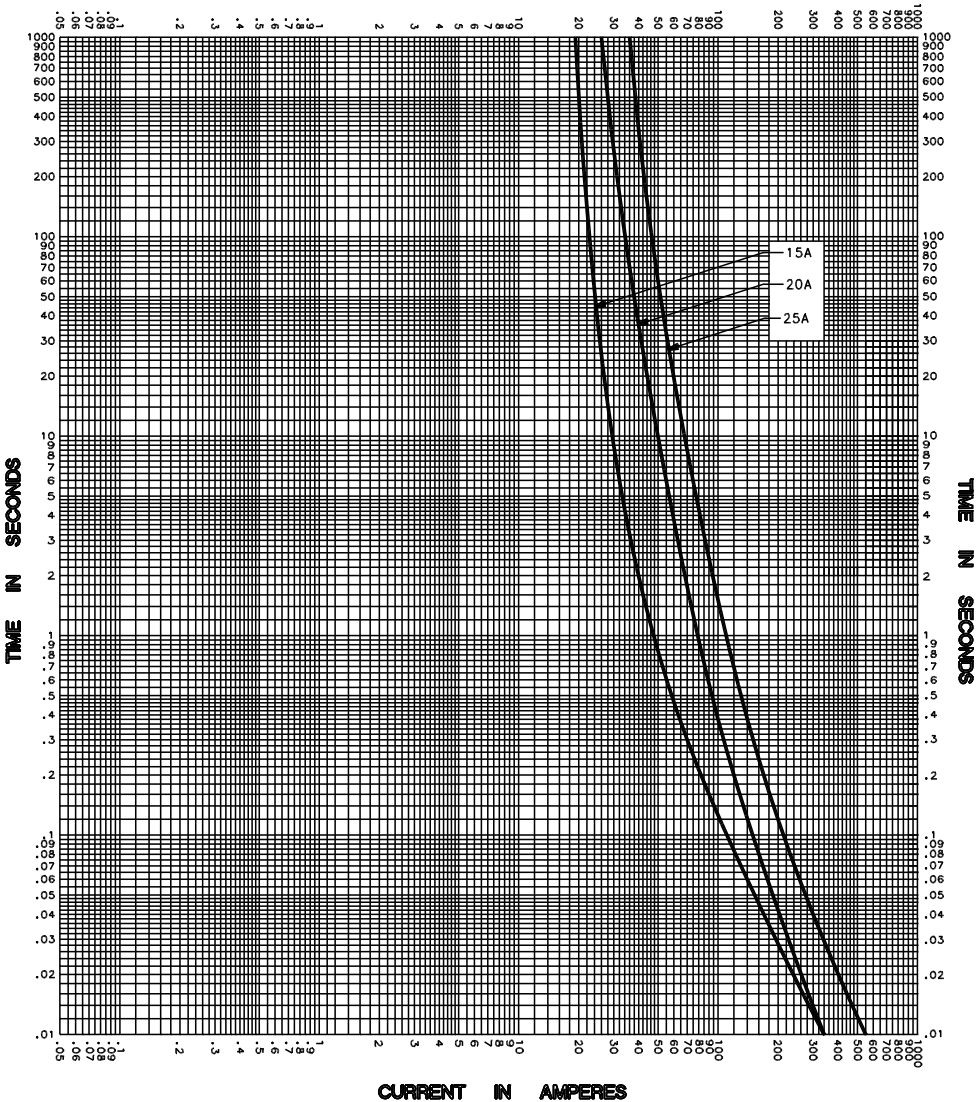


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (15A - 25A)
BASIS FOR DATA _____		

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>04/08/05</u> CHECKED BY <u>MP</u>
	TIME CURRENT CHARACTERISTIC CURVES DRAWING NO. <u>A-FCC017</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

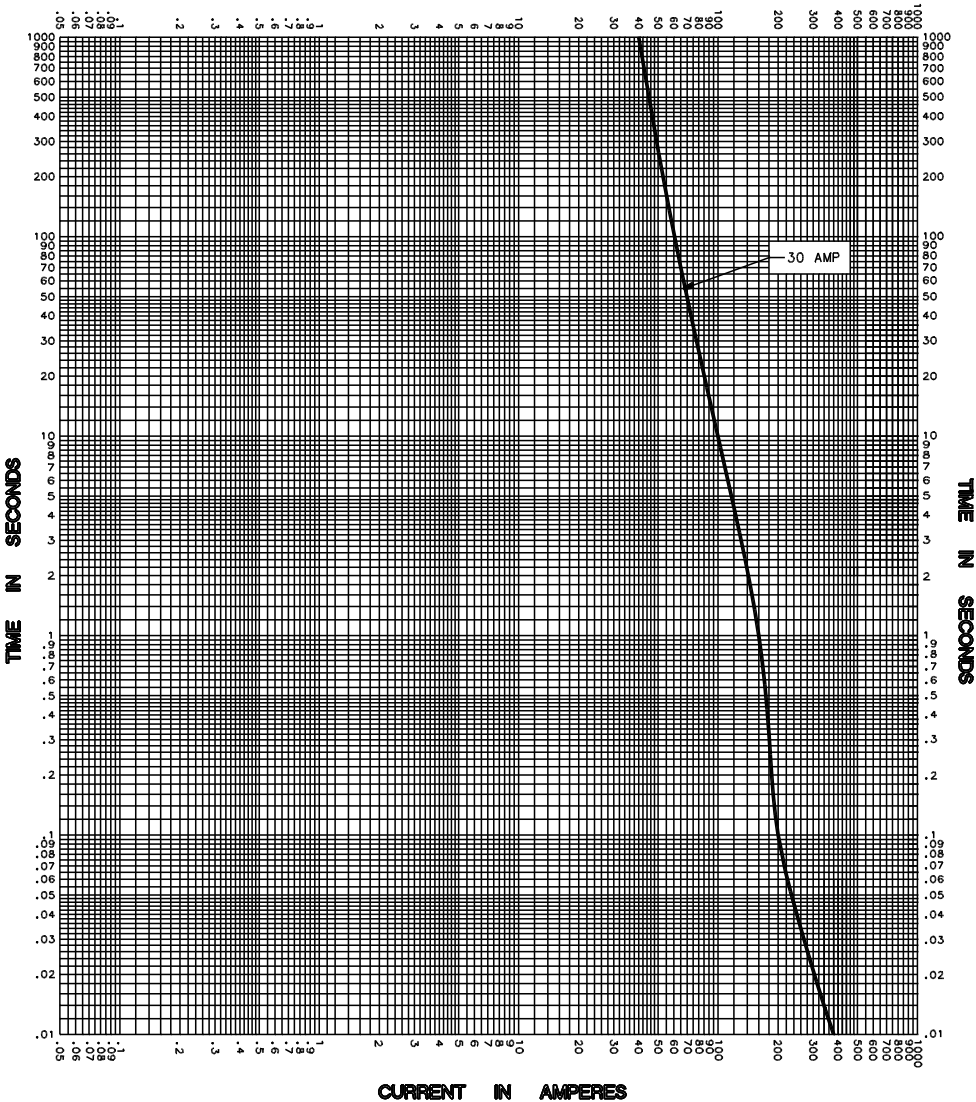

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (30A)
BASIS FOR DATA _____		

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/08/05</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	
DRAWING NO. <u>A-FCC017</u>	

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT