


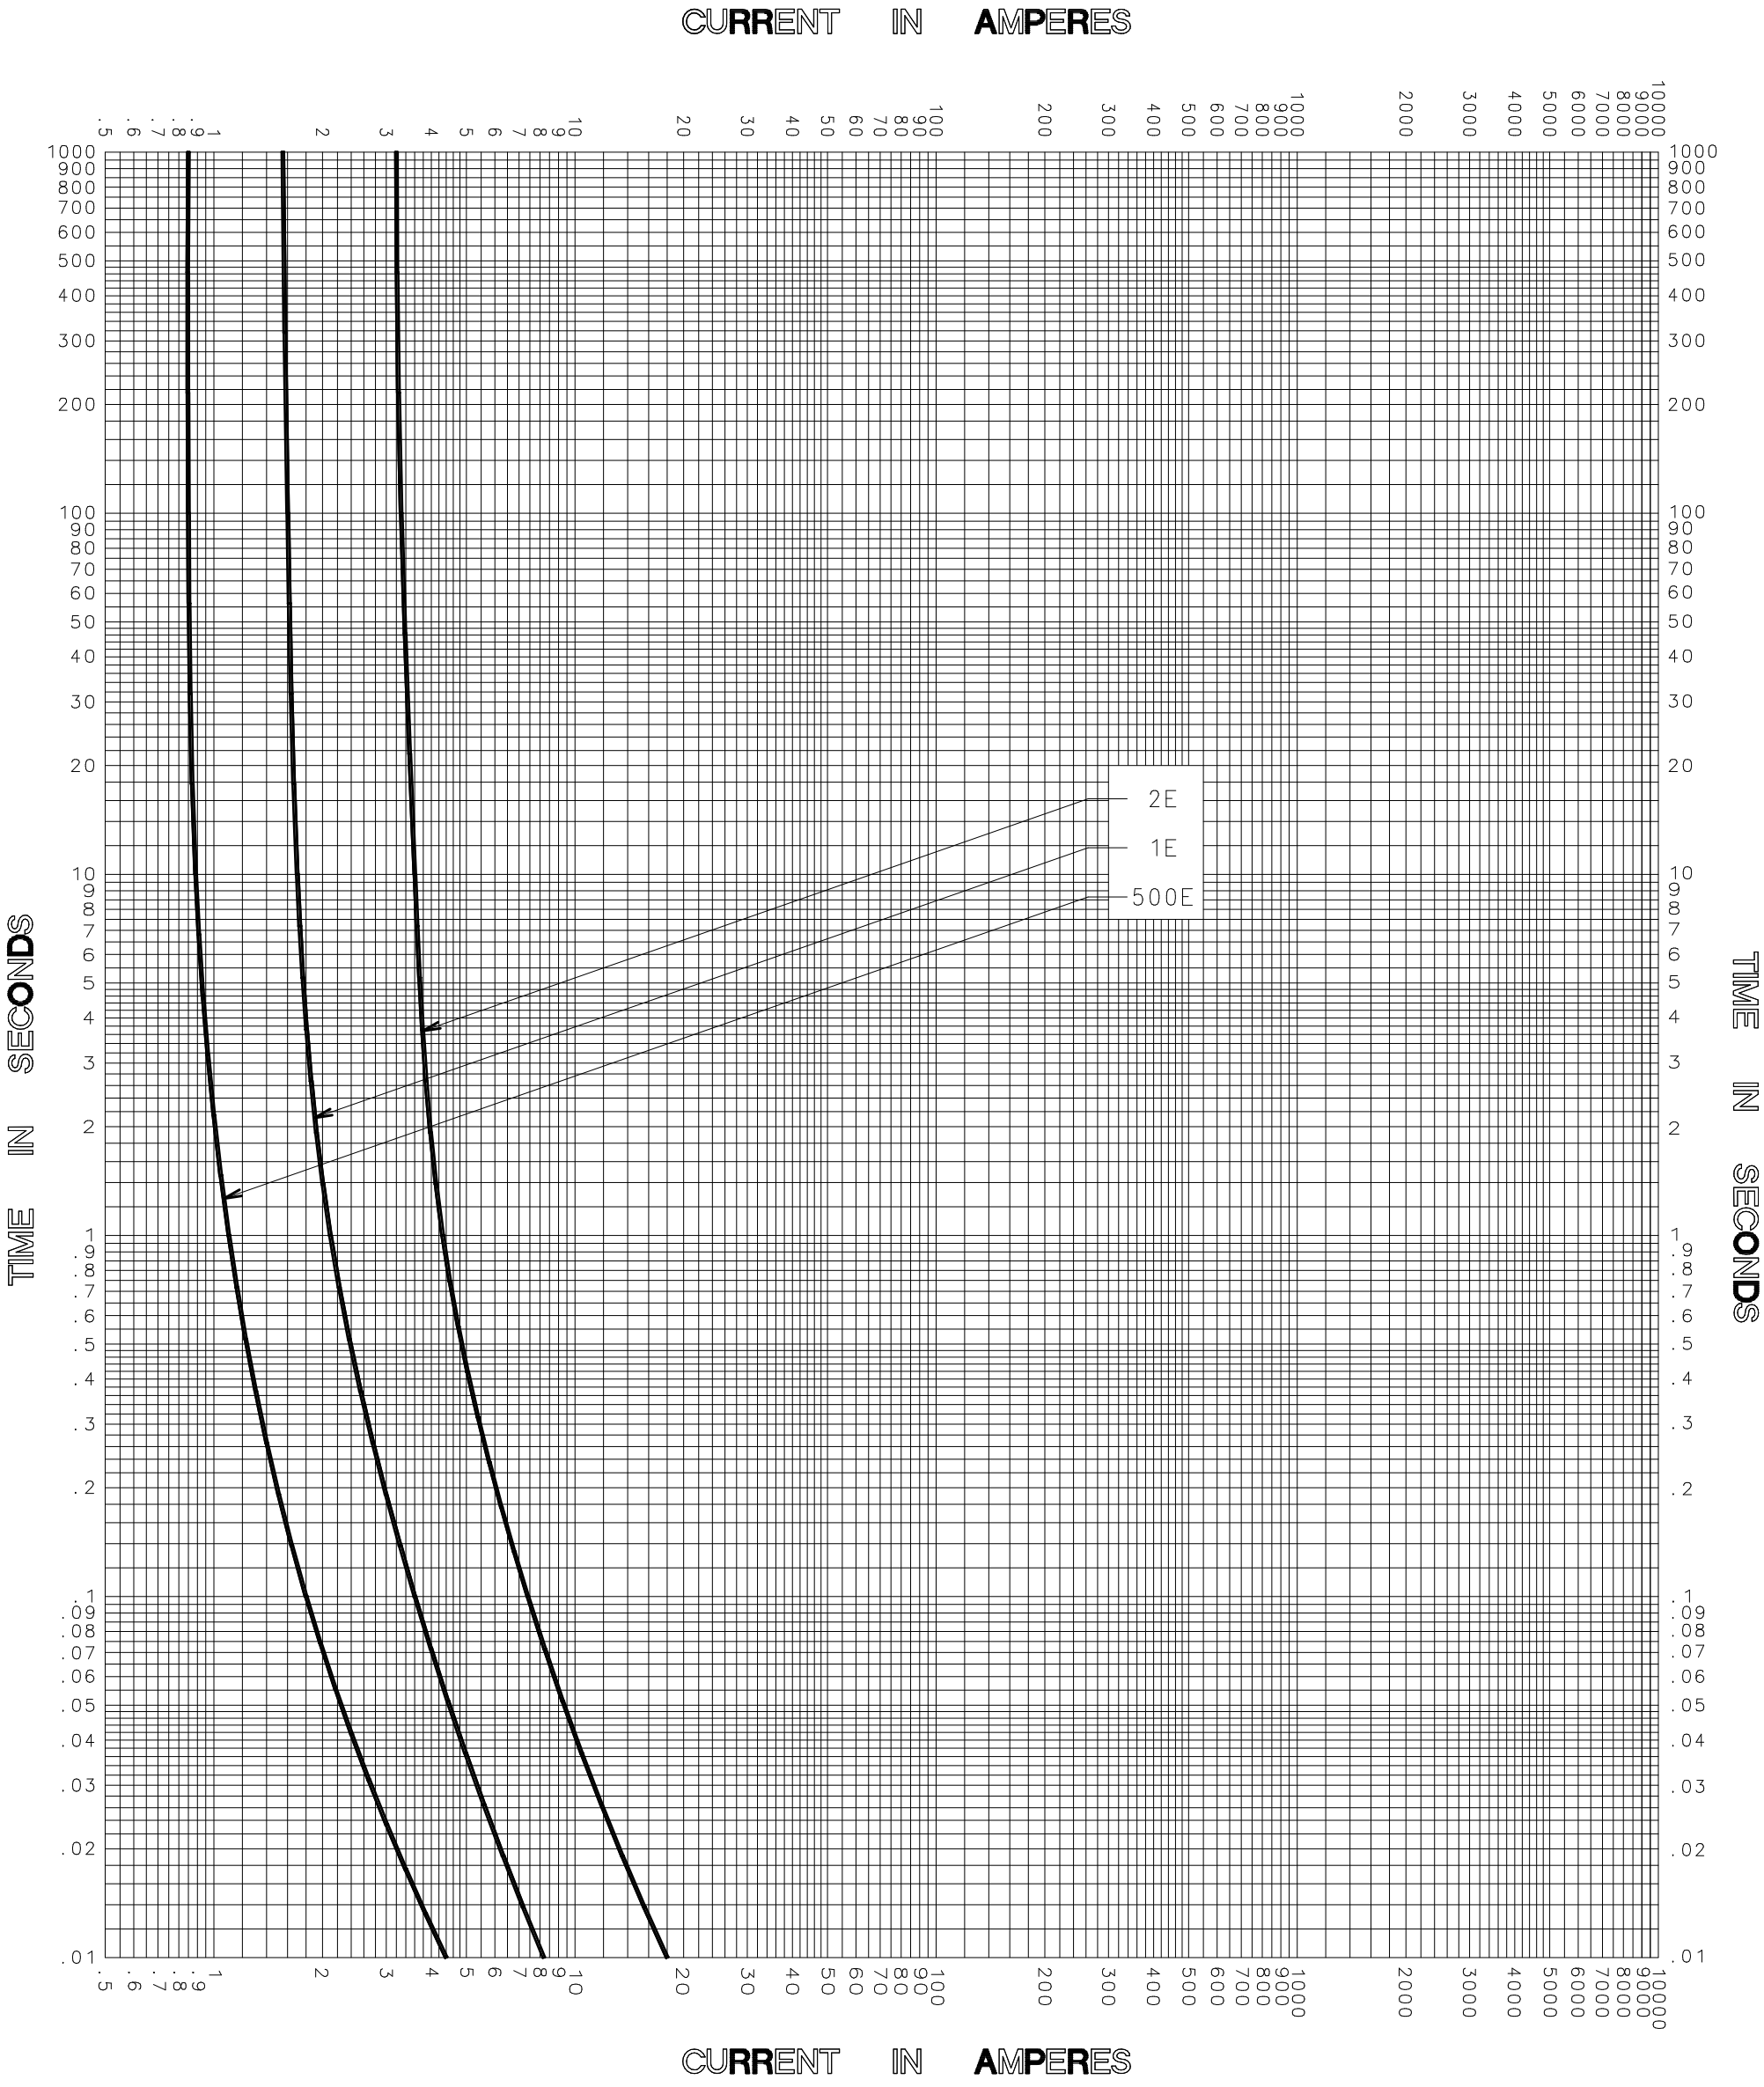

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	500E-4PT-2.4 thru 2E-4PT-2.4

 Littelfuse [®] DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>10/17/05</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A FCC01-01 PT-001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT