


CURRENT IN AMPERES

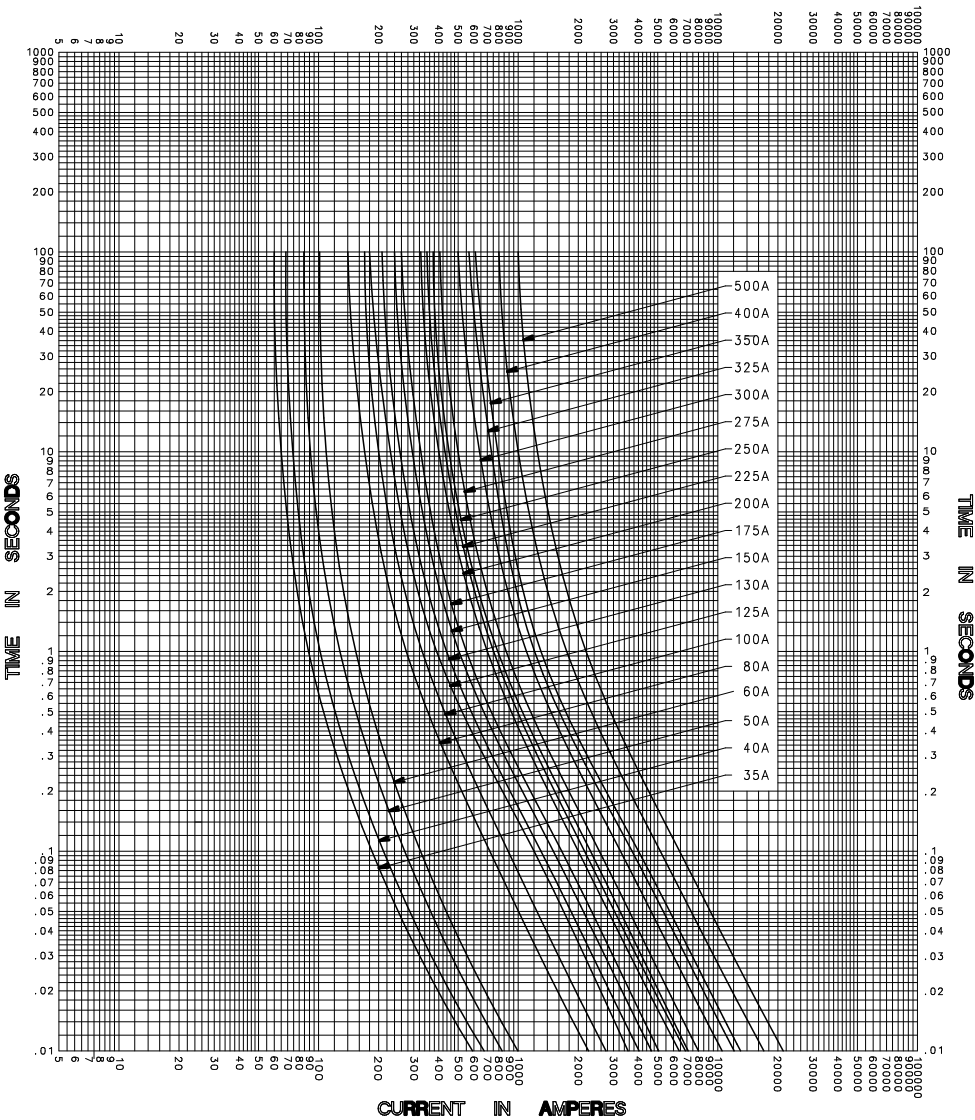

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	CNL (35A - 500A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>03/22/05</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>C-FCC000001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT