


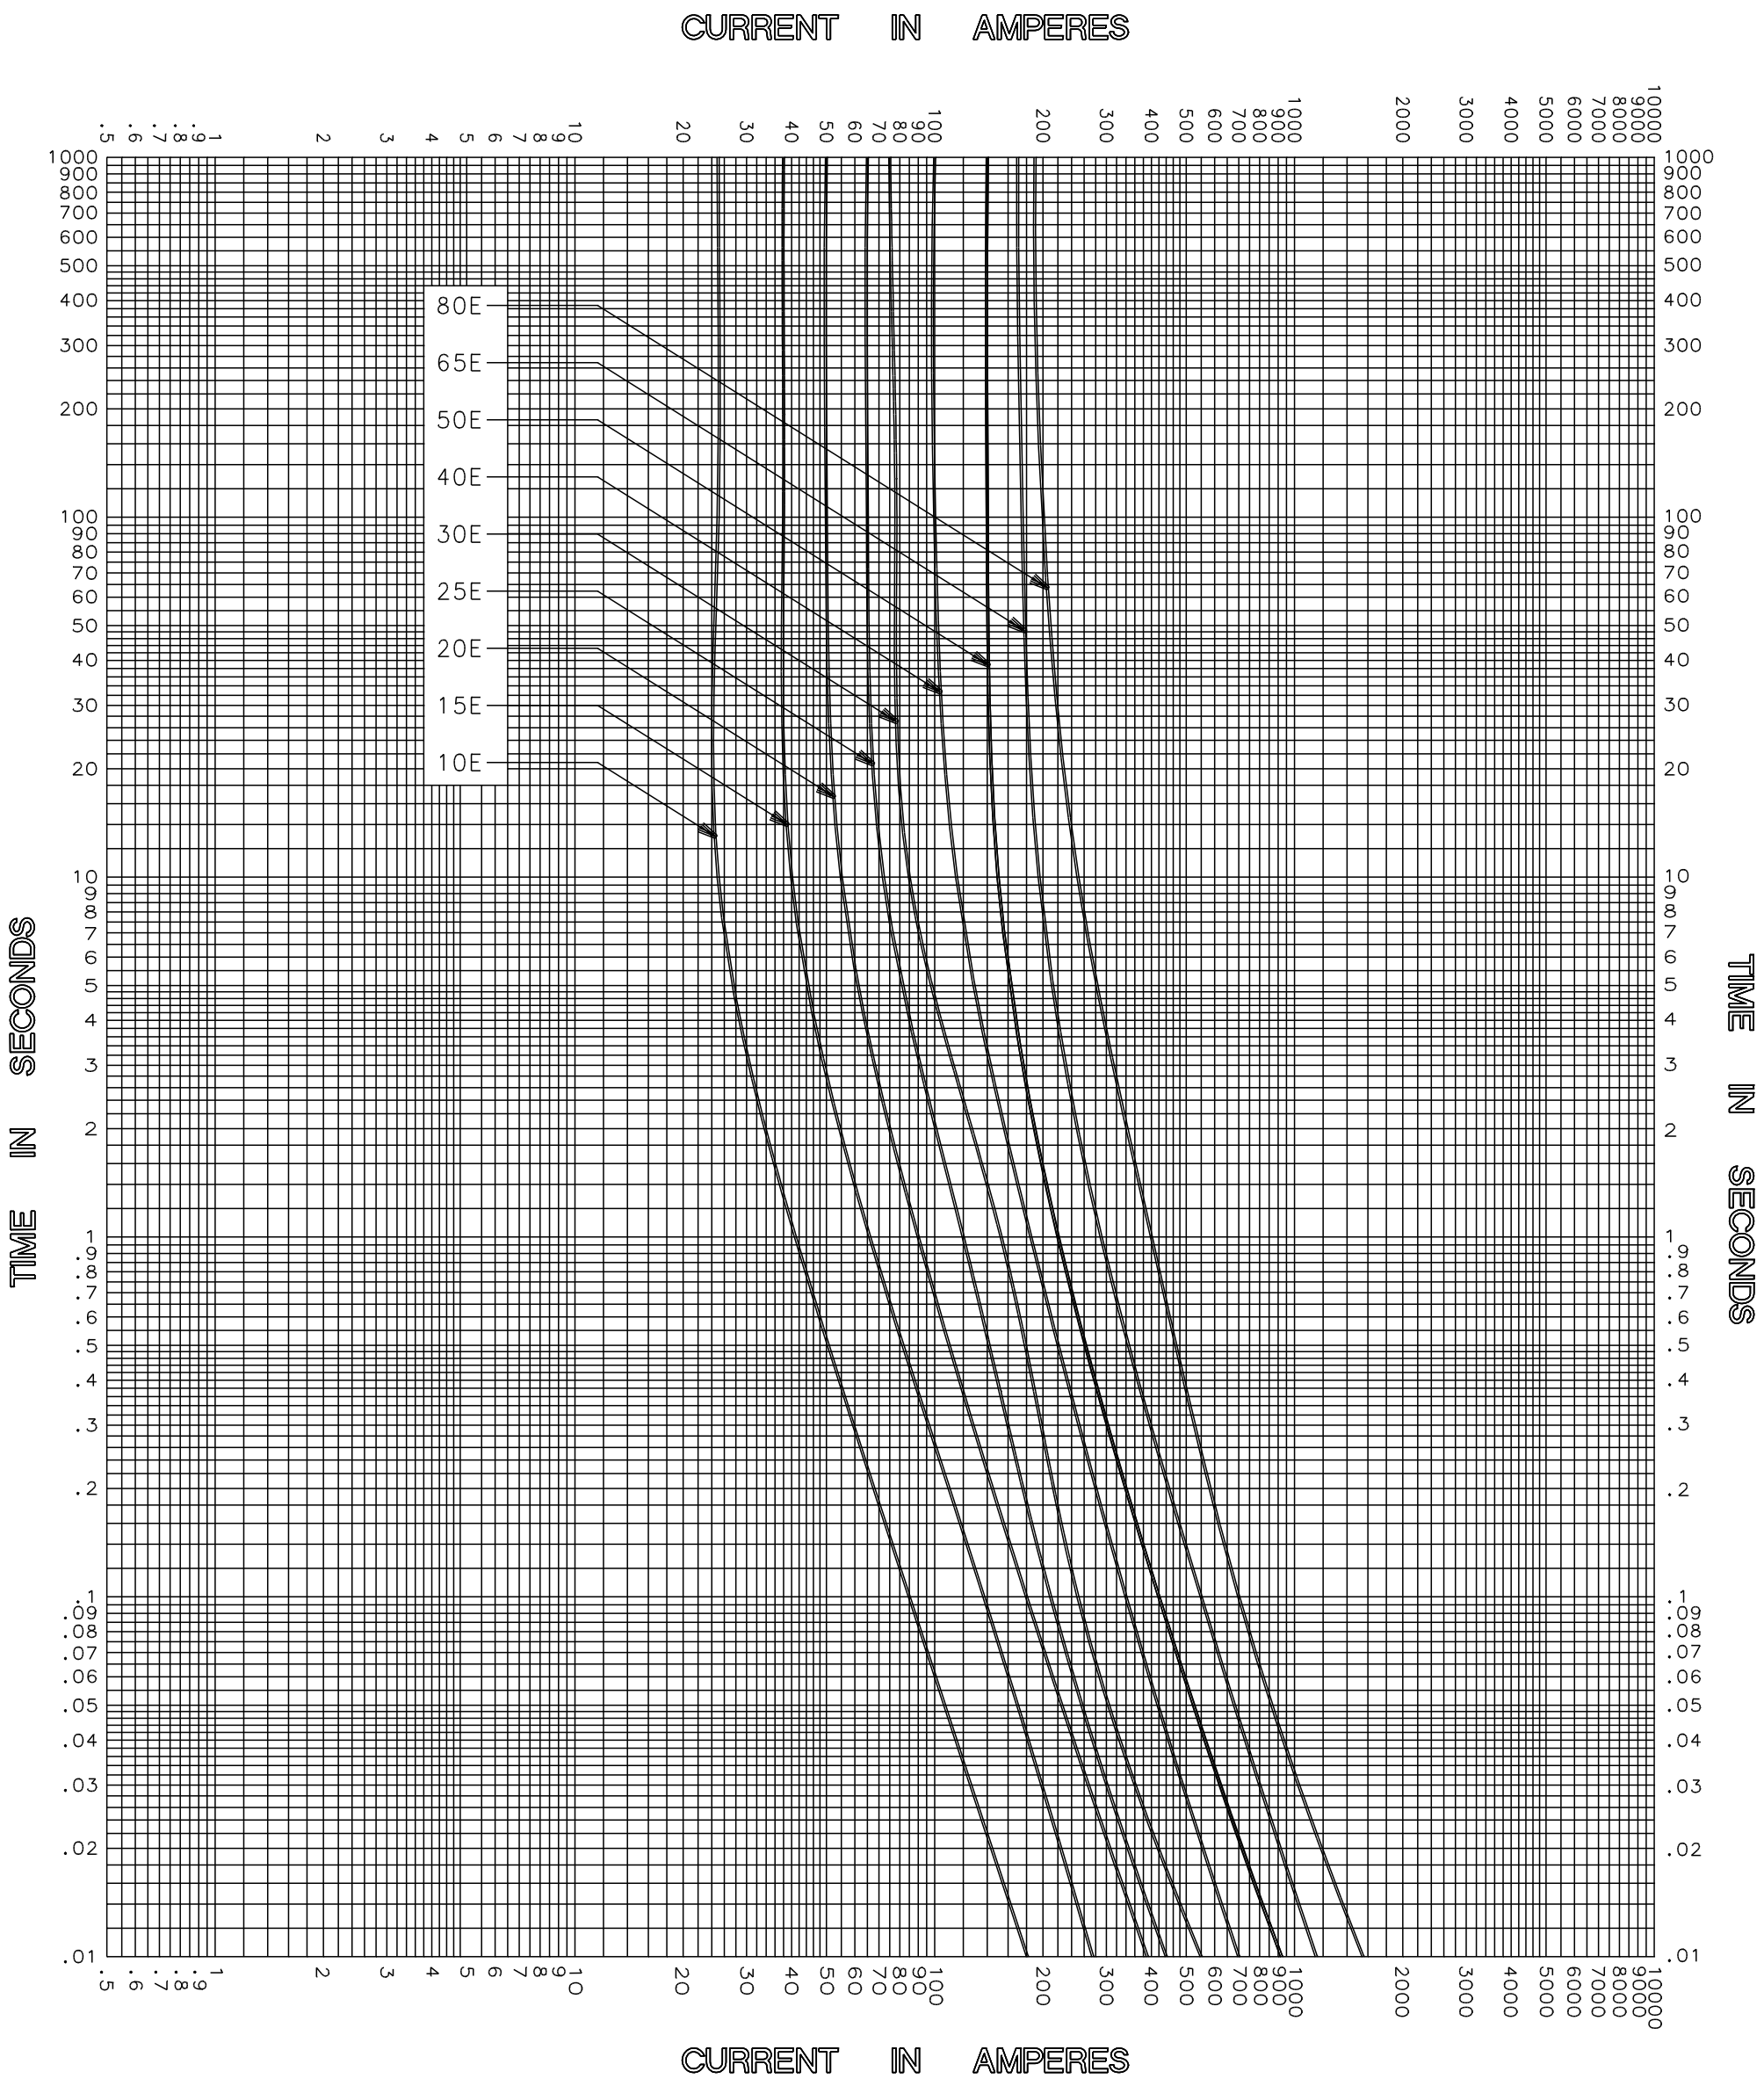

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER <u>15.5kV E-RATED 10E-80E</u>
 Littelfuse® DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>05/17/04</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A-FCC04-50001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT