


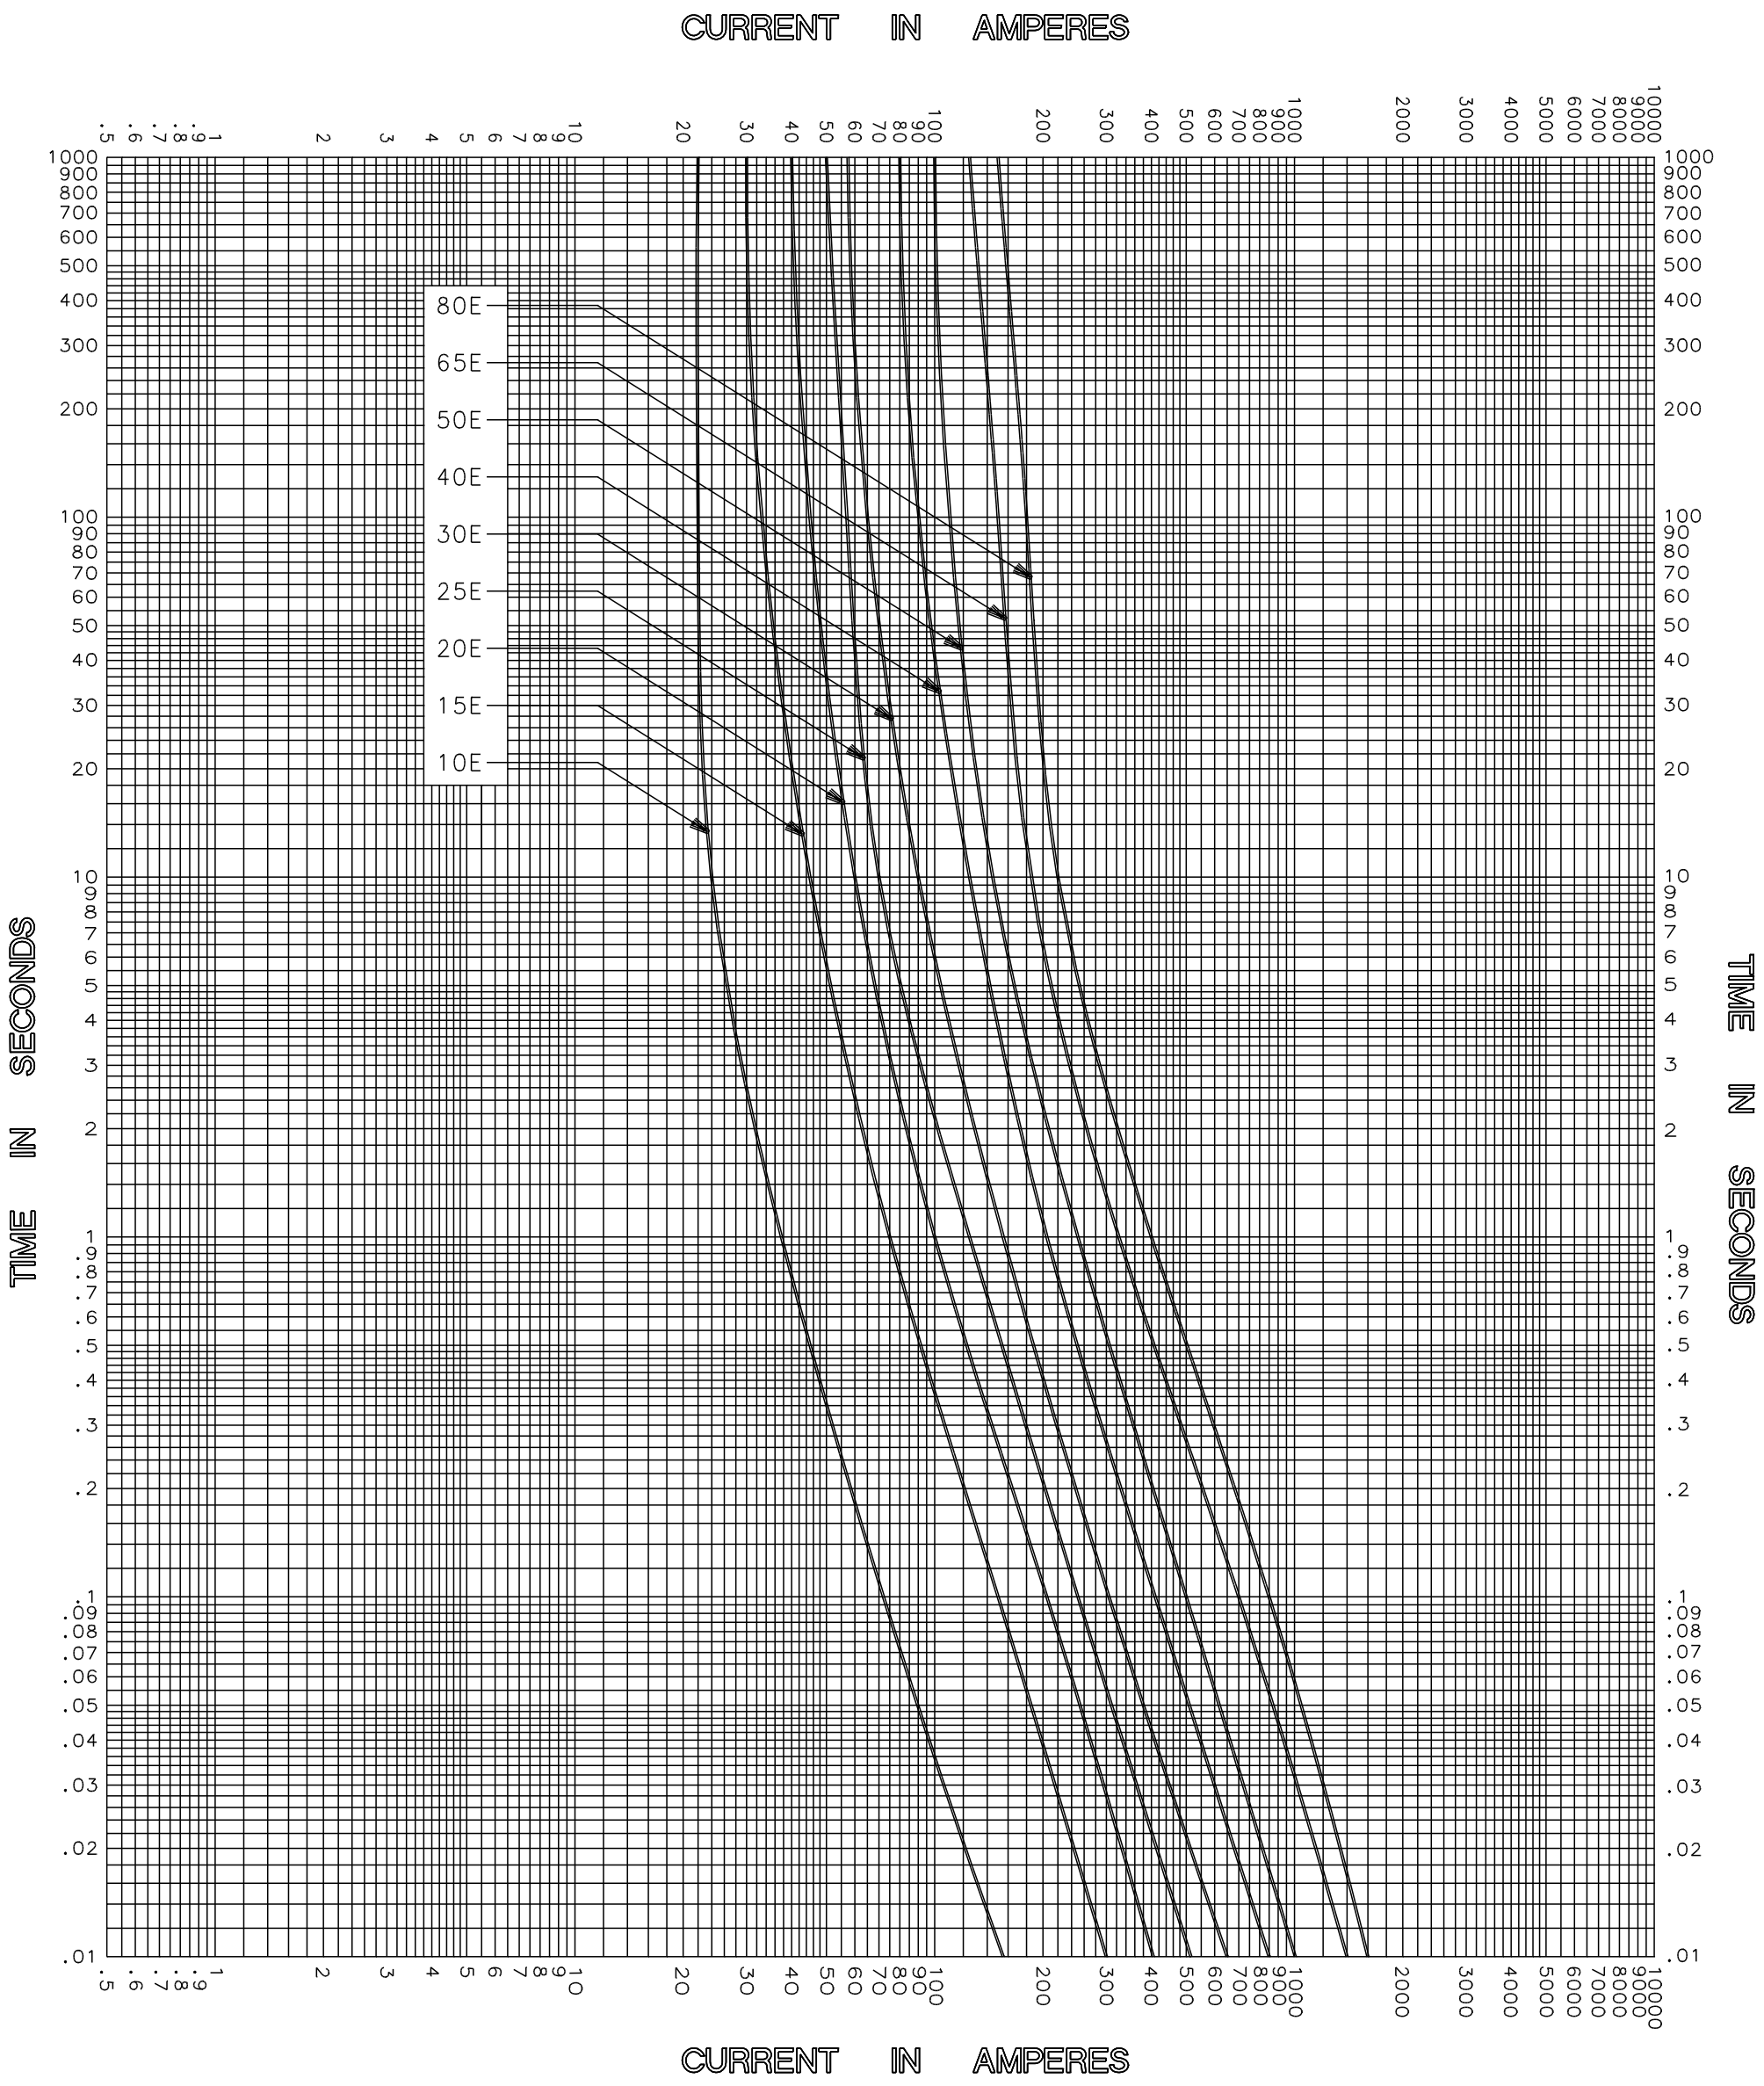

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		8.25kV E-RATED 10E-80E

 Littelfuse® DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u>
	DATE <u>07/26/04</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC03-250001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT