



CURRENT IN AMPERES

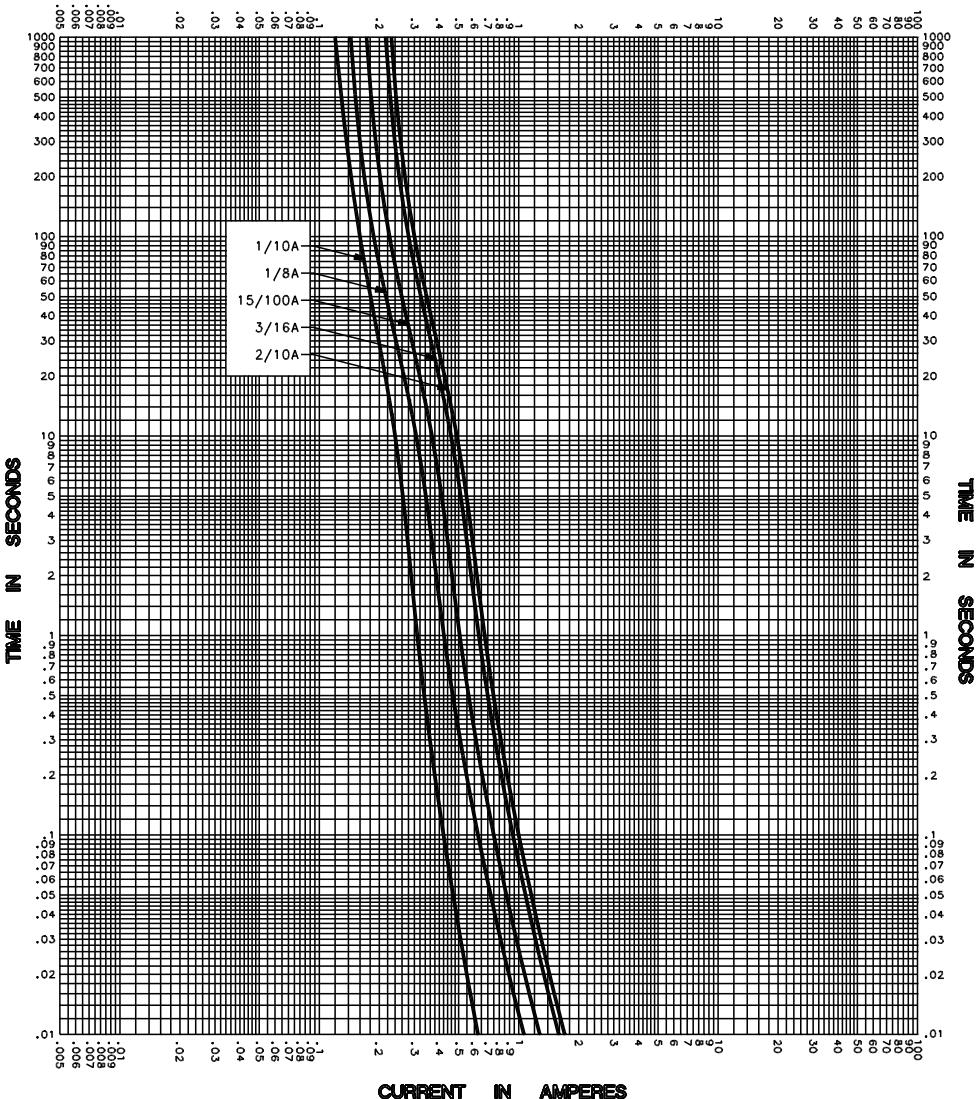


CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLQ (1/10A - 2/10A)
BASIS FOR DATA _____		
 DES PLAINES, ILLINOIS 60016		DRAWN BY MRD
		DATE 02/03/04
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		CHECKED BY MP
		DRAWING NO. B-FCCQ

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

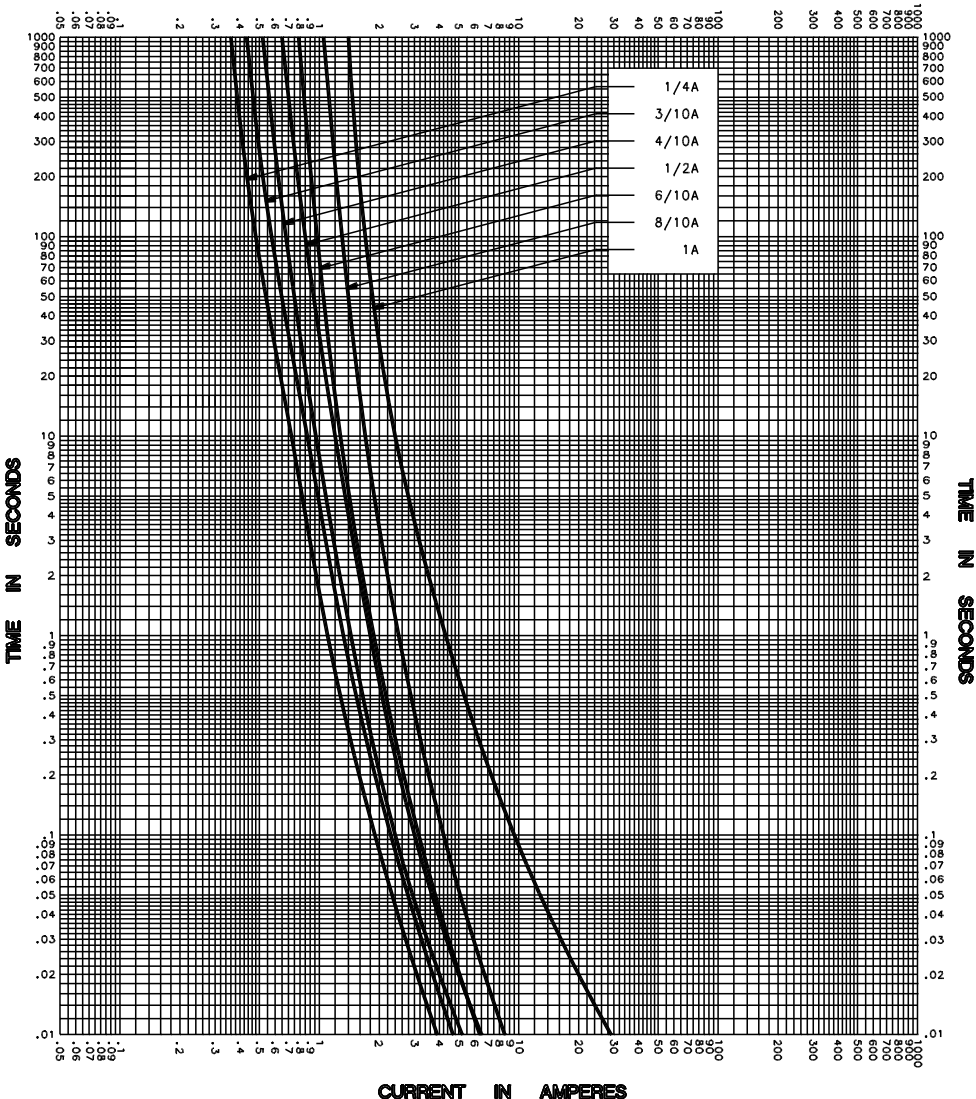

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLQ (1/4A - 1A)




DRAWN BY	MRD
DATE	02/03/04
CHECKED BY	MP

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. D-FCC-0174
---	------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

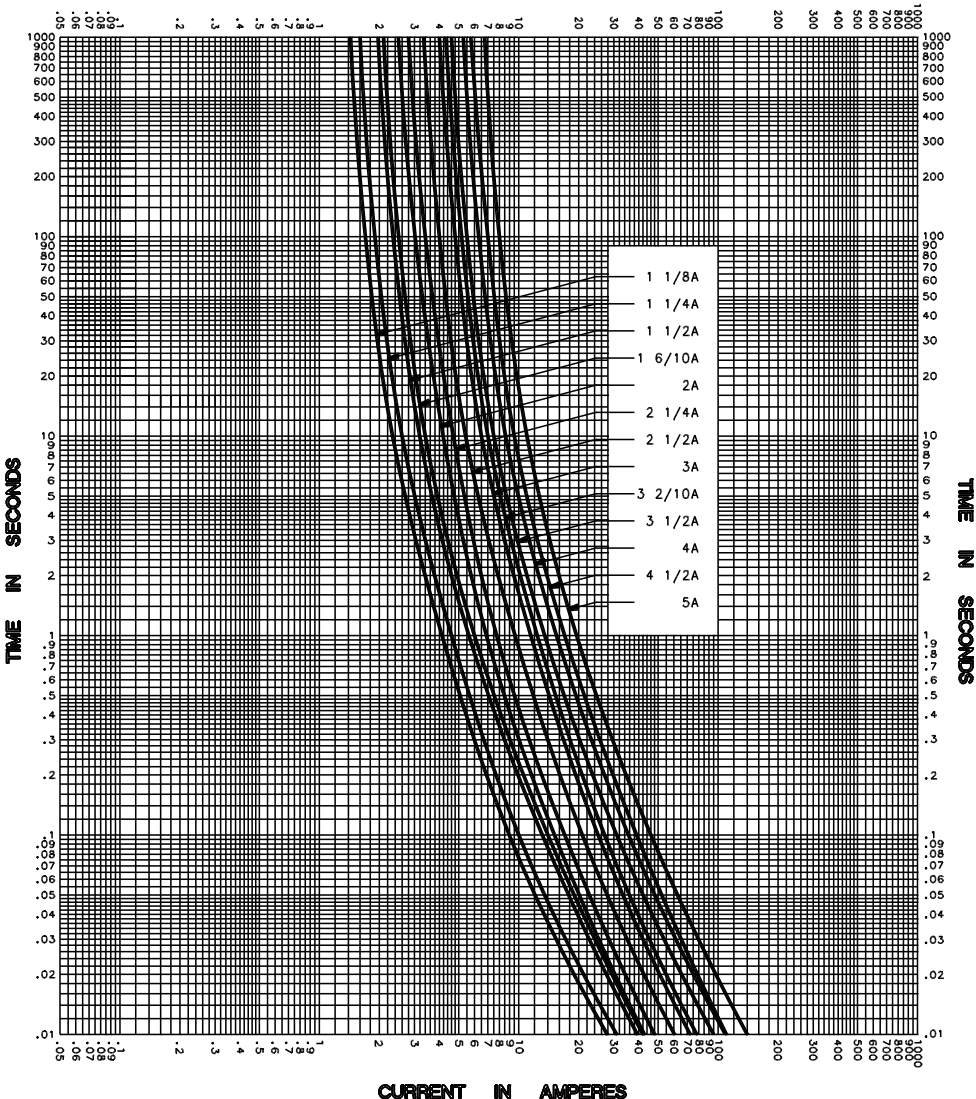

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLQ (1 1/8A - 5A)



DRAWN BY MRD
DATE 02/17/03
CHECKED BY TN

**TIME CURRENT CHARACTERISTIC CURVES**


DRAWING NO. B-FCC-0174

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT



CURRENT IN AMPERES

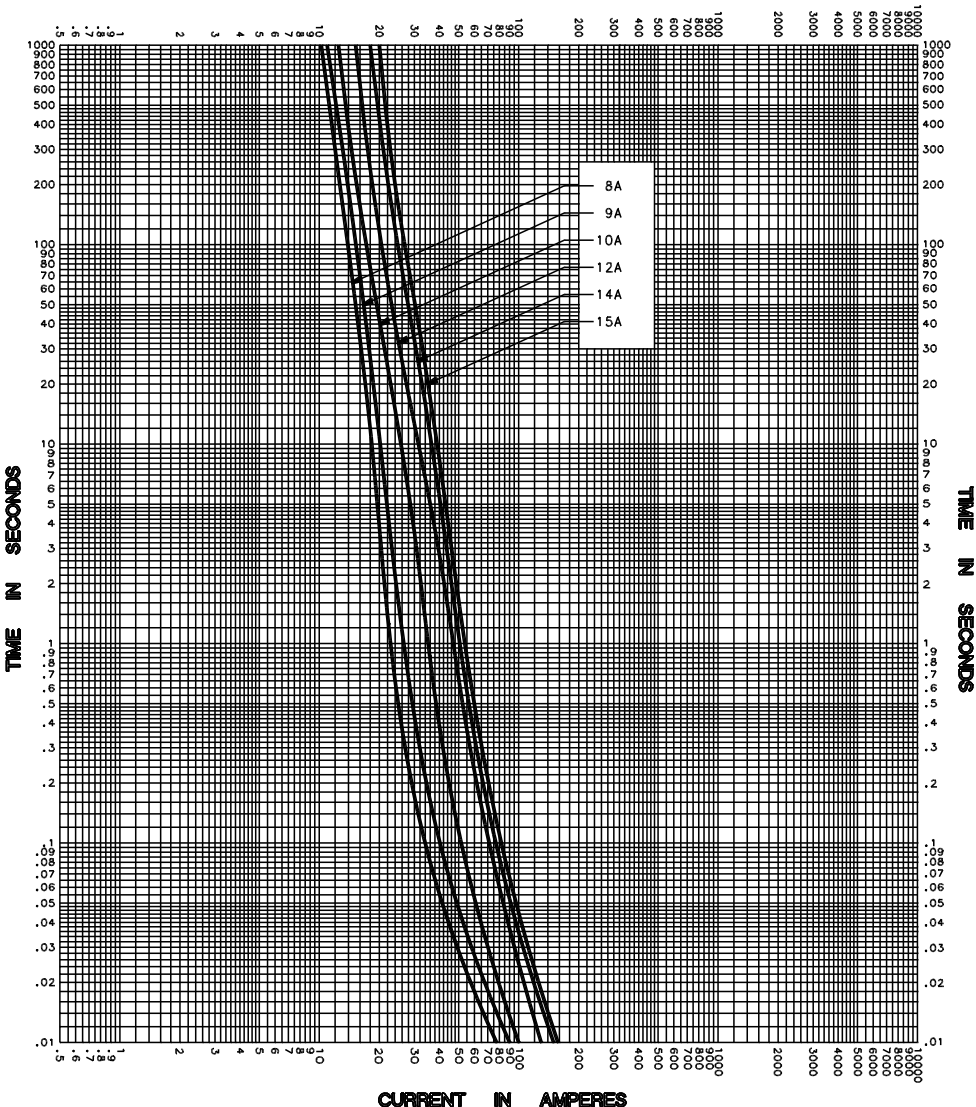

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	FLQ (8A - 15A)


 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/18/05</u>
	CHECKED BY <u>MP</u>

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC0005</u>
---	------------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

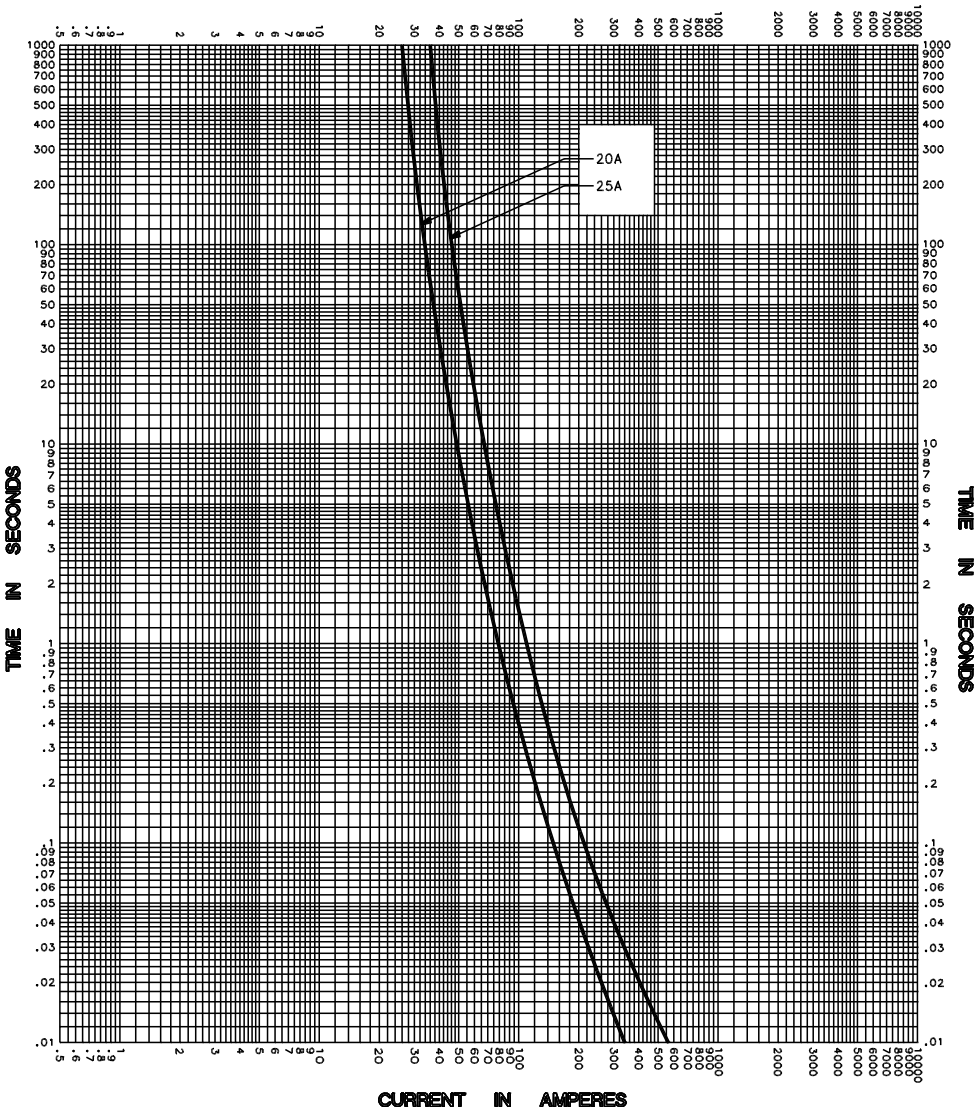

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	FLQ (20A - 25A)


 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/18/05</u>
	CHECKED BY <u>MP</u>

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC016</u>
---	-----------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

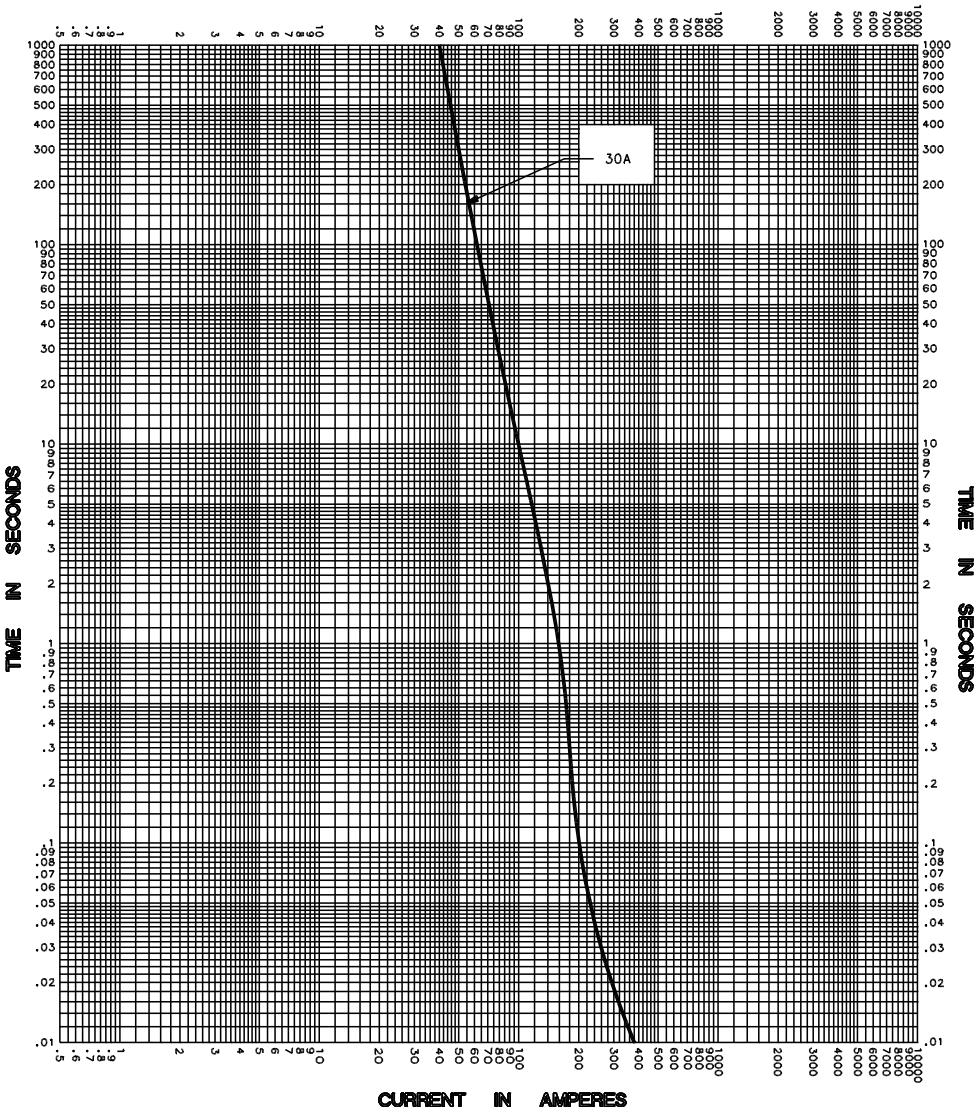


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLQ (30A)

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/18/05</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC007</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

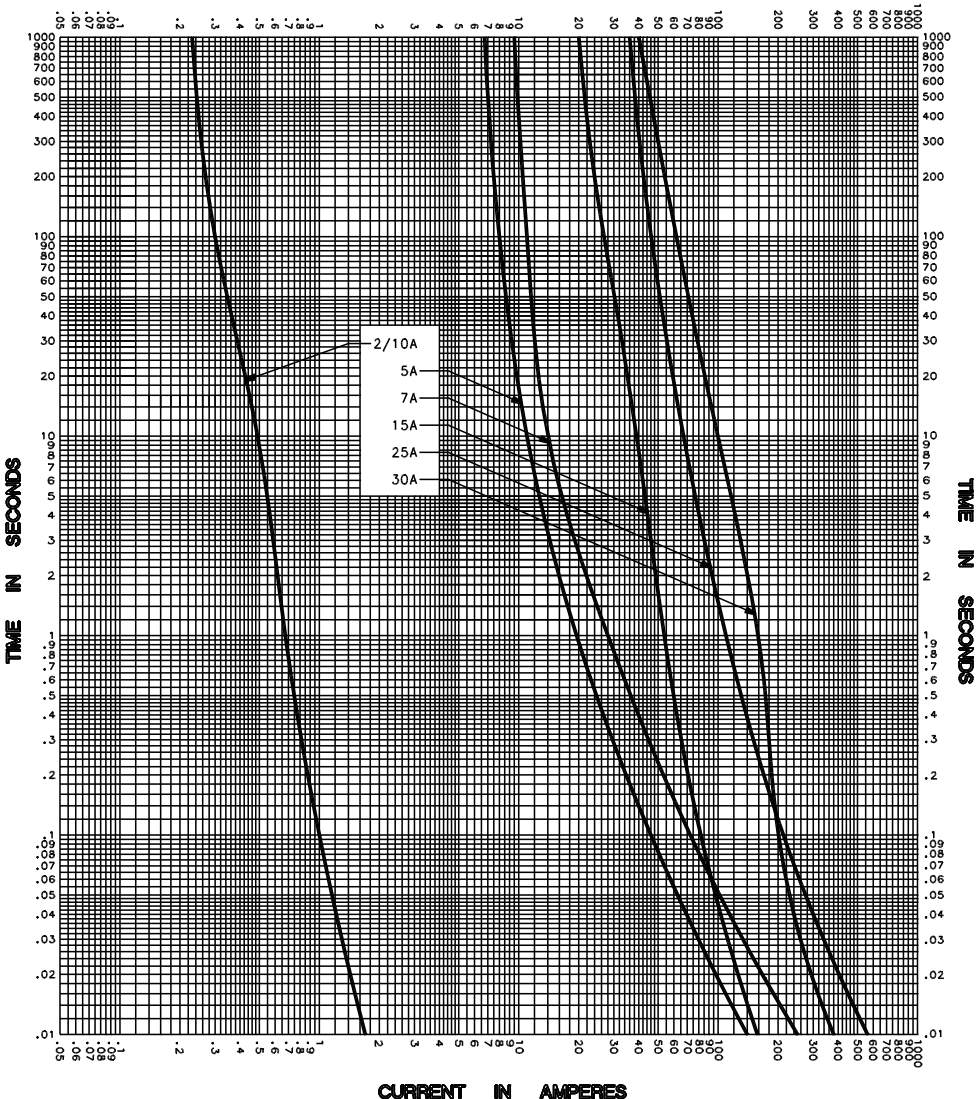

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLQ (2/10A - 30A)
BASIS FOR DATA _____		

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 04/18/05
	CHECKED BY MP

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. A-FCC0017
---	-----------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT