


CURRENT IN AMPERES

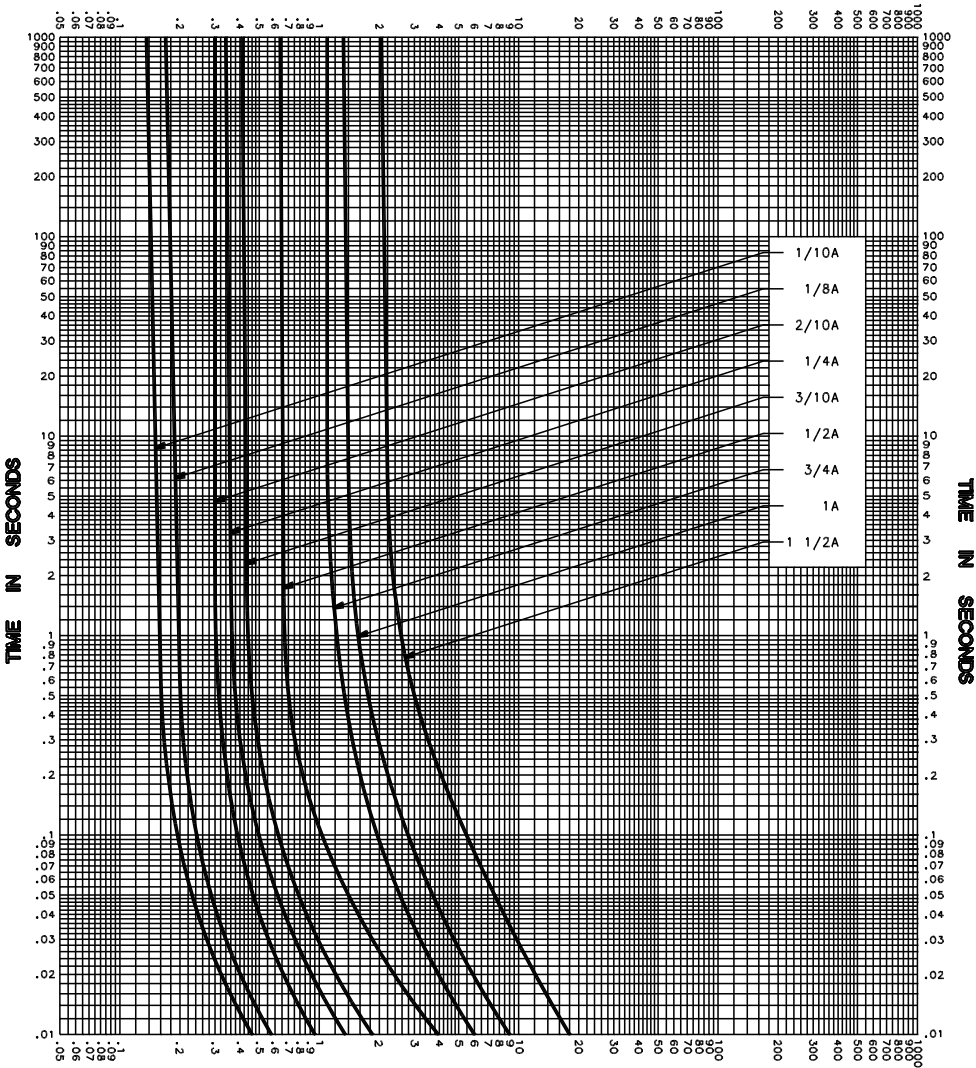


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (1/10A - 1-1/2A)
BASIS FOR DATA _____	
<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY MRD
	DATE 02/17/03
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY TN
	DRAWING NO. C-FCCC

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED DOCUMENT**

CURRENT IN AMPERES

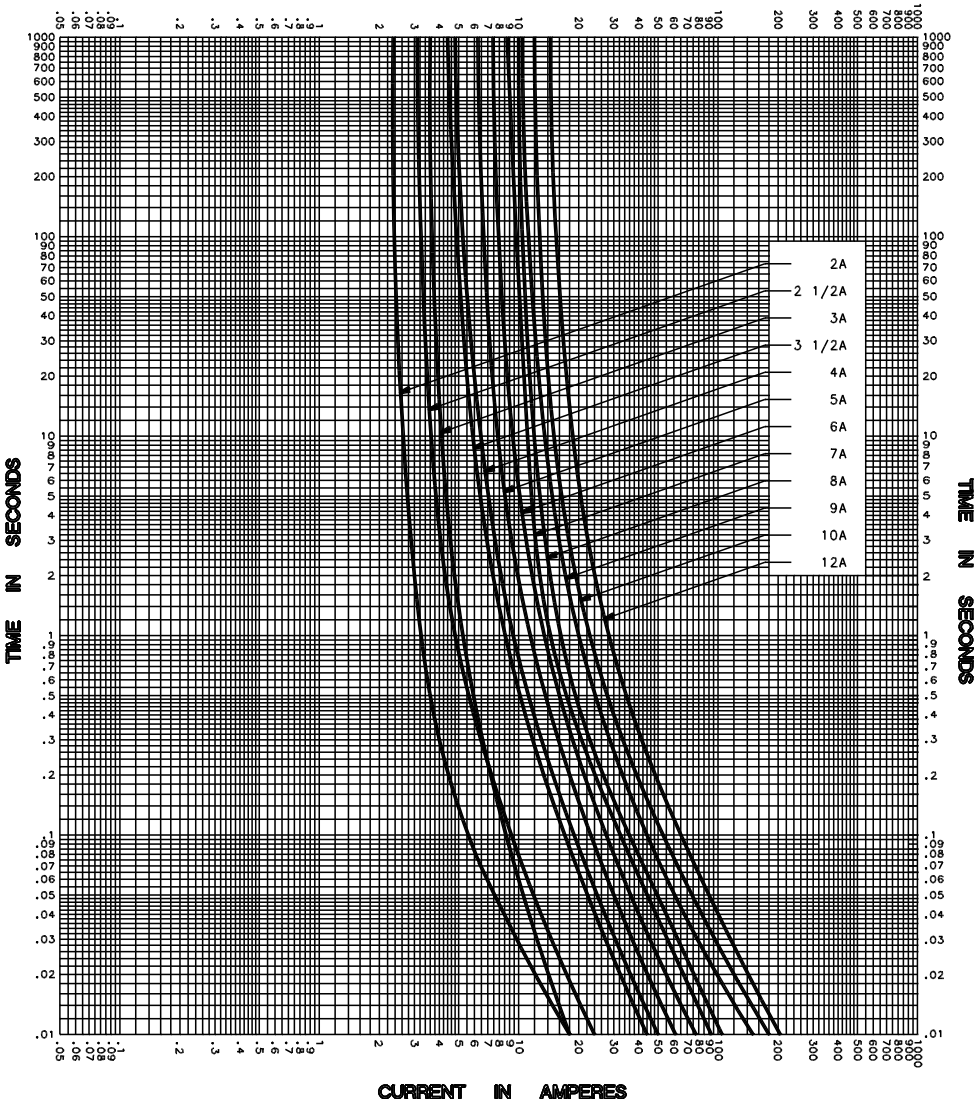

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (2A - 12A)
BASIS FOR DATA _____		

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/08/05</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC002</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

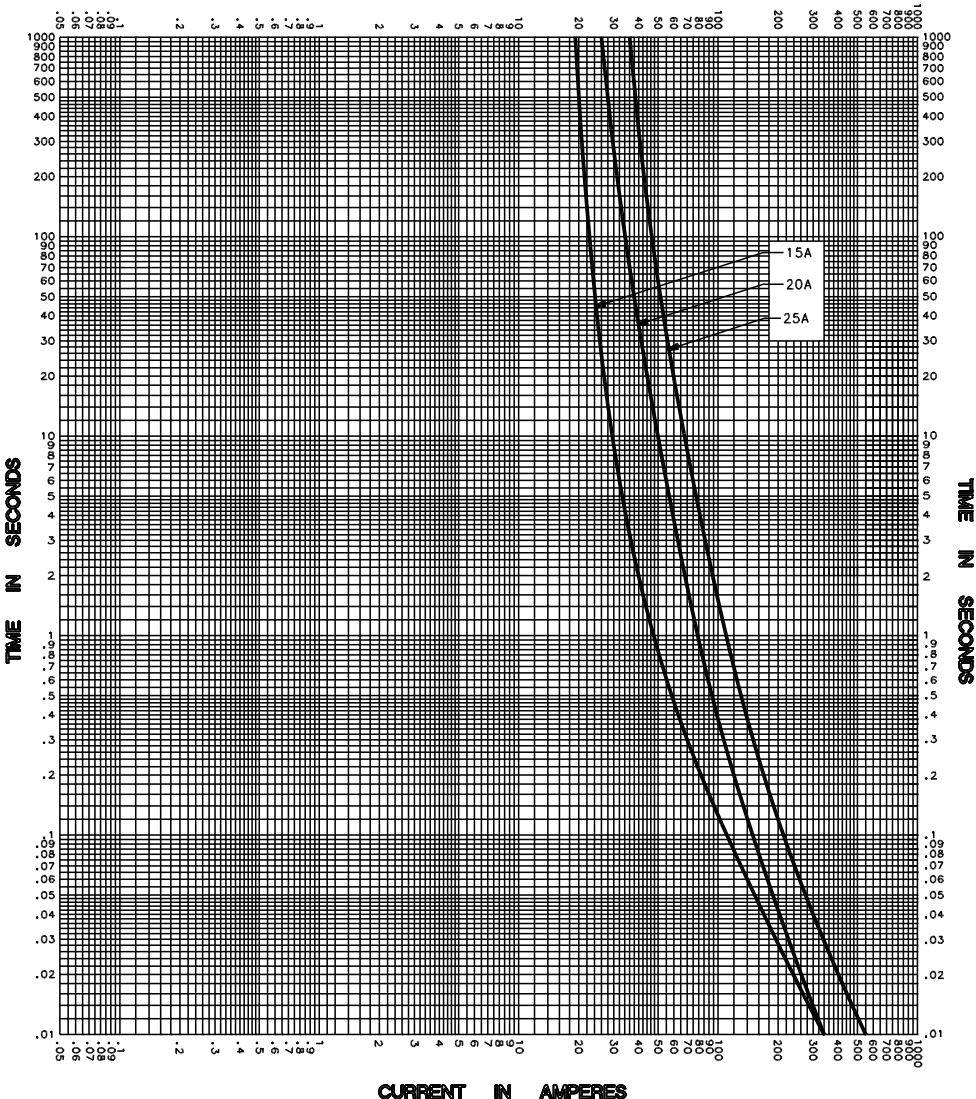

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (15A - 25A)
BASIS FOR DATA _____		

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/08/05</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC003</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

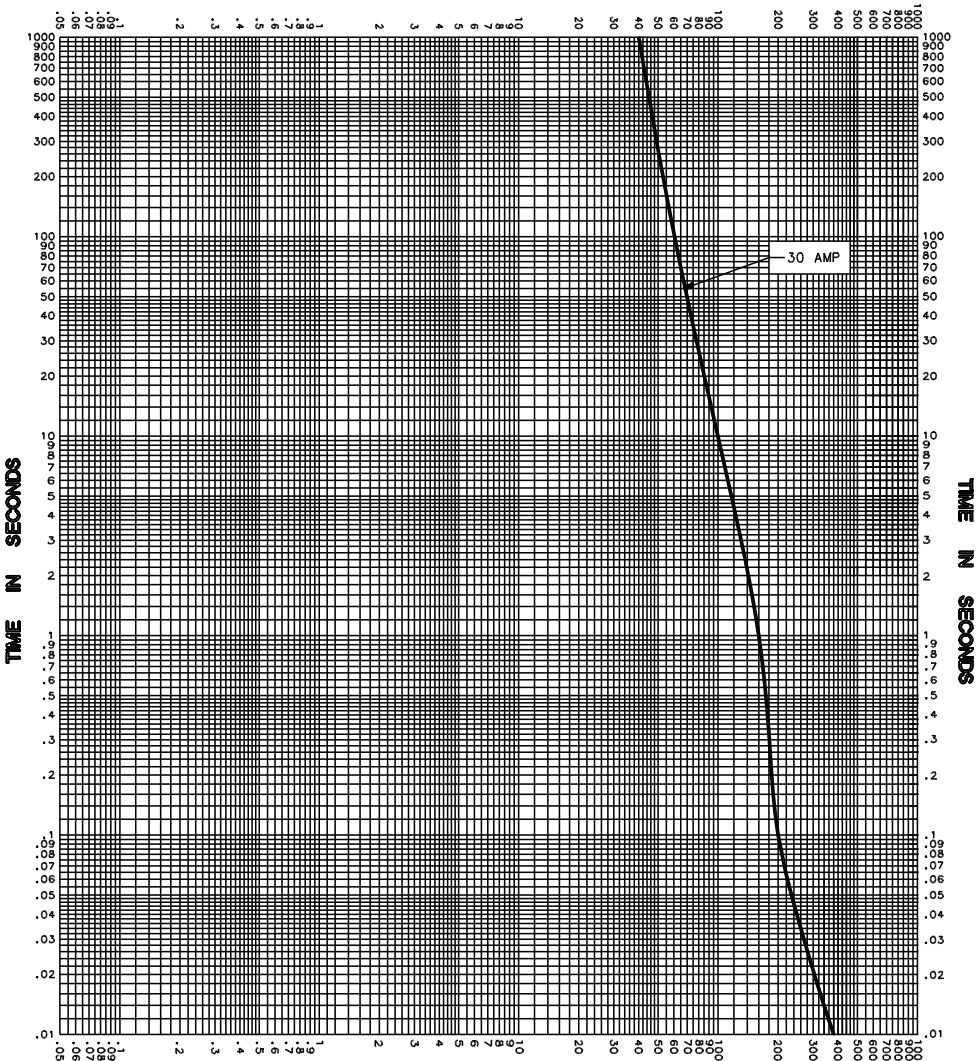

**CURRENT IN AMPERES**

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		KLK (30A)



**LITTELFUSE, INC.**  
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/08/05
CHECKED BY MP

**TIME CURRENT CHARACTERISTIC CURVES**

DRAWING NO. A-FCC0074
-----------------------

UNCONTROLLED DOCUMENT