



Time Current Curve

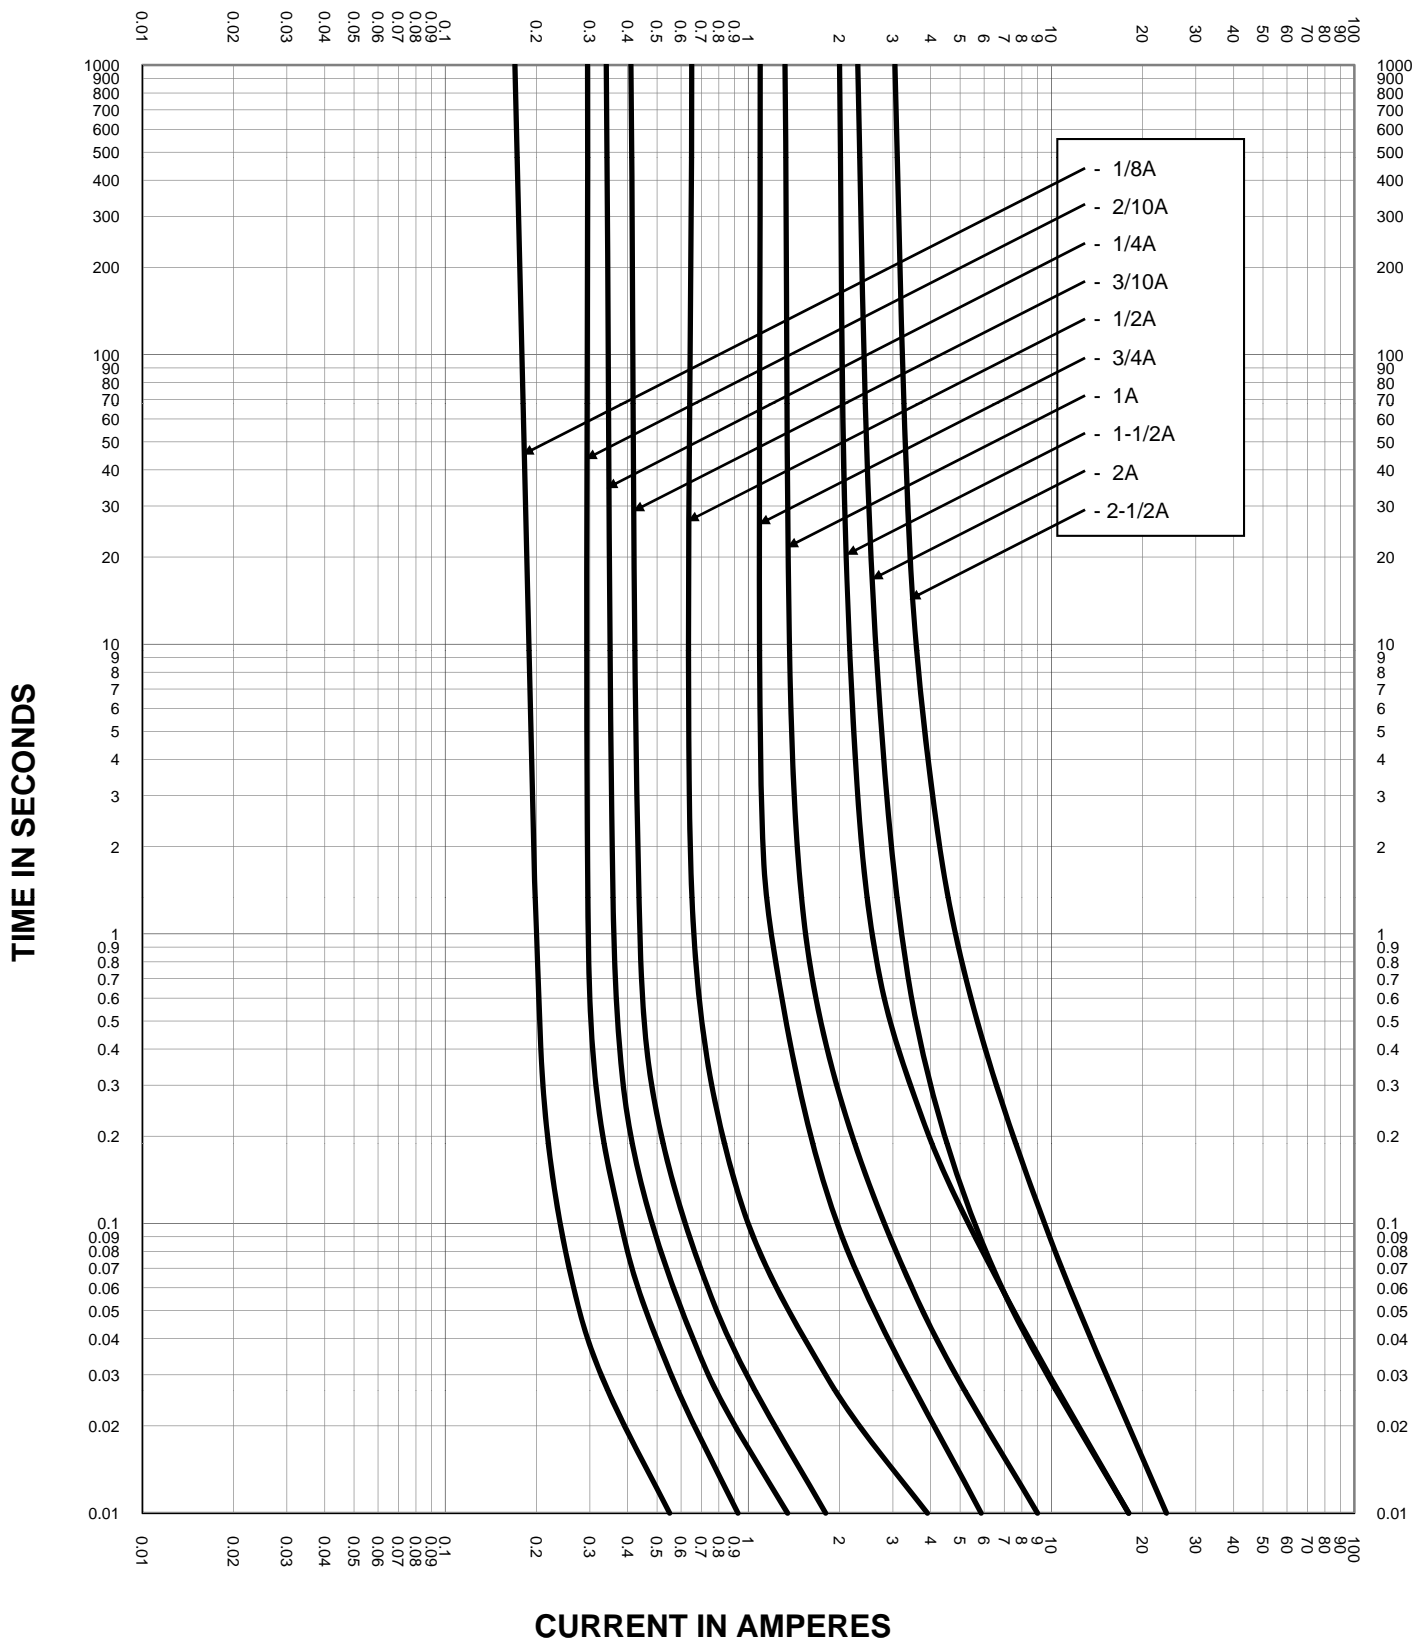


CURRENT IN AMPERES


TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER
BASIS FOR DATA:		KLKD 1/8 - 2-1/2A

	LITTELFUSE, INC. DES PLAINES, IL USA	DRAWN BY: LLL DATE: 4/5/11 REVISION: B
---	--	--


TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. Sheet 2 of 5 FCC01-KLKD
---	--

Time Current Curve

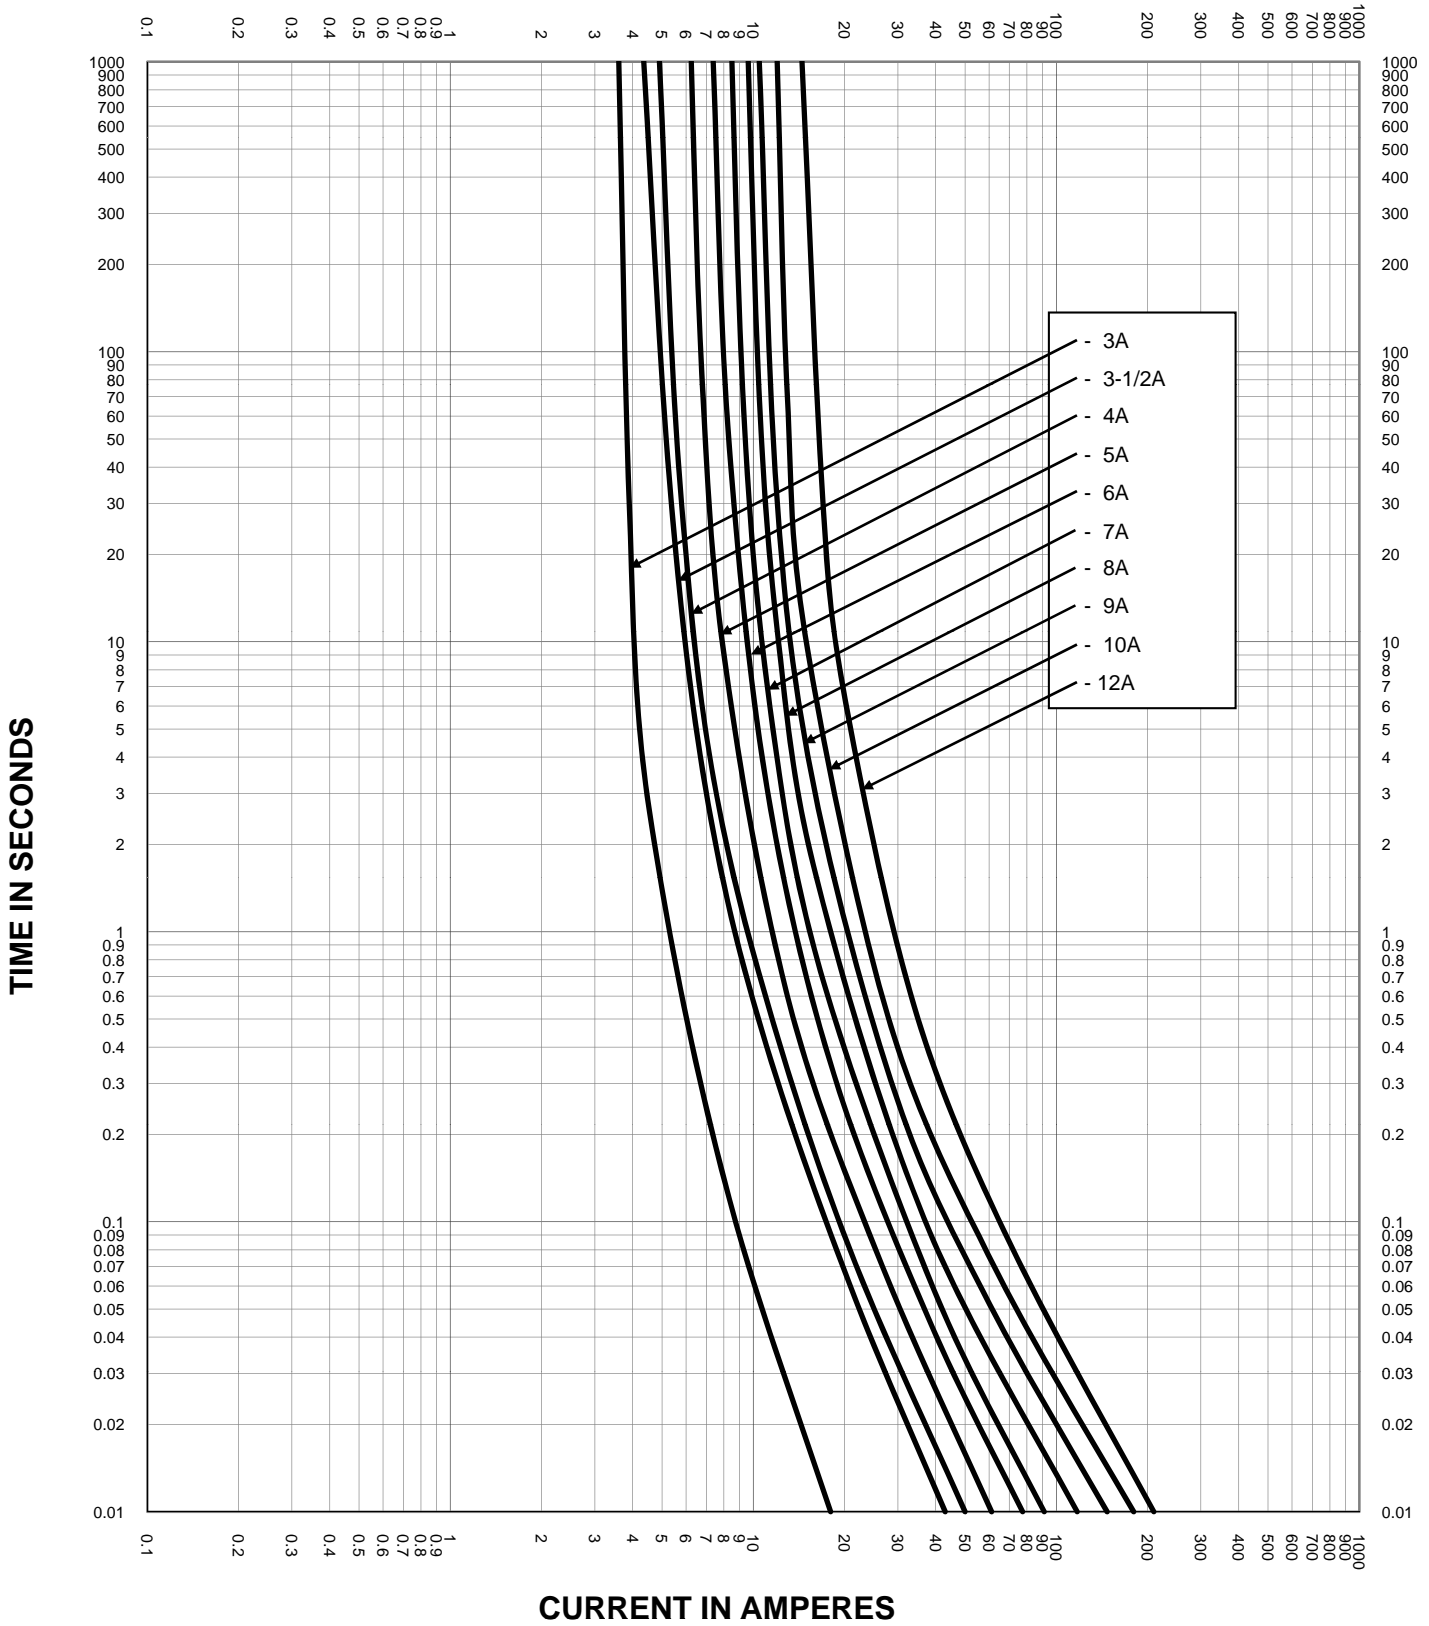


TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER KLKD 3A -12A
BASIS FOR DATA:		
 LITTELFUSE, INC. DES PLAINES, IL USA		DRAWN BY: LLL DATE: 4/5/11 REVISION: B
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. Sheet 3 of 5 FCC01-KLKD

Time Current Curve

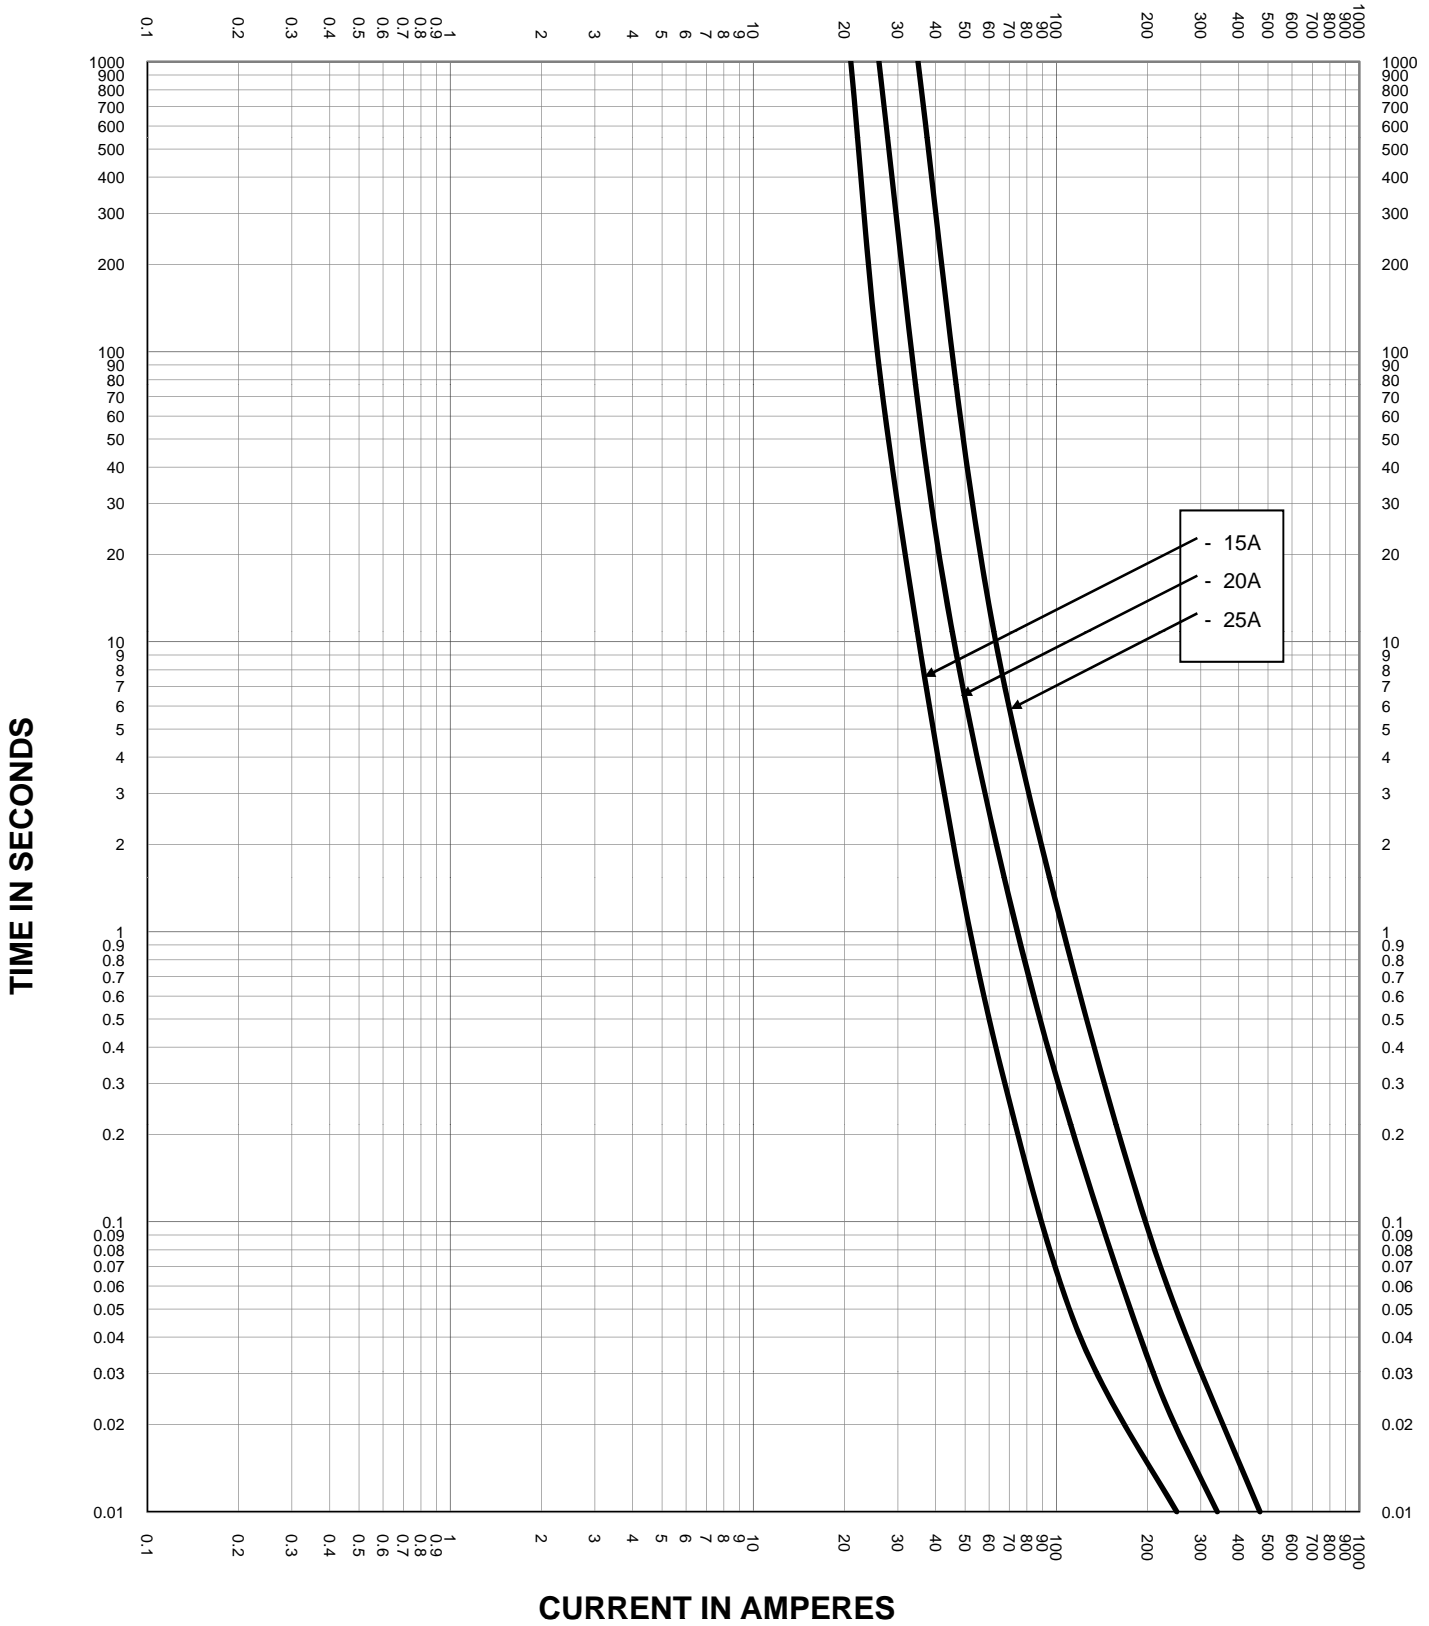


TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER KLKD 15A - 25A
BASIS FOR DATA:		
LITTELFUSE, INC. DES PLAINES, IL USA		DRAWN BY: LLL DATE: 4/5/11 REVISION: B
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. Sheet 4 of 5 FCC01-KLKD

Time Current Curve

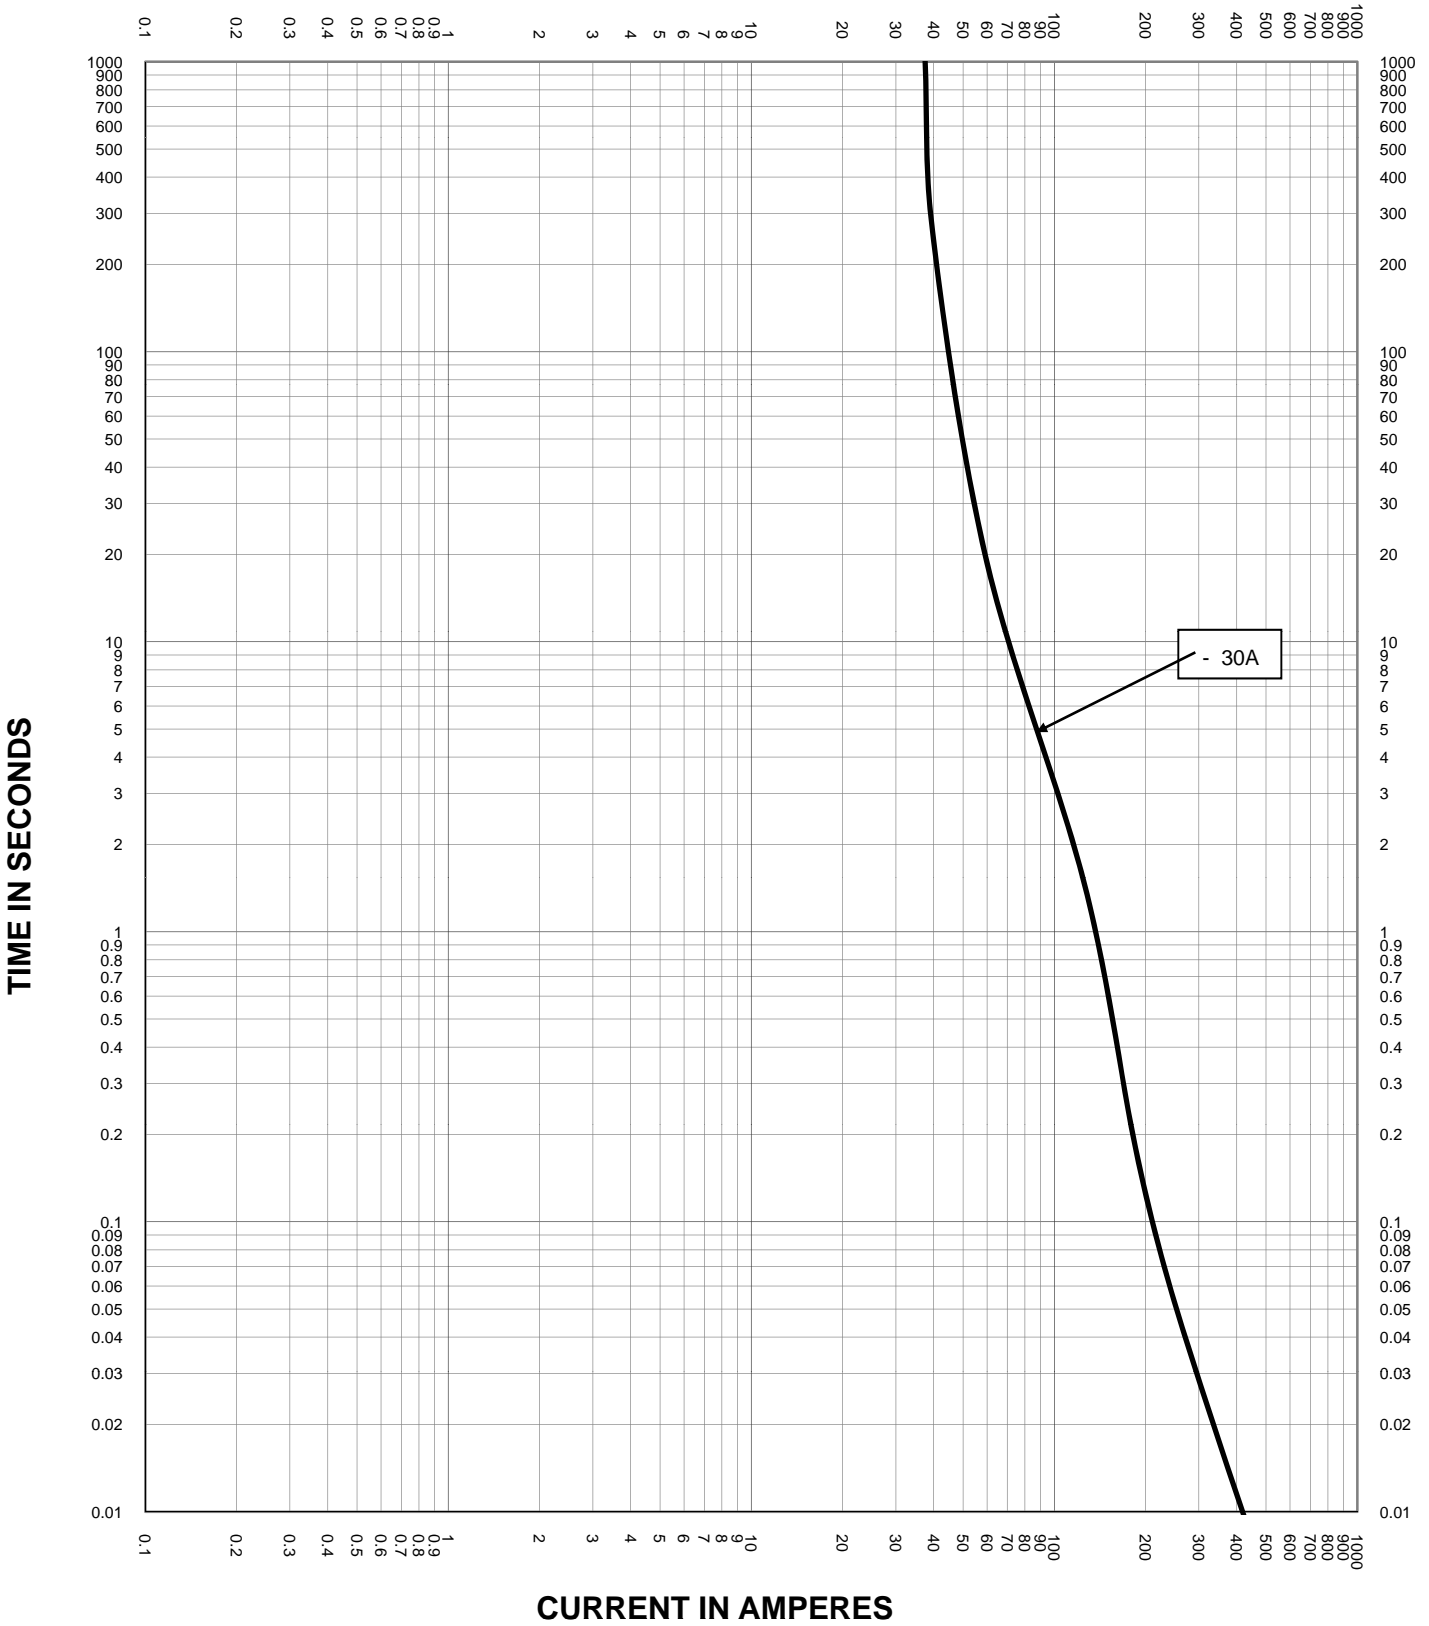

CURRENT IN AMPERES

TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER KLKD 30A
BASIS FOR DATA:		
 LITTELFUSE, INC. DES PLAINES, IL USA		DRAWN BY: LLL DATE: 4/5/11 REVISION: B
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. Sheet 5 of 5 FCC01-KLKD