



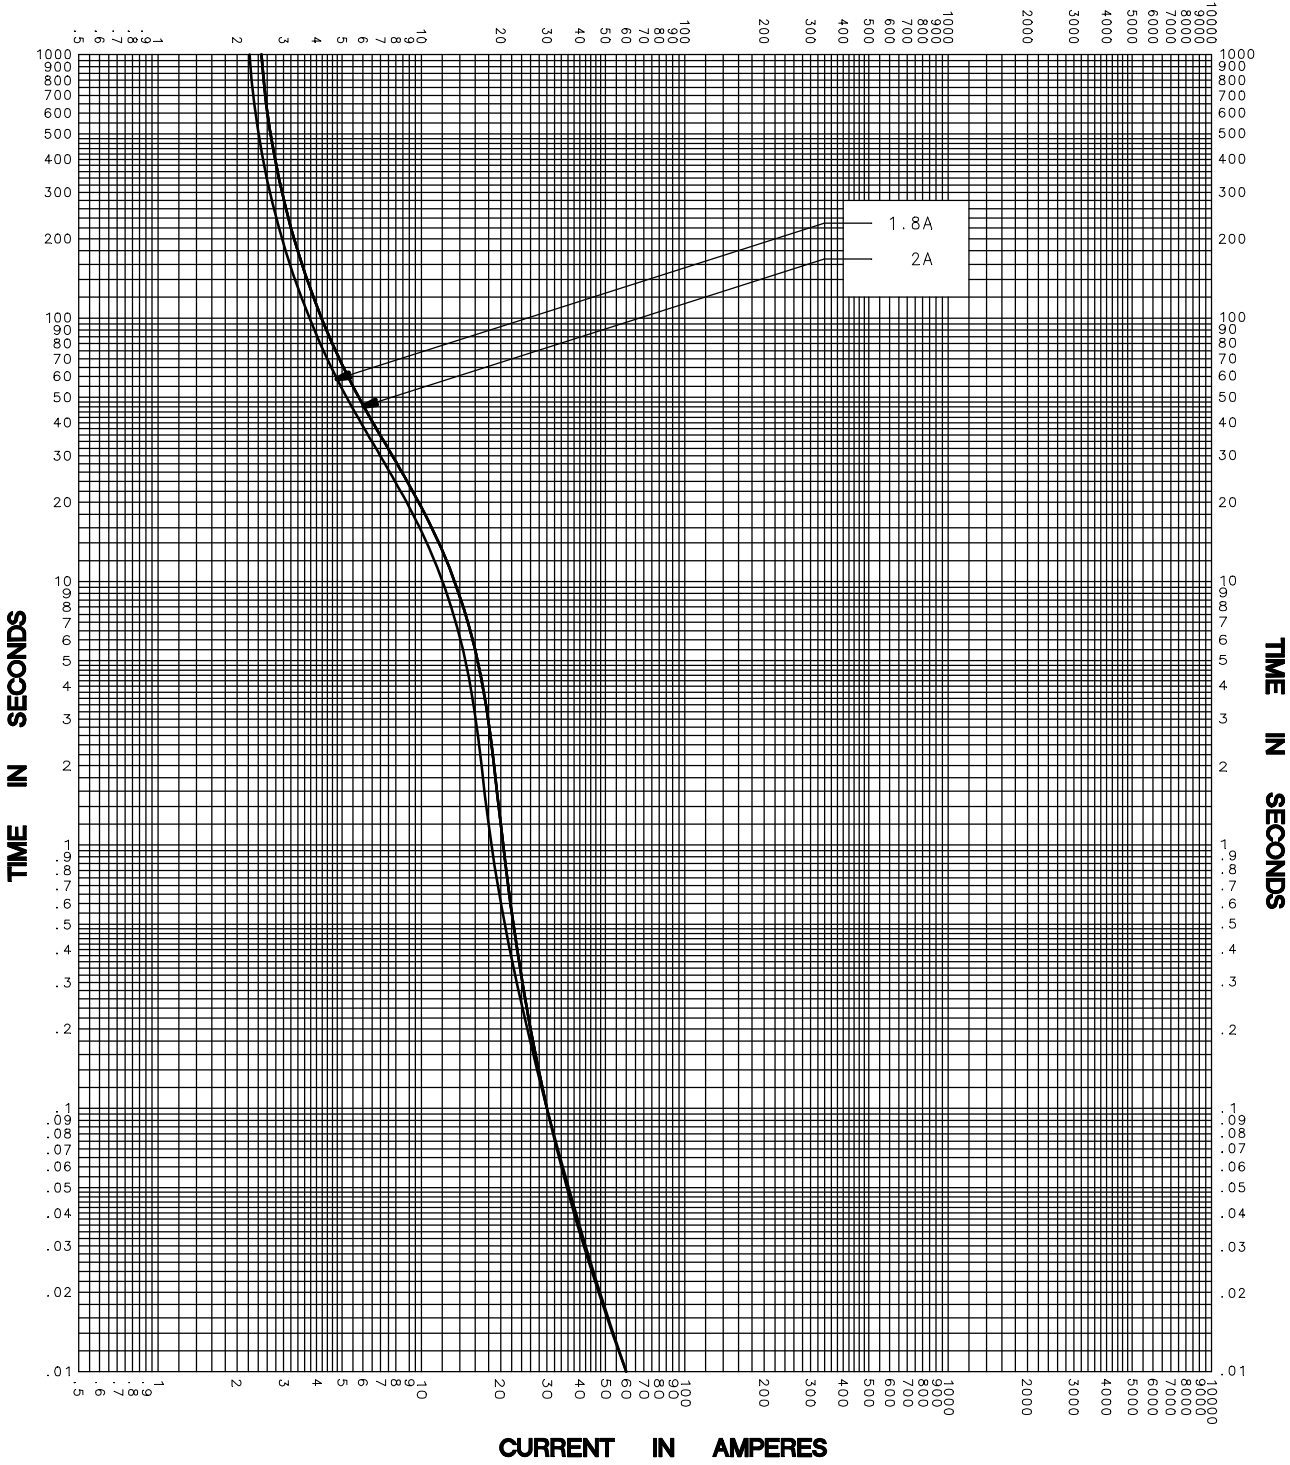
CURRENT IN AMPERES

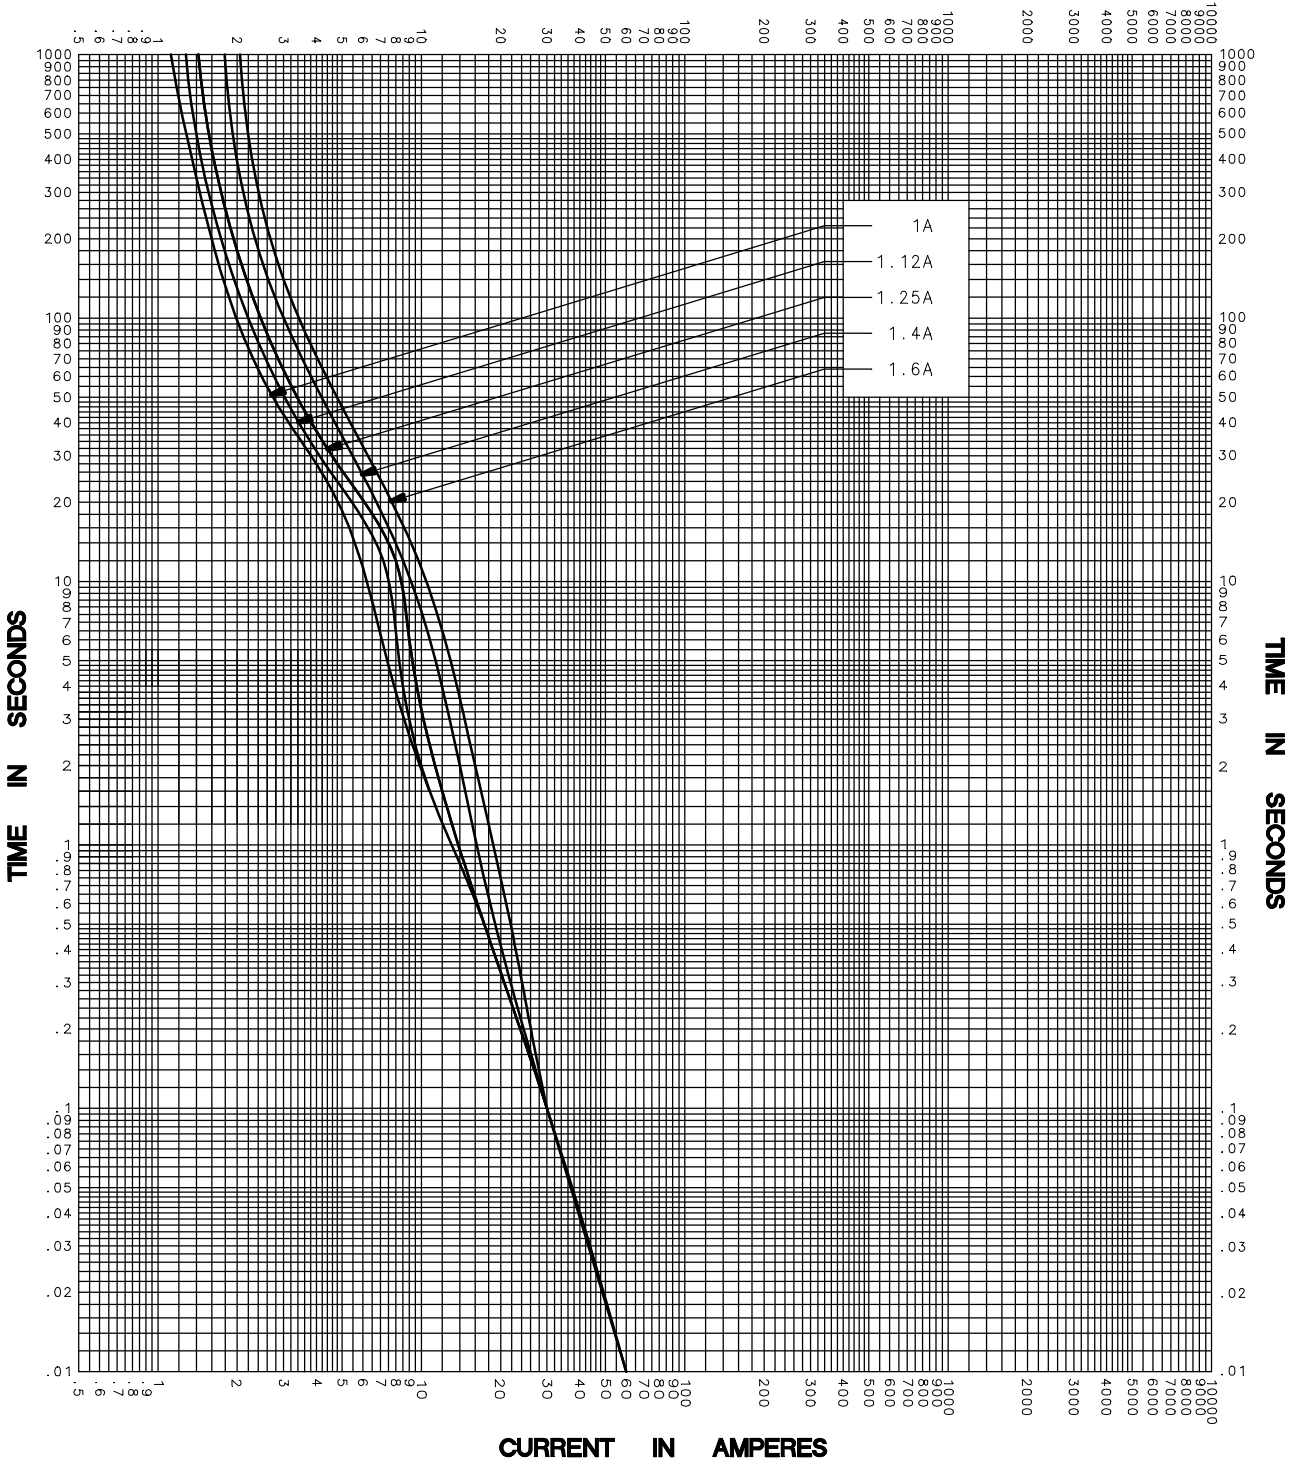


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (1A - 1.6A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-LSRK-002</u>

-THIS DATA GENERATED ON CAD-


CURRENT IN AMPERES




TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (1.8A - 2A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 12/03/04
	CHECKED BY MP
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. B-FCC01-LSRK-003

-THIS DATA GENERATED ON CAD-


CURRENT IN AMPERES

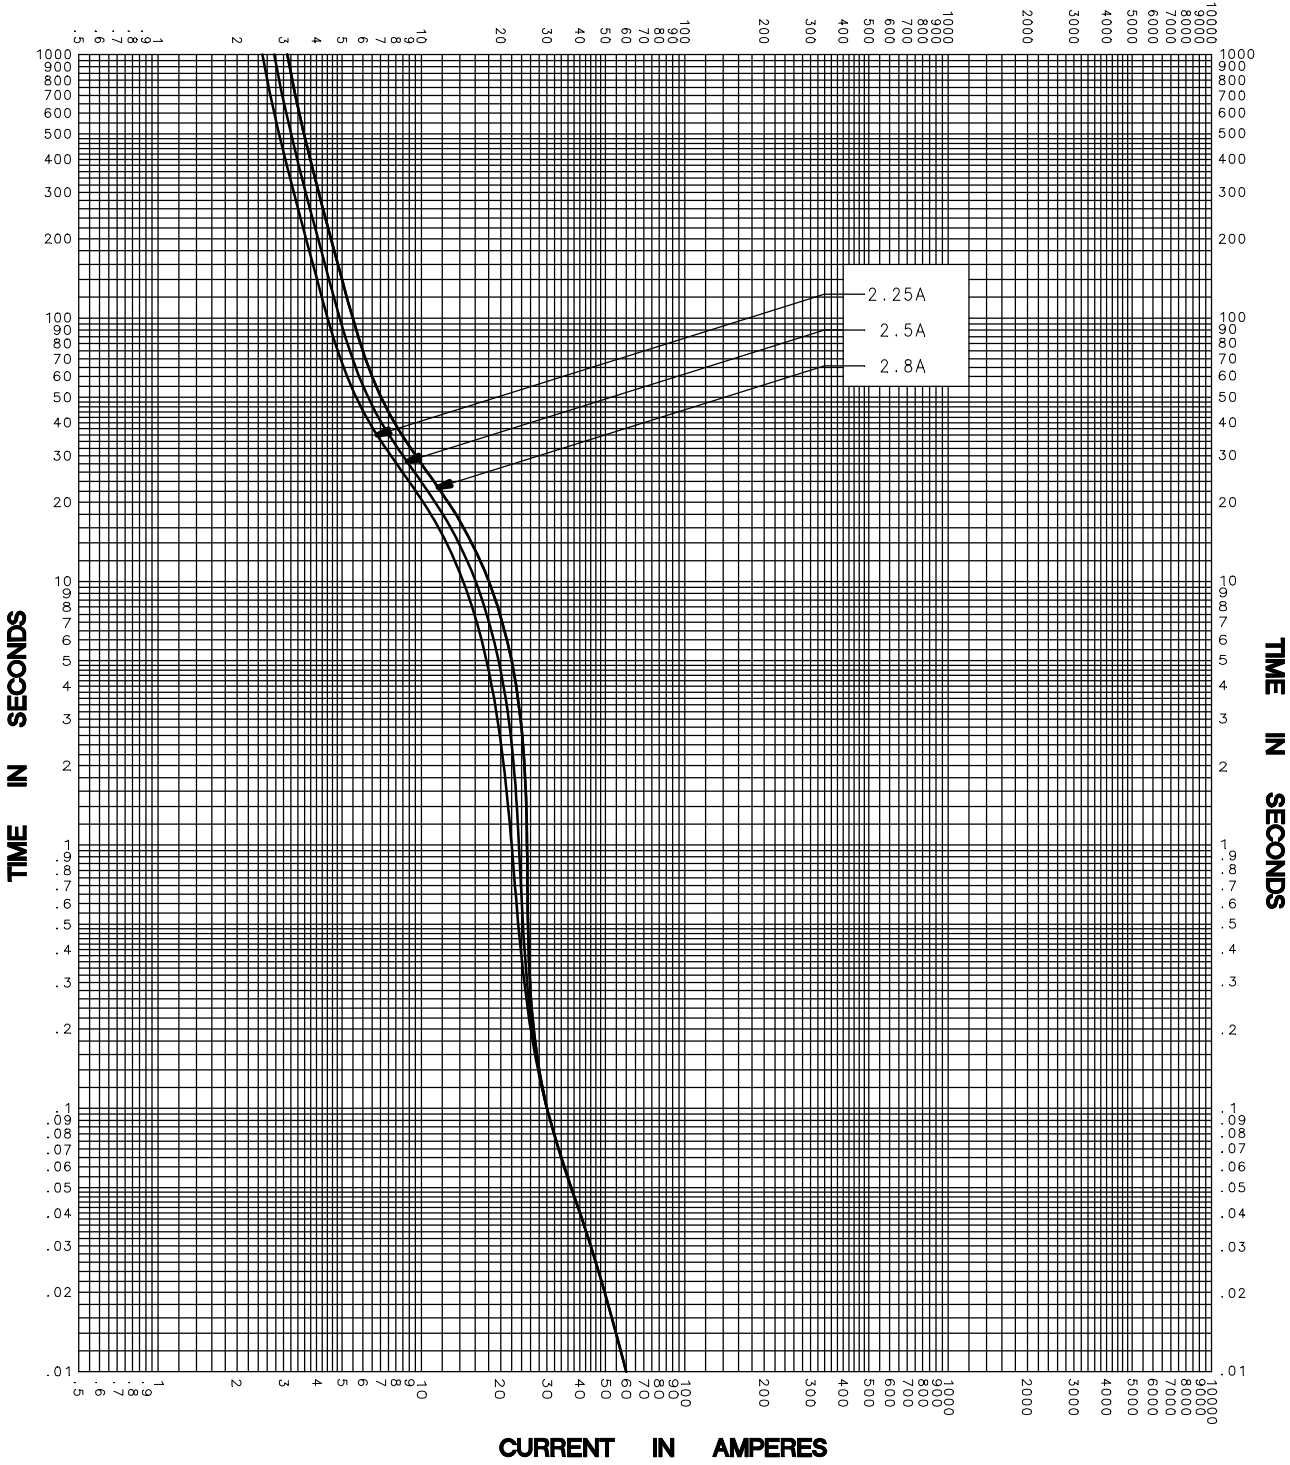


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (2.25A - 2.8A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 12/03/04
	CHECKED BY MP
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. B-FCC01-LSRK-004


CURRENT IN AMPERES

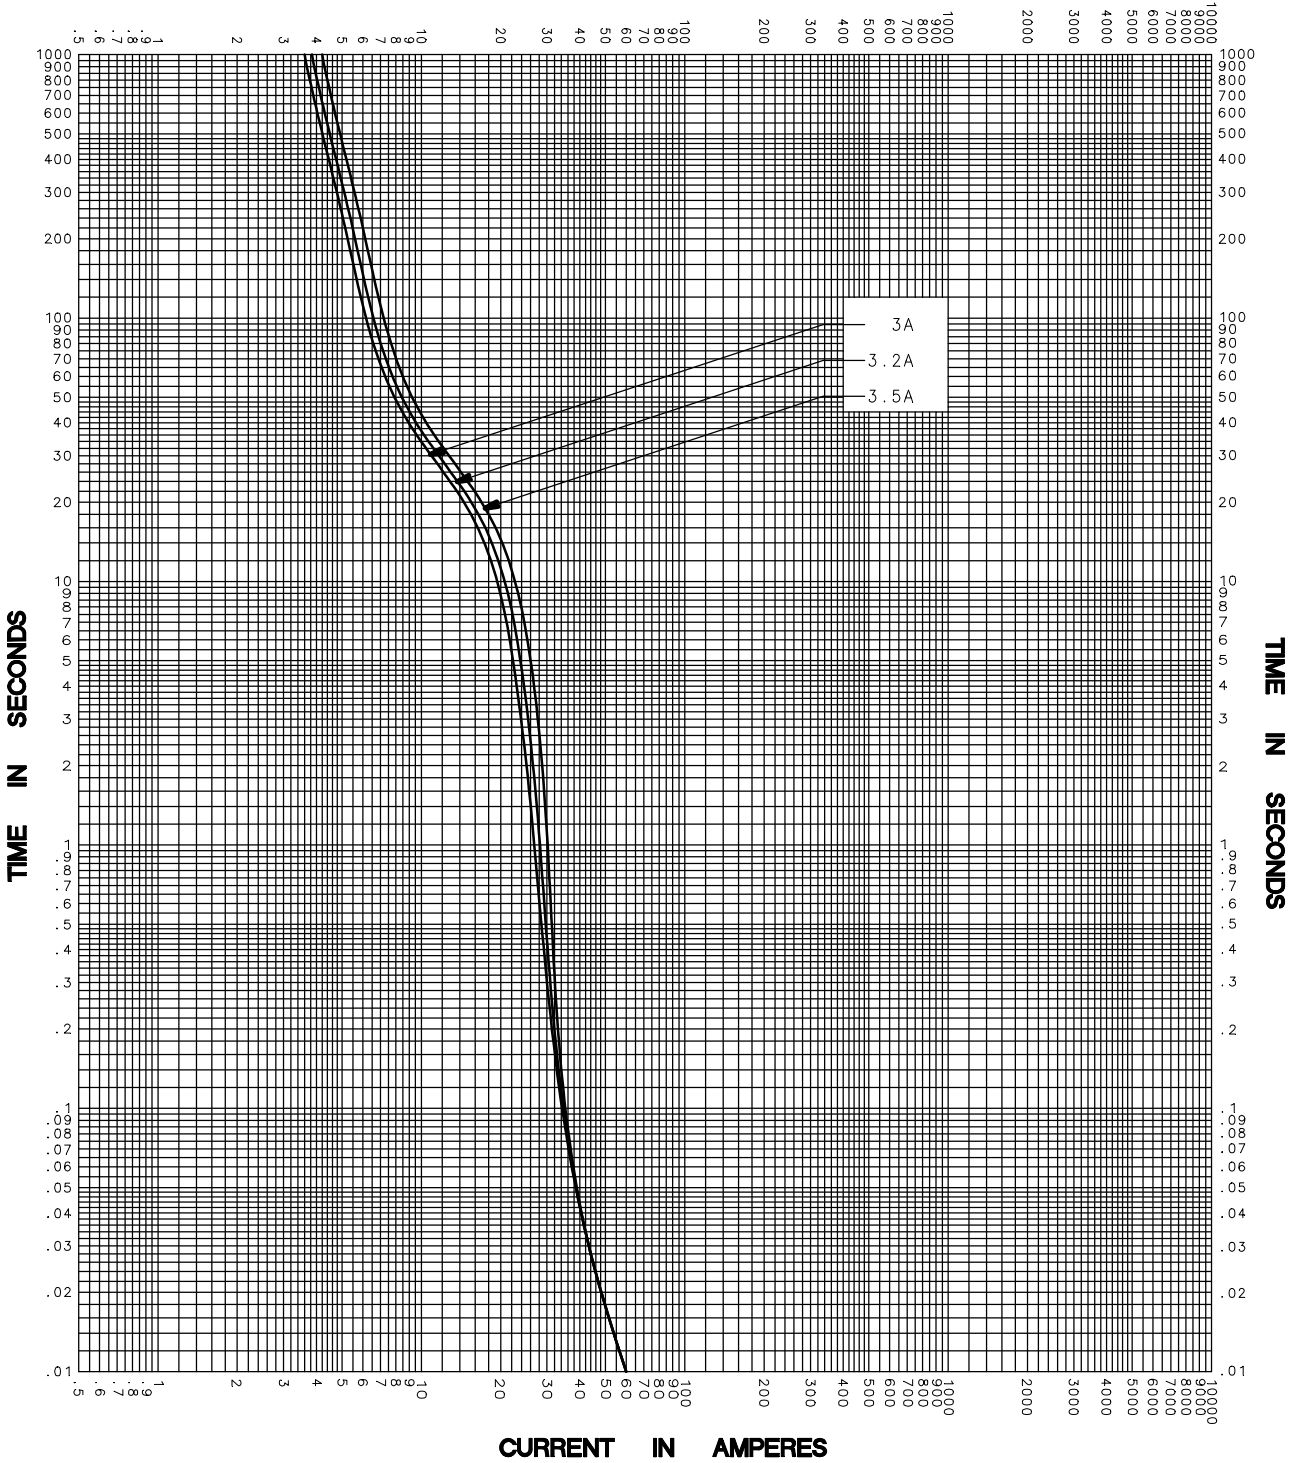


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK(3A - 3.5A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>B-FCC01-LSRK-005</u>

CURRENT IN AMPERES

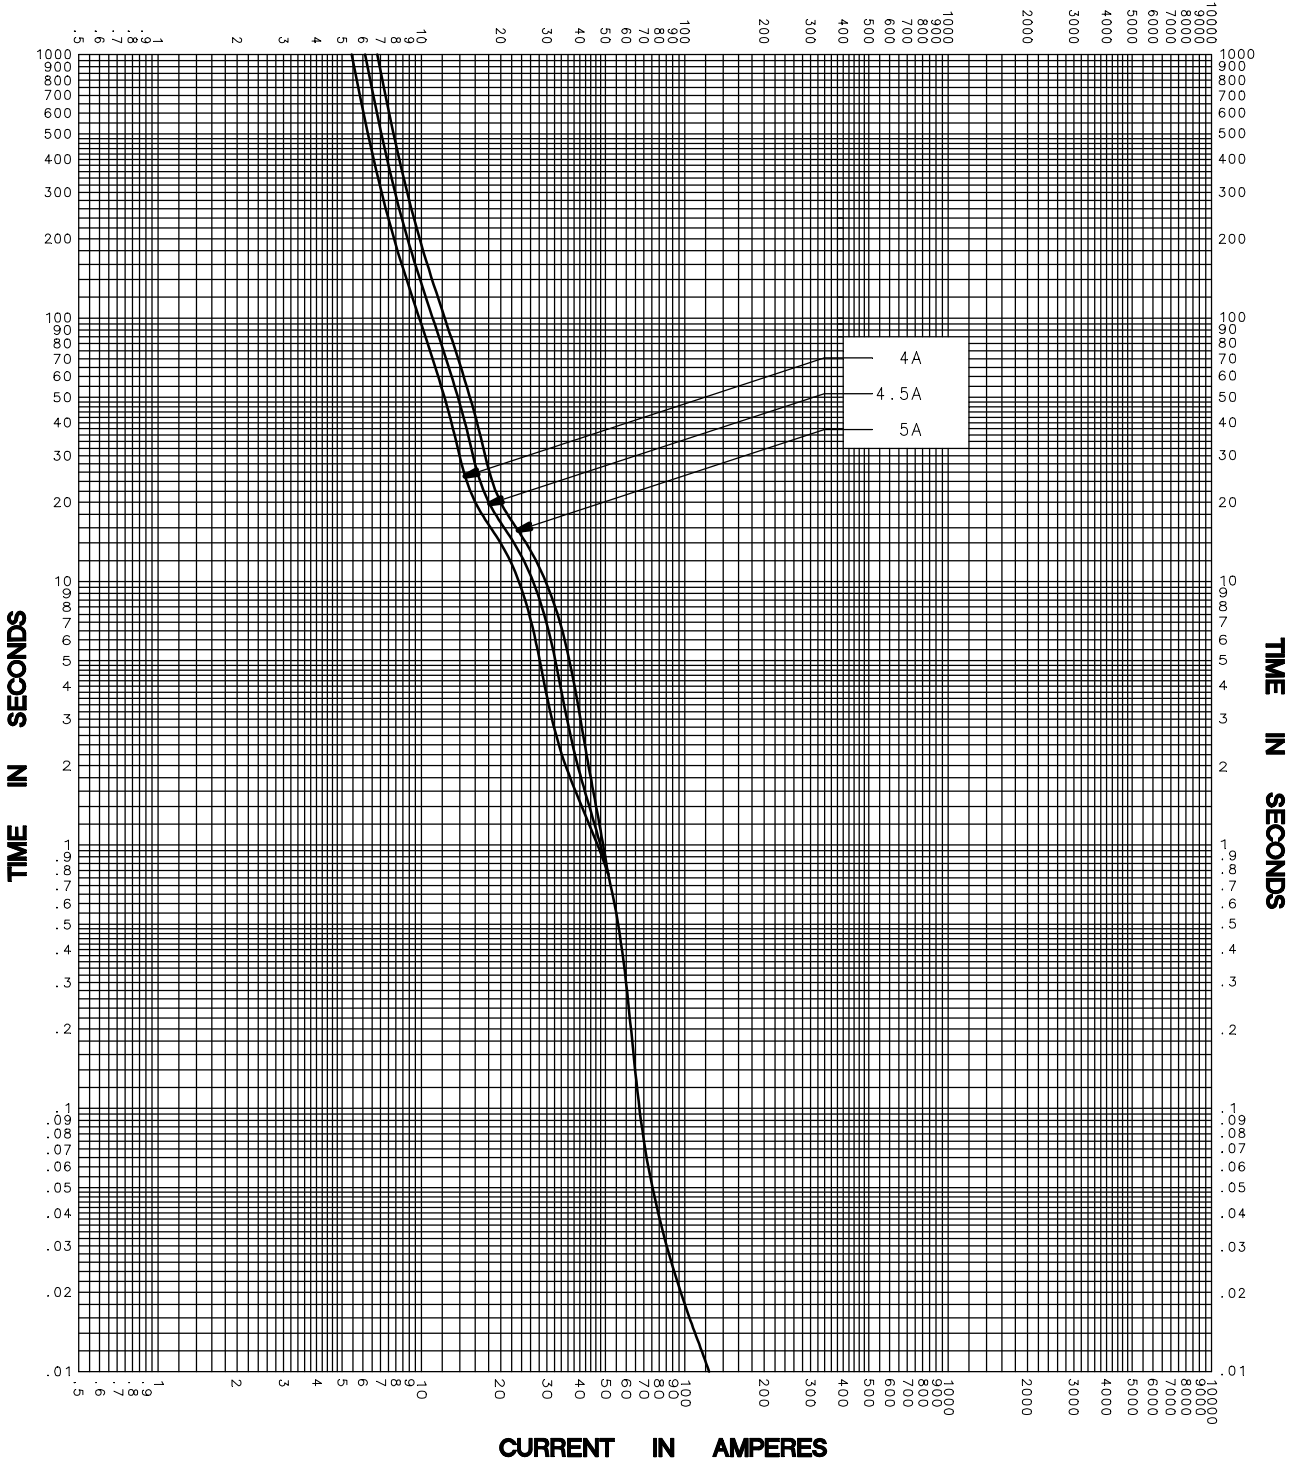


CURRENT IN AMPERES


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (4A - 5A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 12/03/04
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY MP
	DRAWING NO. B-FCC01-LSRK-006

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

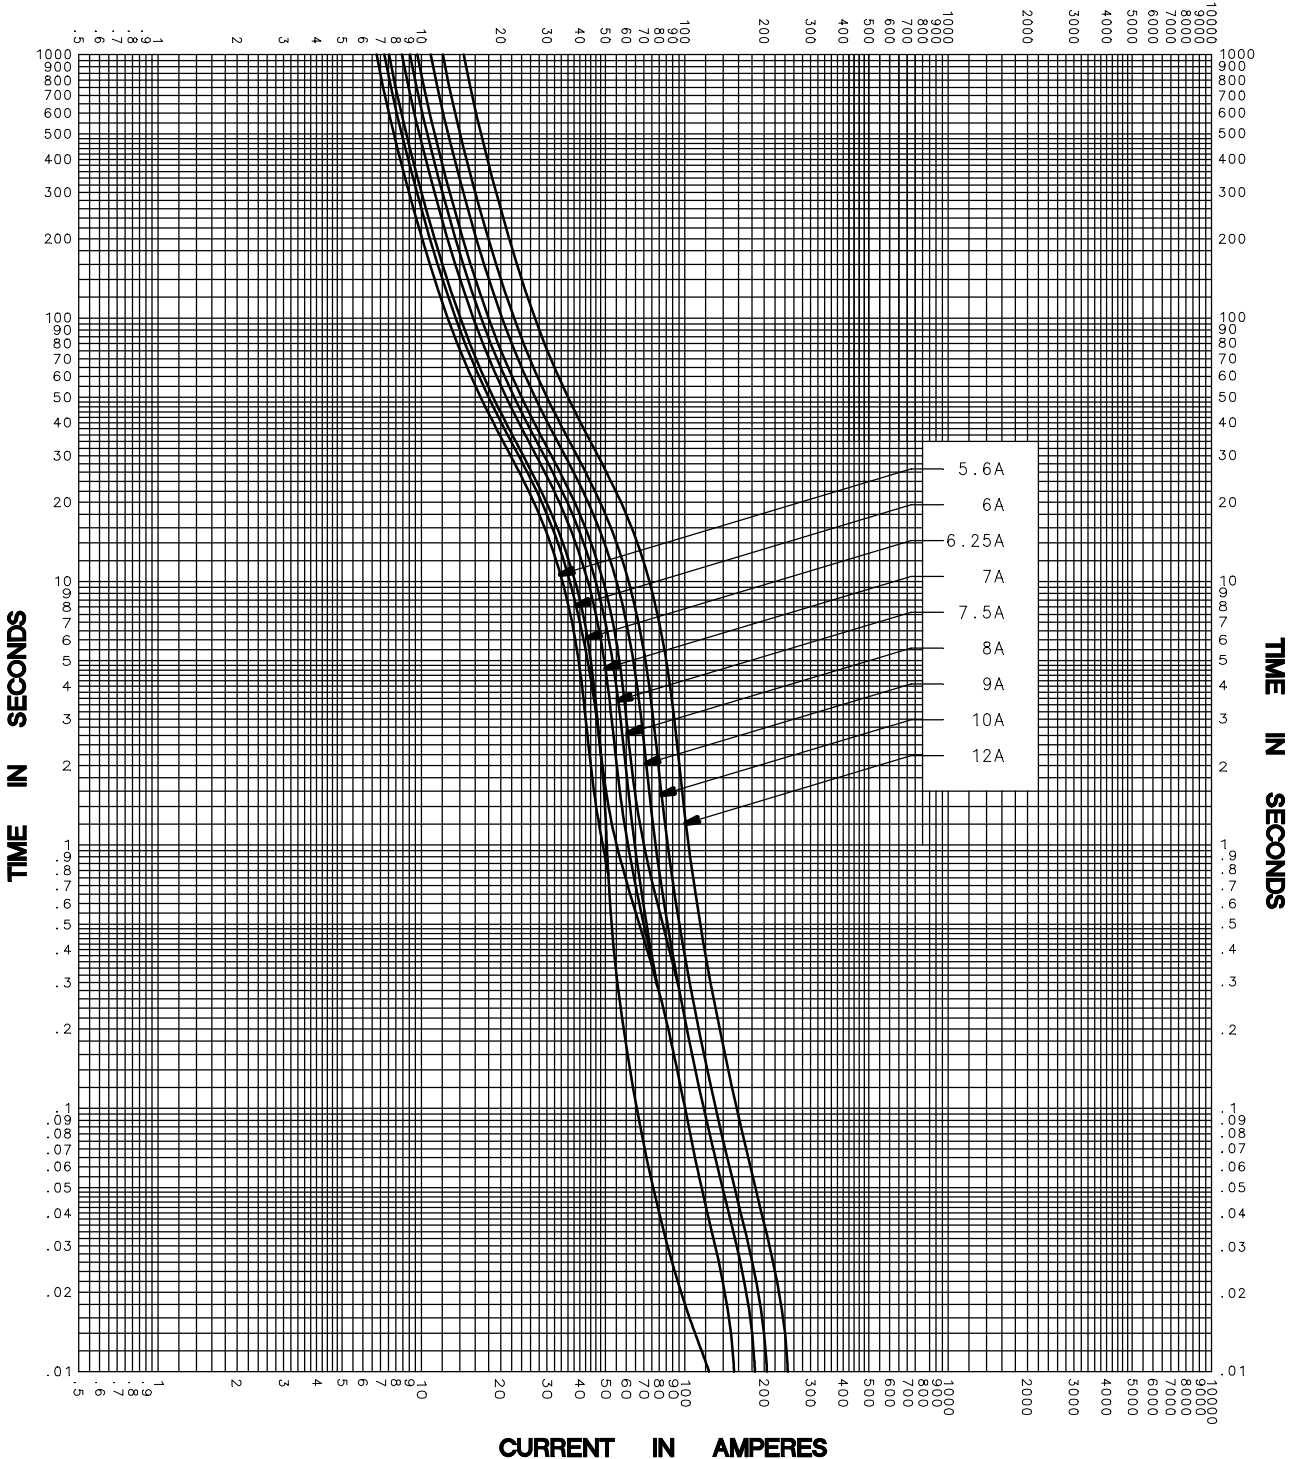


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (5.6A - 12A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 12/03/04
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY MP
	DRAWING NO. B-FCC01-LSRK-007

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

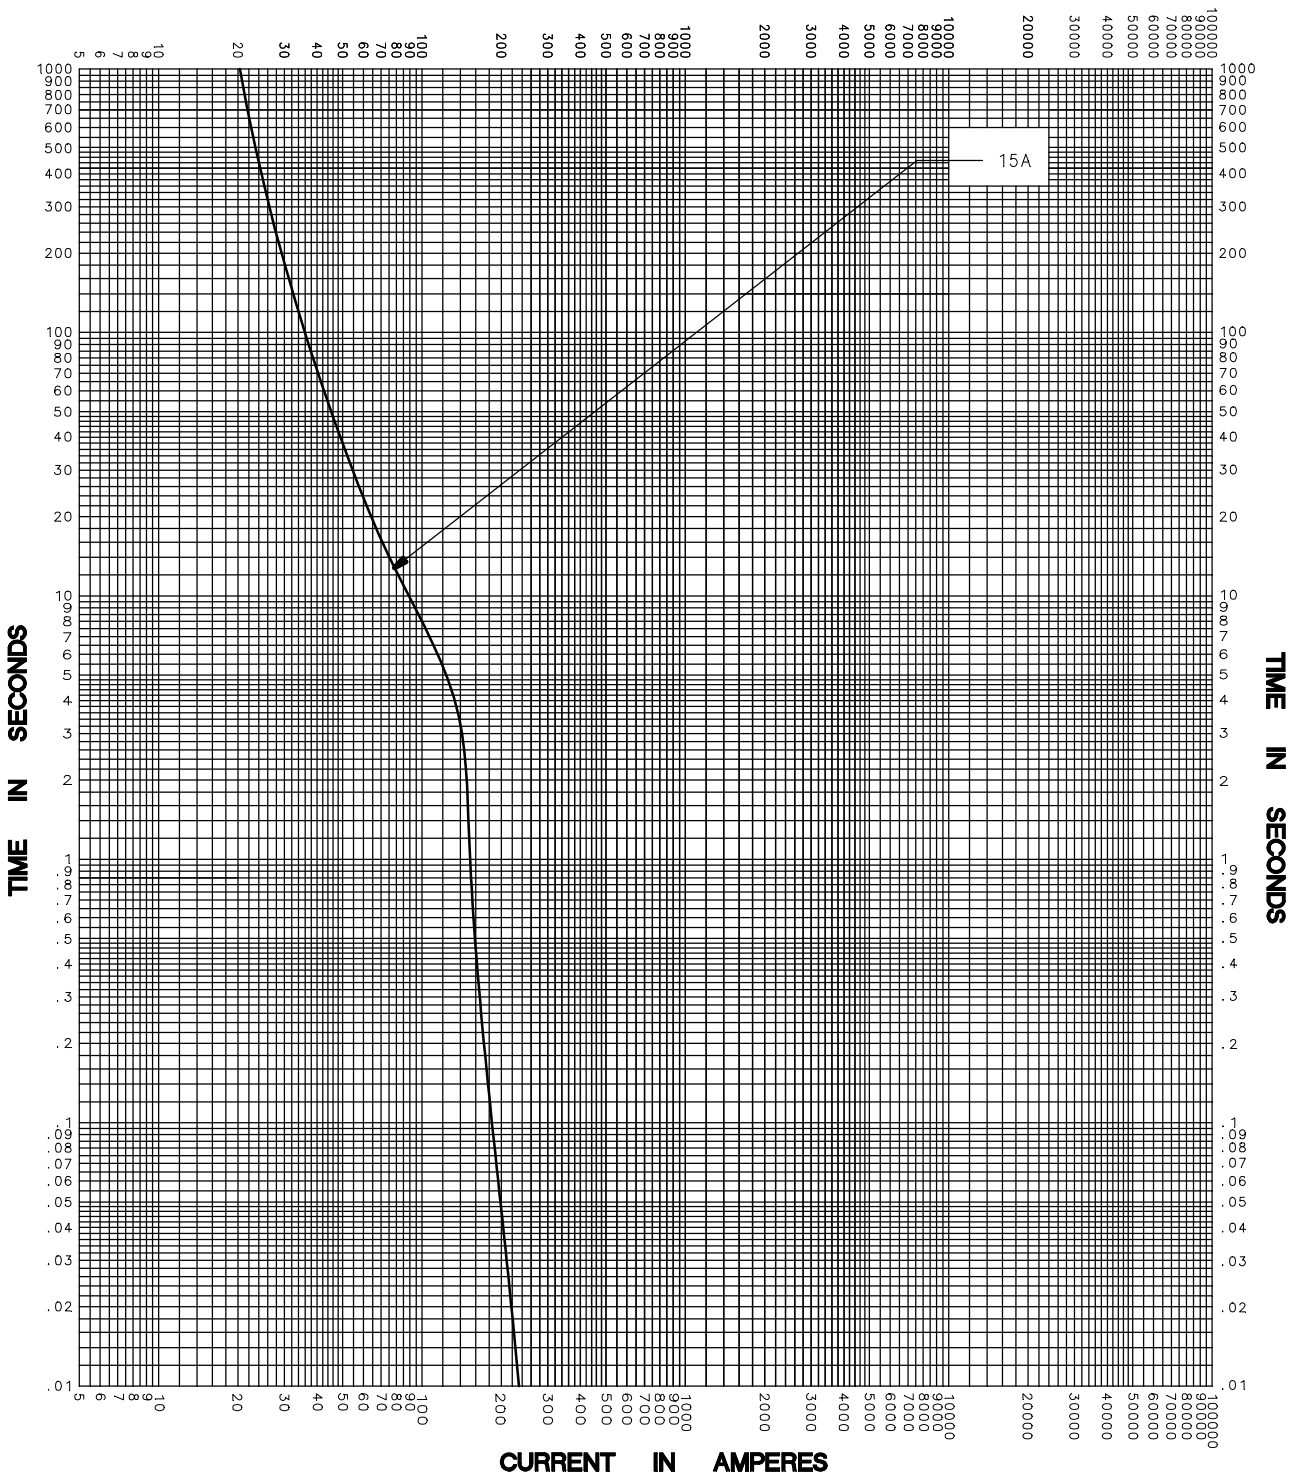


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (15A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>B-FCC01-LSRK-008</u>

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

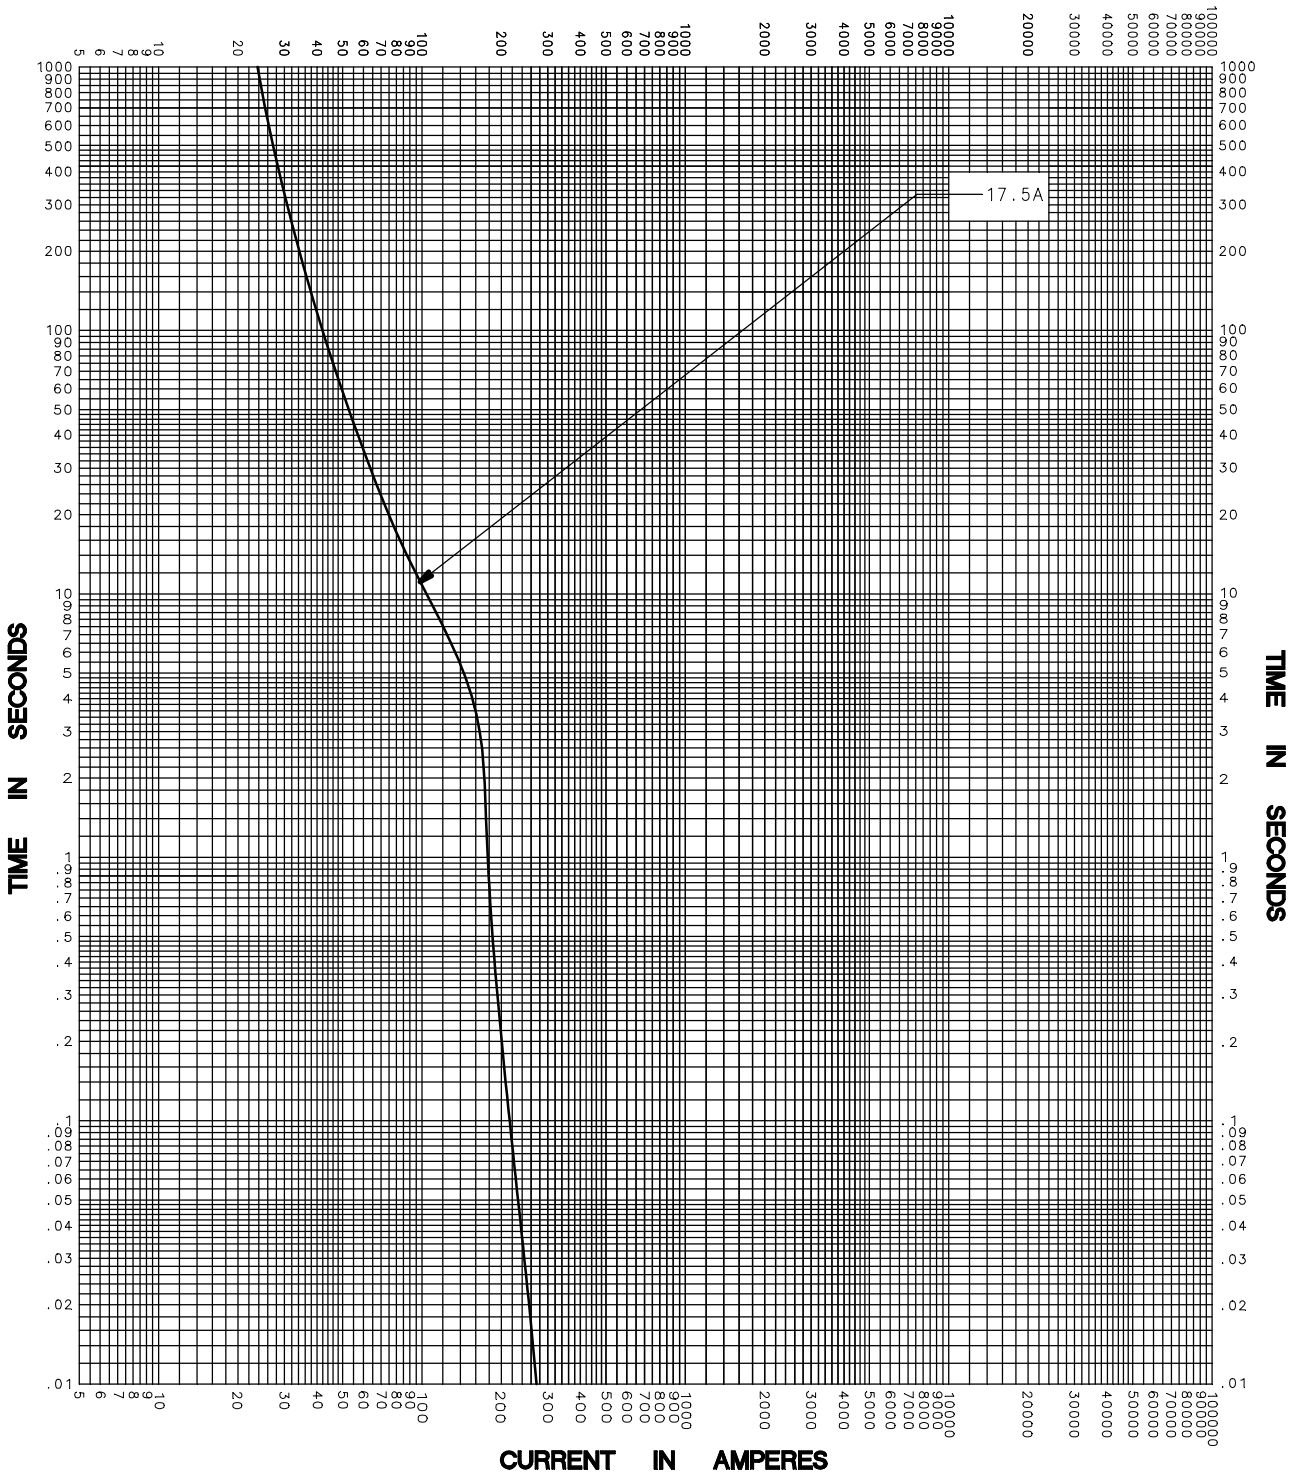

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (17.5A)


 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
	CHECKED BY <u>MP</u>
DRAWING NO. <u>B-FCC01-LSRK-009</u>	

**TIME CURRENT CHARACTERISTIC CURVES**

-THIS DATA GENERATED ON CAD-




CURRENT IN AMPERES

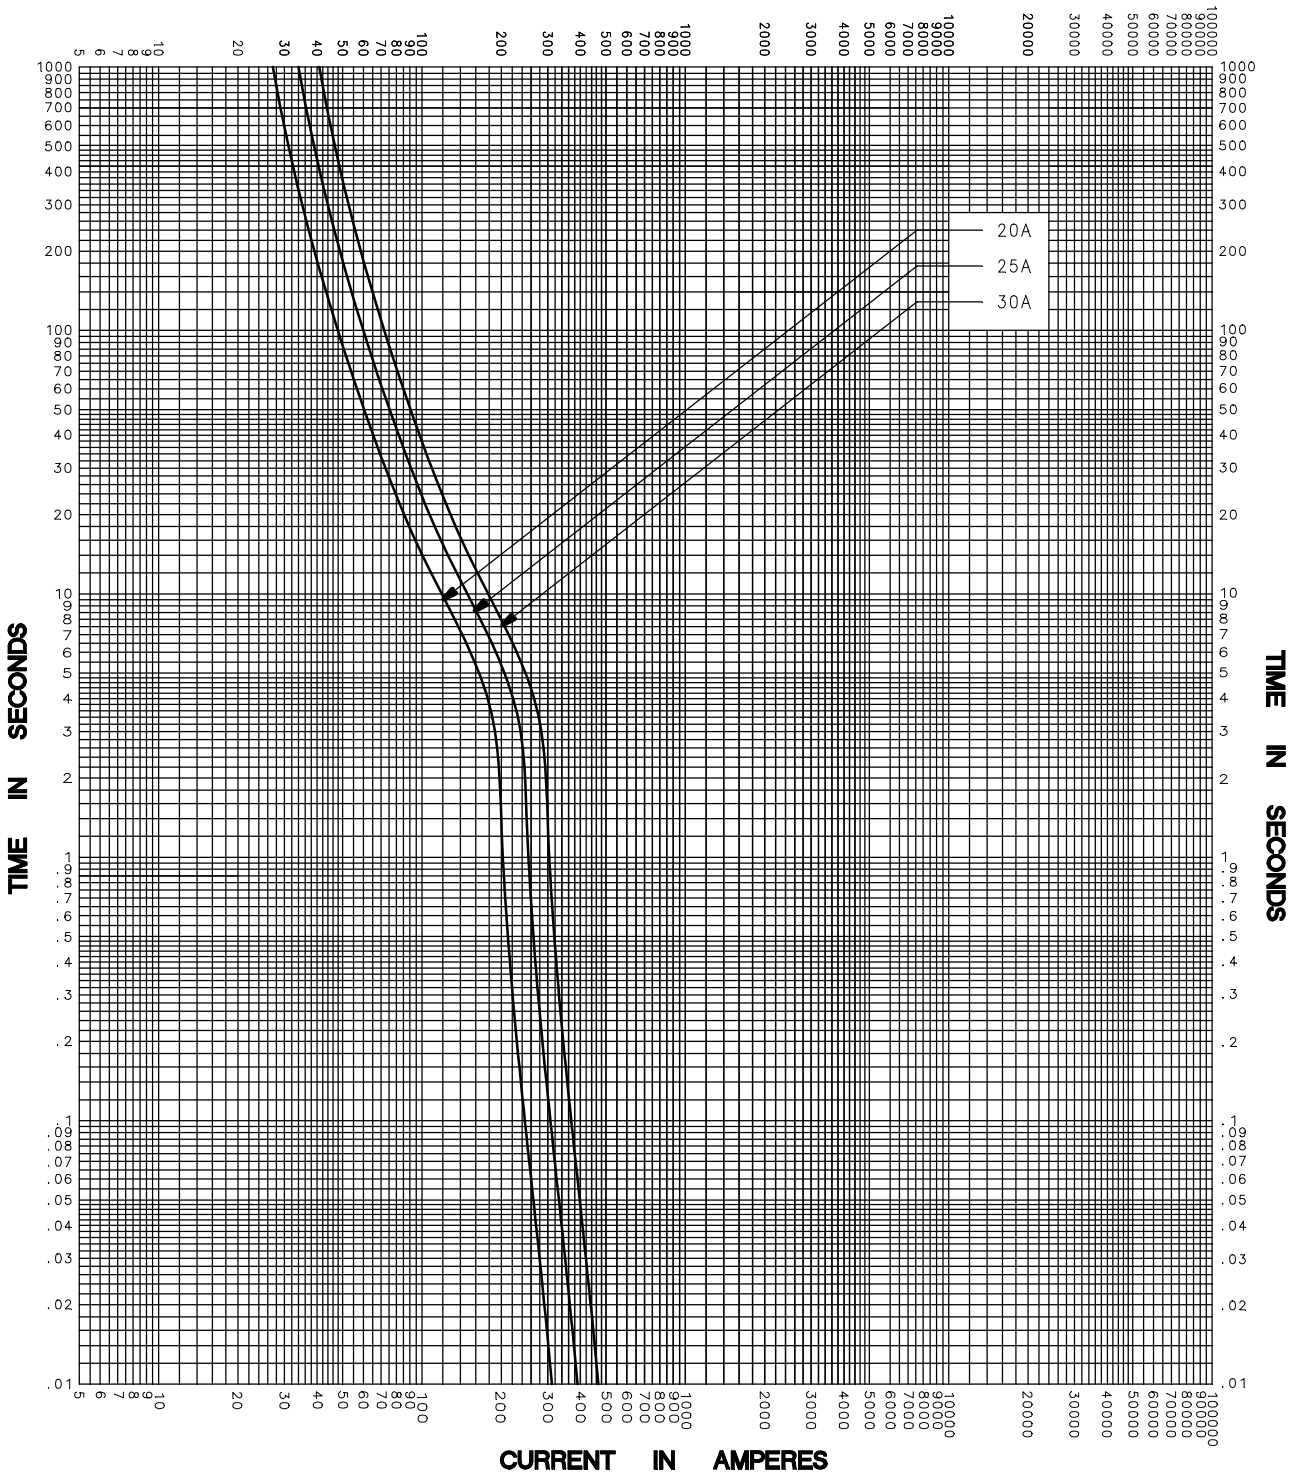

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (20A - 30A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-LSRK-010</u>


CURRENT IN AMPERES

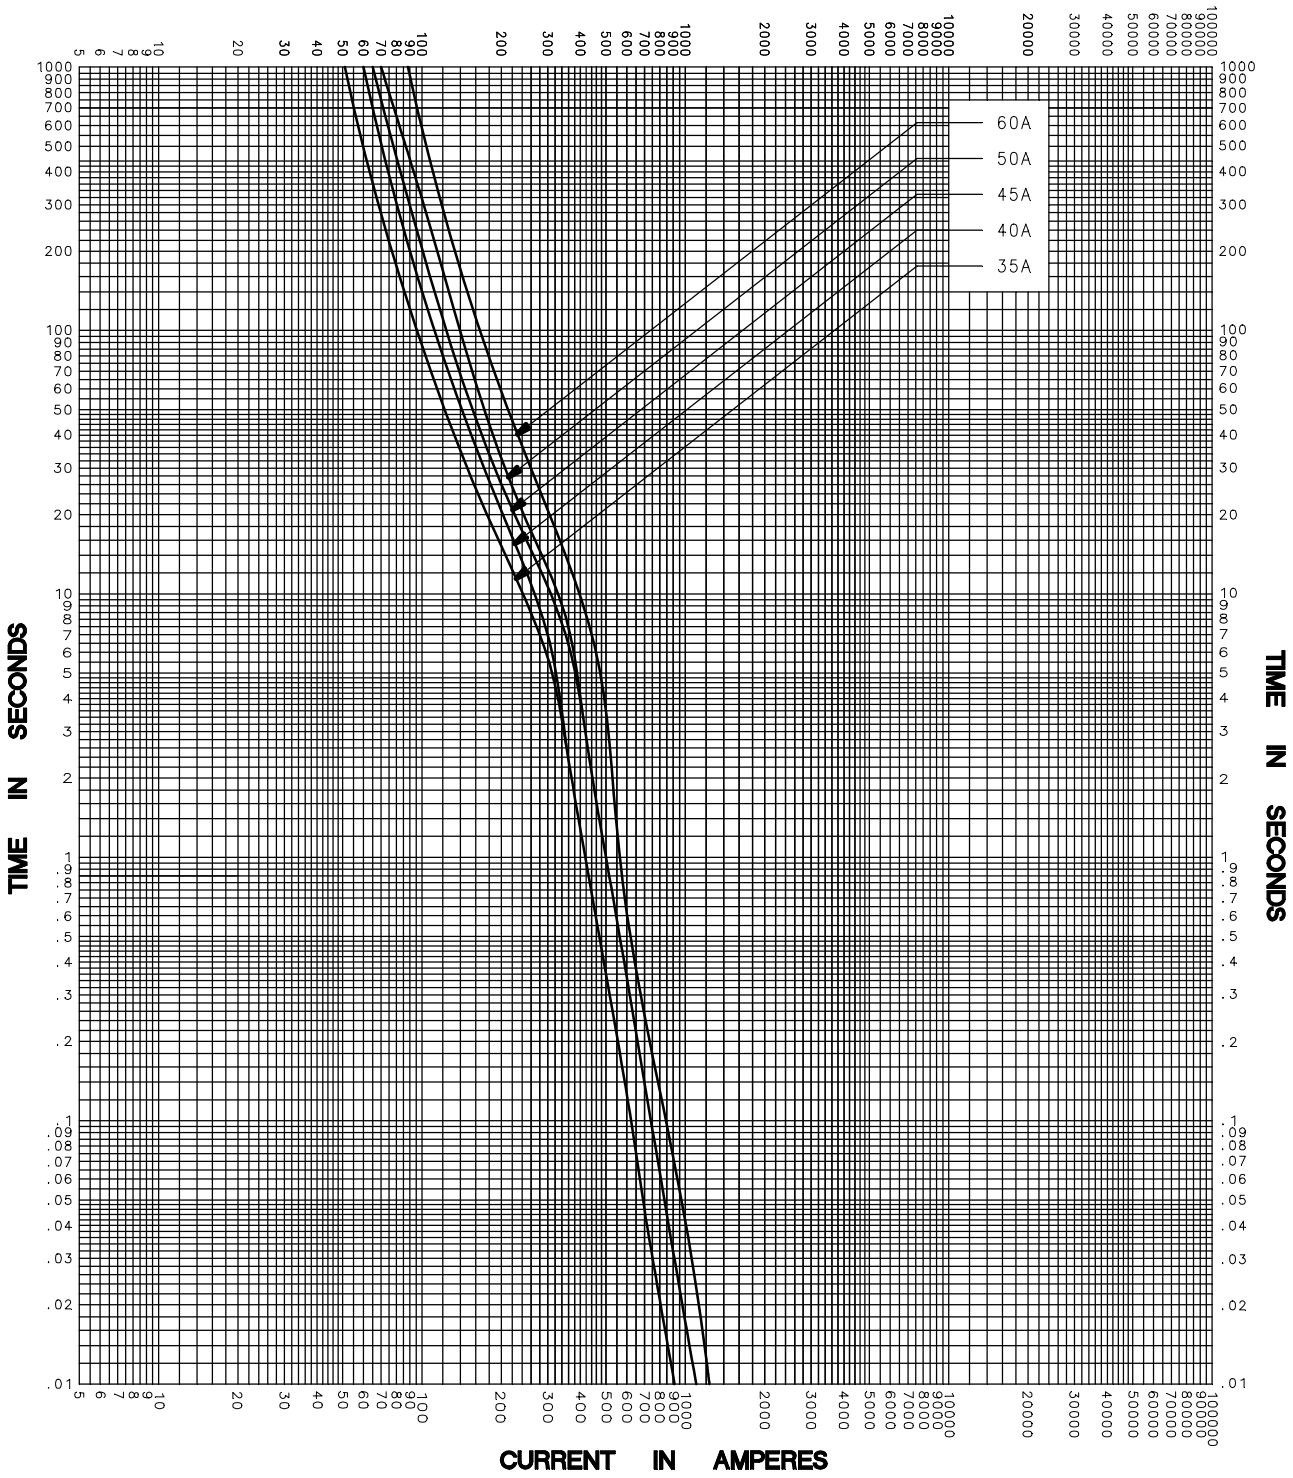

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (35A - 60A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-LSRK-011</u>

CURRENT IN AMPERES

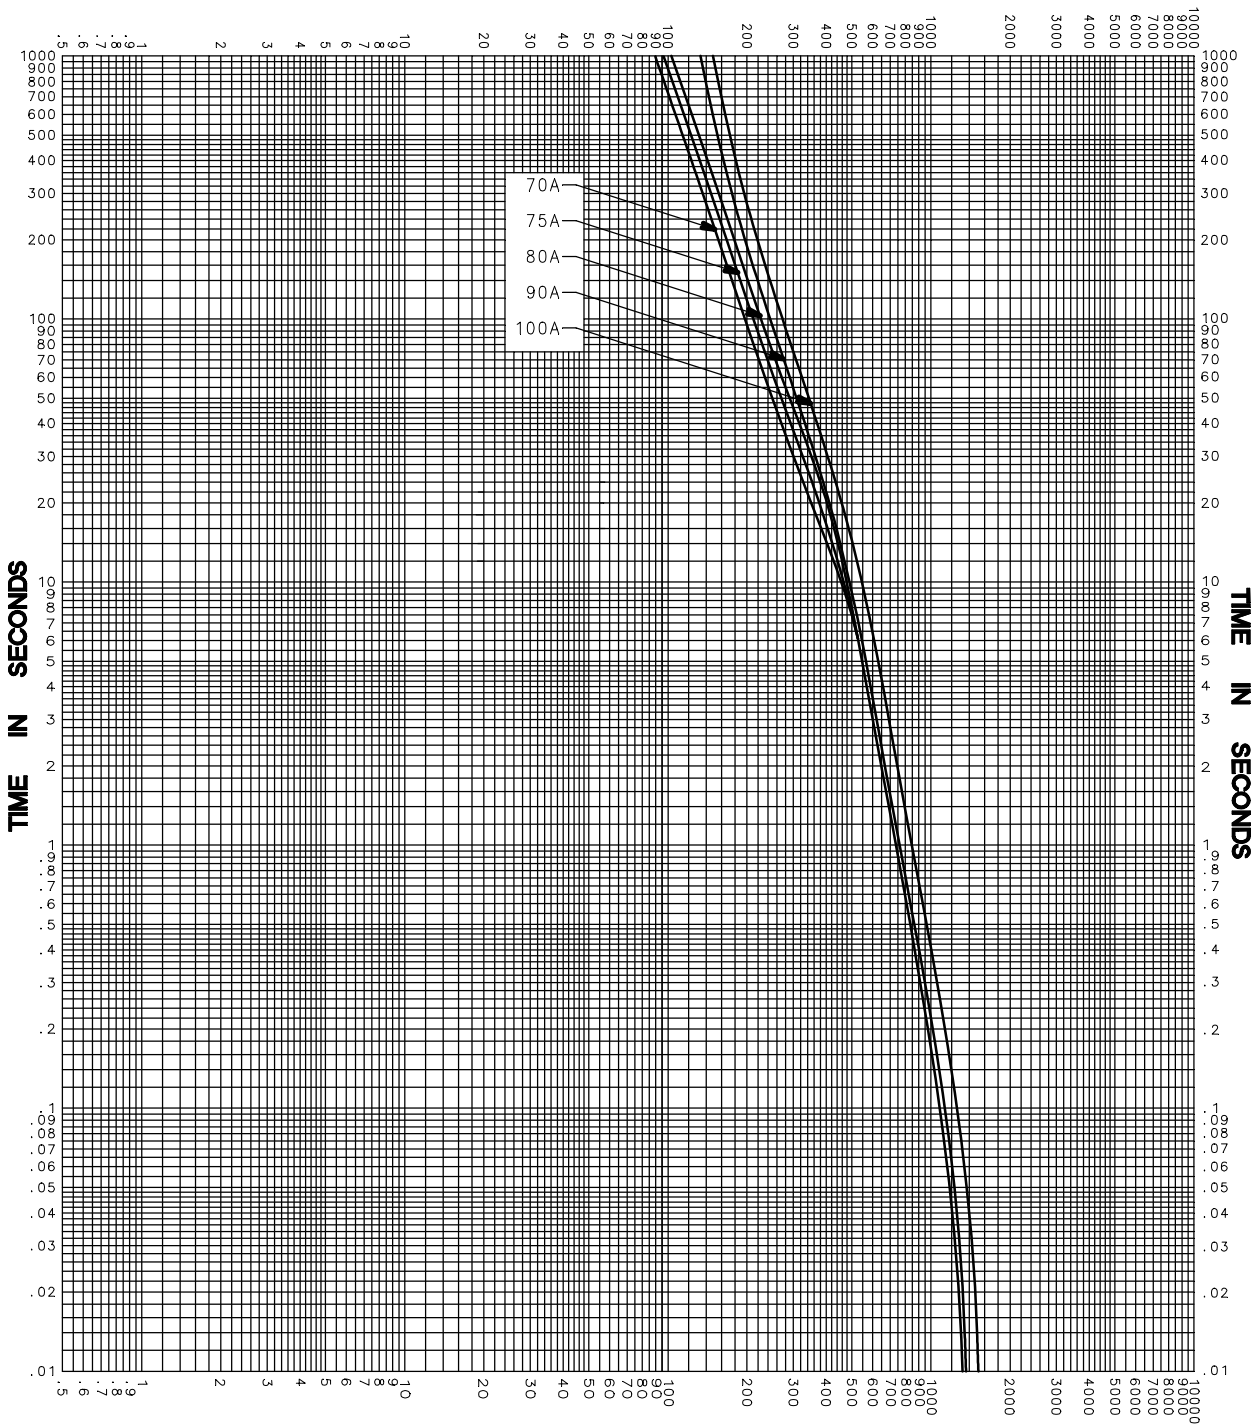

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (70A - 100A)



DRAWN BY	LLL
DATE	12/03/04
CHECKED BY	MP

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. B-FCC01-LSRK-012
---	---------------------------------

CURRENT IN AMPERES

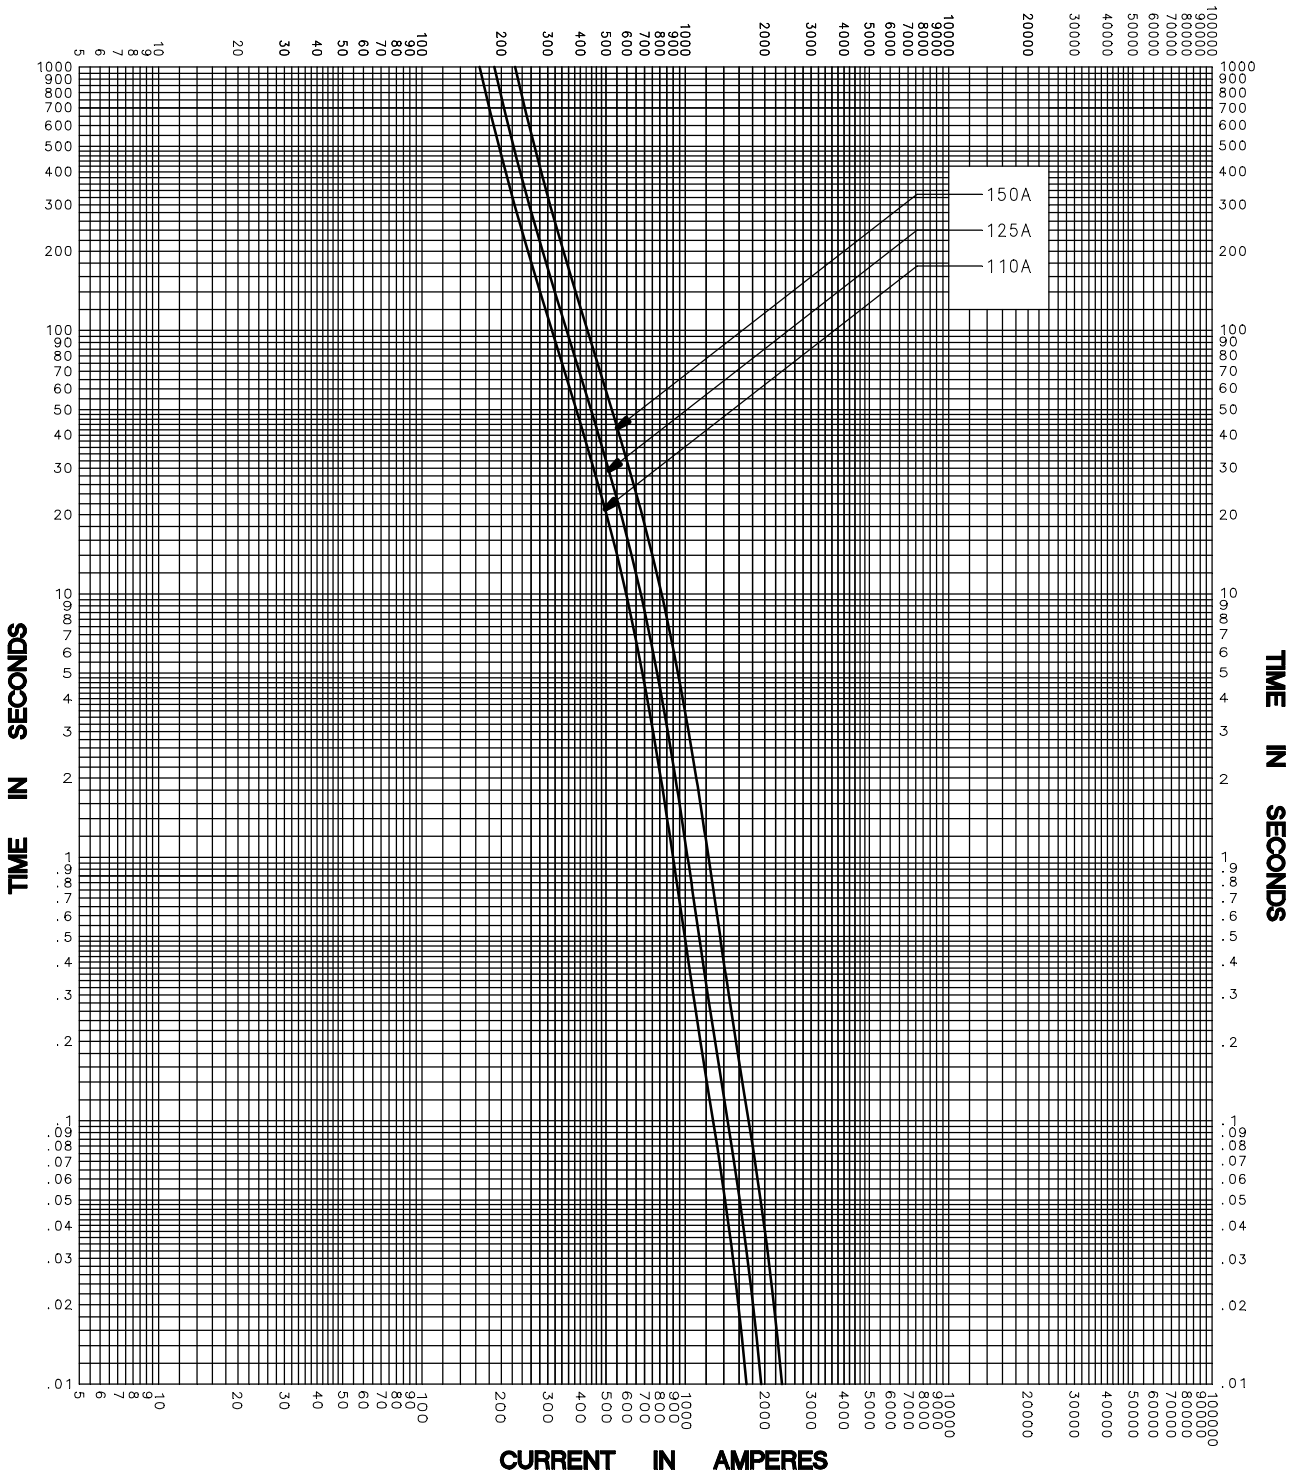


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (110A - 150A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
	CHECKED BY <u>MP</u>
DRAWING NO. <u>B-FCC01-LSRK-013</u>	

**TIME CURRENT CHARACTERISTIC CURVES**

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

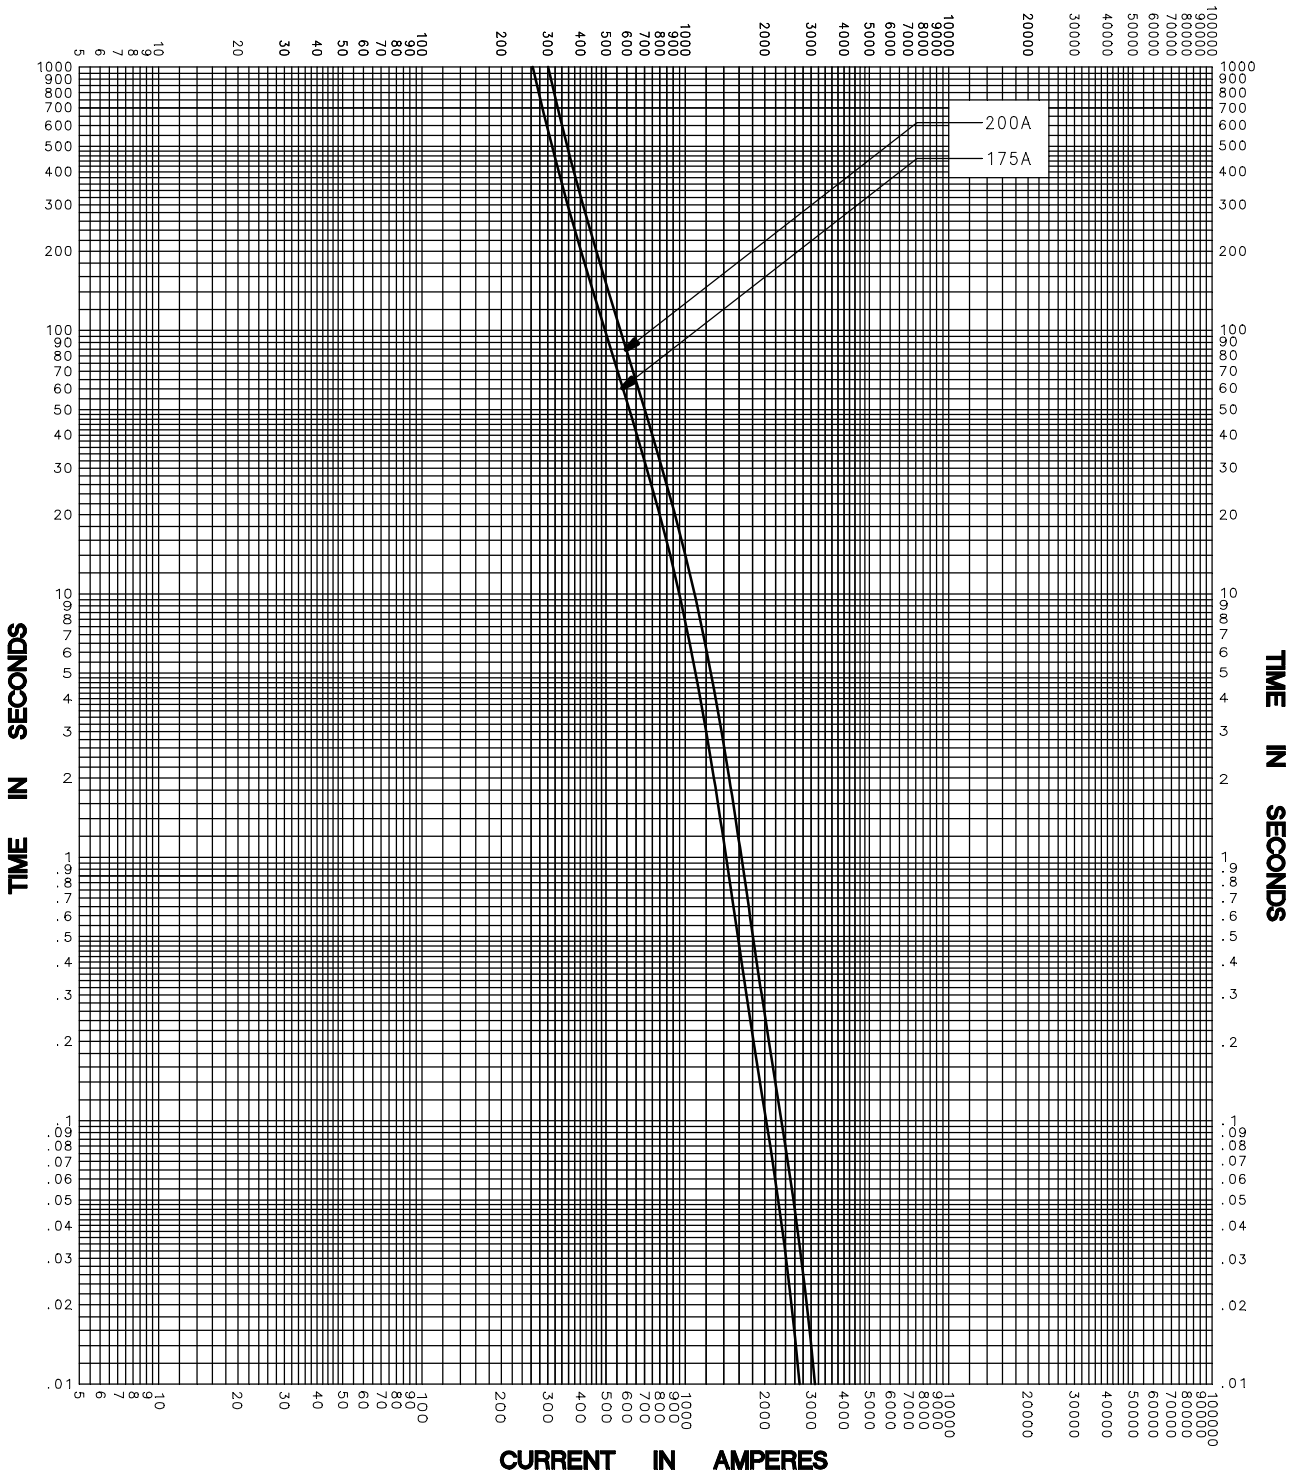


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (175A - 200A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
	CHECKED BY <u>MP</u>
DRAWING NO. <u>B-FCC01-LSRK-014</u>	

**TIME CURRENT CHARACTERISTIC CURVES**

-THIS DATA GENERATED ON CAD-


CURRENT IN AMPERES

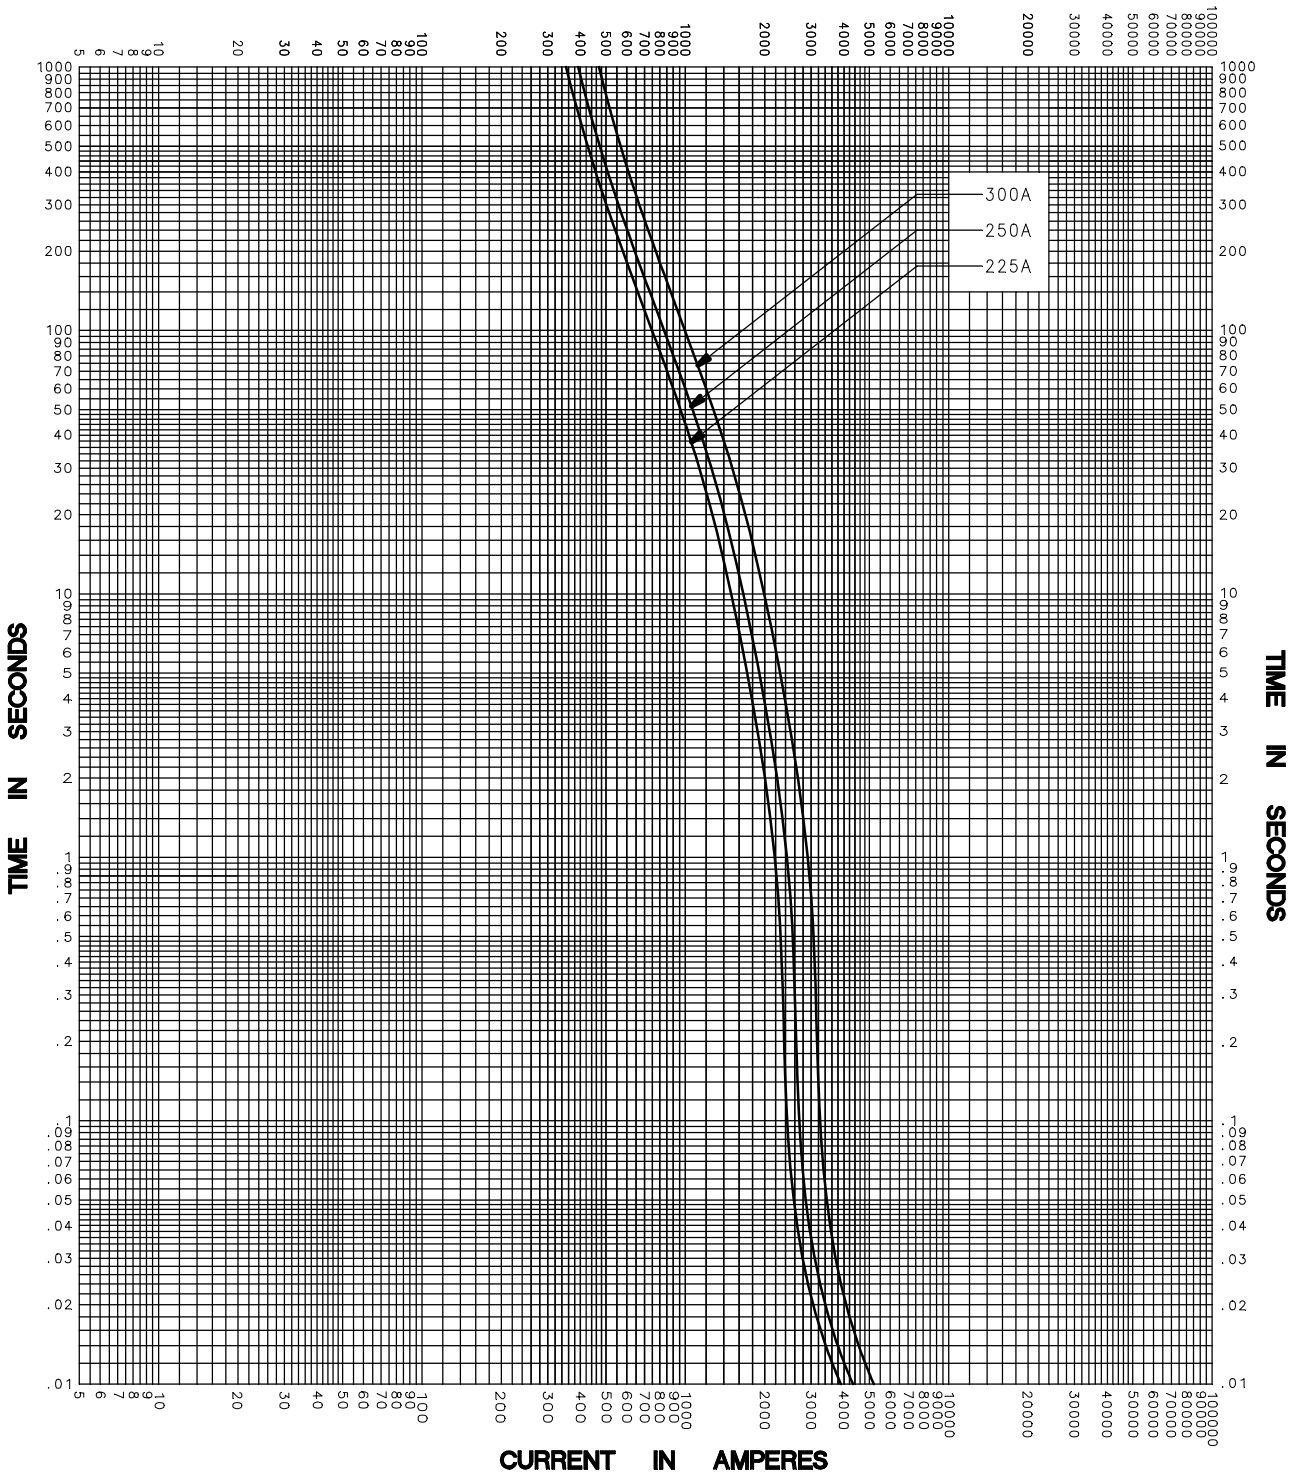

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	LLSRK (225A - 300A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>B-FCC01-LSRK-015</u>

CURRENT IN AMPERES

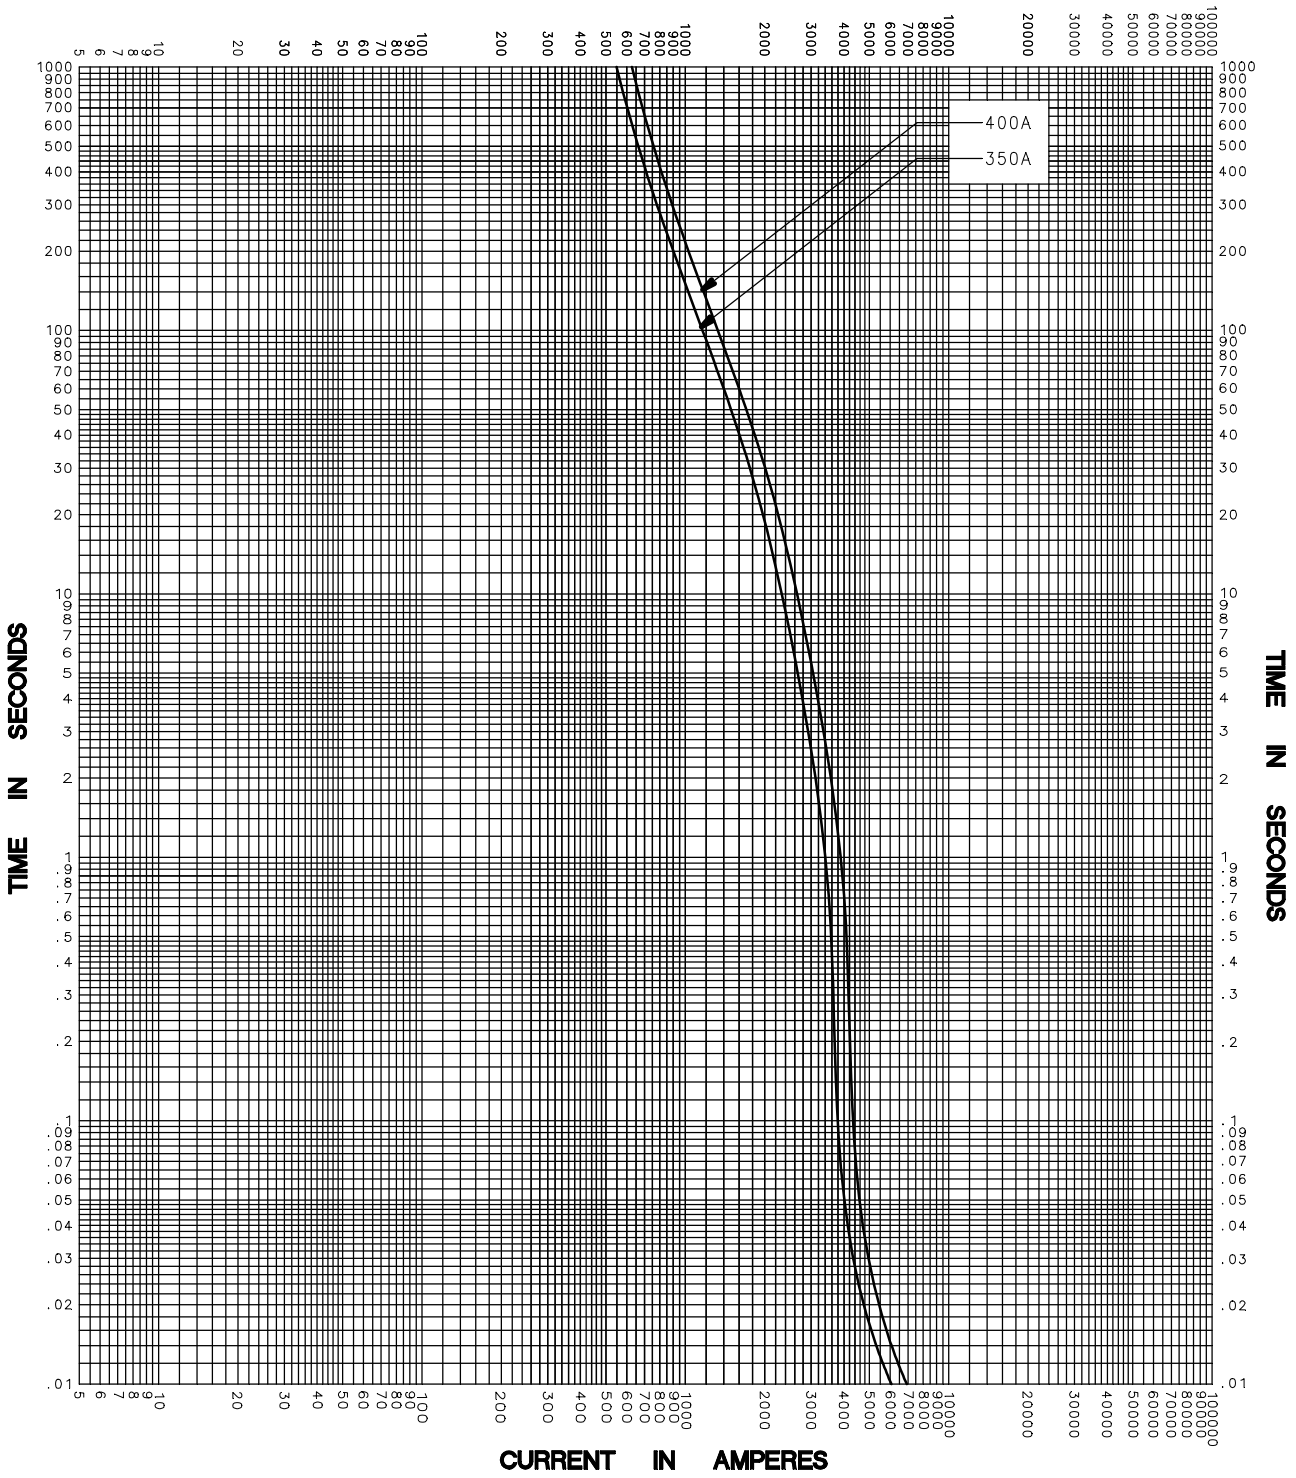


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (350A - 400A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
	CHECKED BY <u>MP</u>
DRAWING NO. <u>B-FCC01-LSRK-016</u>	

**TIME CURRENT CHARACTERISTIC CURVES**

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

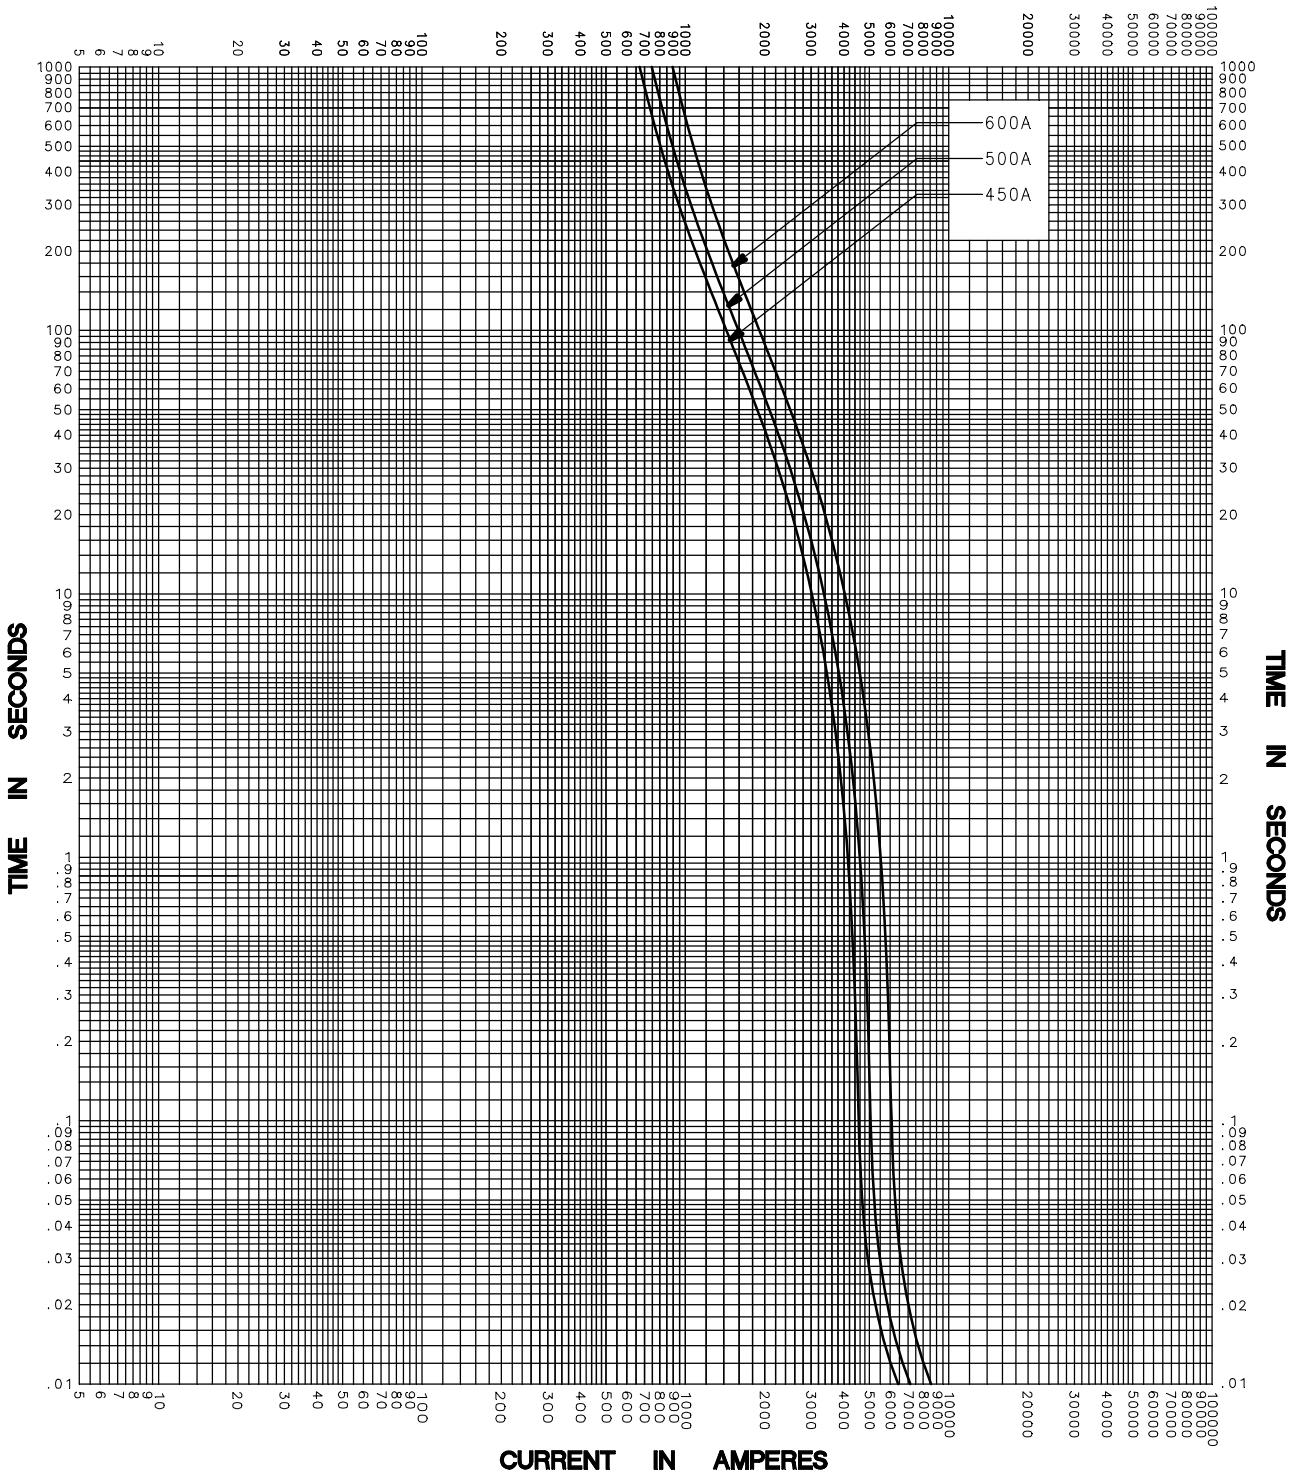

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (450A - 600A)

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>12/03/04</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>B-FCC01-LSRK-017</u>