



**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

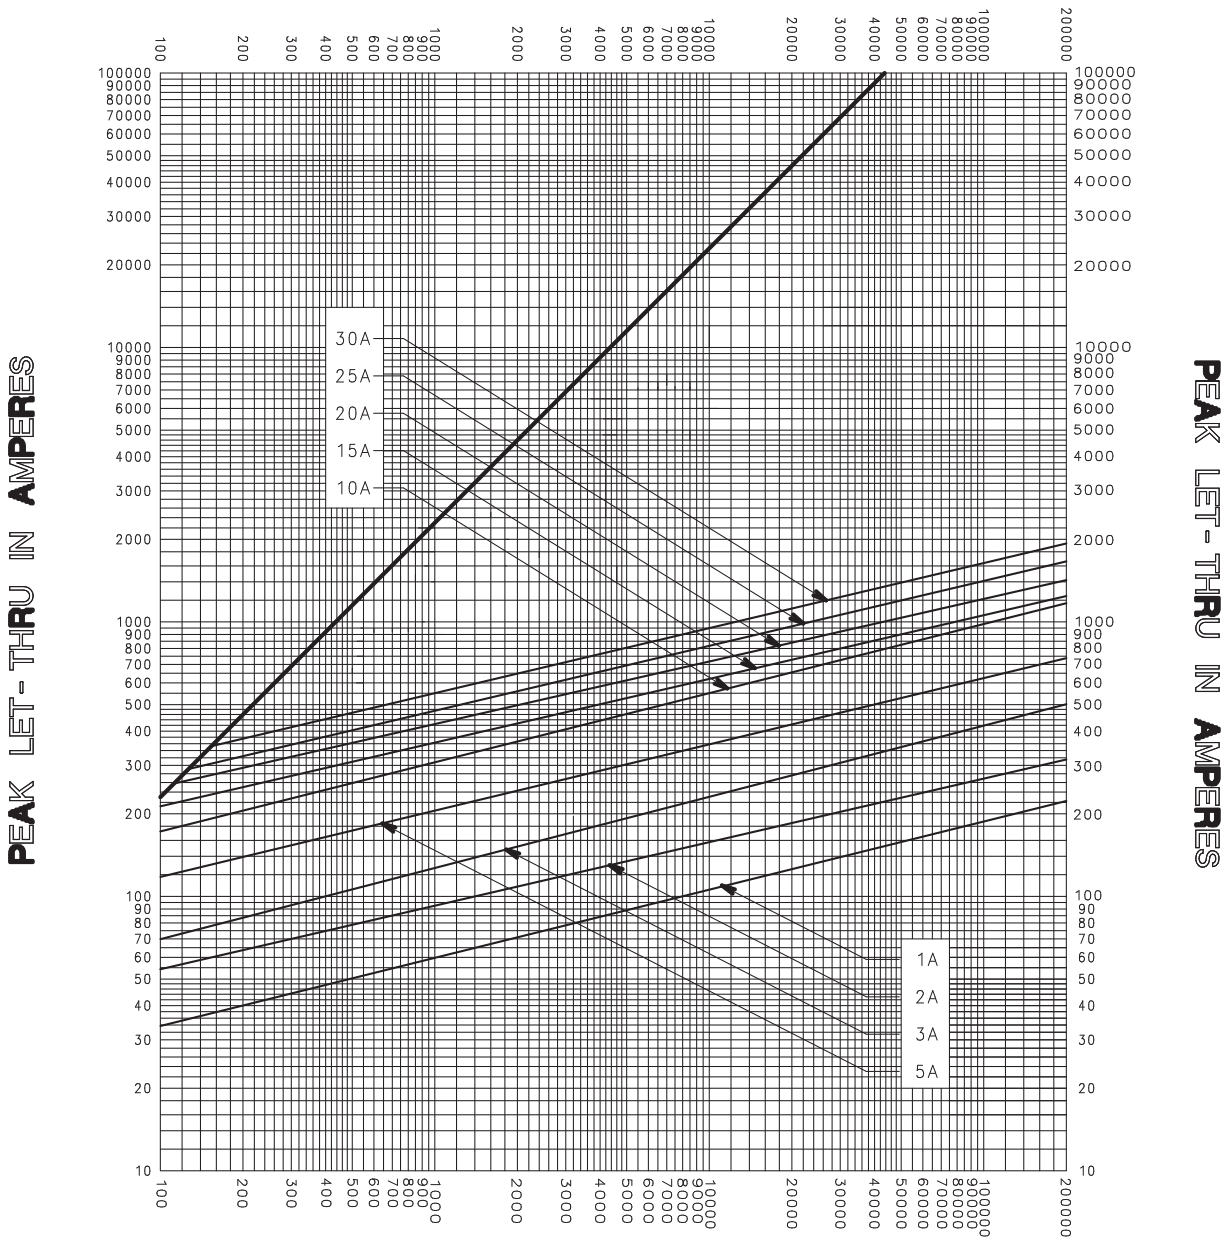



**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

| | |
|--|--|
| TEST VOLTAGE <u>250V</u> TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER <u>L25S (1A - 30A)</u> |
| BASIS FOR DATA _____ | |
|  LITTELFUSE, INC. DES PLAINES, ILL. USA | DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u> |
| | PEAK LET-THRU CHARACTERISTIC CURVES DRAWING NO. <u>A-FCC05-355-1</u> |


-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**

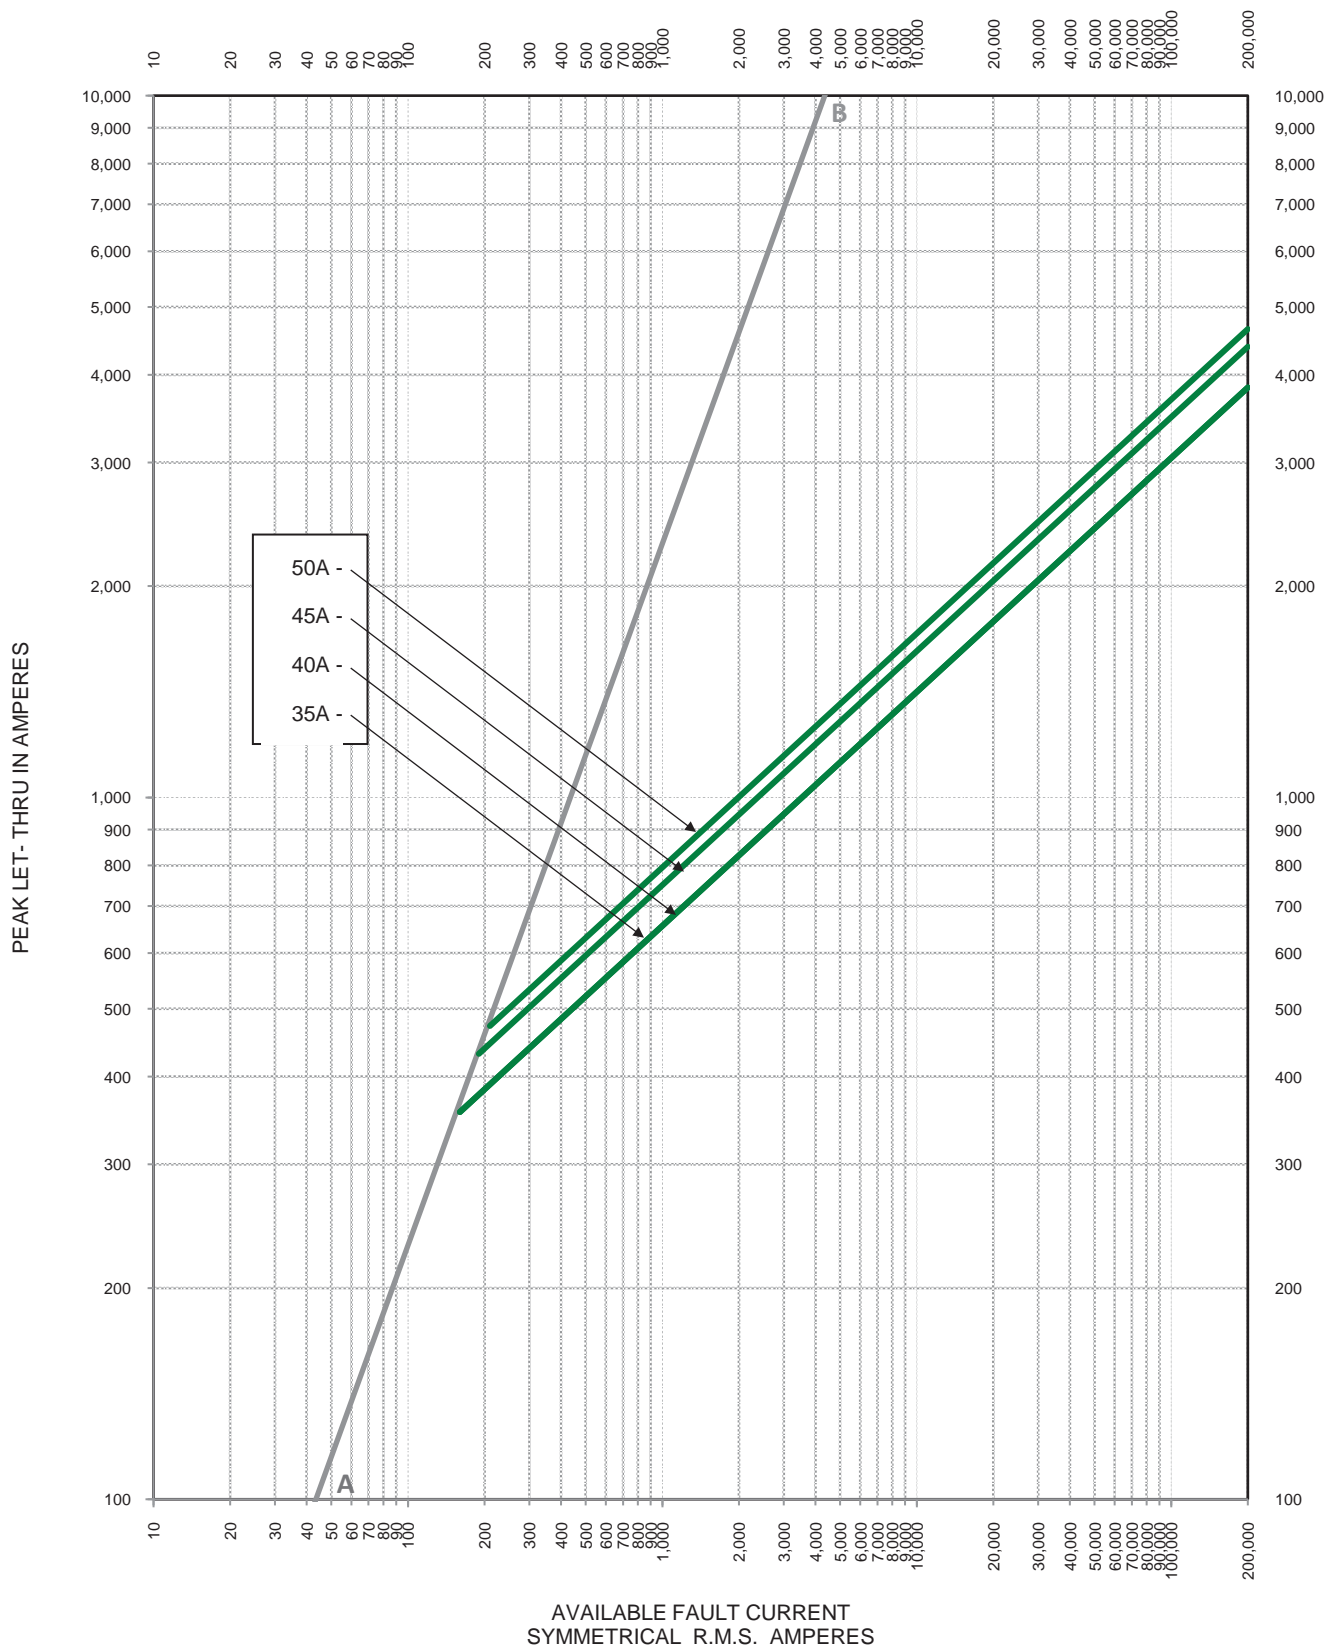


| | | |
|---|-----------------------------|---------------------------|
| TEST VOLTAGE: | TIME CONSTANT/POWER FACTOR: | FUSE CATALOG NUMBER: |
| BASIS FOR DATA: AB = 15% Power Factor | | L25S 35A - 50A |
|  | | DRAWN BY: LLL |
| | | DATE: 11/27/2018 |
| PEAK LET-THRU CHARACTERISTIC CURVES | | REVISION: A |
| | | DRAWING NO.: SHEET 2 OF 2 |
| | | FCC05-L25S |

**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

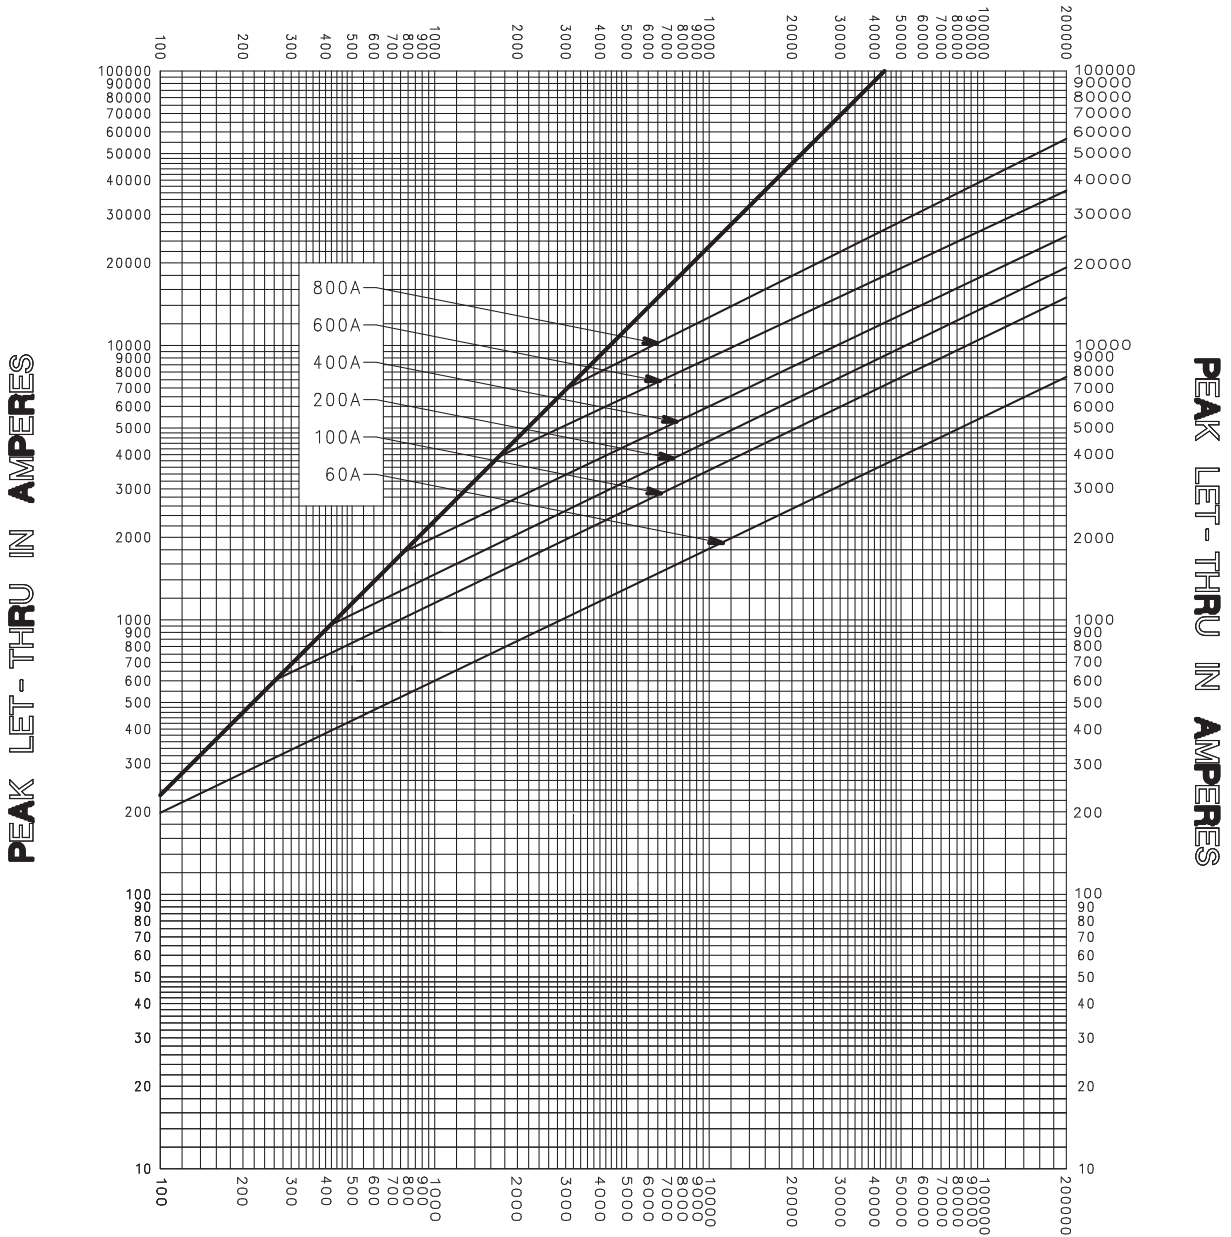

**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

| | |
|--|----------------------------------|
| TEST VOLTAGE <u>250V</u> TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER |
| BASIS FOR DATA _____ | L25S (60A - 800A) |
|  LITTELFUSE, INC. DES PLAINES, ILL. USA | DRAWN BY <u>LLL</u> |
| | DATE <u>05/17/06</u> |
| PEAK LET-THRU CHARACTERISTIC CURVES | CHECKED BY <u>MP</u> |
| | DRAWING NO. <u>A-FCC05-355-2</u> |

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**