


AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES


PEAK LET-THRU IN AMPERES

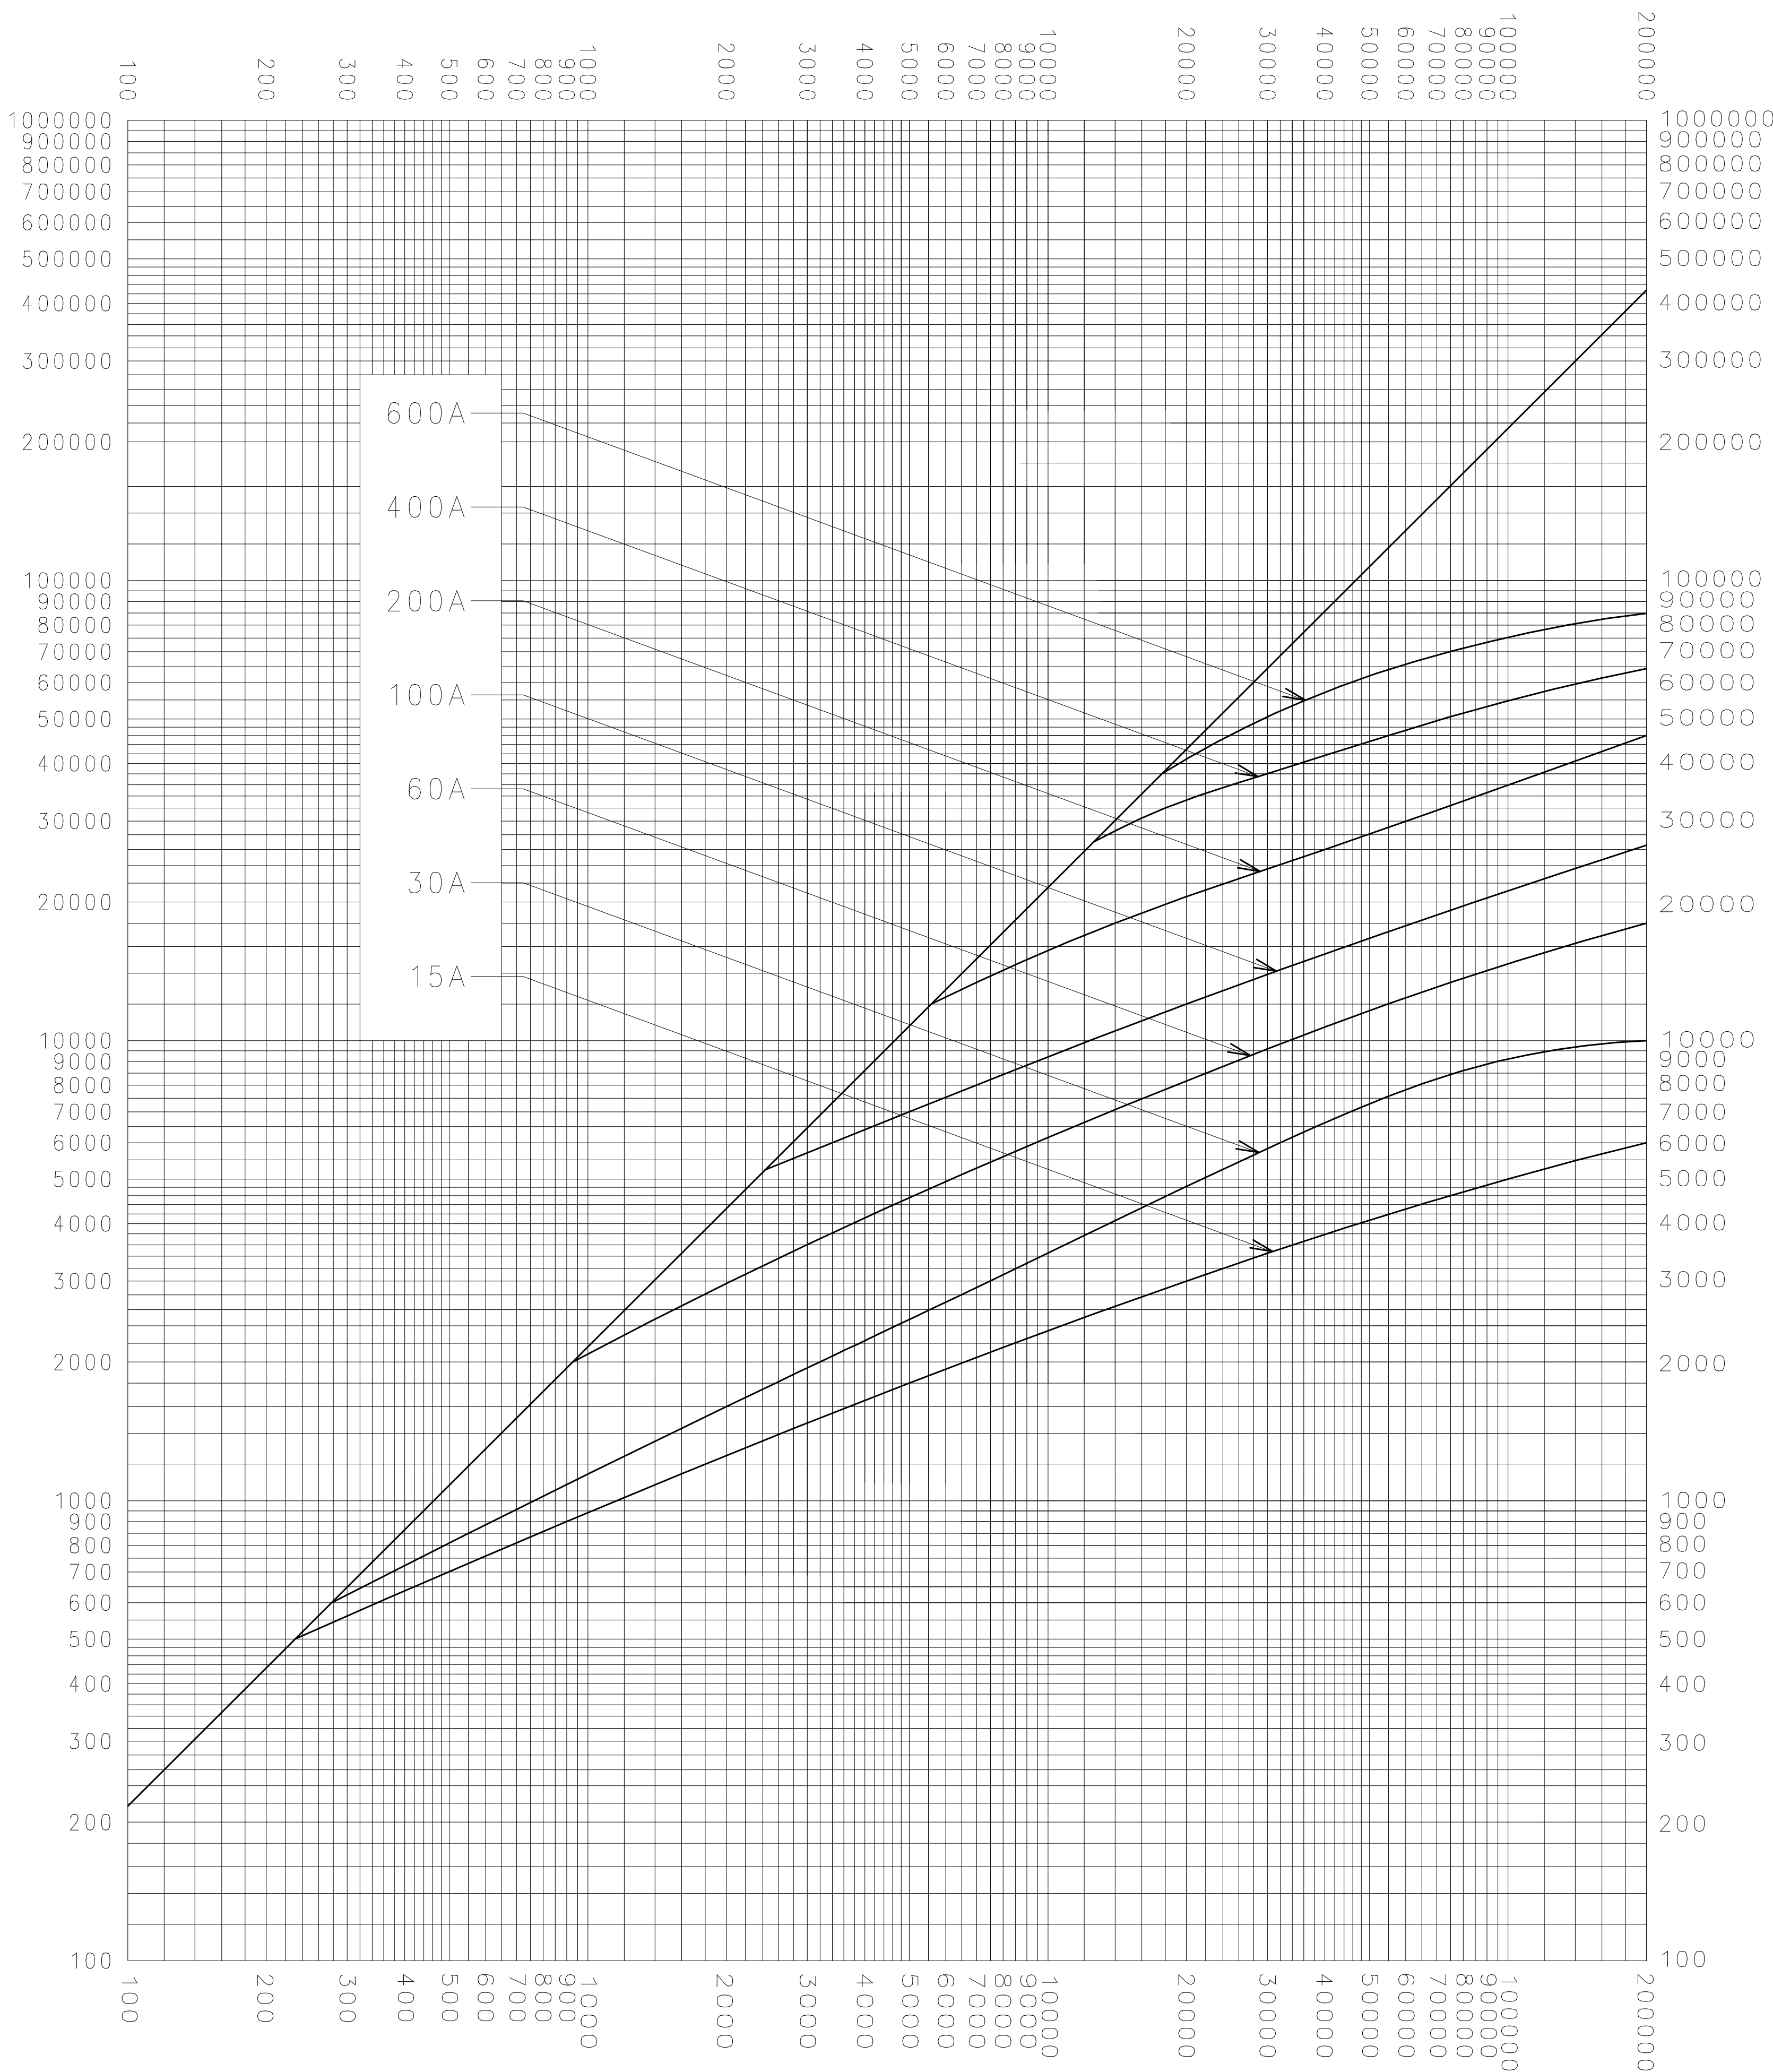

PEAK LET-THRU IN AMPERES

AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER _____
BASIS FOR DATA _____	FLSR (15A - 600A) ID _____

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>09/06/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES	DRAWING NO. <u>A-FCC05-FLSR-001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT