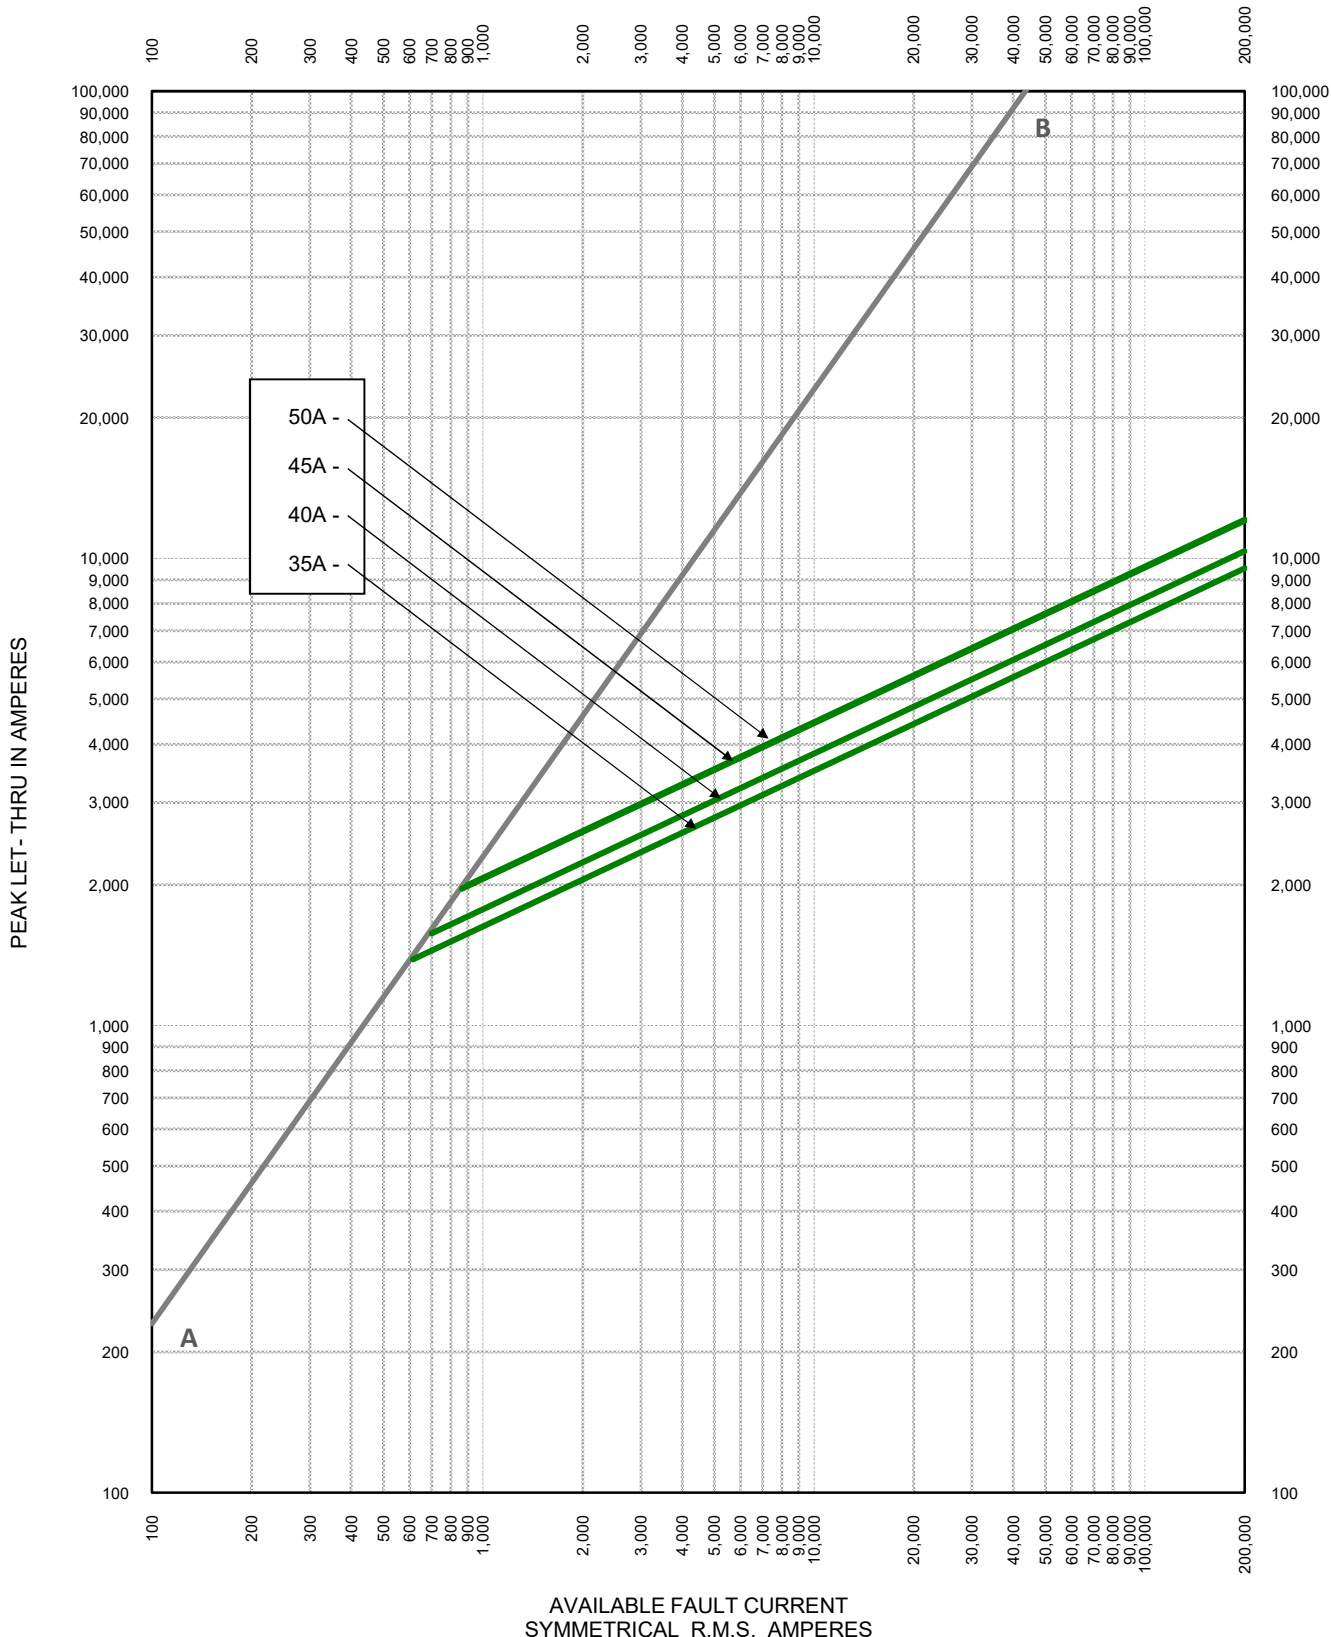

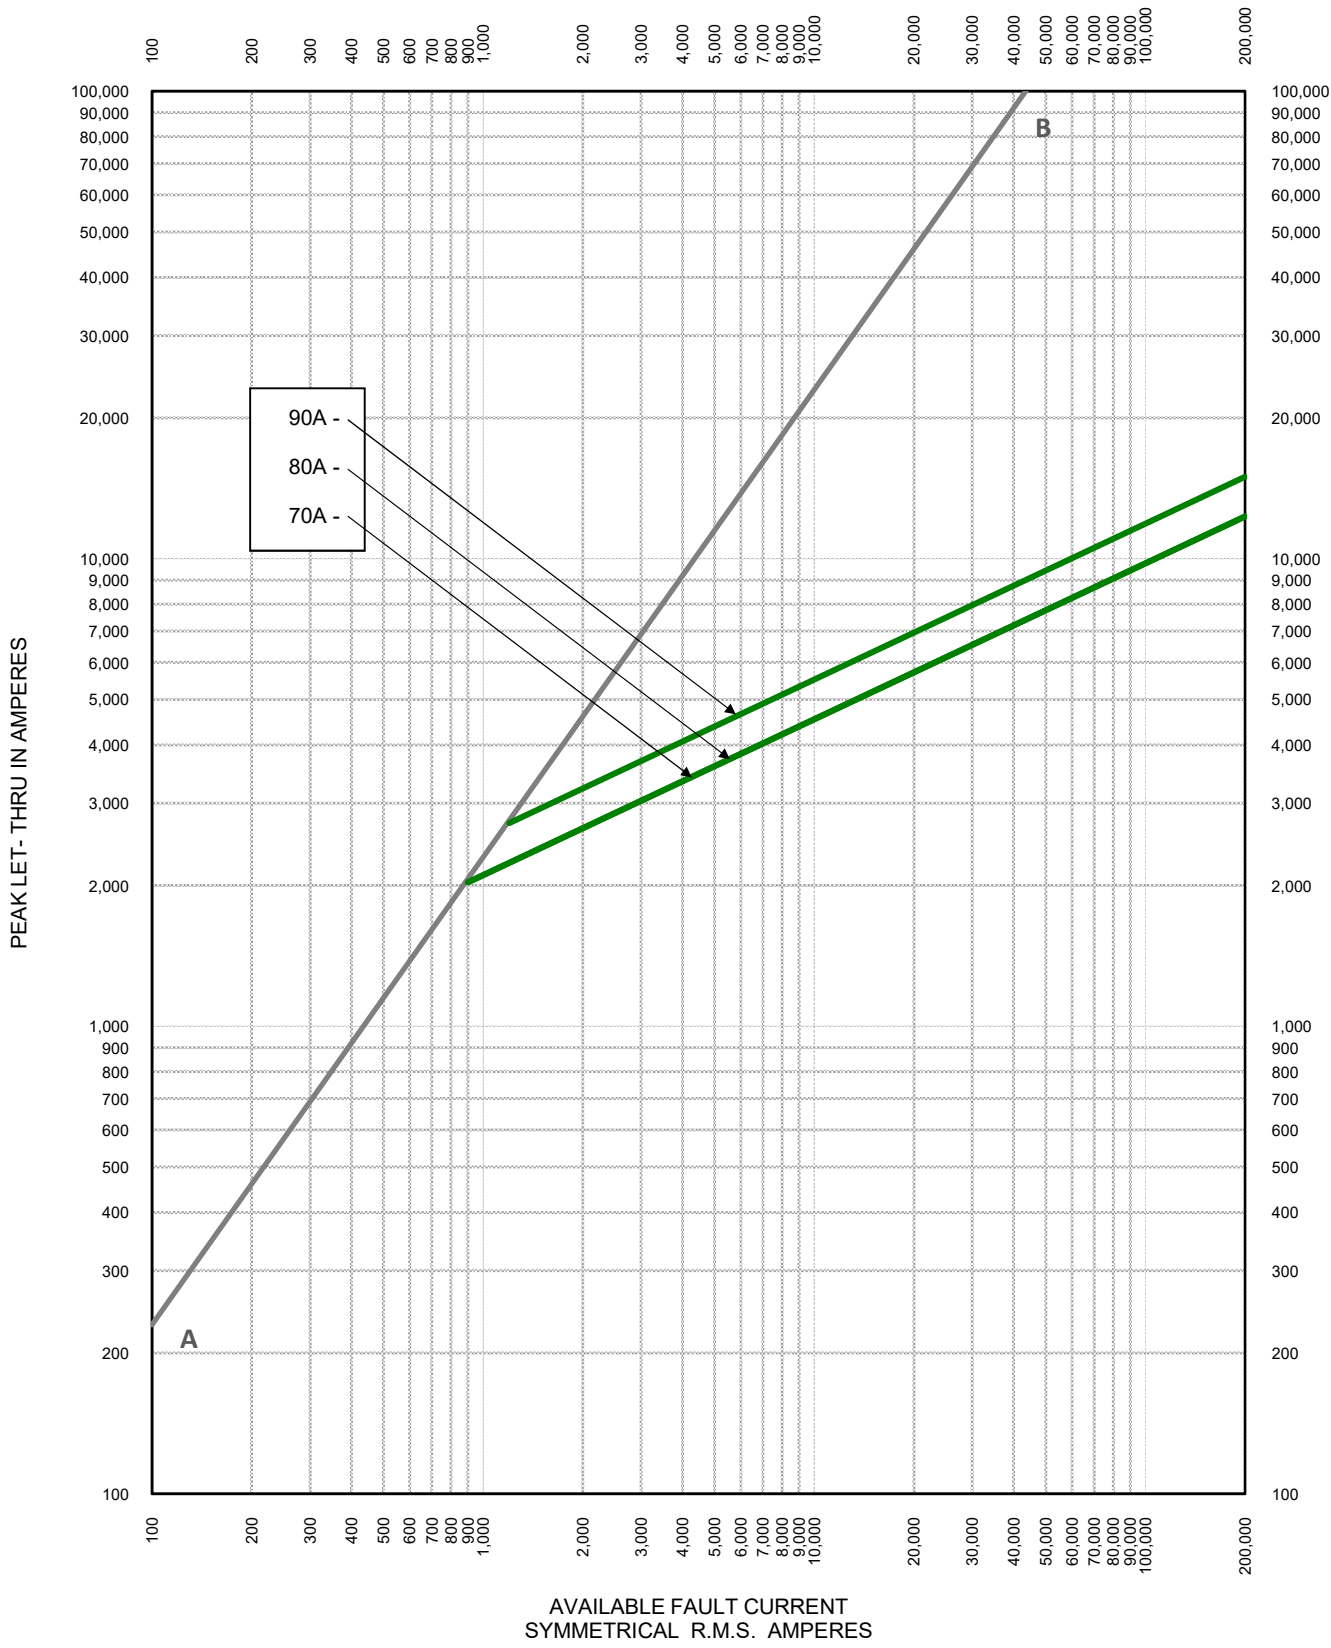


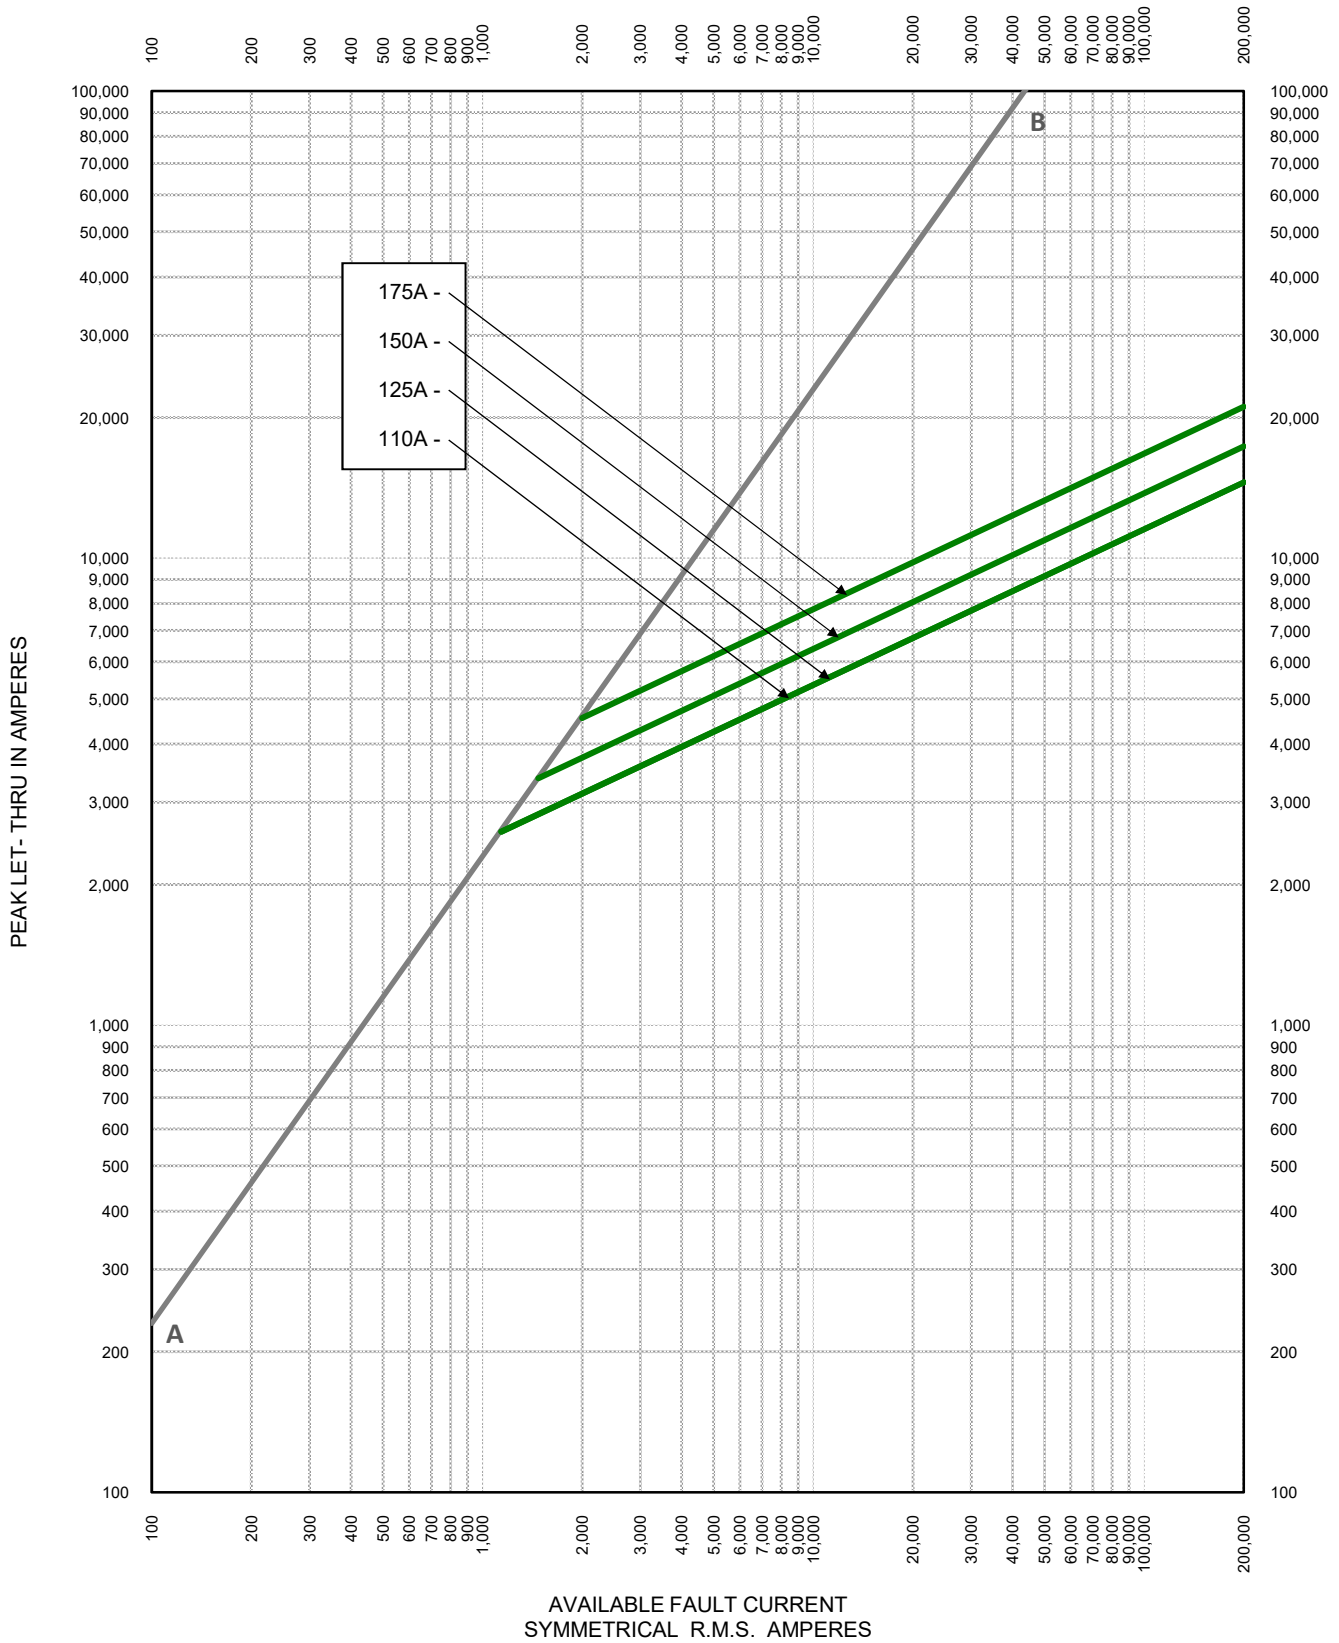
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		JTD & JTDID 30A - 600A
		DRAWN BY: LLL
		DATE: 09/23/2019
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: D
		DRAWING NO.: FCC05-JTD SHEET 2 OF 6




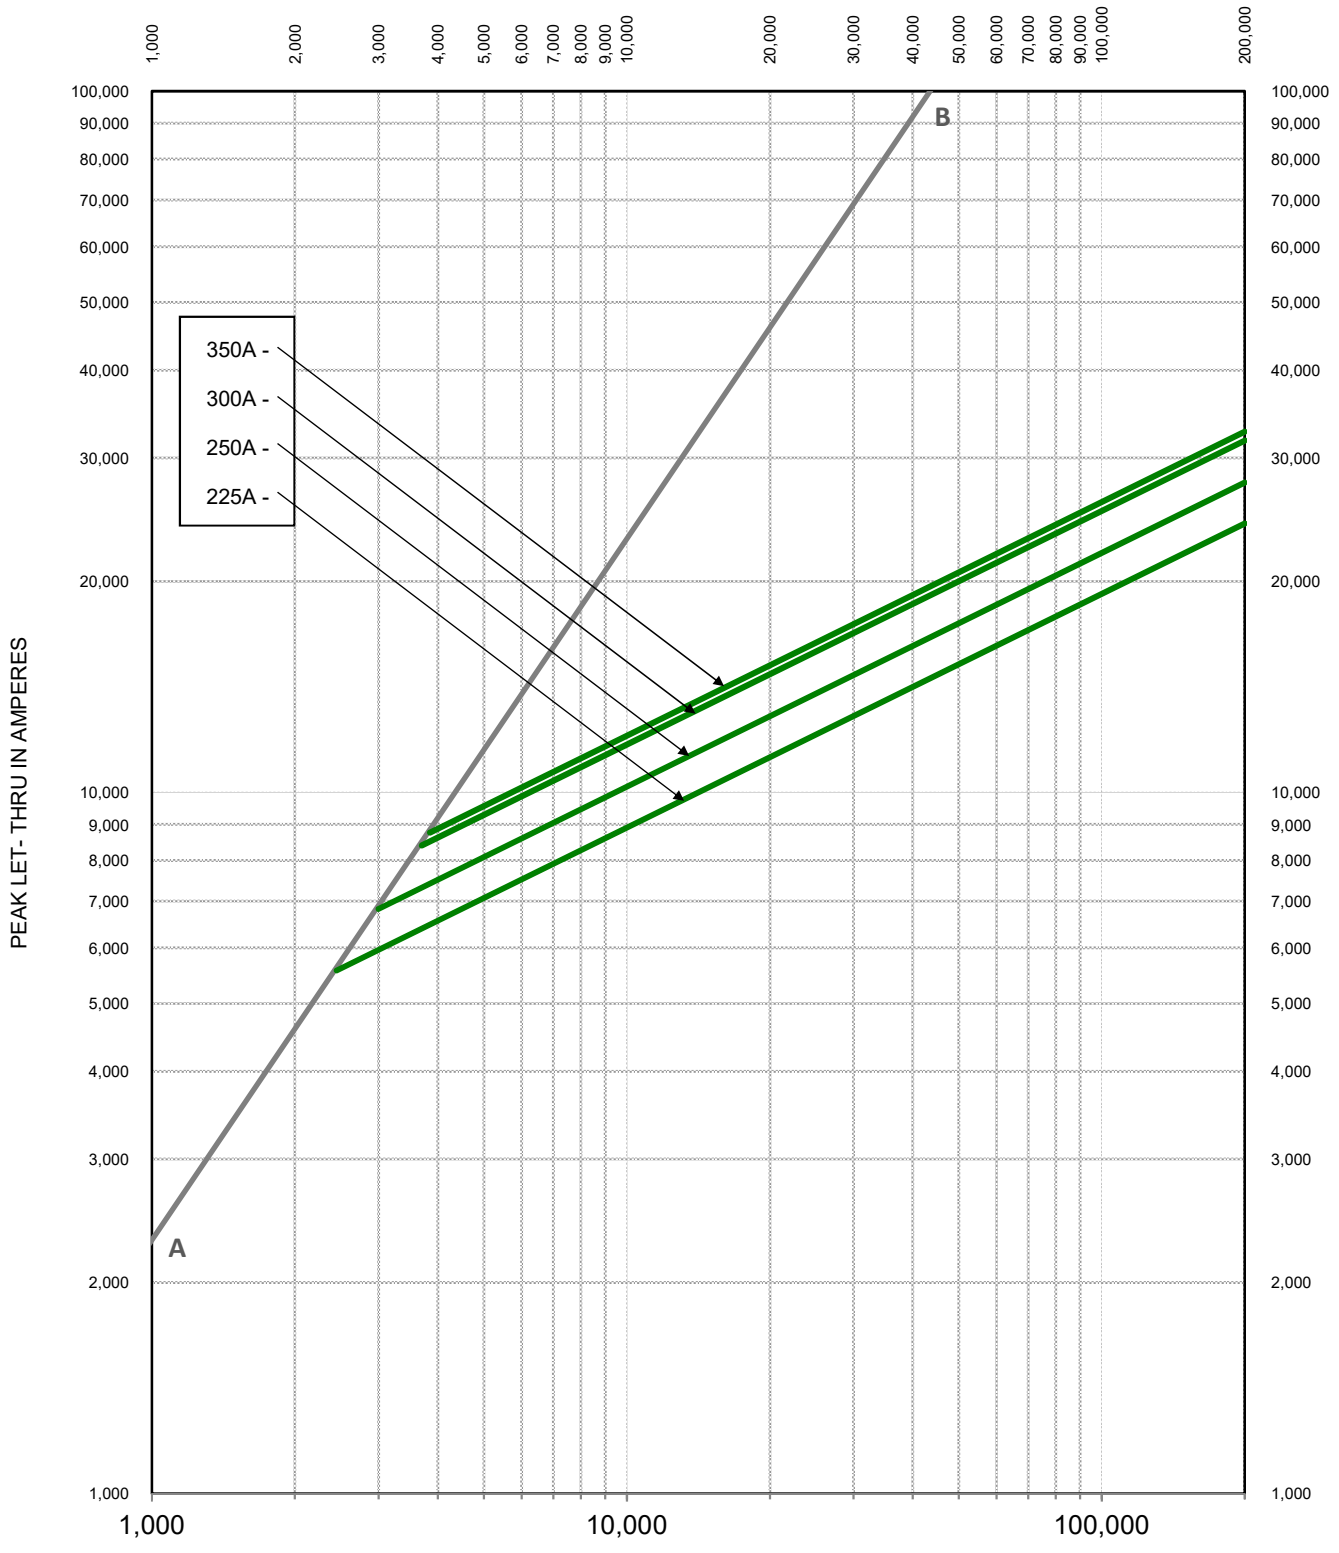
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		JTD & JTDID 35A - 600A
		DRAWN BY: LLL
		DATE: 09/23/2019
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: D
		DRAWING NO.: SHEET 3 OF 6
		FCC05-JTD




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		JTD & JTDID 35A - 600A
		DRAWN BY: LLL
		DATE: 09/23/2019
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: D
		DRAWING NO.: FCC05-JTD SHEET 4 OF 6



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		JTD & JTDID 30A - 600A
		DRAWN BY: LLL
		DATE: 09/23/2019
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: D
		DRAWING NO.: FCC05-JTD SHEET 5 OF 6



AVAILABLE FAULT CURRENT  
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		JTD & JTDID 30A - 600A
		DRAWN BY: LLL
		DATE: 09/23/2019
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: D
		DRAWING NO.: FCC05-JTD SHEET 6 OF 6

- DATA GENERATED IN EXCEL -