


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

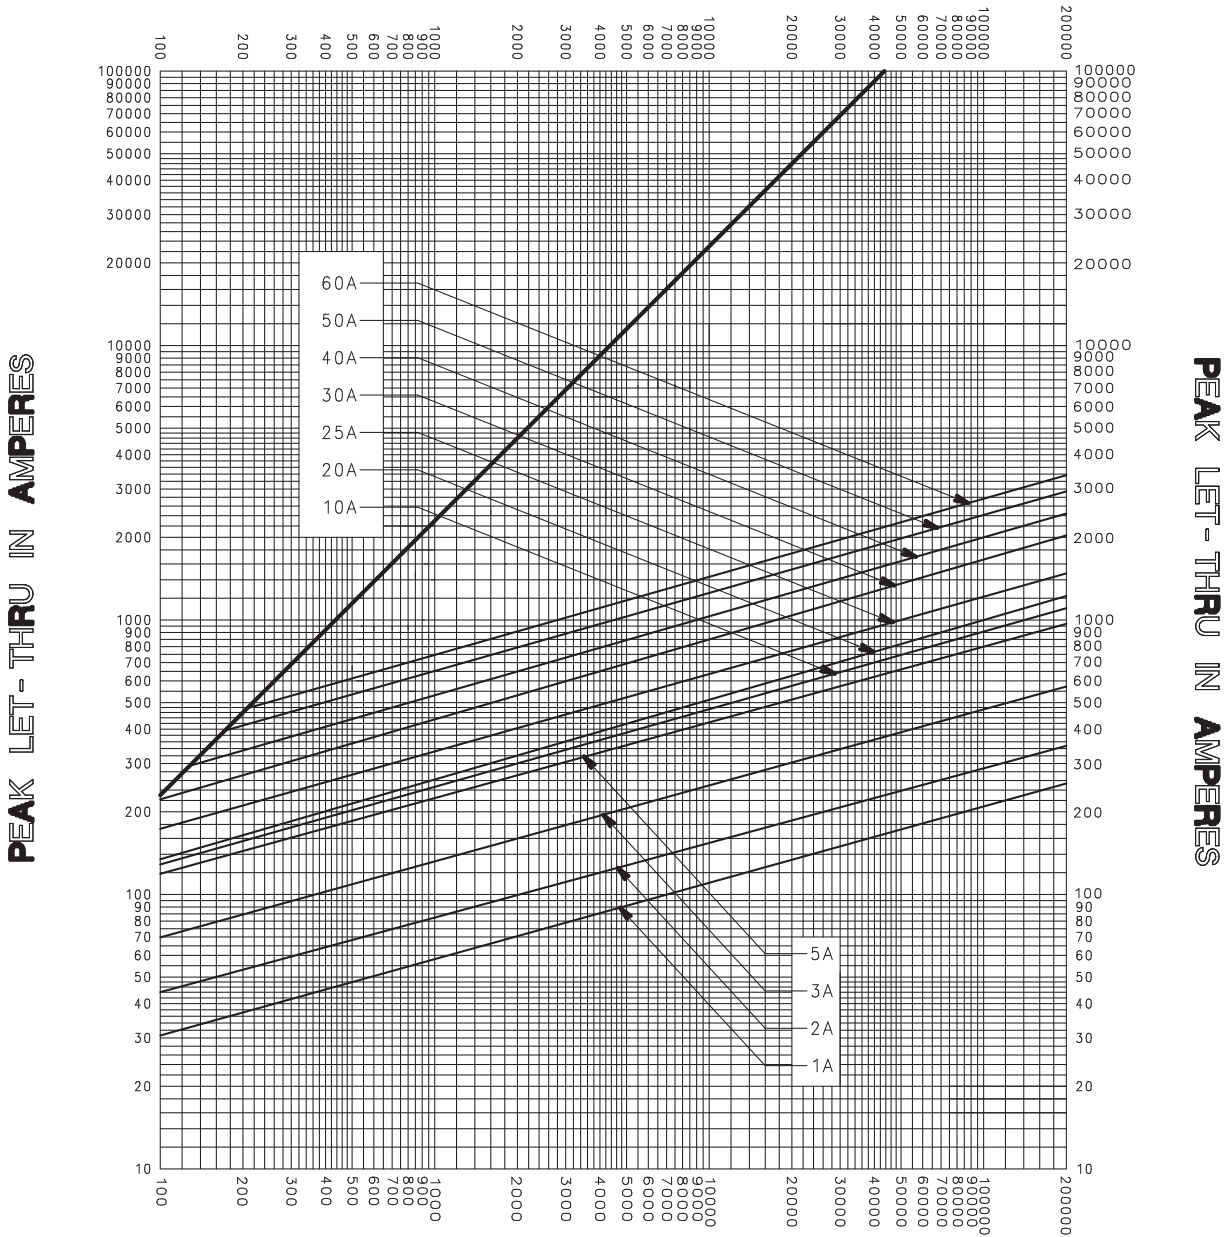


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE <u>150V</u> TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		L 15S (1A-60A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. _____ A-FCC05-15S-11

- THIS DATA GENERATED ON CAD -

**UNCONTROLLED
DOCUMENT**

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

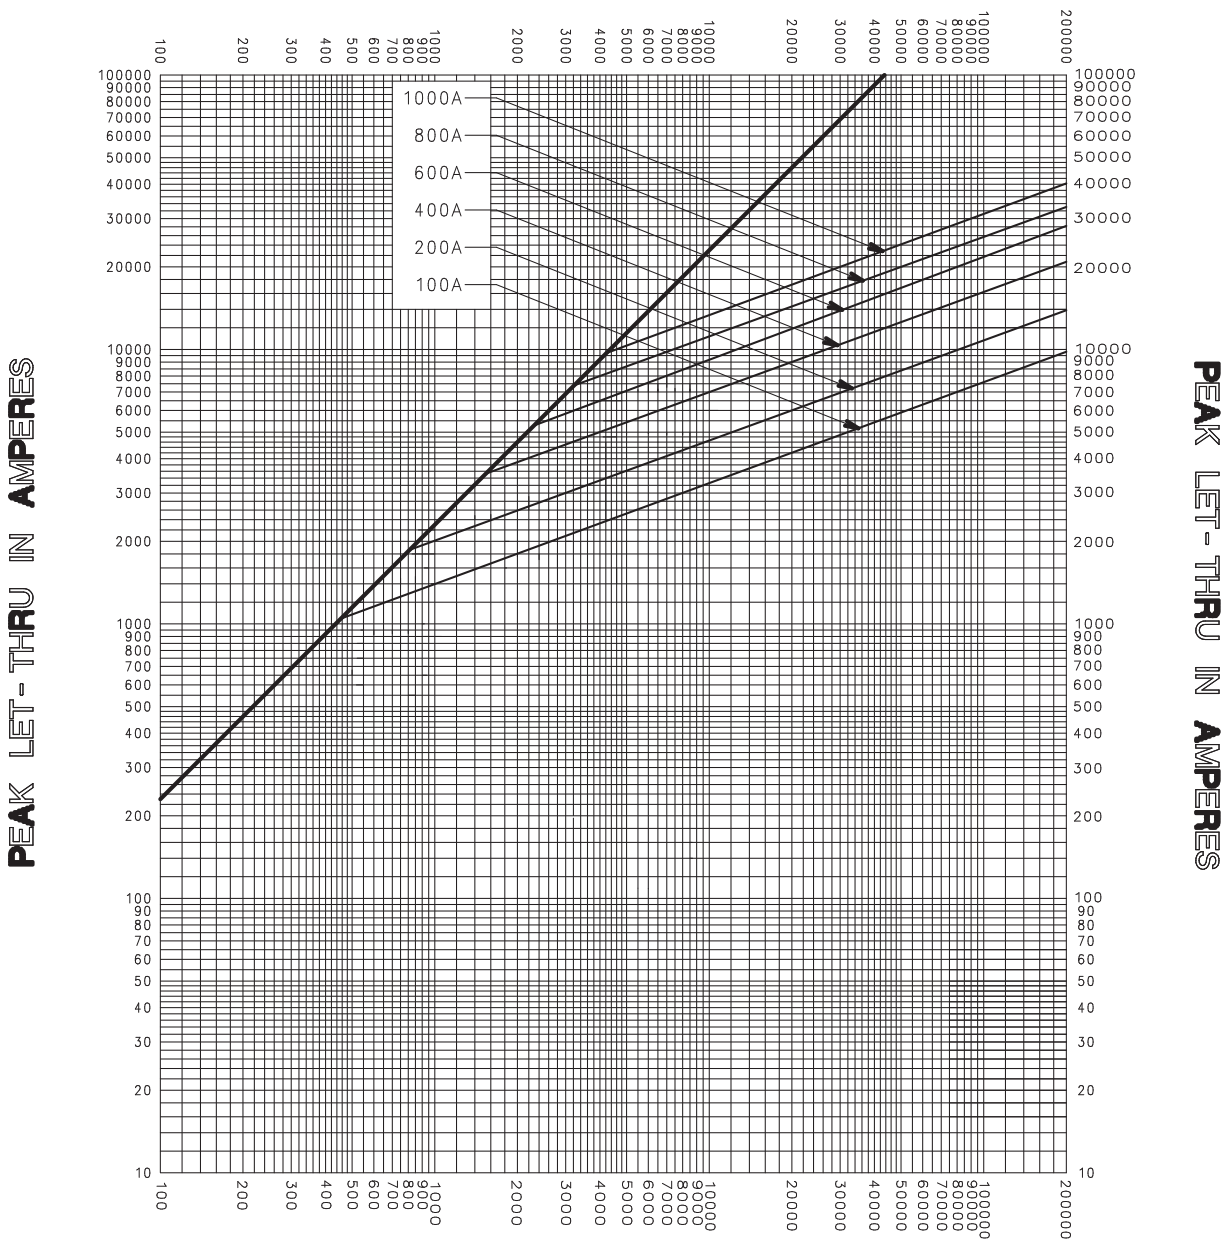


AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE <u>150V</u> TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____		FUSE CATALOG NUMBER <u>L15S (100A - 1000A)</u>
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. <u>A-FCC05-15S-12</u>

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**

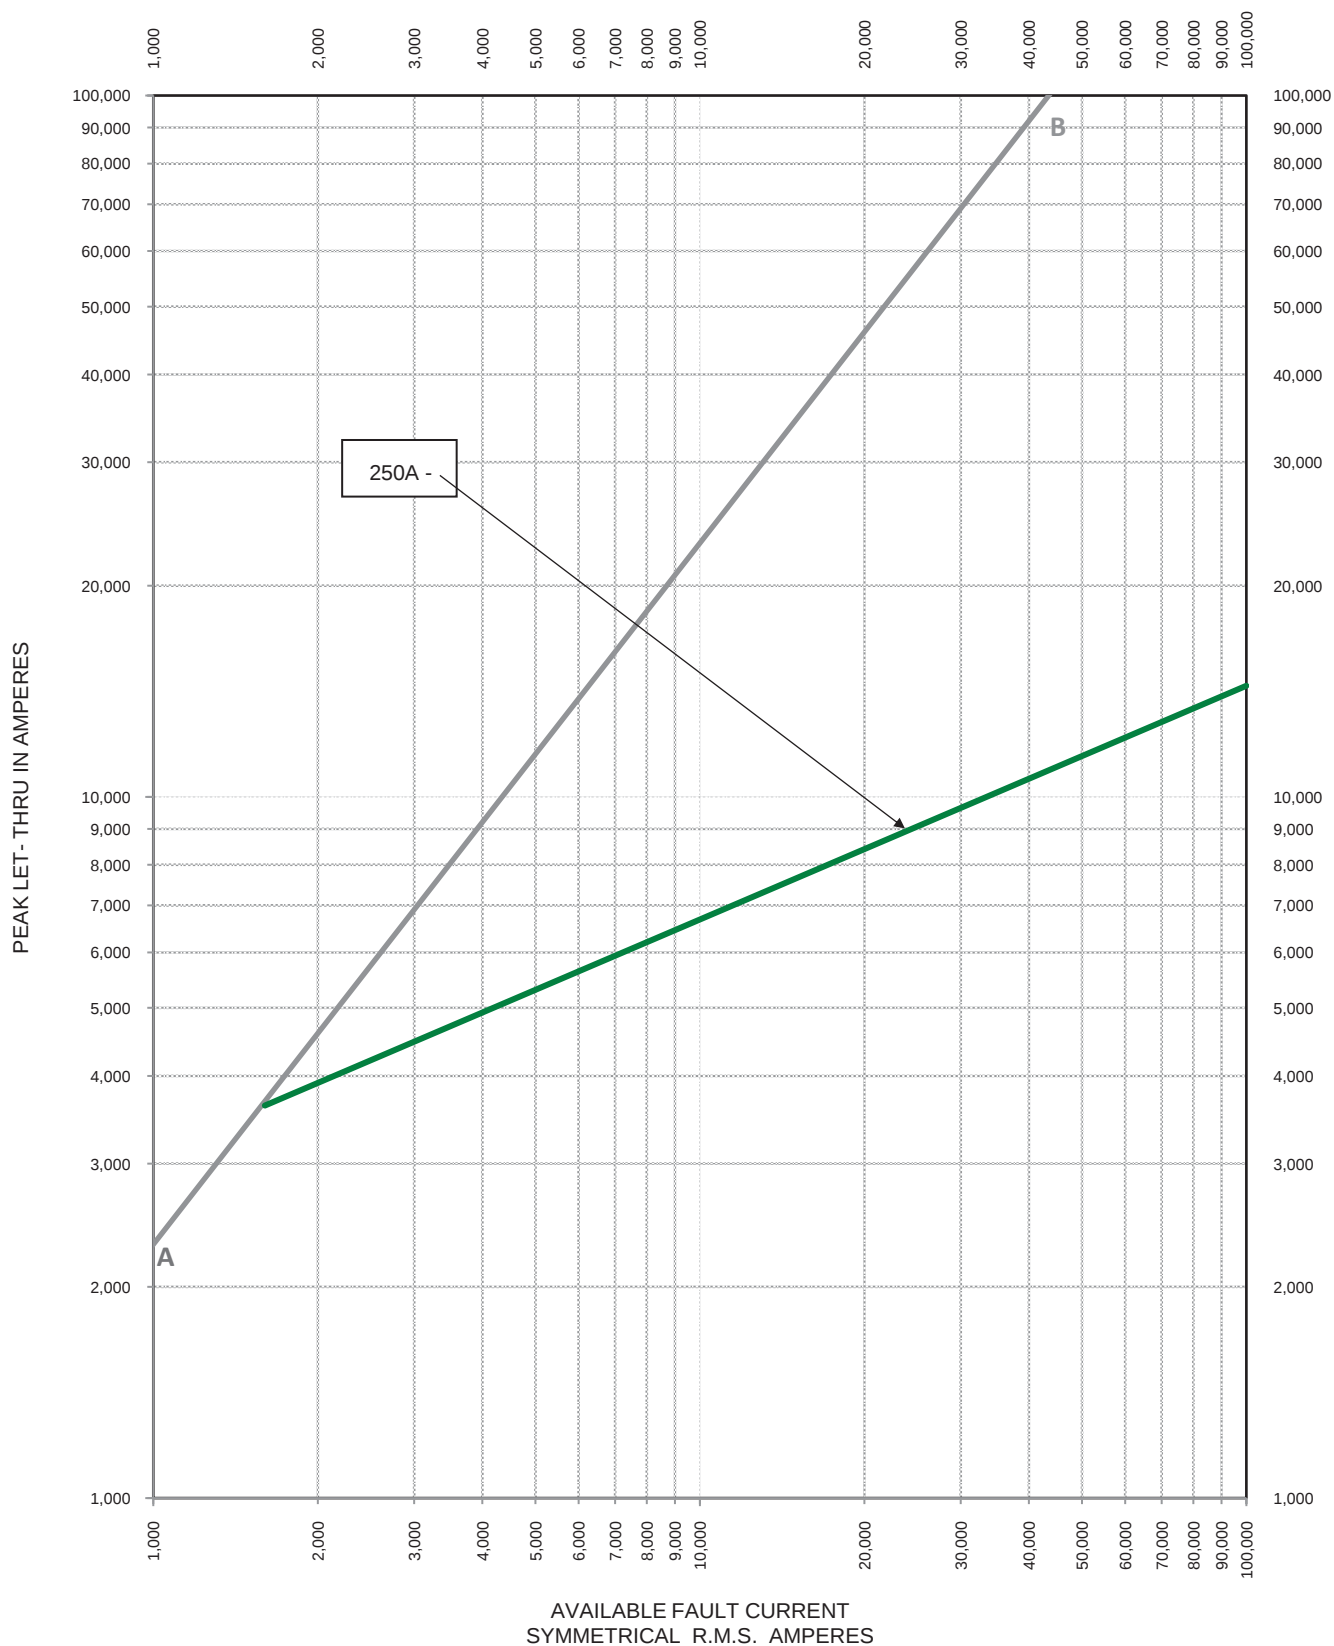

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L15S 250A
 LITTELFUSE, INC. CHICAGO, IL. USA	DRAWN BY: LLL	
	DATE: 12/18/2018	
PEAK LET-THRU CHARACTERISTIC CURVES	REVISION: A	
	DRAWING NO.:	SHEET 2 OF 2
	FCC05-L15S	