


AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES


PEAK LET-THRU IN AMPERES

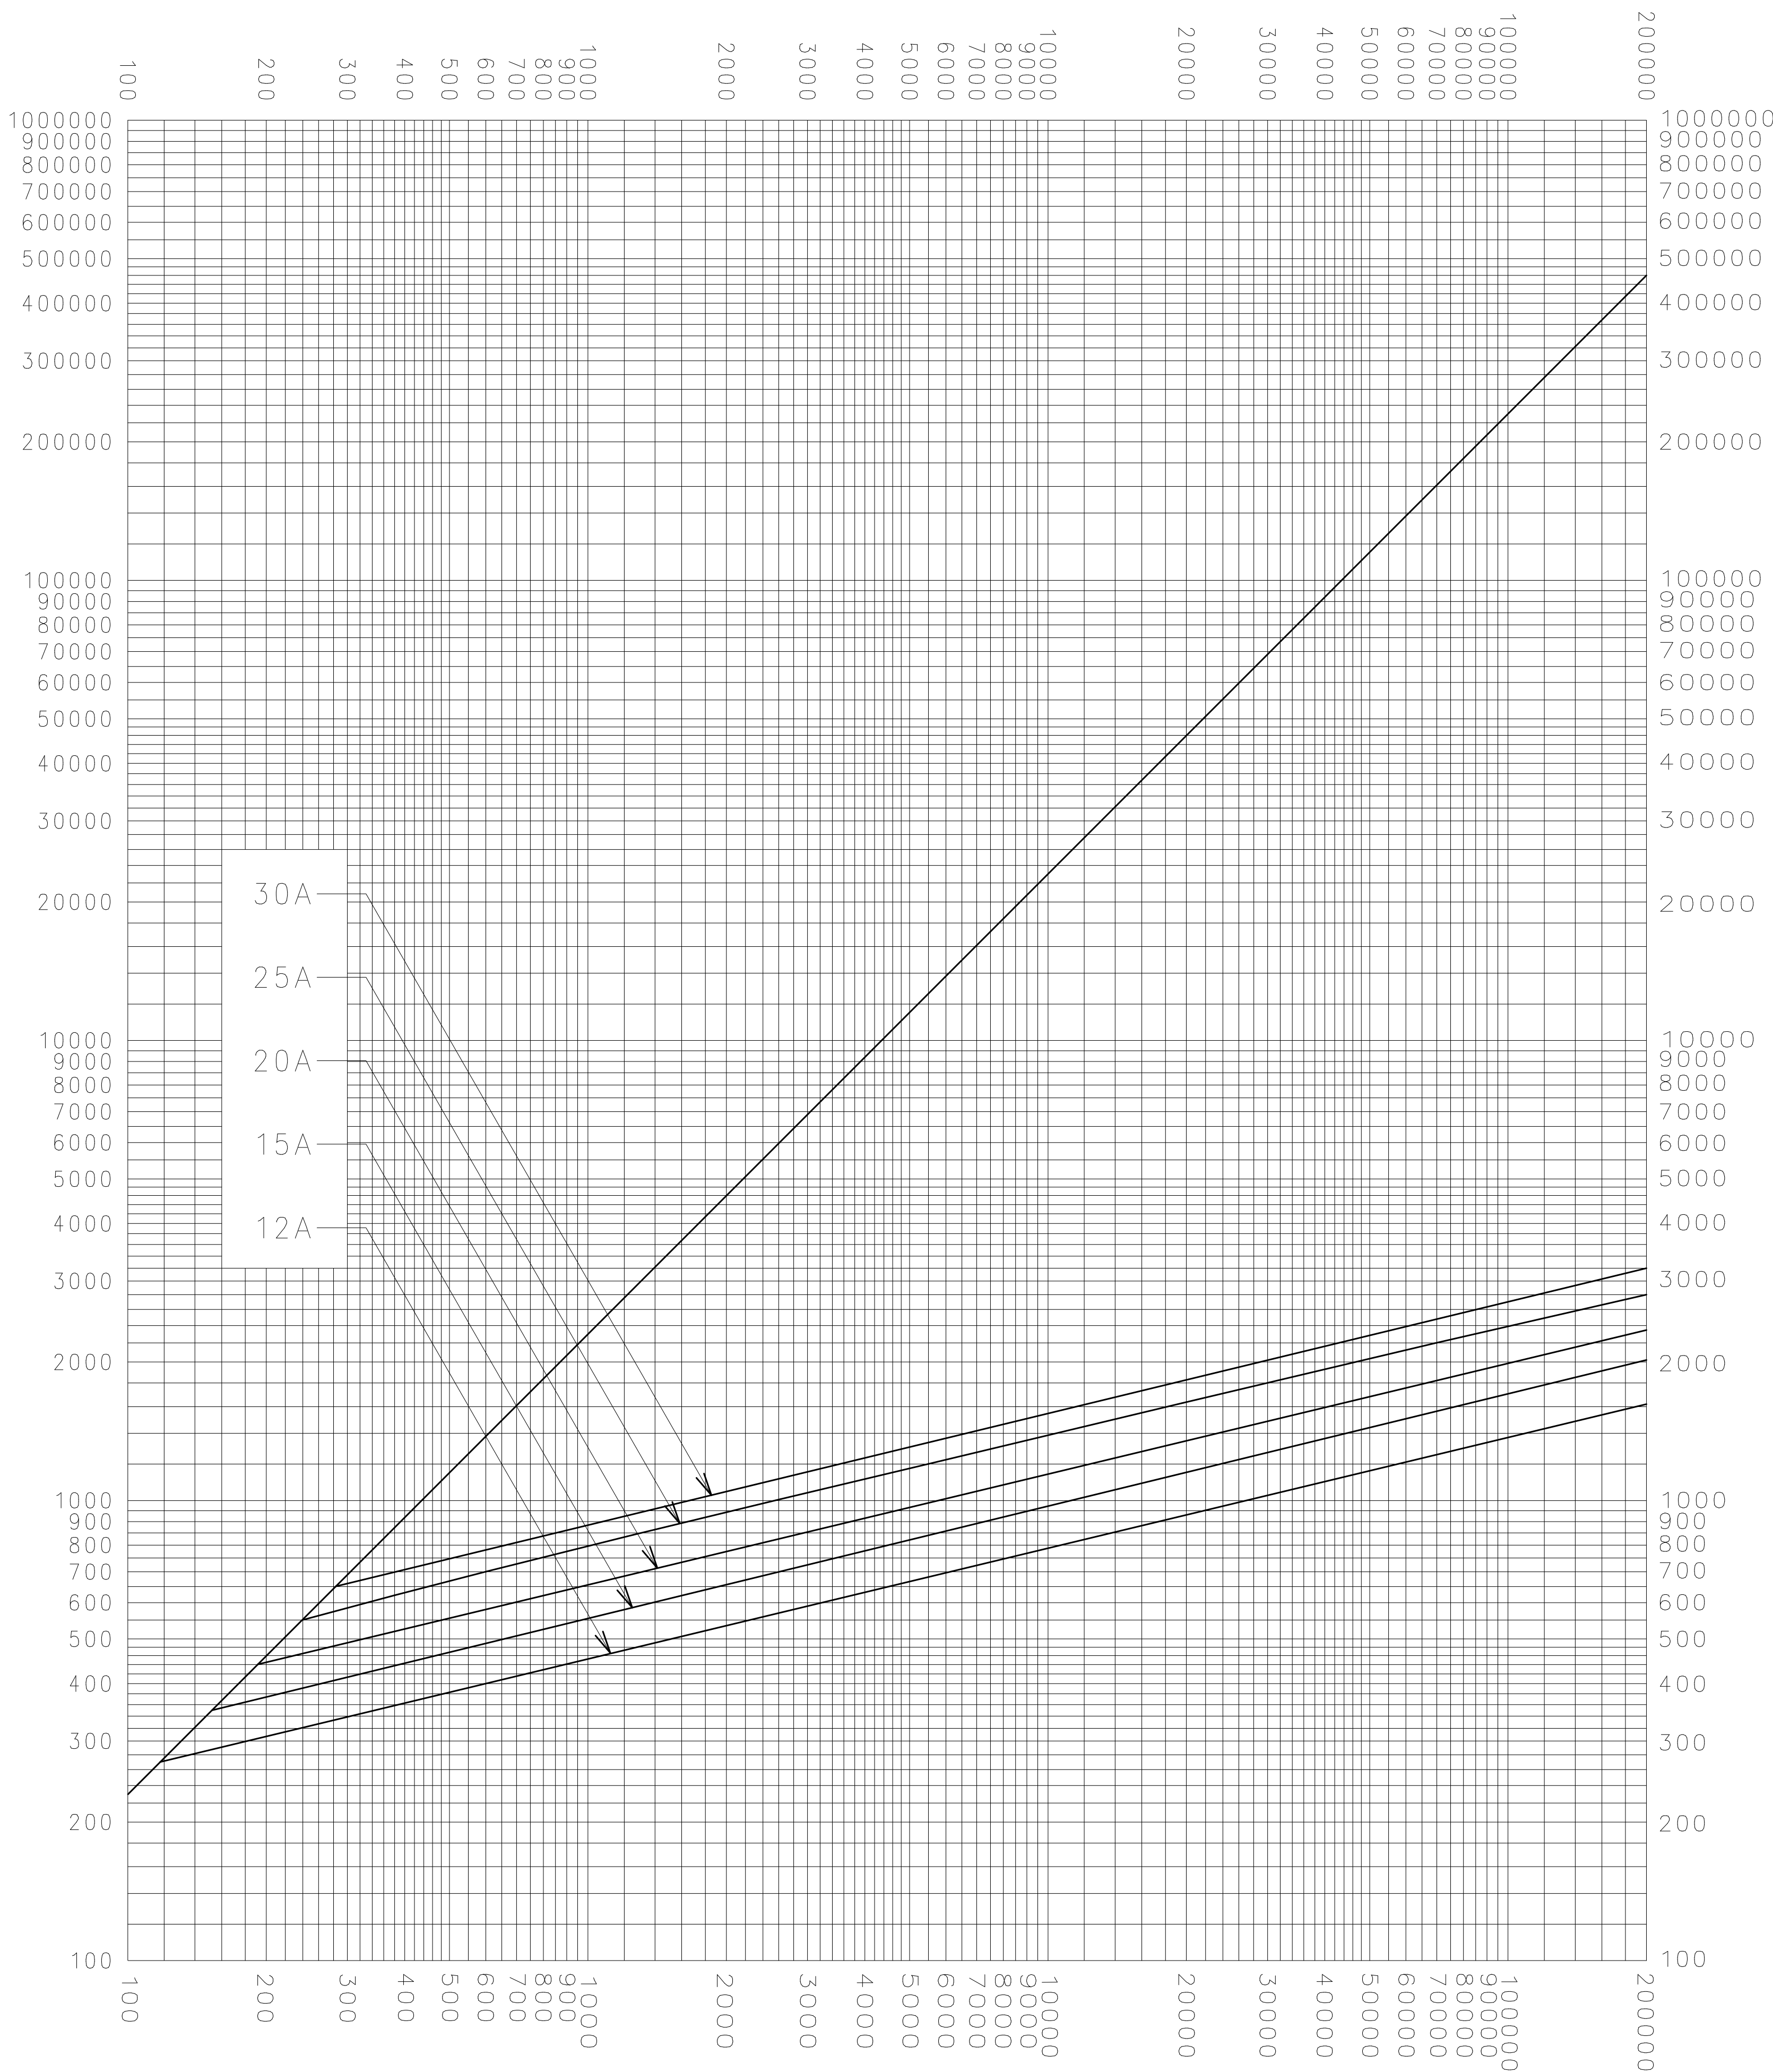

PEAK LET-THRU IN AMPERES

AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES

|                                                       |                           |
|-------------------------------------------------------|---------------------------|
| TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER _____ |
| BASIS FOR DATA _____                                  | KLKR (12A - 30A)          |

|                                                                                                                                      |                                                                     |
|--------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------|
|  <b>LITTELFUSE, INC.</b><br>DES PLAINES, ILL. USA | DRAWN BY <u>LLL</u><br>DATE <u>09/06/06</u><br>CHECKED BY <u>MP</u> |
| <b>PEAK LET-THRU CHARACTERISTIC CURVES</b>                                                                                           | DRAWING NO. <u>A-FCC05</u>                                          |

-THIS DATA GENERATED ON CAD-

UNCONTROLLED  
DOCUMENT