
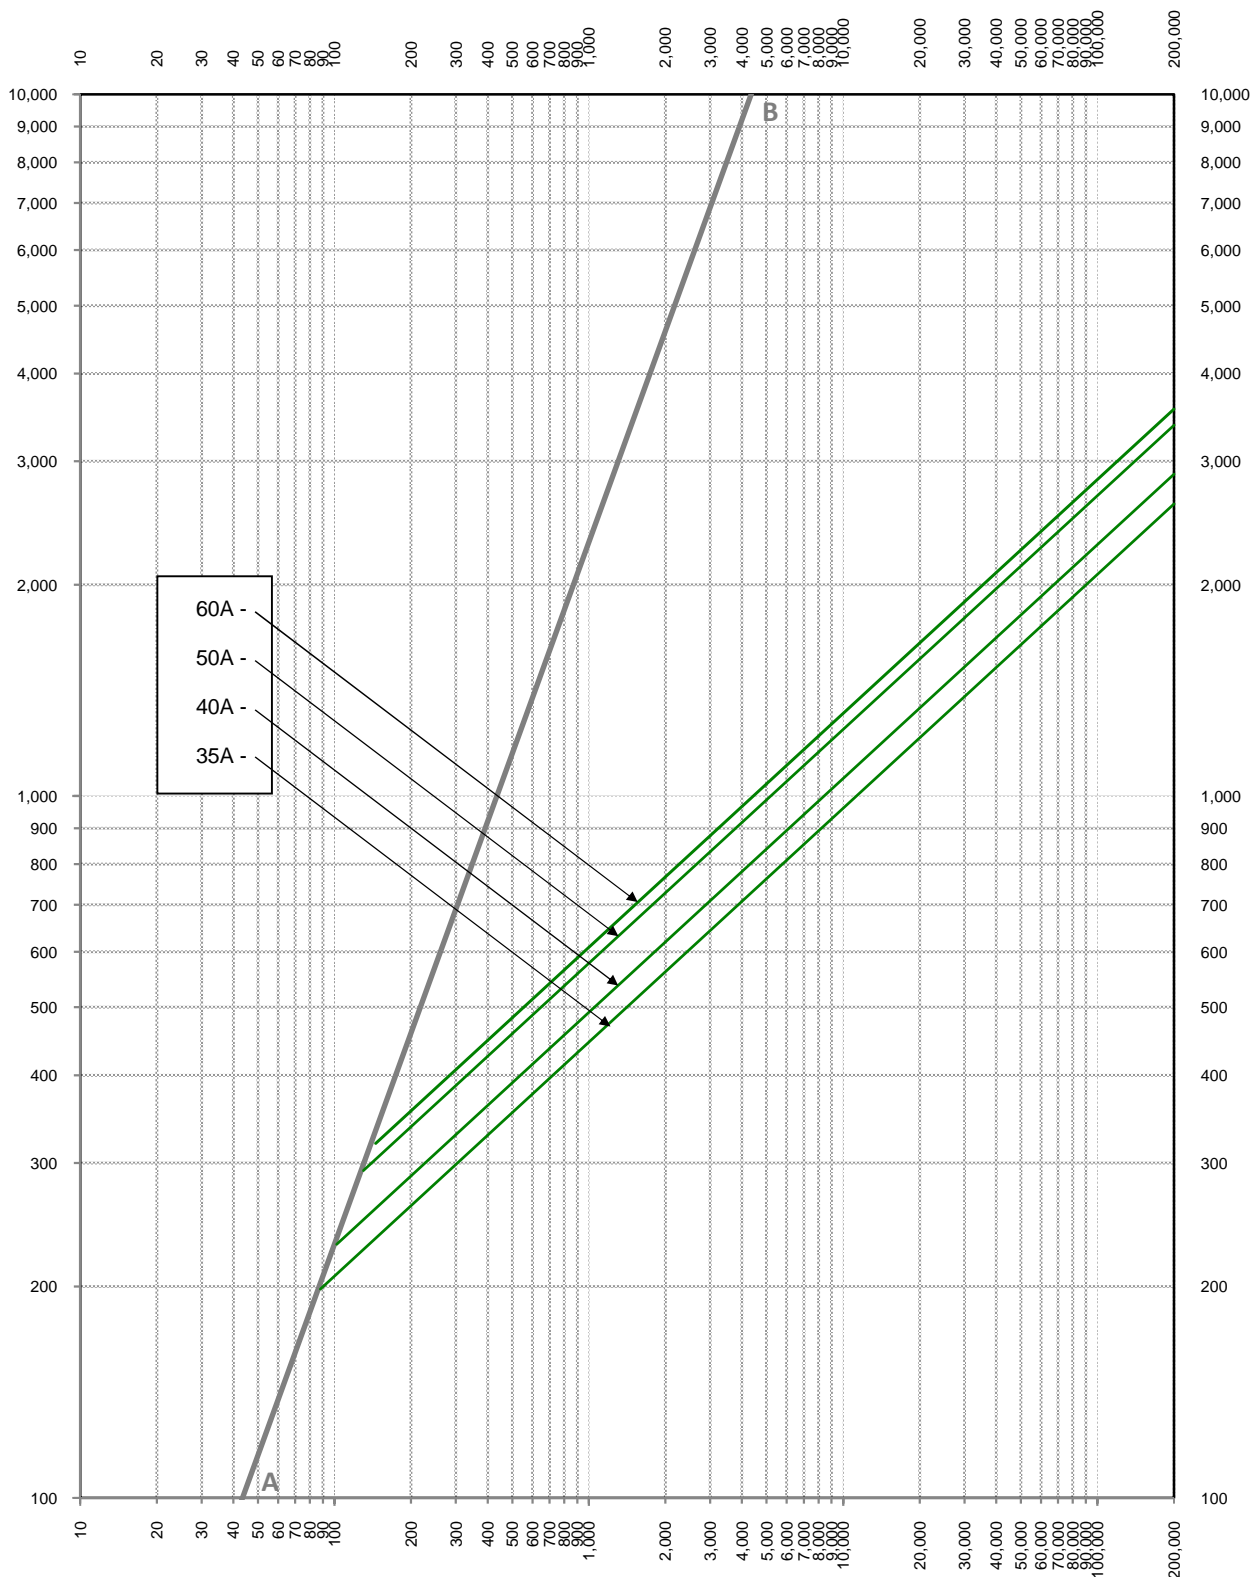



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-L70QS SHEET 2 OF 8


PEAK LET-THRU IN AMPERES




AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

<p>TEST VOLTAGE:</p> <p>TIME CONSTANT/POWER FACTOR:</p> <p>BASIS FOR DATA: AB = 15% Power Factor</p>	<p>FUSE CATALOG NUMBER:</p> <p>L70QS 35A - 800A</p>
<p> LITTELFUSE, INC. CHICAGO, IL. USA</p>	<p>DRAWN BY: LLL</p> <p>DATE: 10/13/2015</p> <p>REVISION: C</p>
<p>PEAK LET-THRU CHARACTERISTIC CURVES</p>	<p>DRAWING NO.: FCC05-L70QS SHEET 3 OF 8</p>


PEAK LET-THRU IN AMPERES

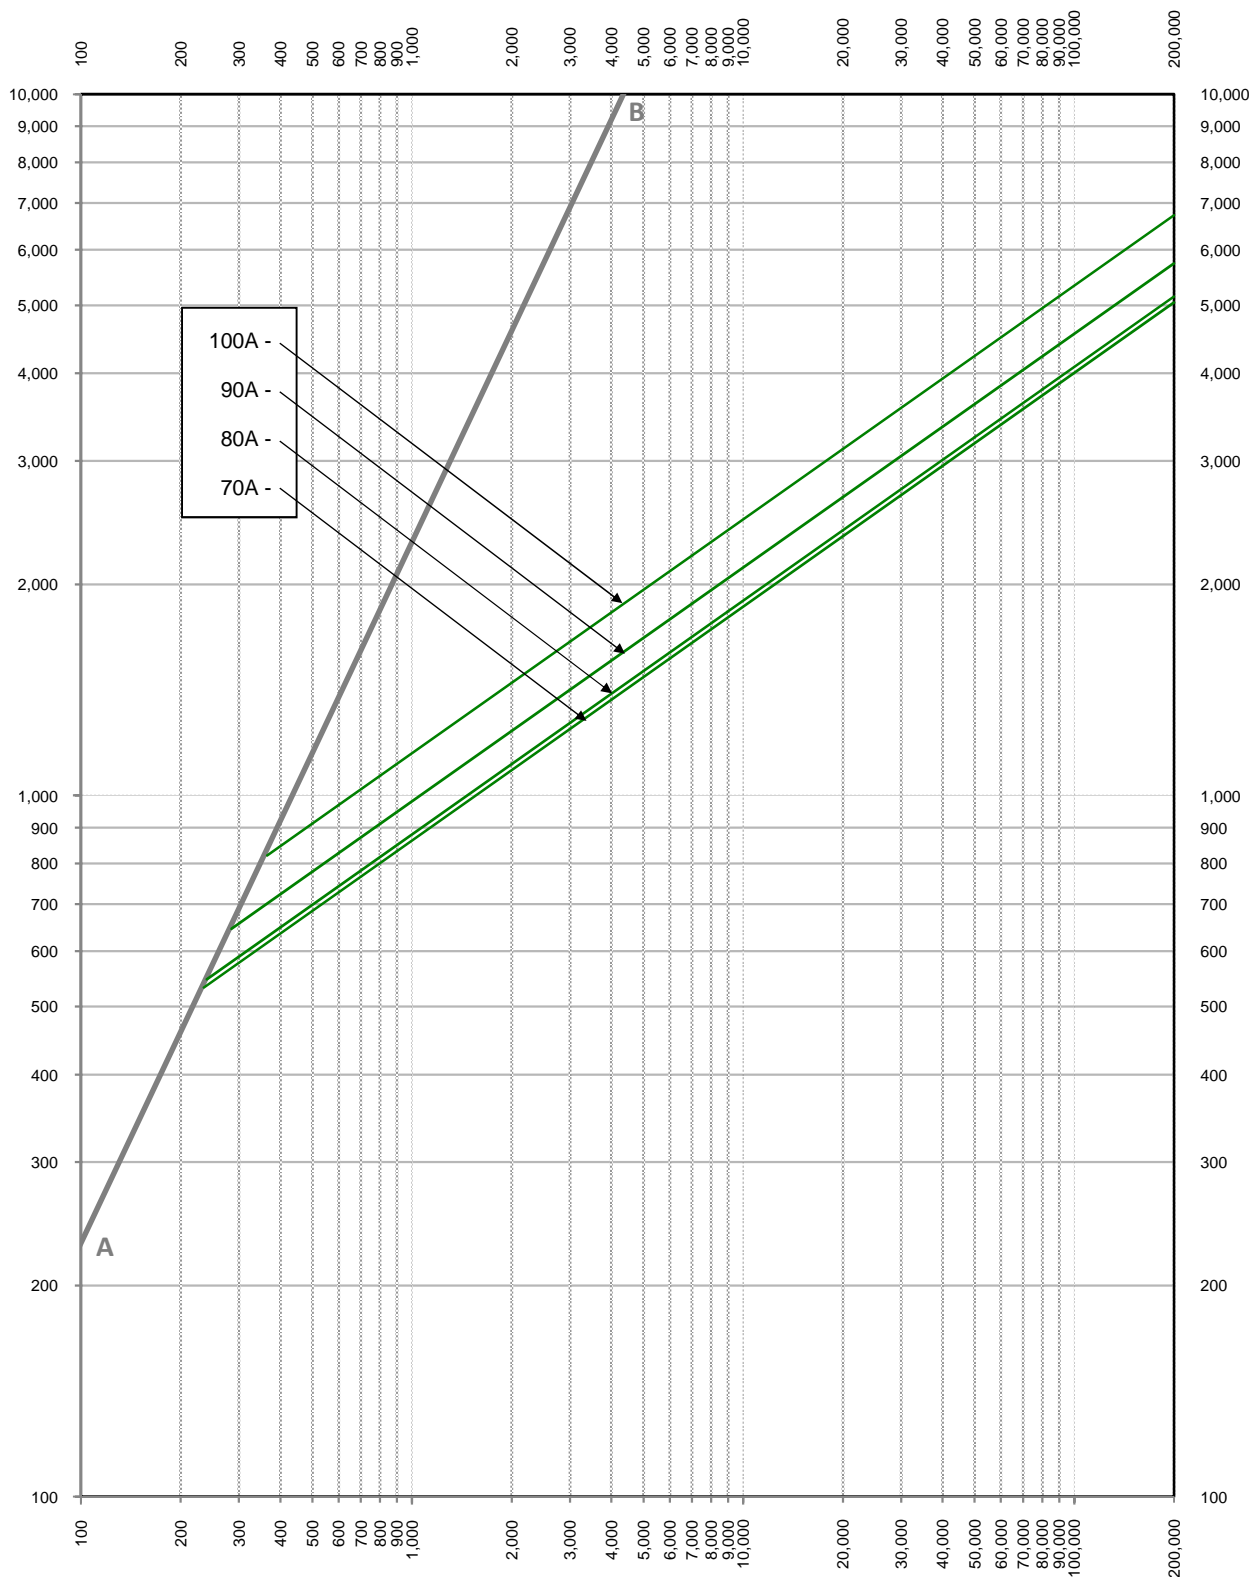


AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/13/2015	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: C	
		DRAWING NO.: FCC05-L70QS	SHEET 4 OF 8


PEAK LET-THRU IN AMPERES

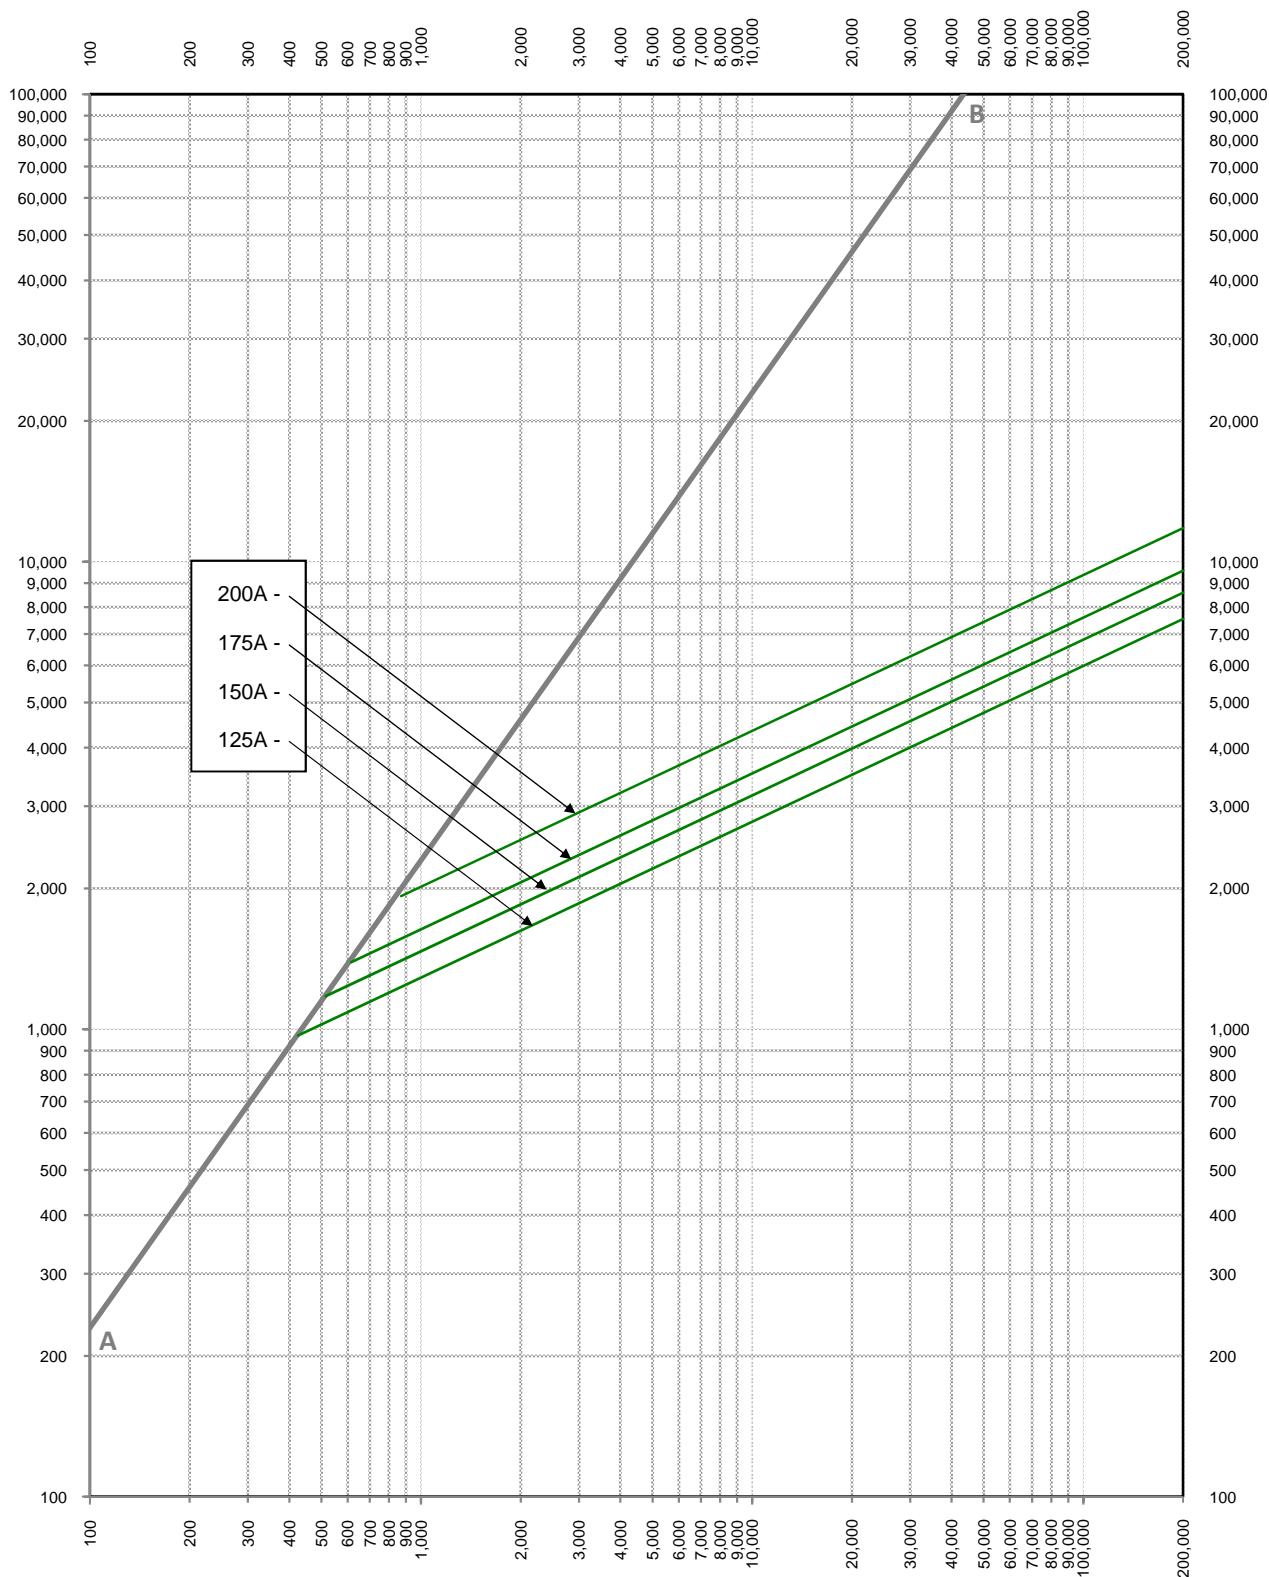


AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-L70QS SHEET 5 OF 8


PEAK LET-THRU IN AMPERES

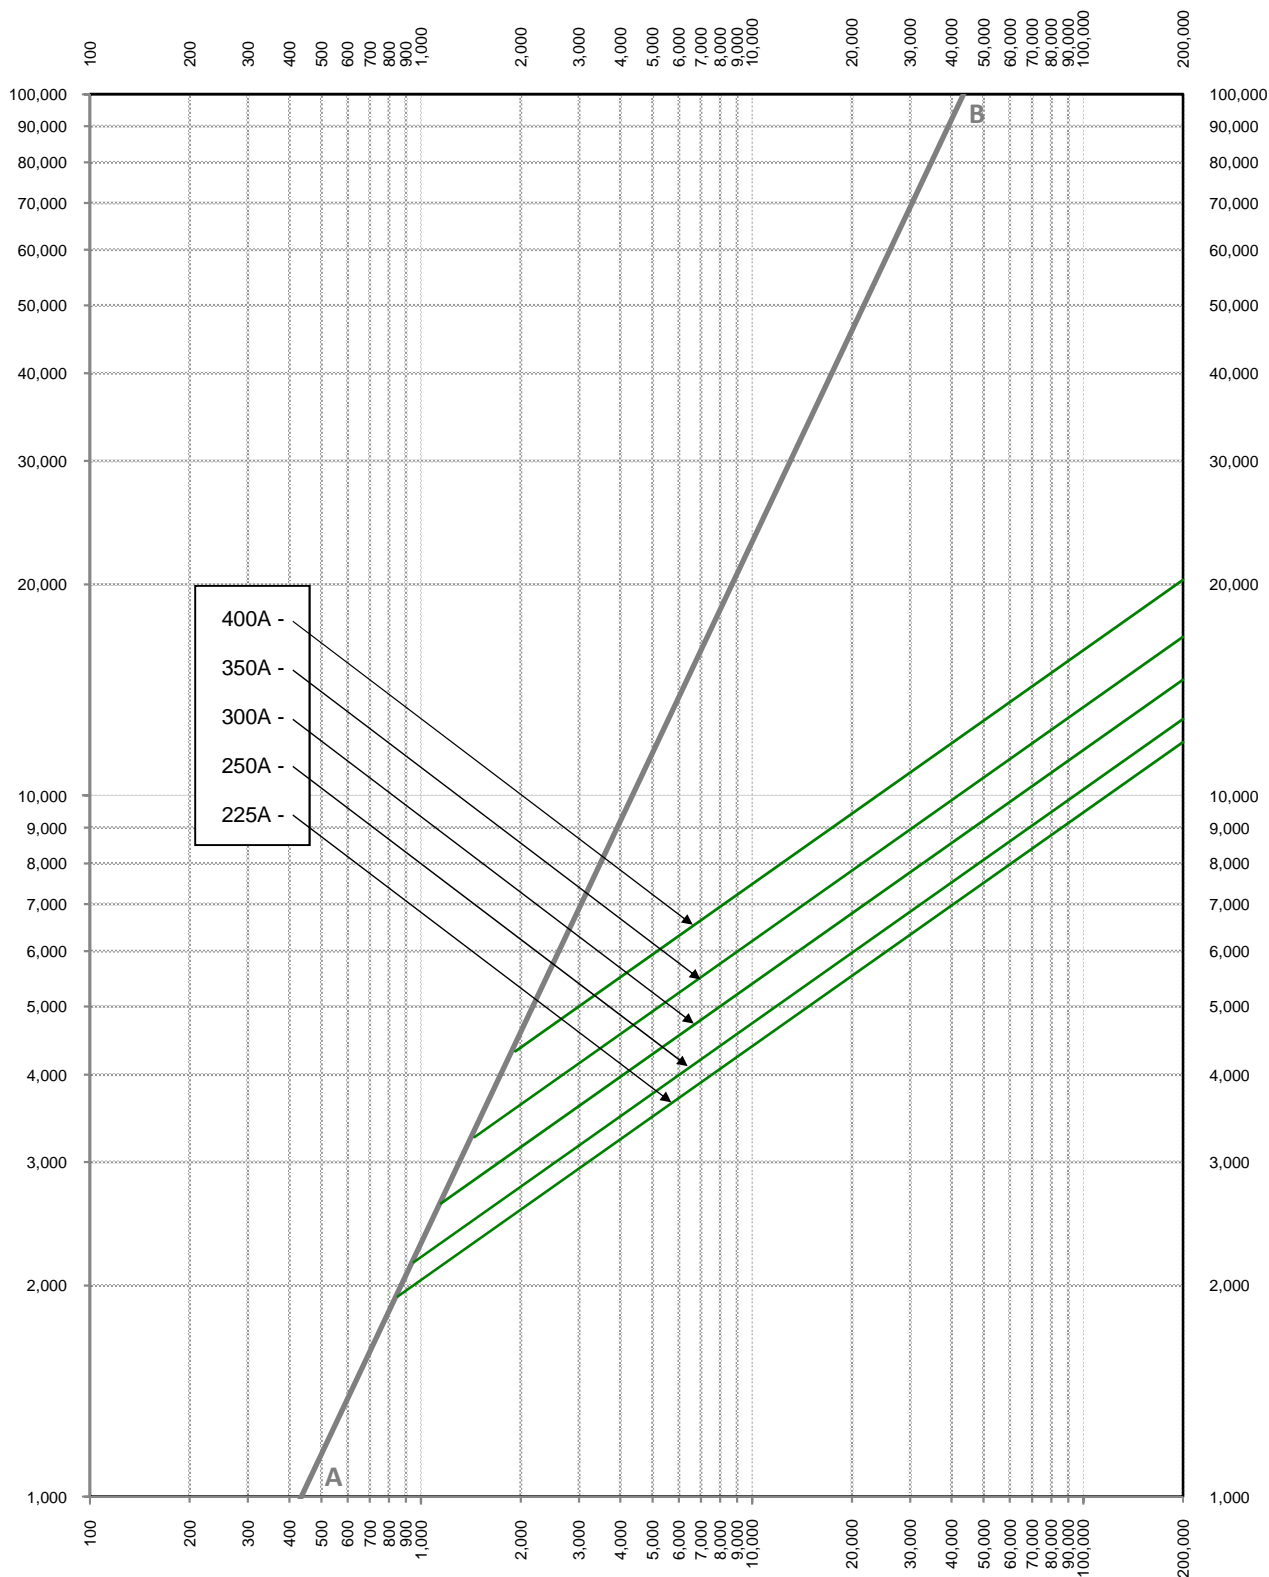


AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-L70QS SHEET 6 OF 8

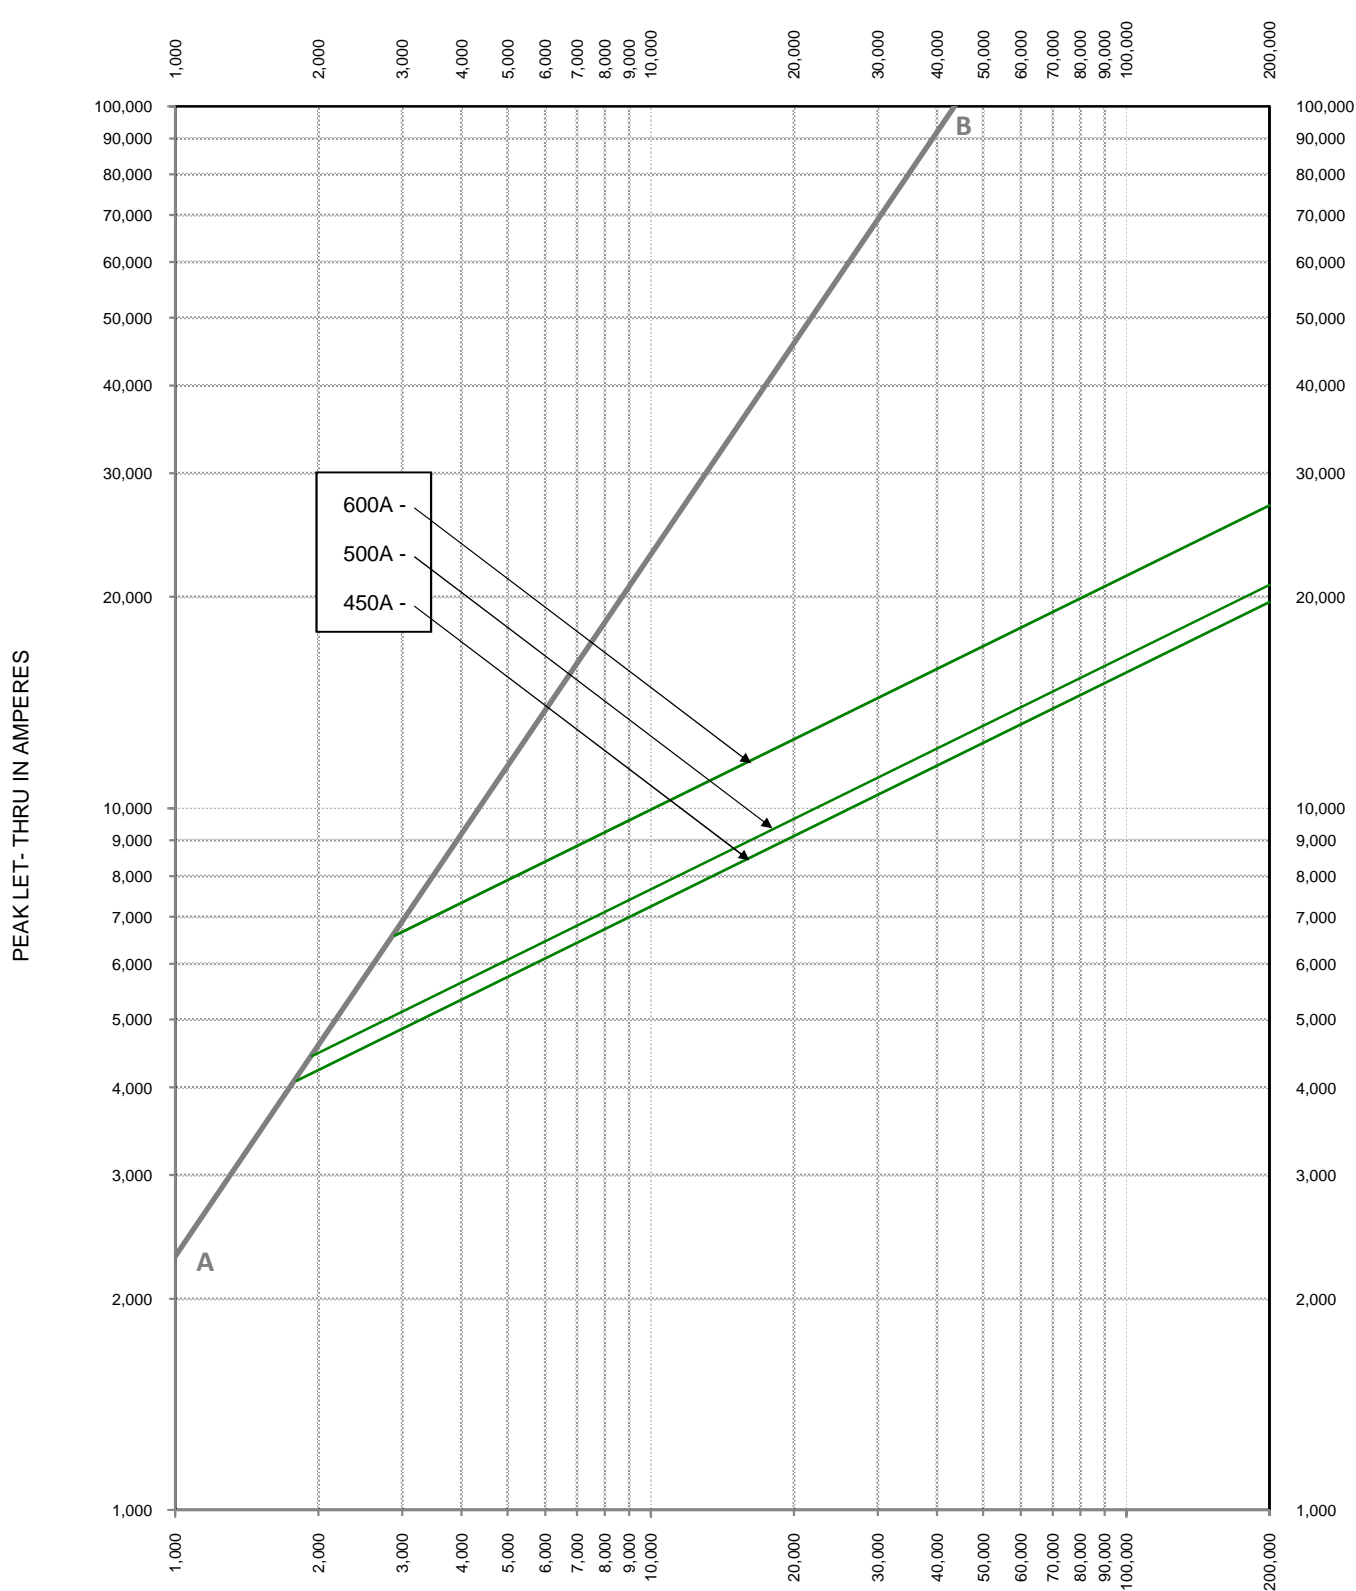


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-L70QS SHEET 7 OF 8

PEAK LET-THRU IN AMPERES

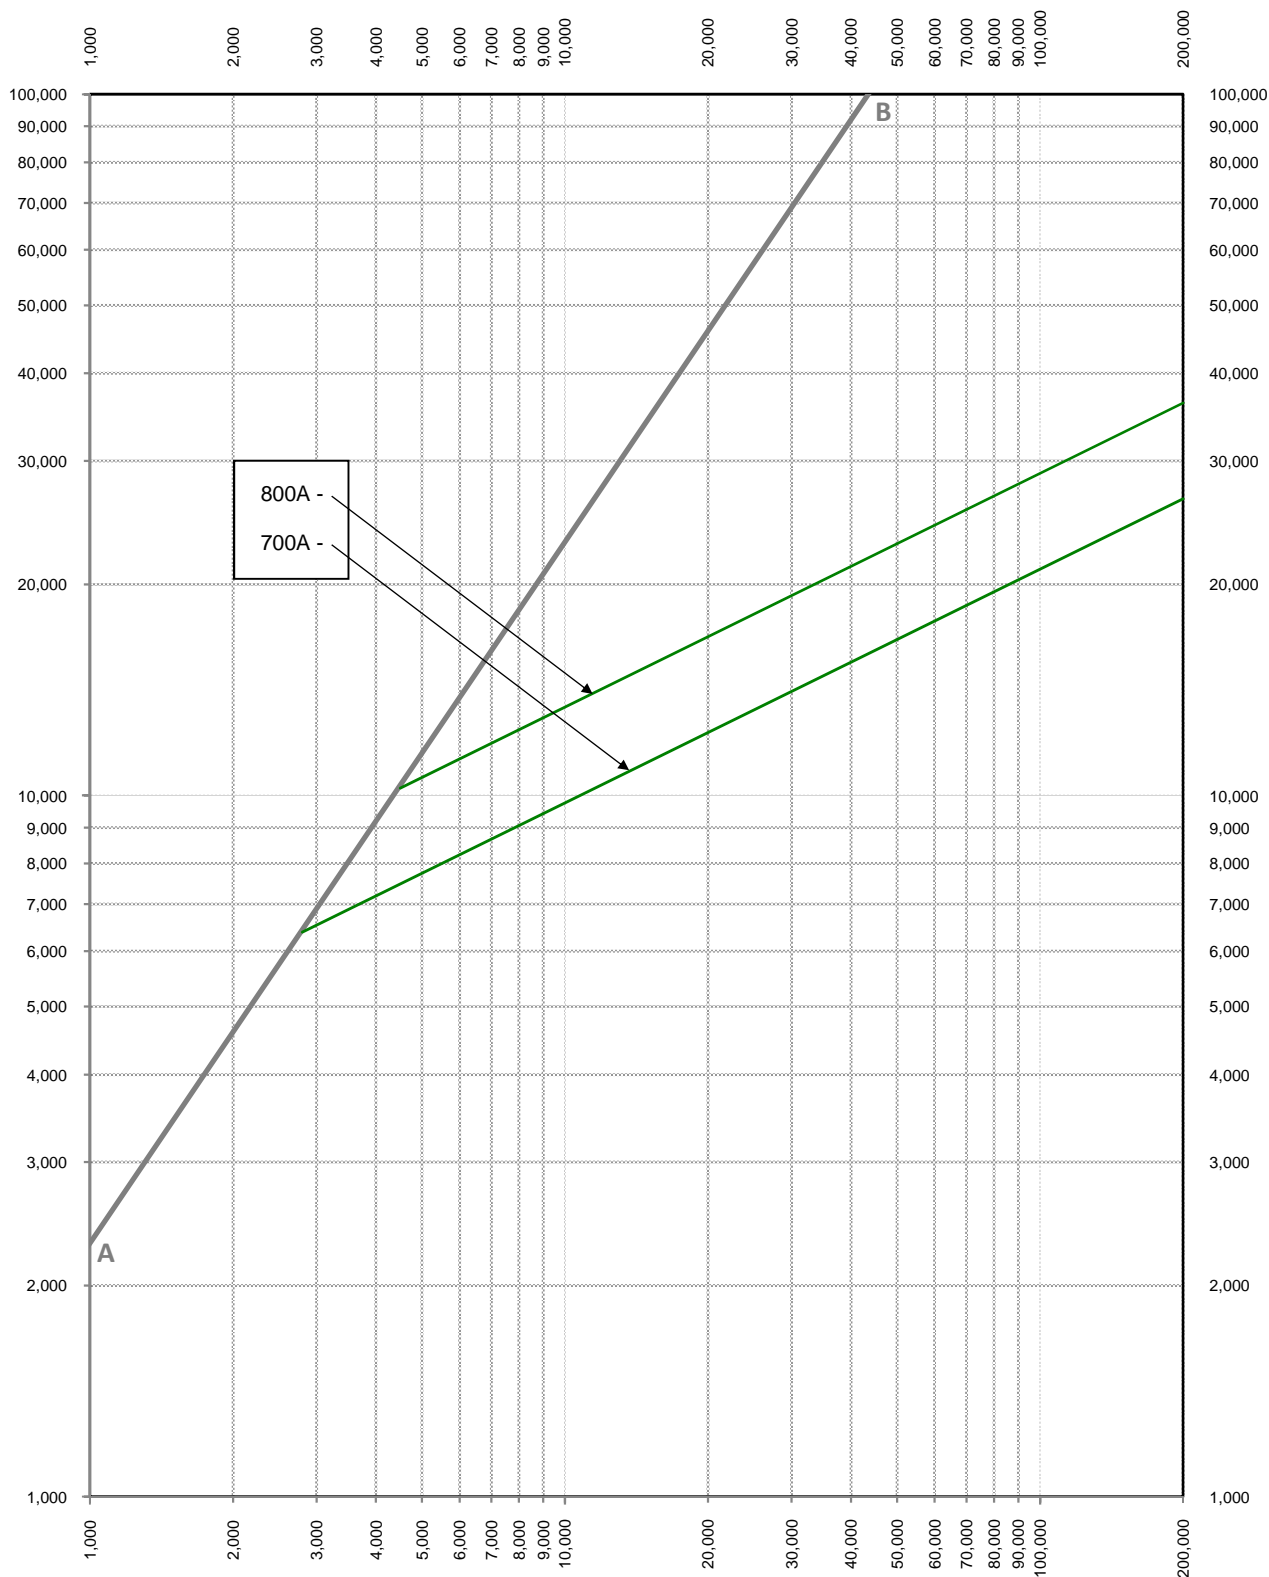

AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L70QS 35A - 800A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/13/2015	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: C	
		DRAWING NO.: FCC05-L70QS	SHEET 8 OF 8