
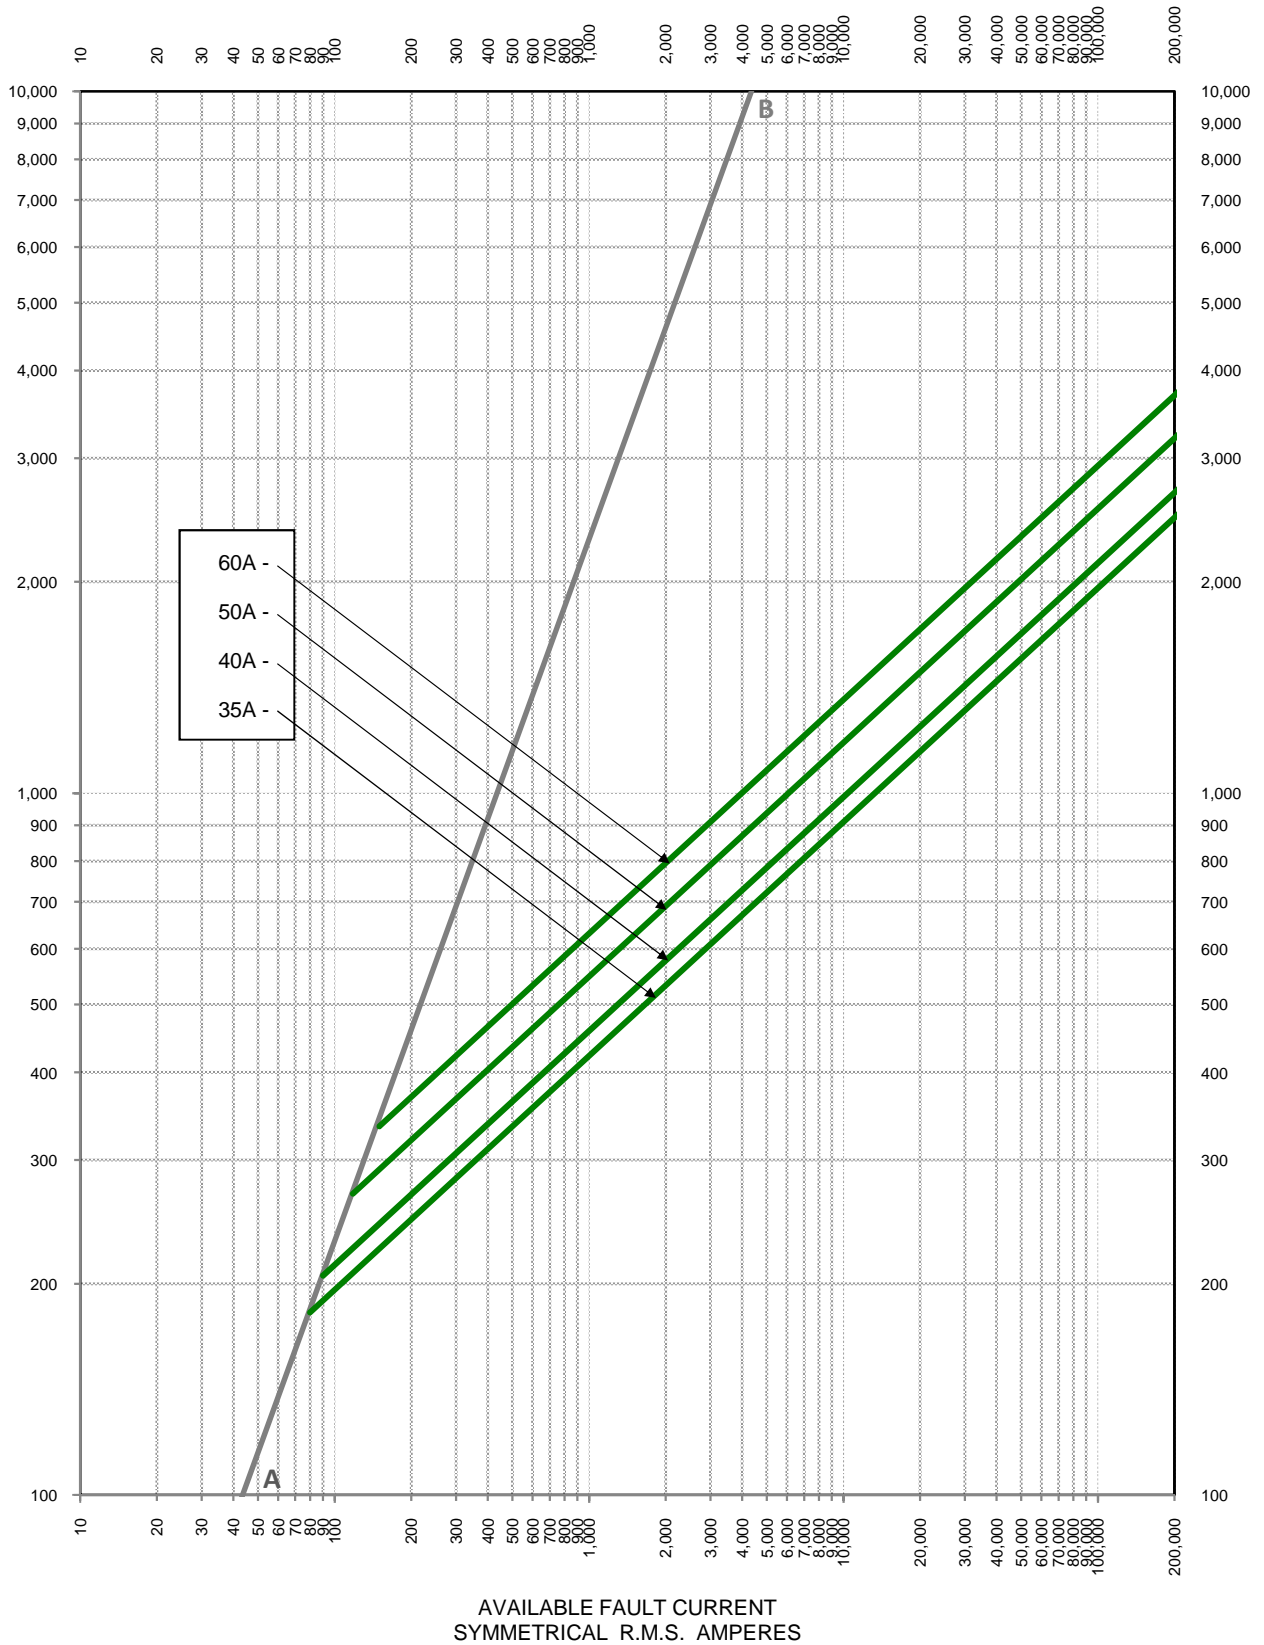



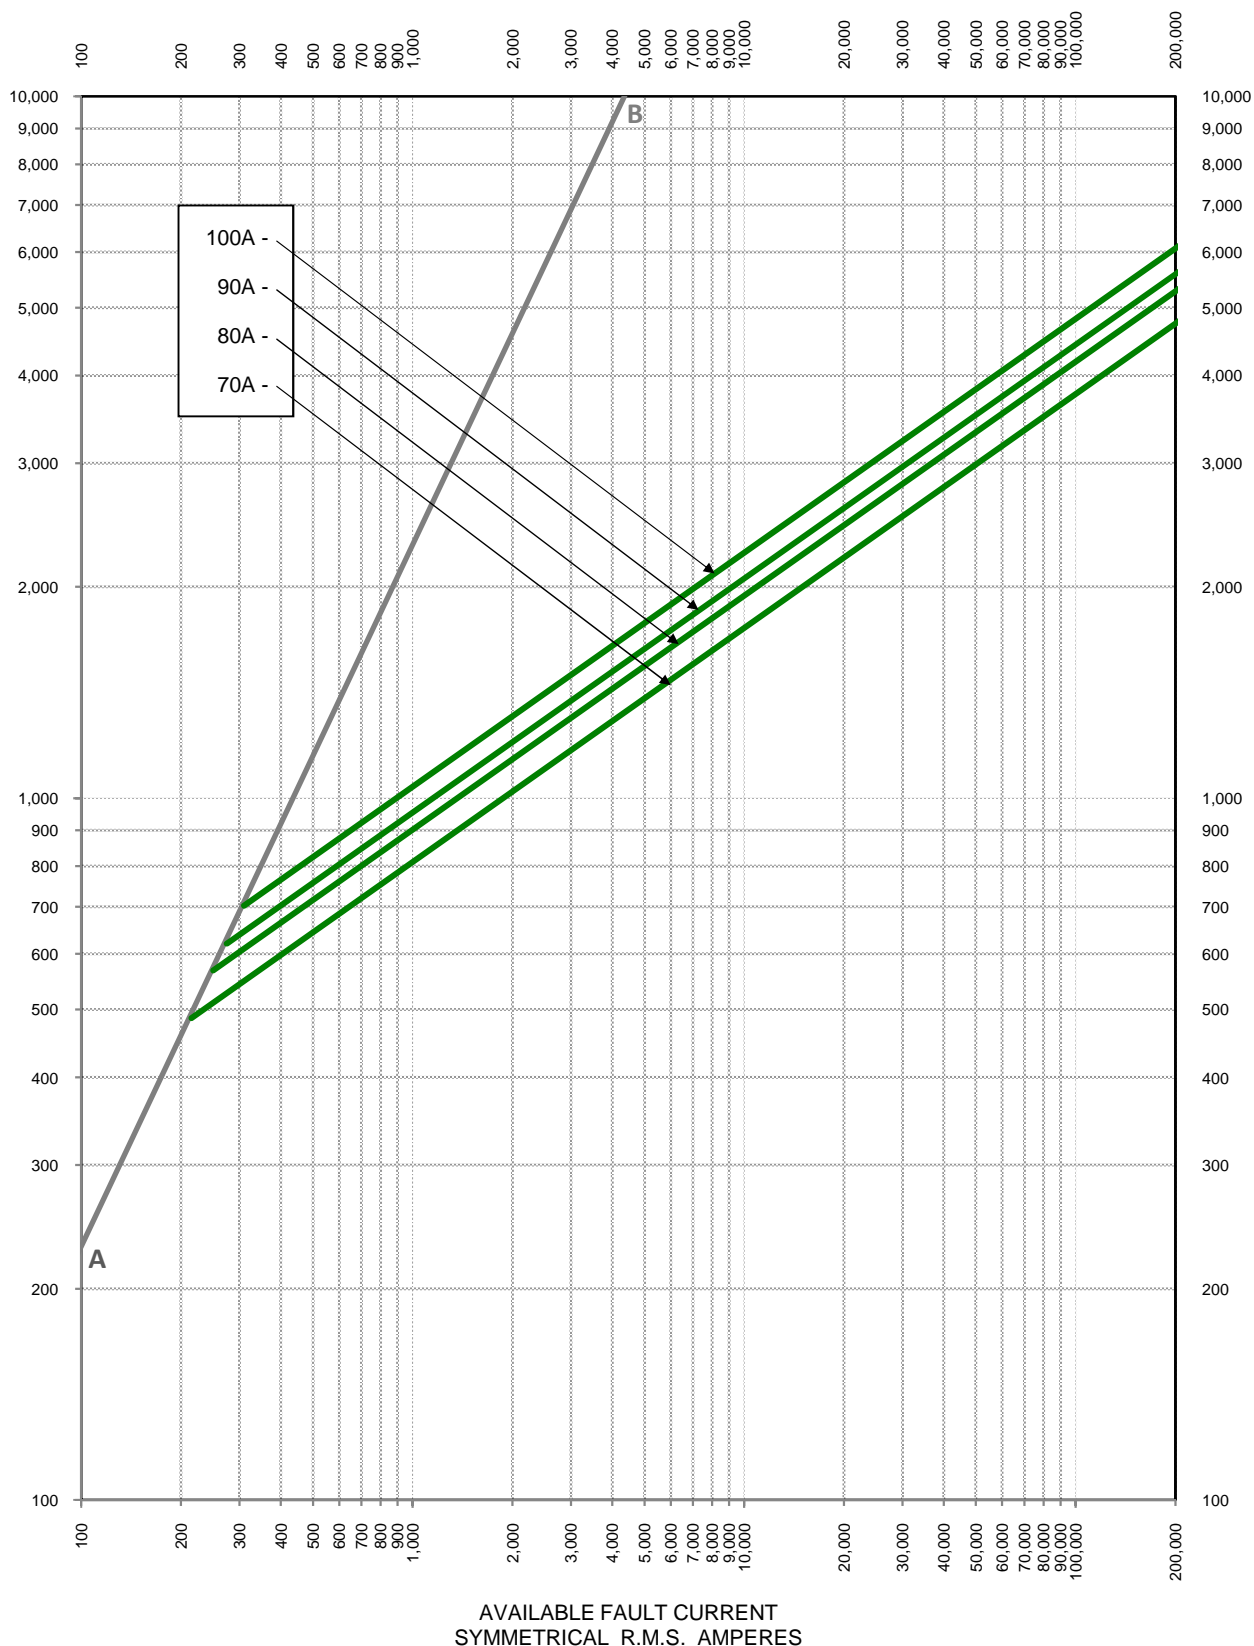
TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L50QS 60A - 800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/13/2015	
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: C	
		DRAWING NO.: FCC05-L50QS SHEET 2 OF 8	

PEAK LET-THRU IN AMPERES




<p>TEST VOLTAGE:</p> <p>TIME CONSTANT/POWER FACTOR:</p> <p>BASIS FOR DATA: AB = 15% Power Factor</p>	<p>FUSE CATALOG NUMBER:</p> <p>L50QS 60A - 800A</p>
<p> <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA</p> <p><b>PEAK LET-THRU CHARACTERISTIC CURVES</b></p>	<p>DRAWN BY: LLL</p> <p>DATE: 10/13/2015</p> <p>REVISION: C</p> <p>DRAWING NO.: <b>FCC05-L50QS</b></p> <p>SHEET 3 OF 8</p>


PEAK LET-THRU IN AMPERES




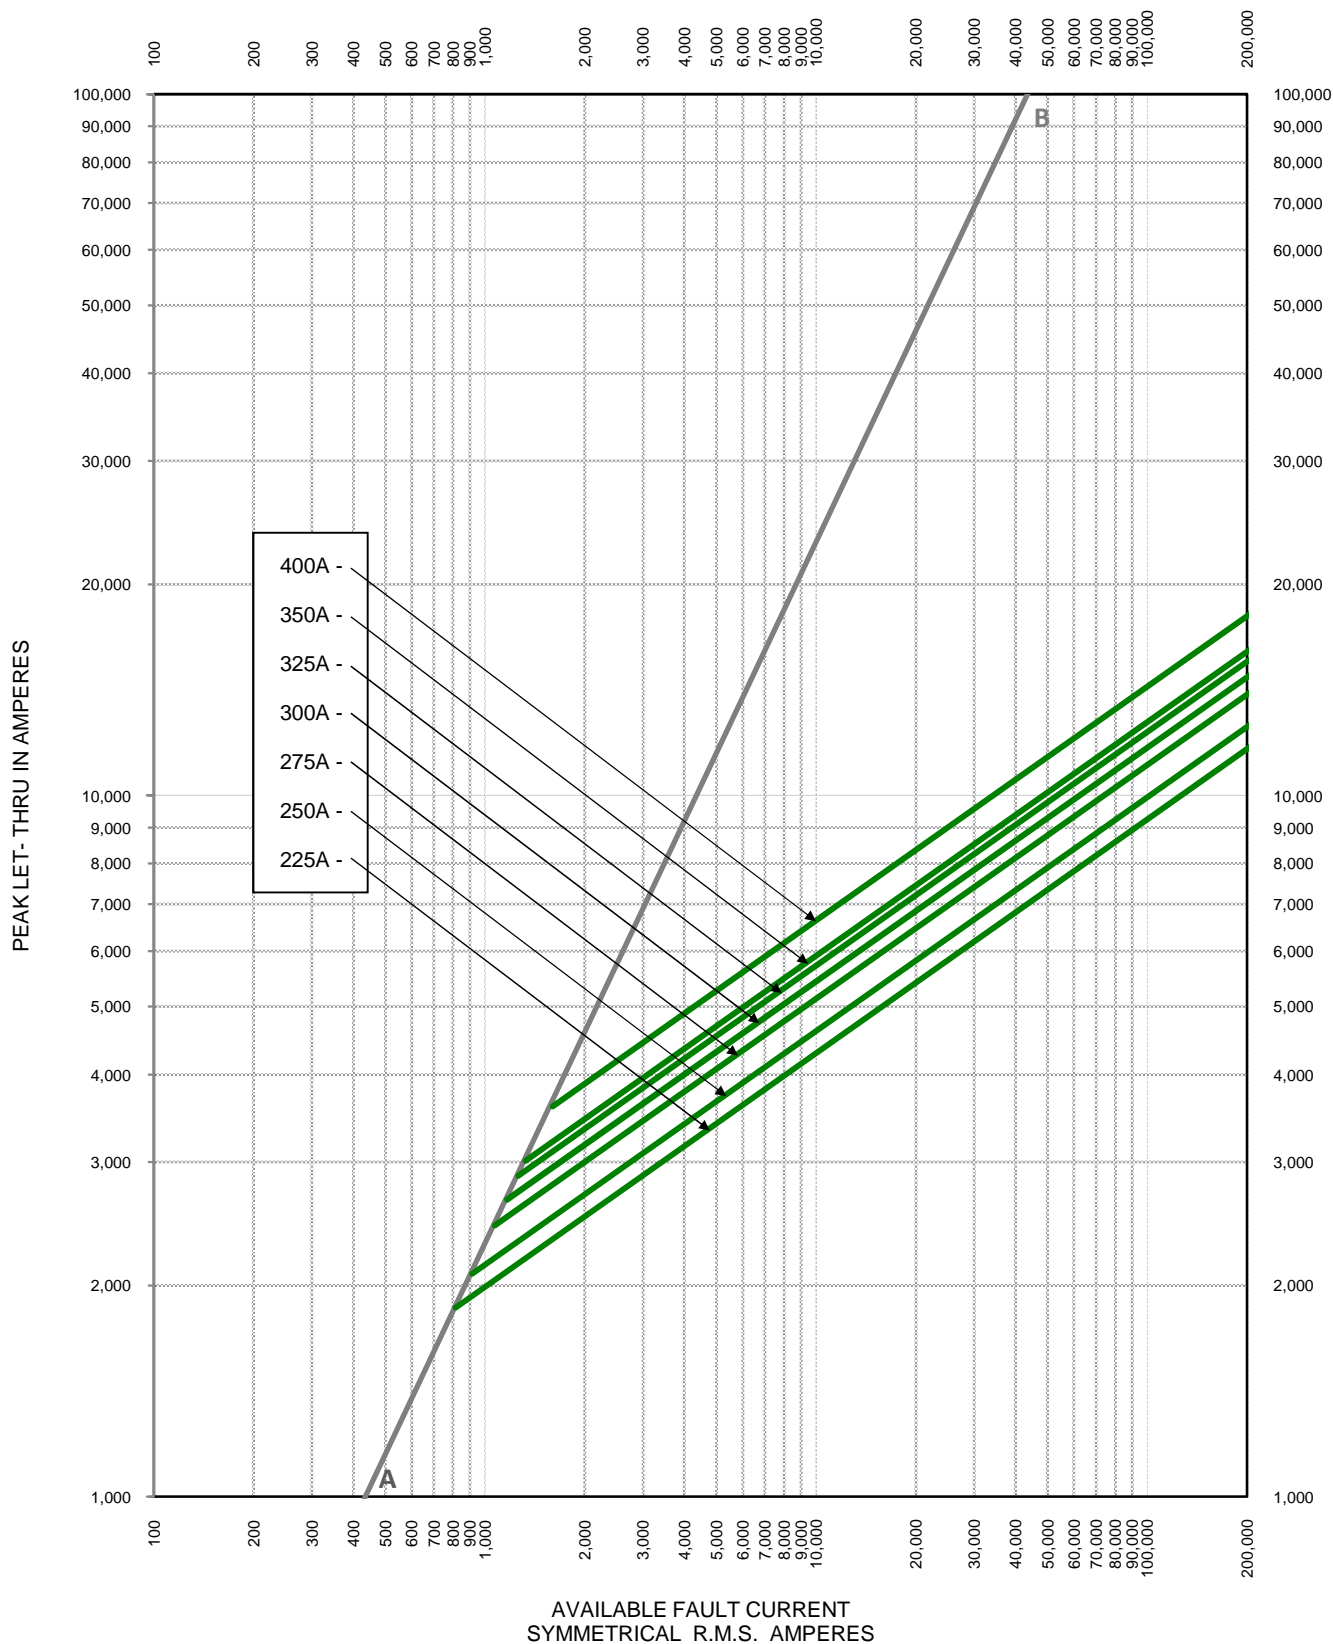
AVAILABLE FAULT CURRENT  
SYMMETRICAL R.M.S. AMPERES


TEST VOLTAGE: BASIS FOR DATA: AB = 15% Power Factor	TIME CONSTANT/POWER FACTOR: FUSE CATALOG NUMBER: L50QS 60A - 800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA	DRAWN BY: LLL DATE: 10/13/2015 REVISION: C DRAWING NO.: FCC05-L50QS SHEET 4 OF 8


PEAK LET-THRU CHARACTERISTIC CURVES

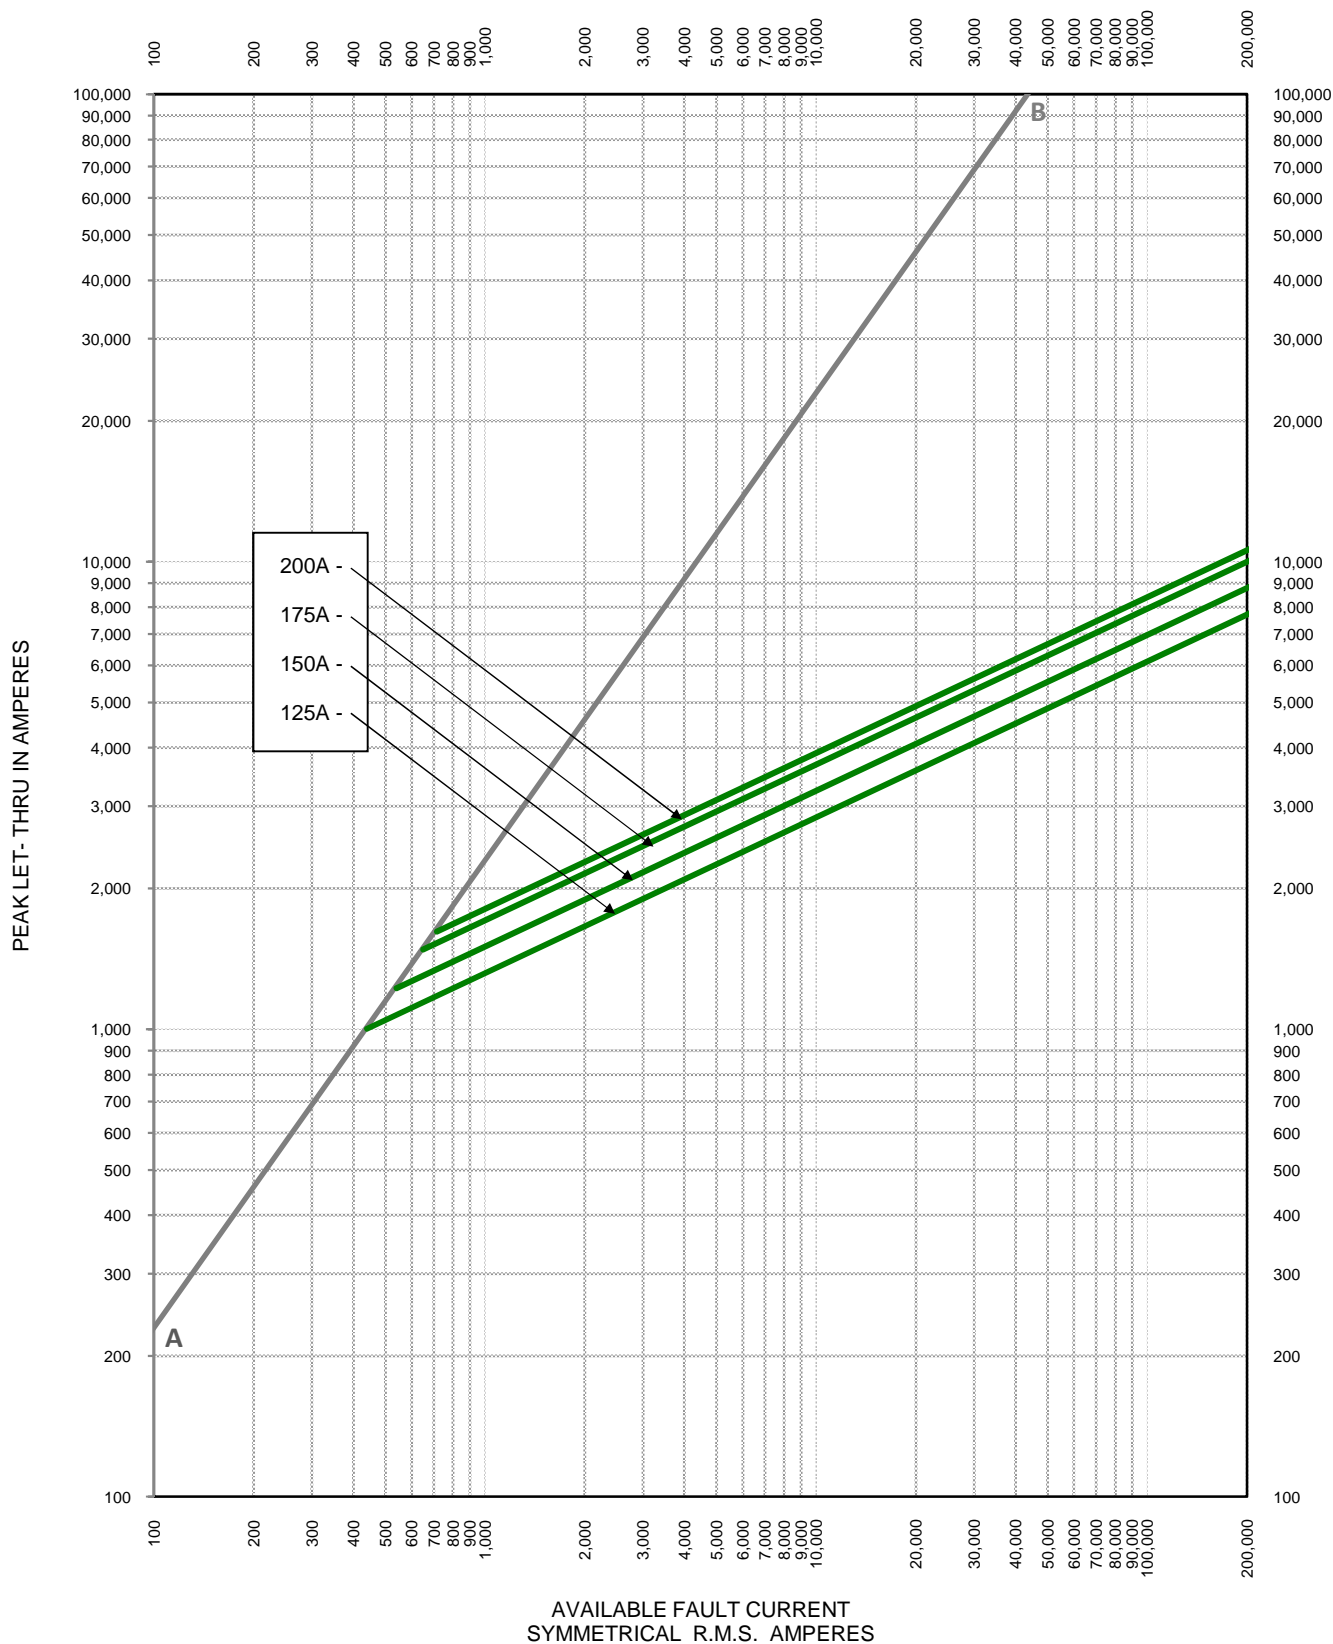


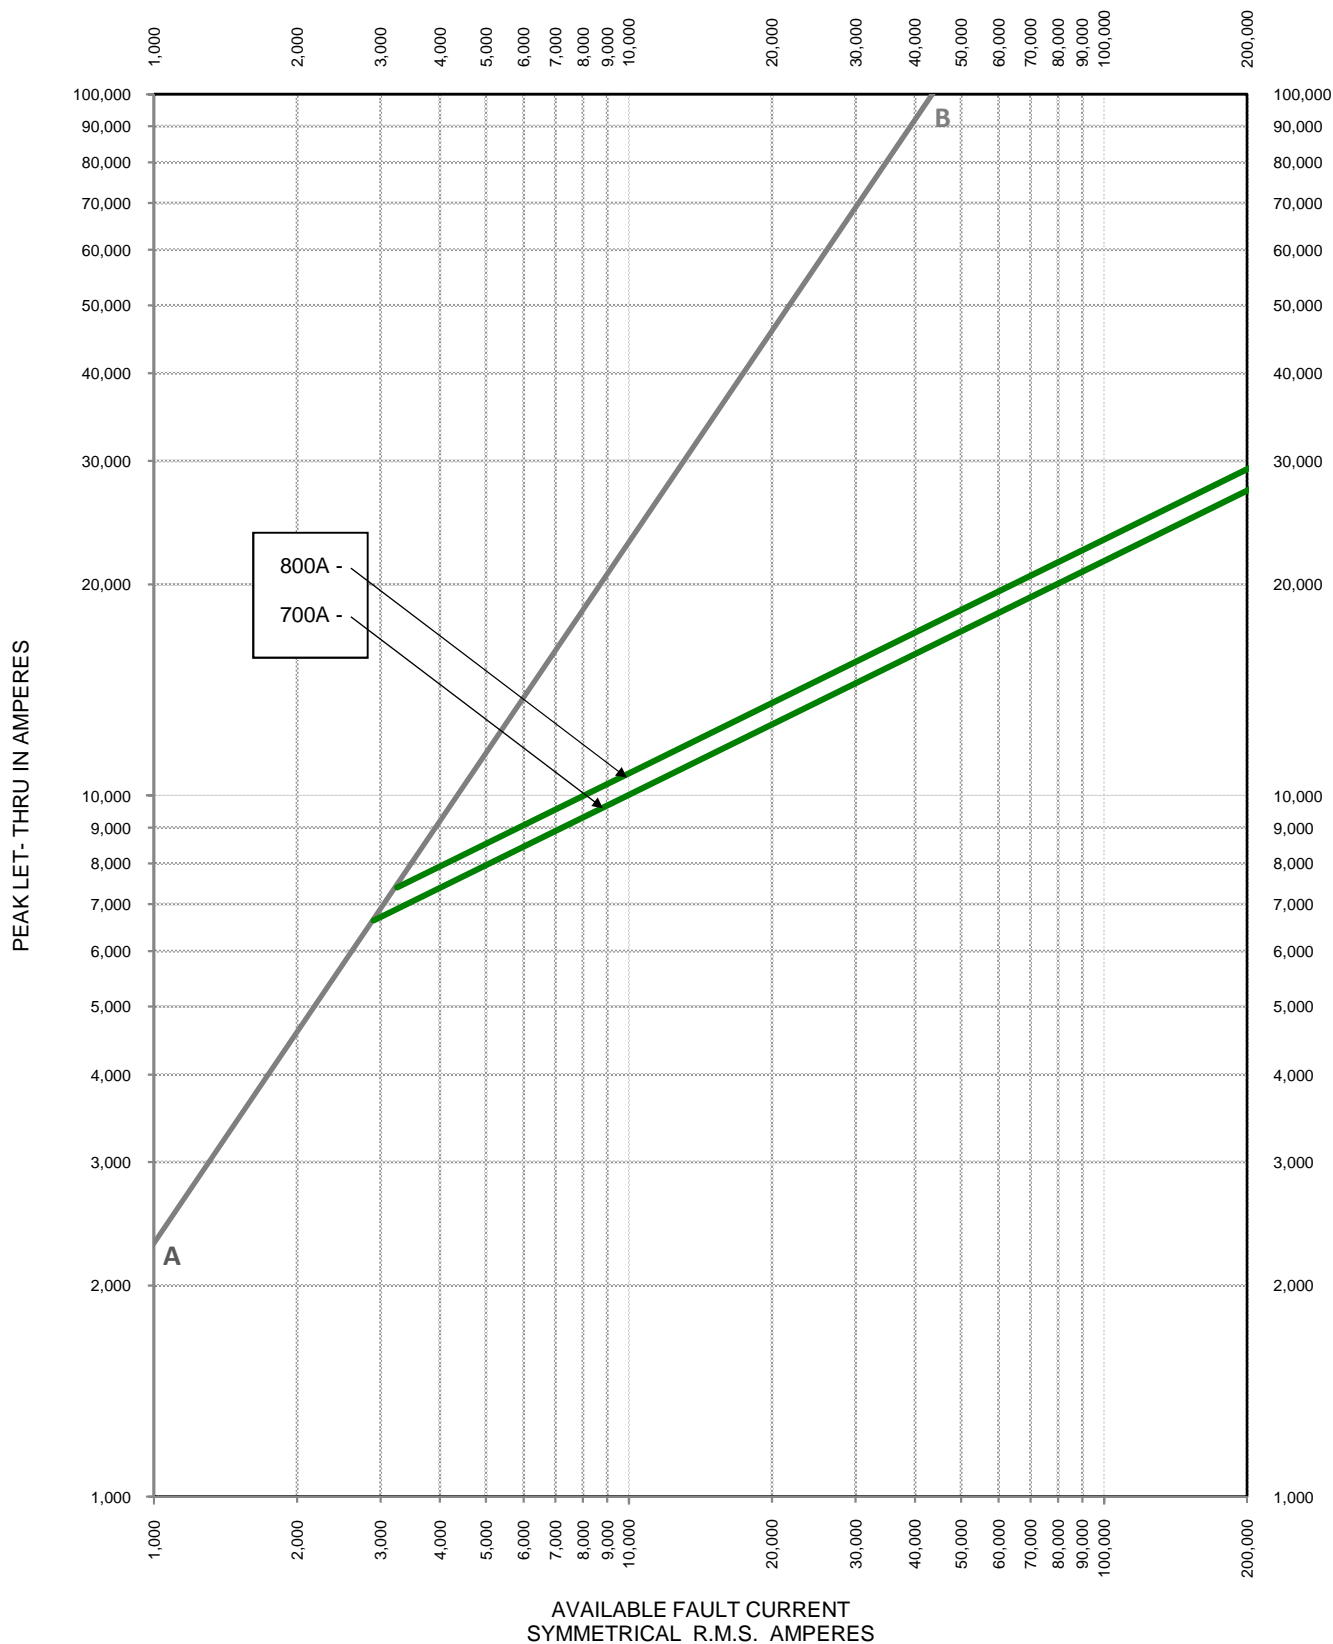
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L50QS 60A - 800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC05-L50QS SHEET 5 OF 8




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L50QS 60A - 800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		DRAWING NO.: <b>FCC05-L50QS</b> SHEET 6 OF 8

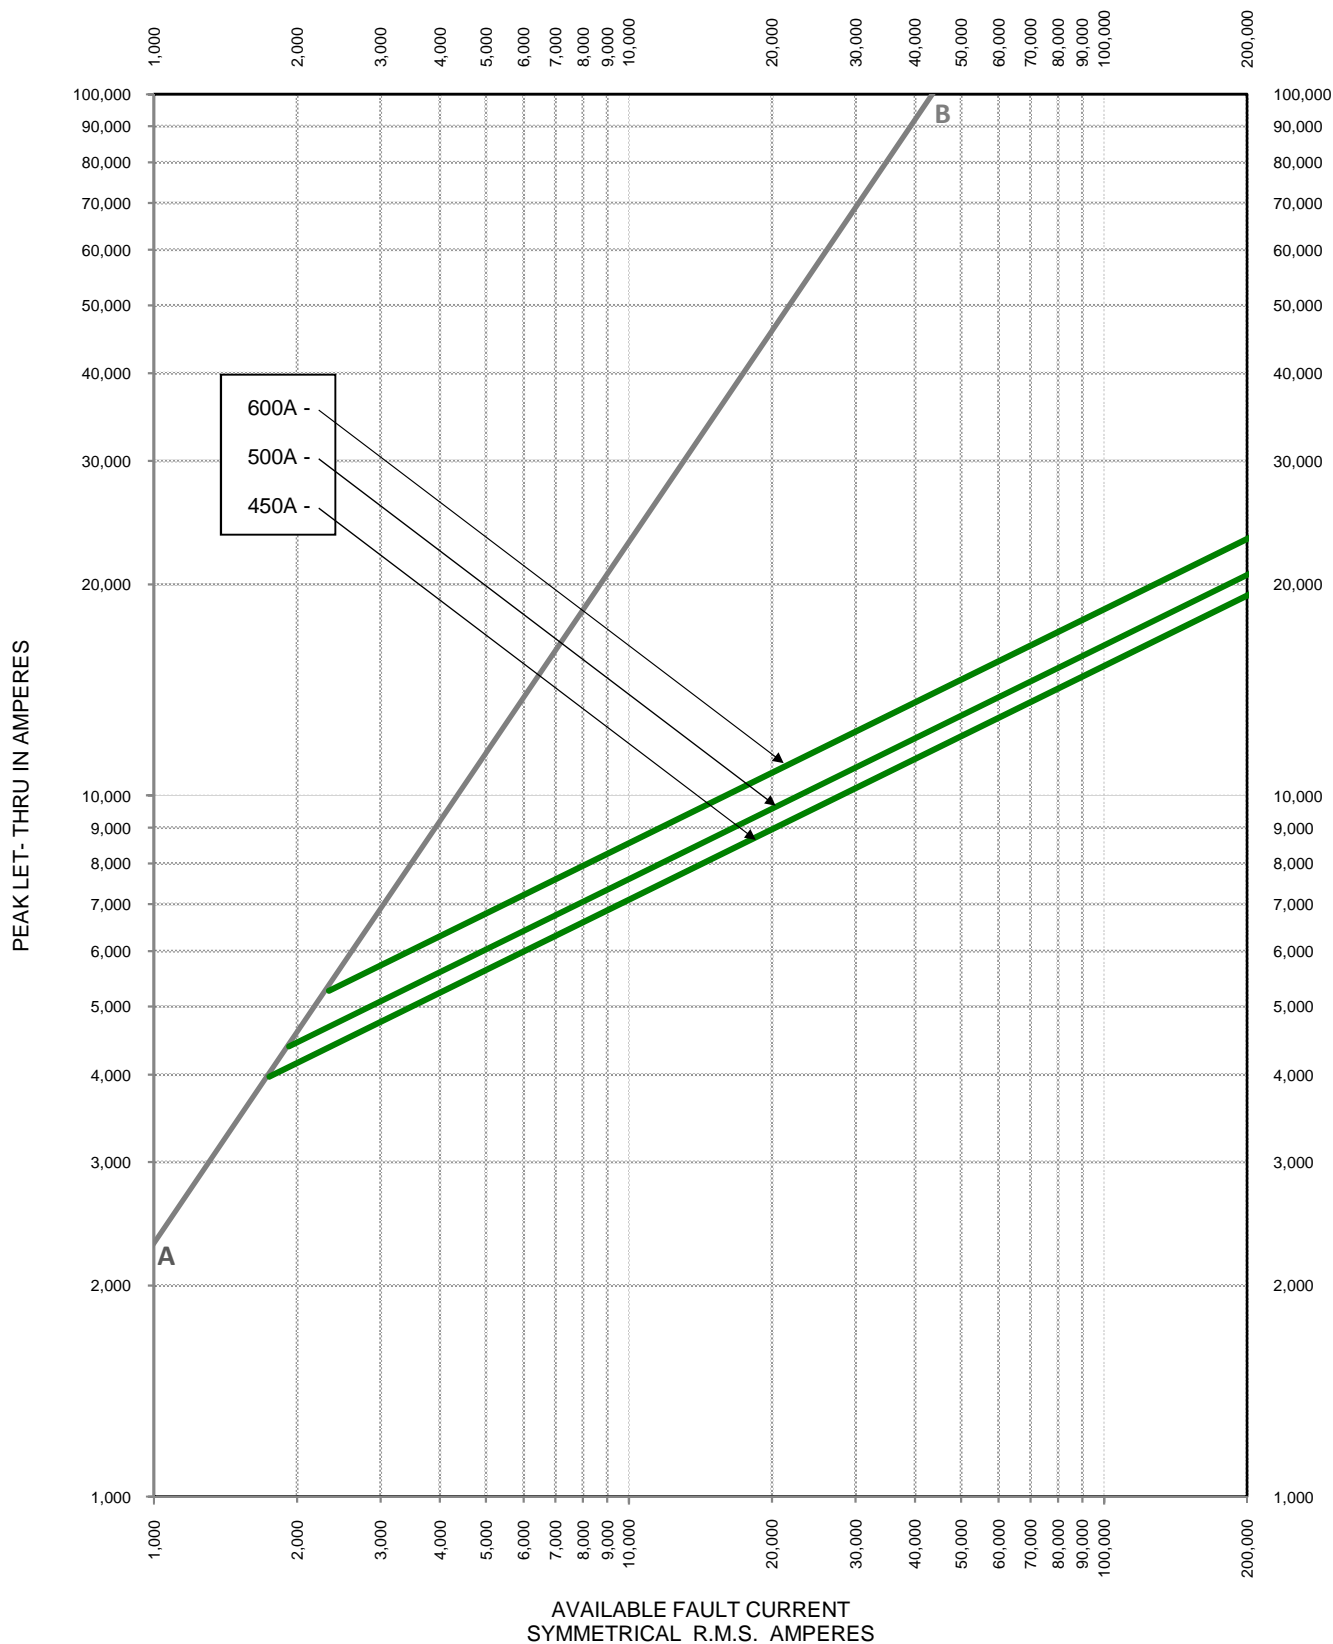

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		L50QS 60A - 800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 10/13/2015 REVISION: C
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		DRAWING NO.: <b>FCC05-L50QS</b> SHEET 7 OF 8



TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L50QS 60A - 800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/13/2015	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: C	
		DRAWING NO.: FCC05-L50QS	SHEET 8 OF 8