


TIME IN SECONDS



TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
JTD (8/10A - 3-1/2A) ID

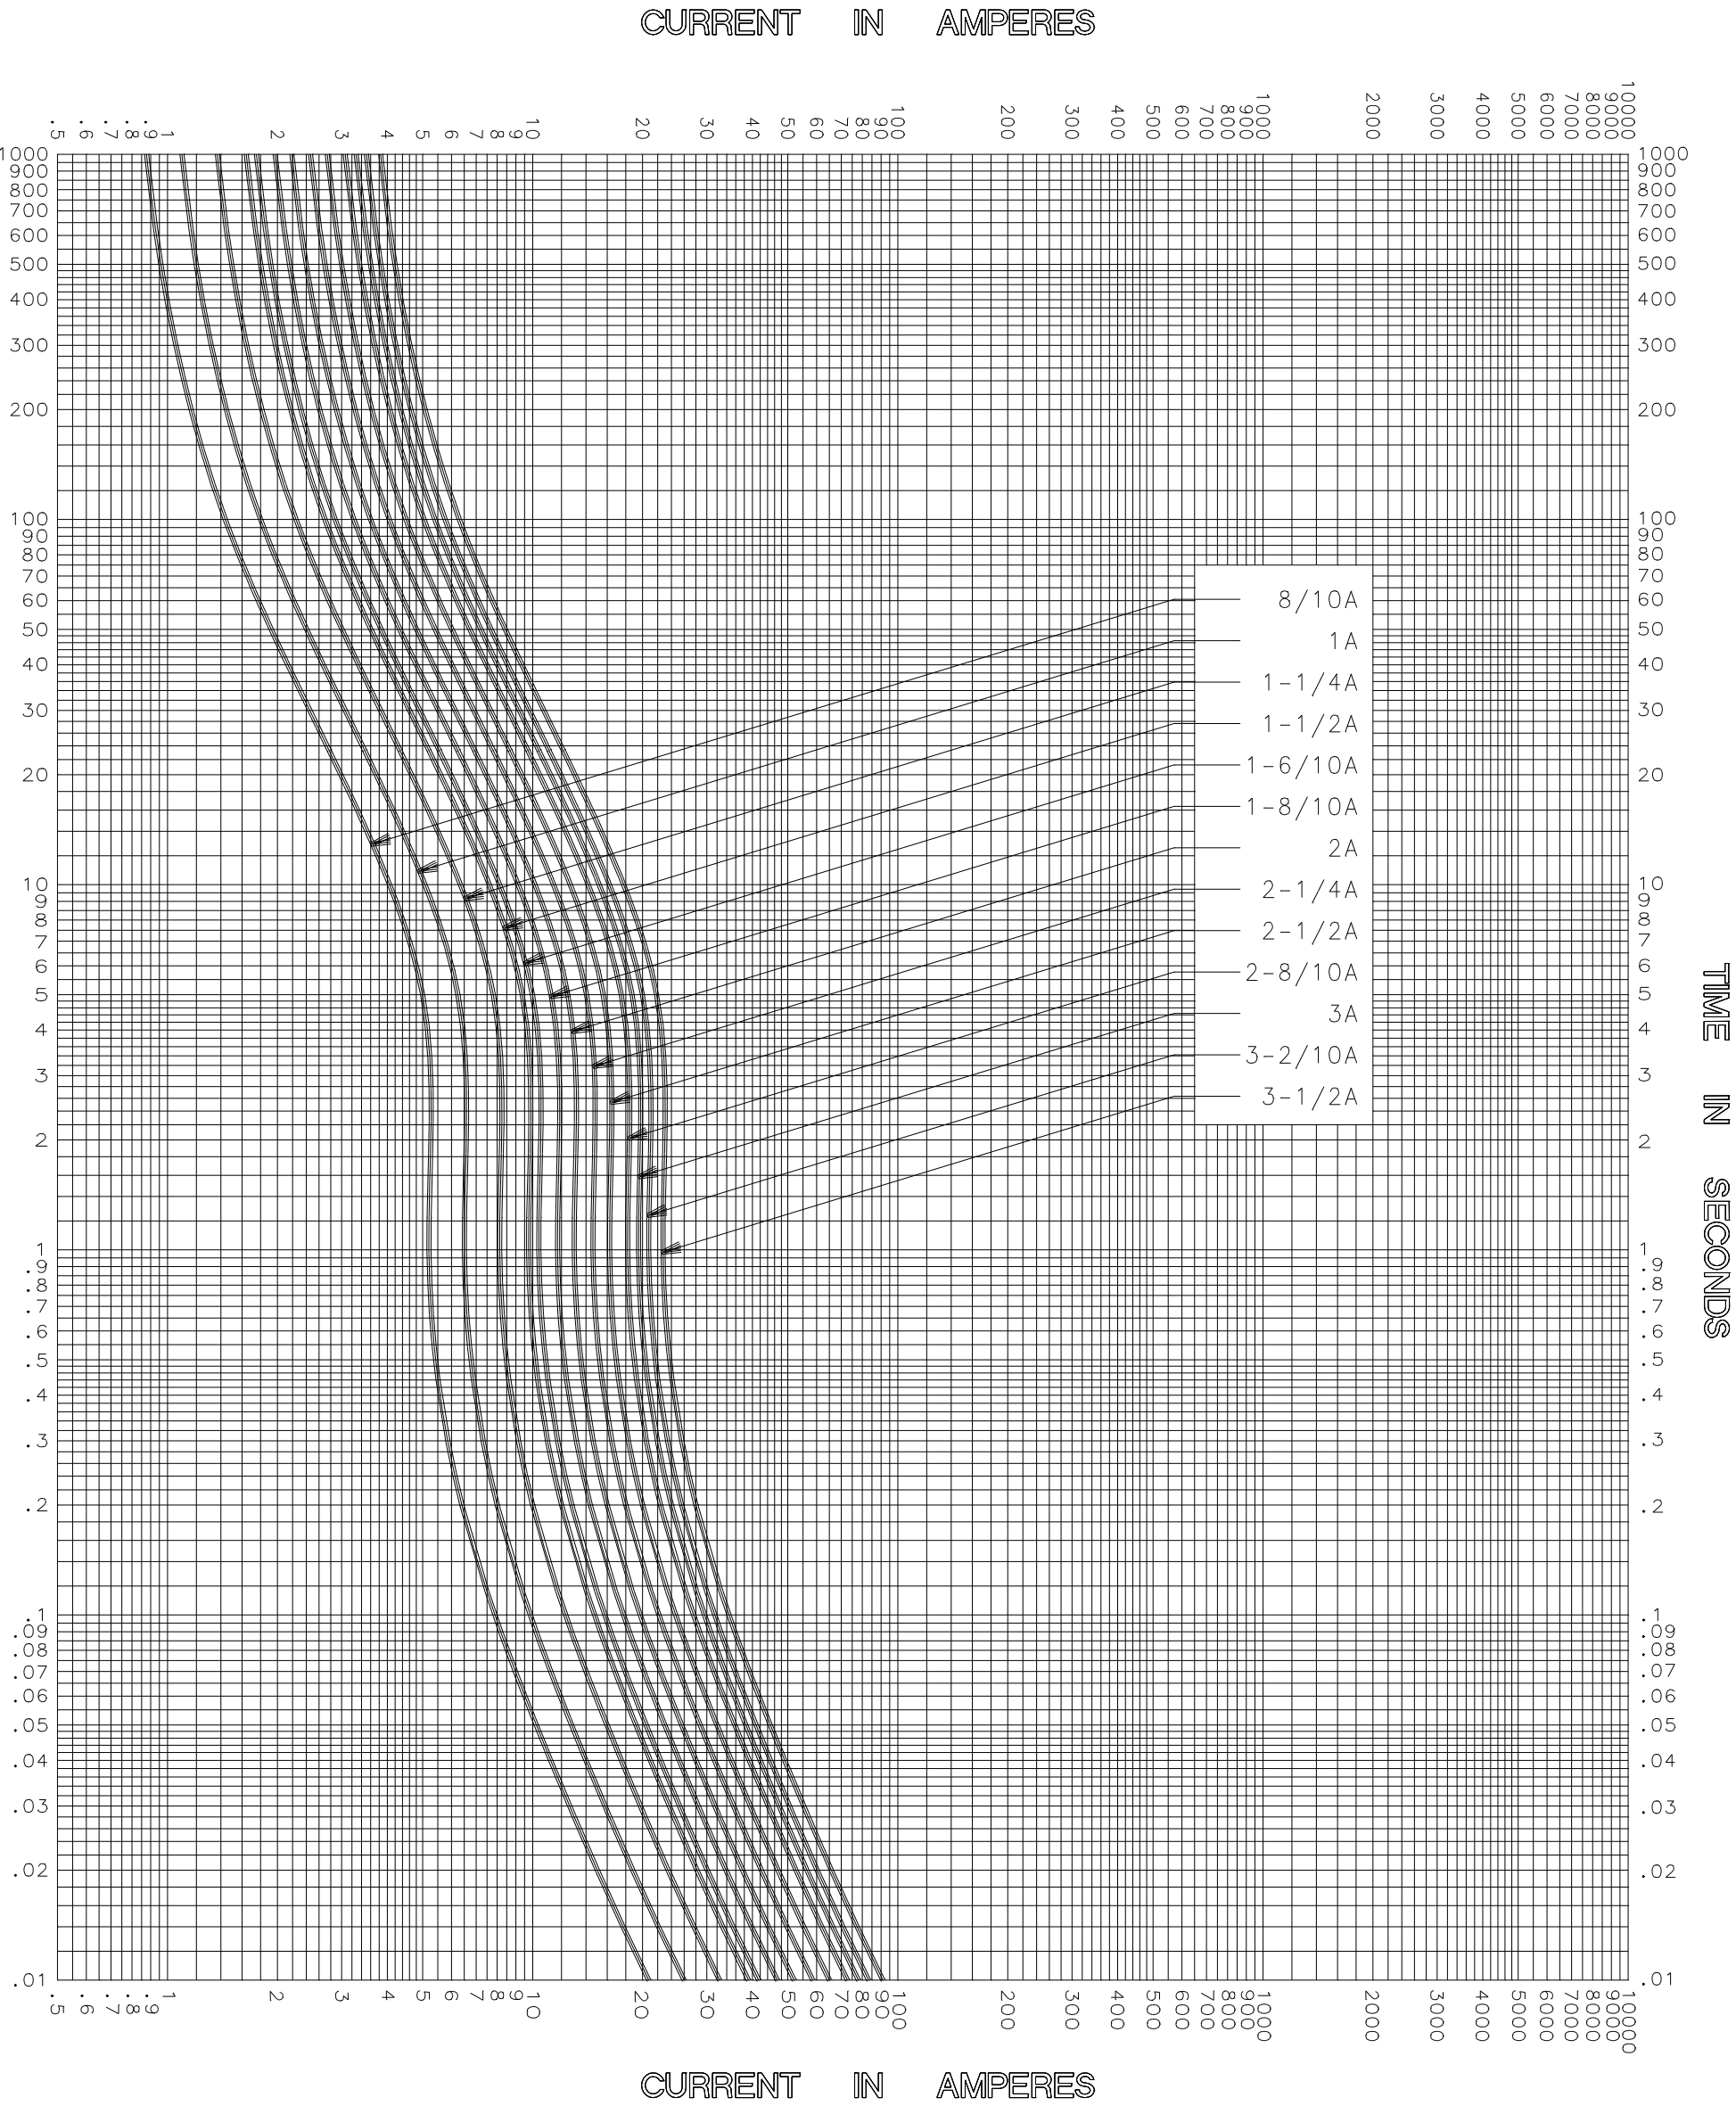

LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-10001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

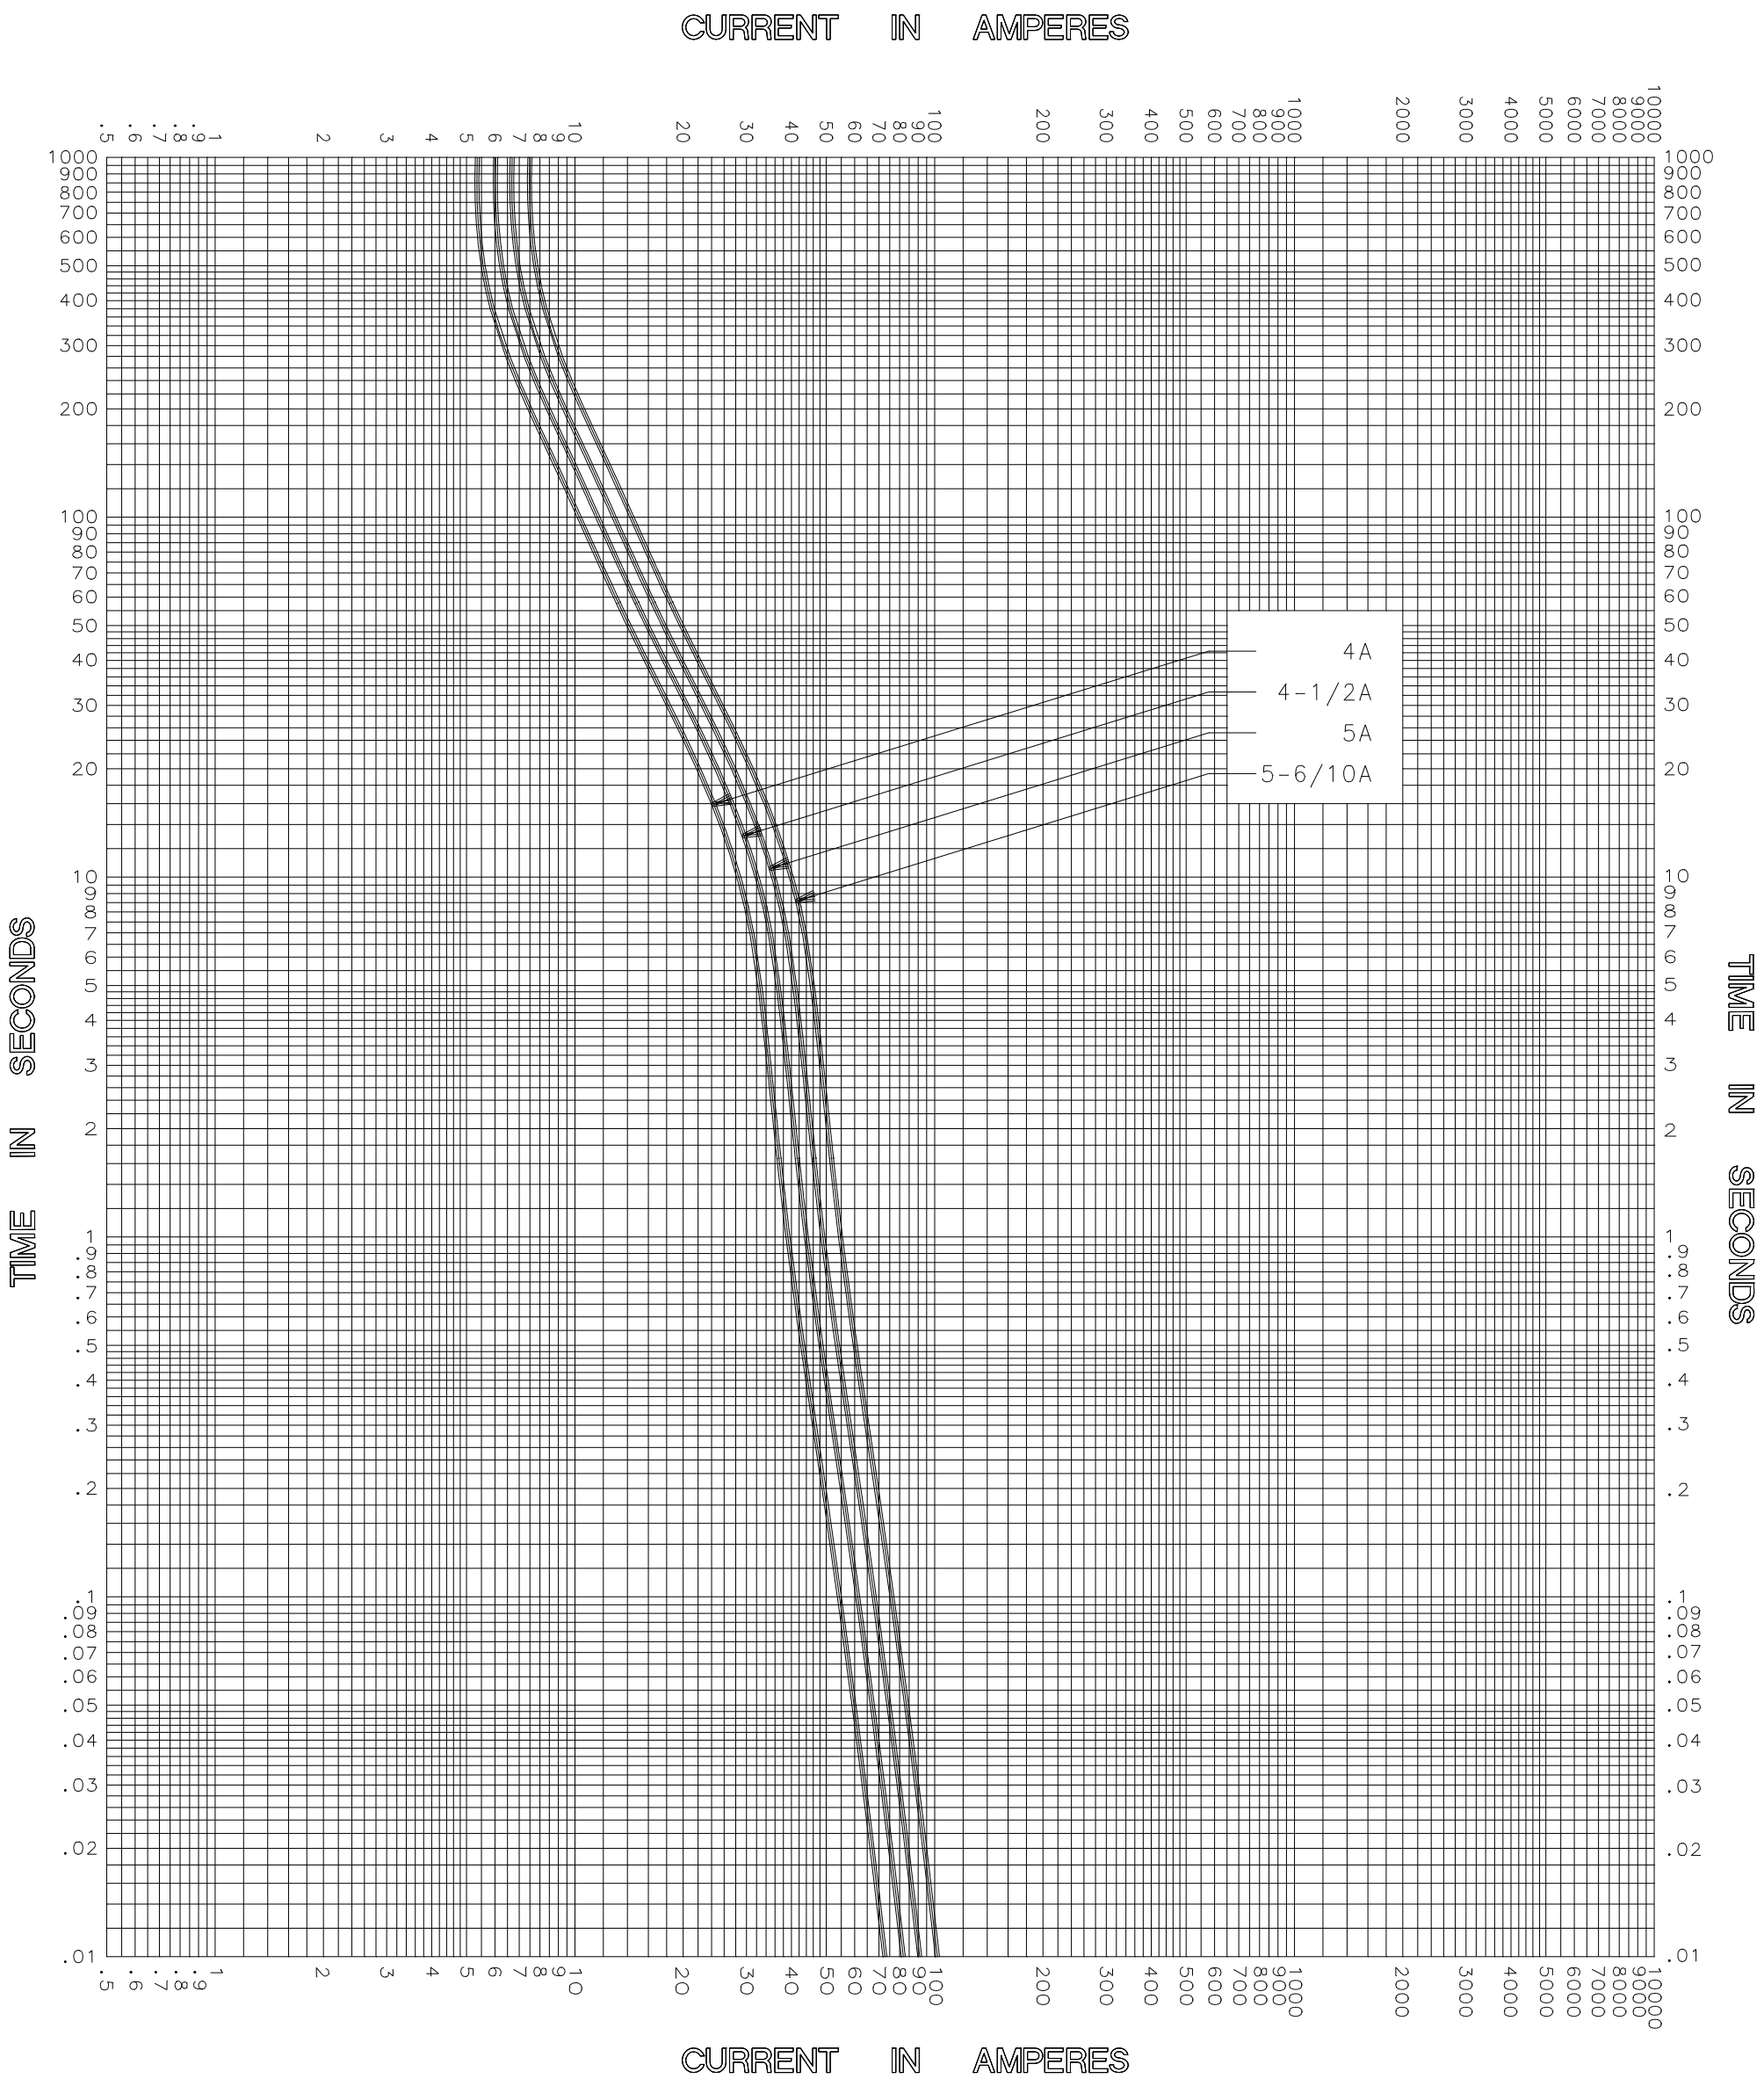


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER JTD (4A - 5-6/10A) ID _____
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY LLL DATE 01/07/05 CHECKED BY MP
	DRAWING NO. A-FCC01-110-02

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

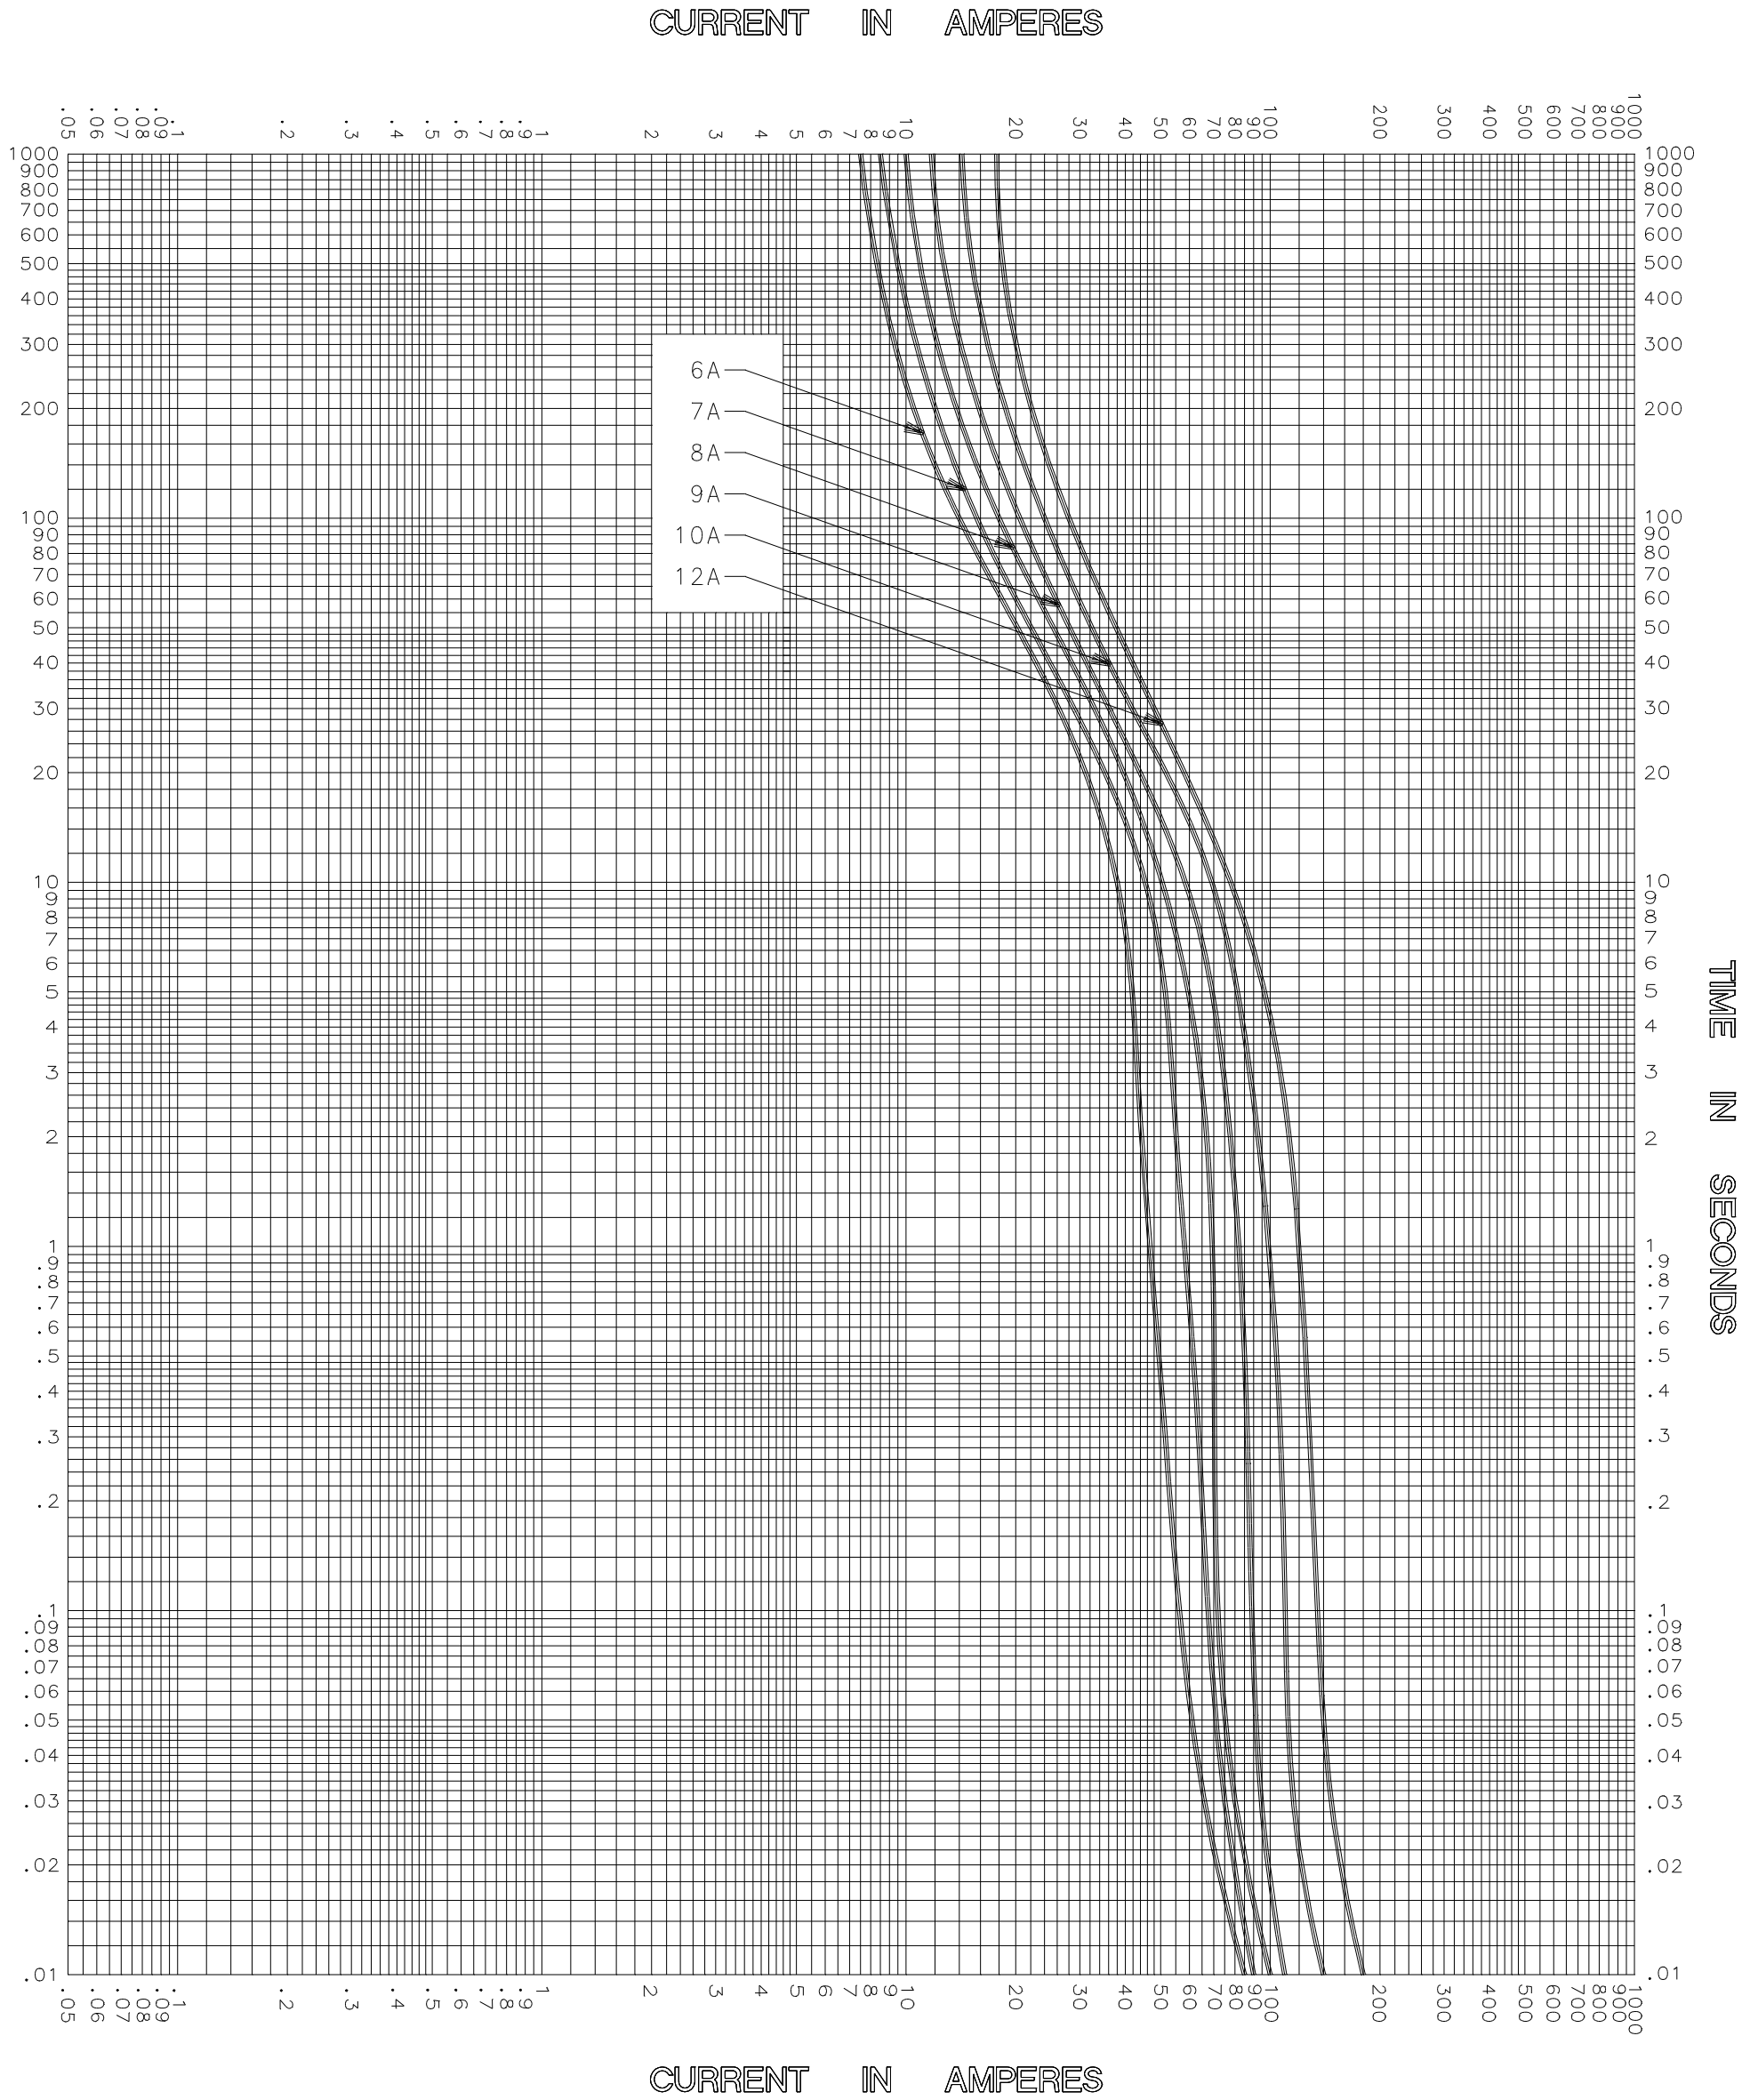

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
JTD (6A - 12A) ID



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-JTDID-003


-THIS DATA GENERATED ON CAD-

TIME IN SECONDS

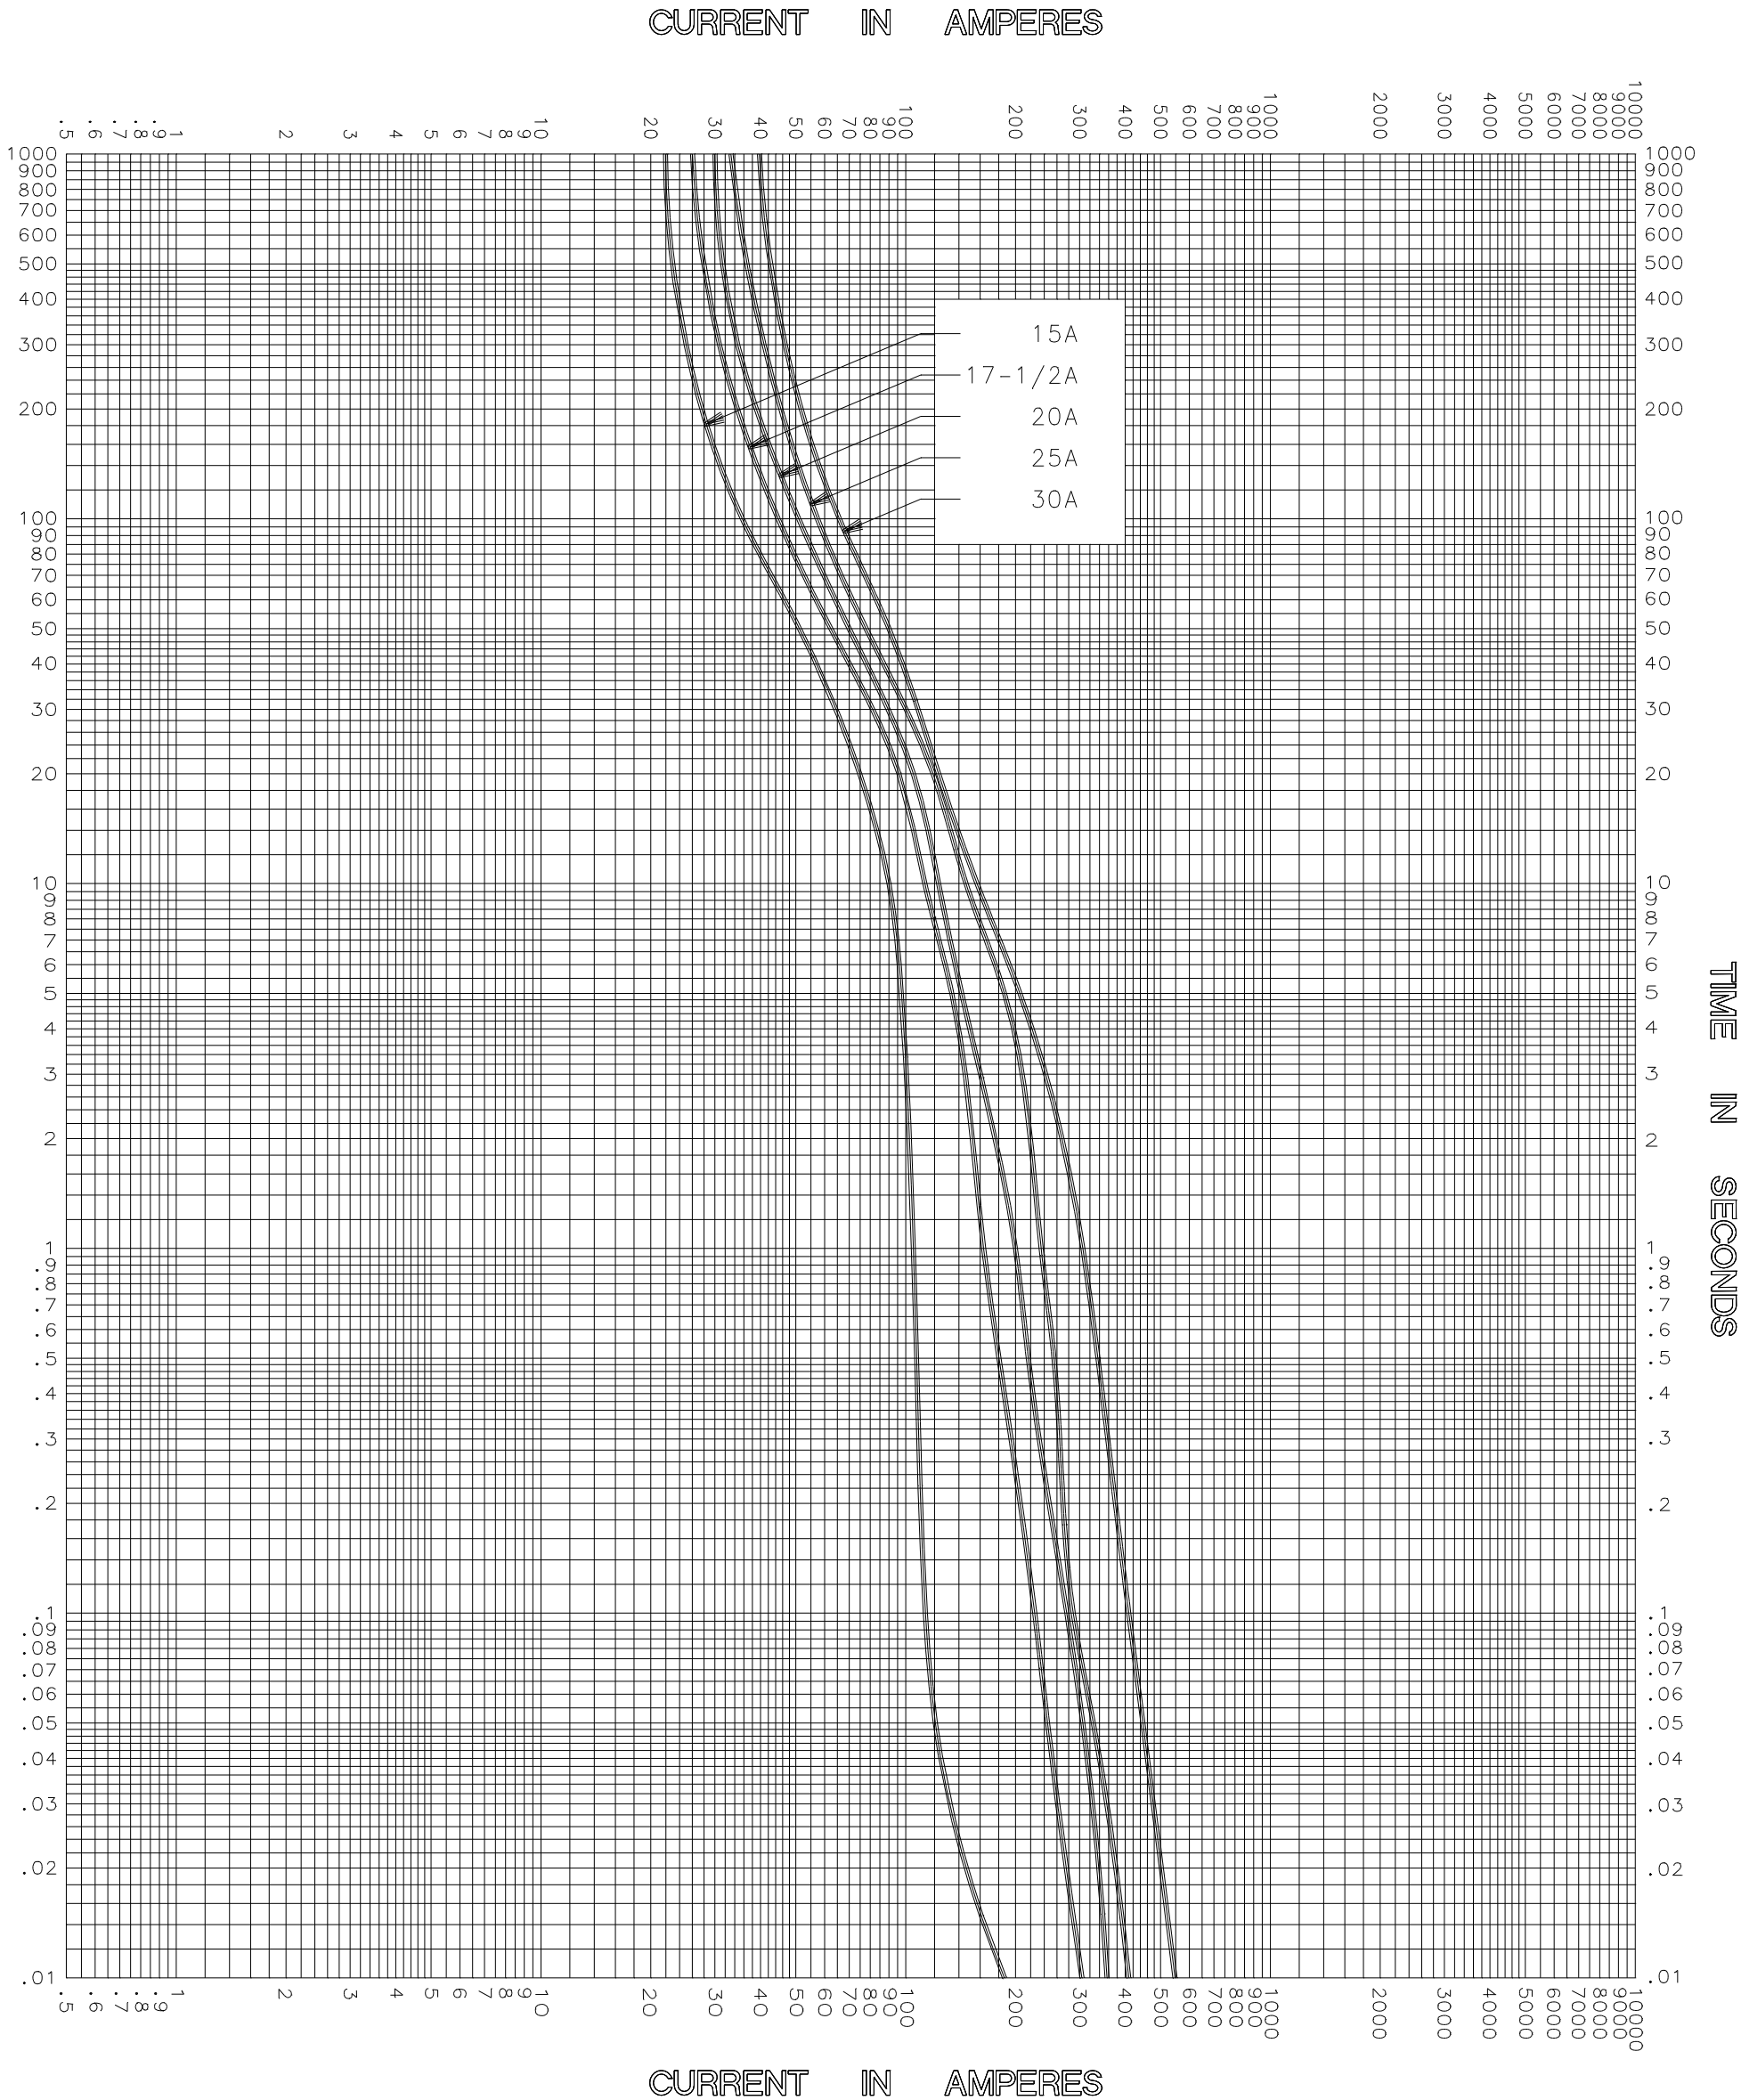

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER JTD (15A - 30A)ID
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY LLL DATE 01/07/05 CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-JTDID-004

TIME IN SECONDS

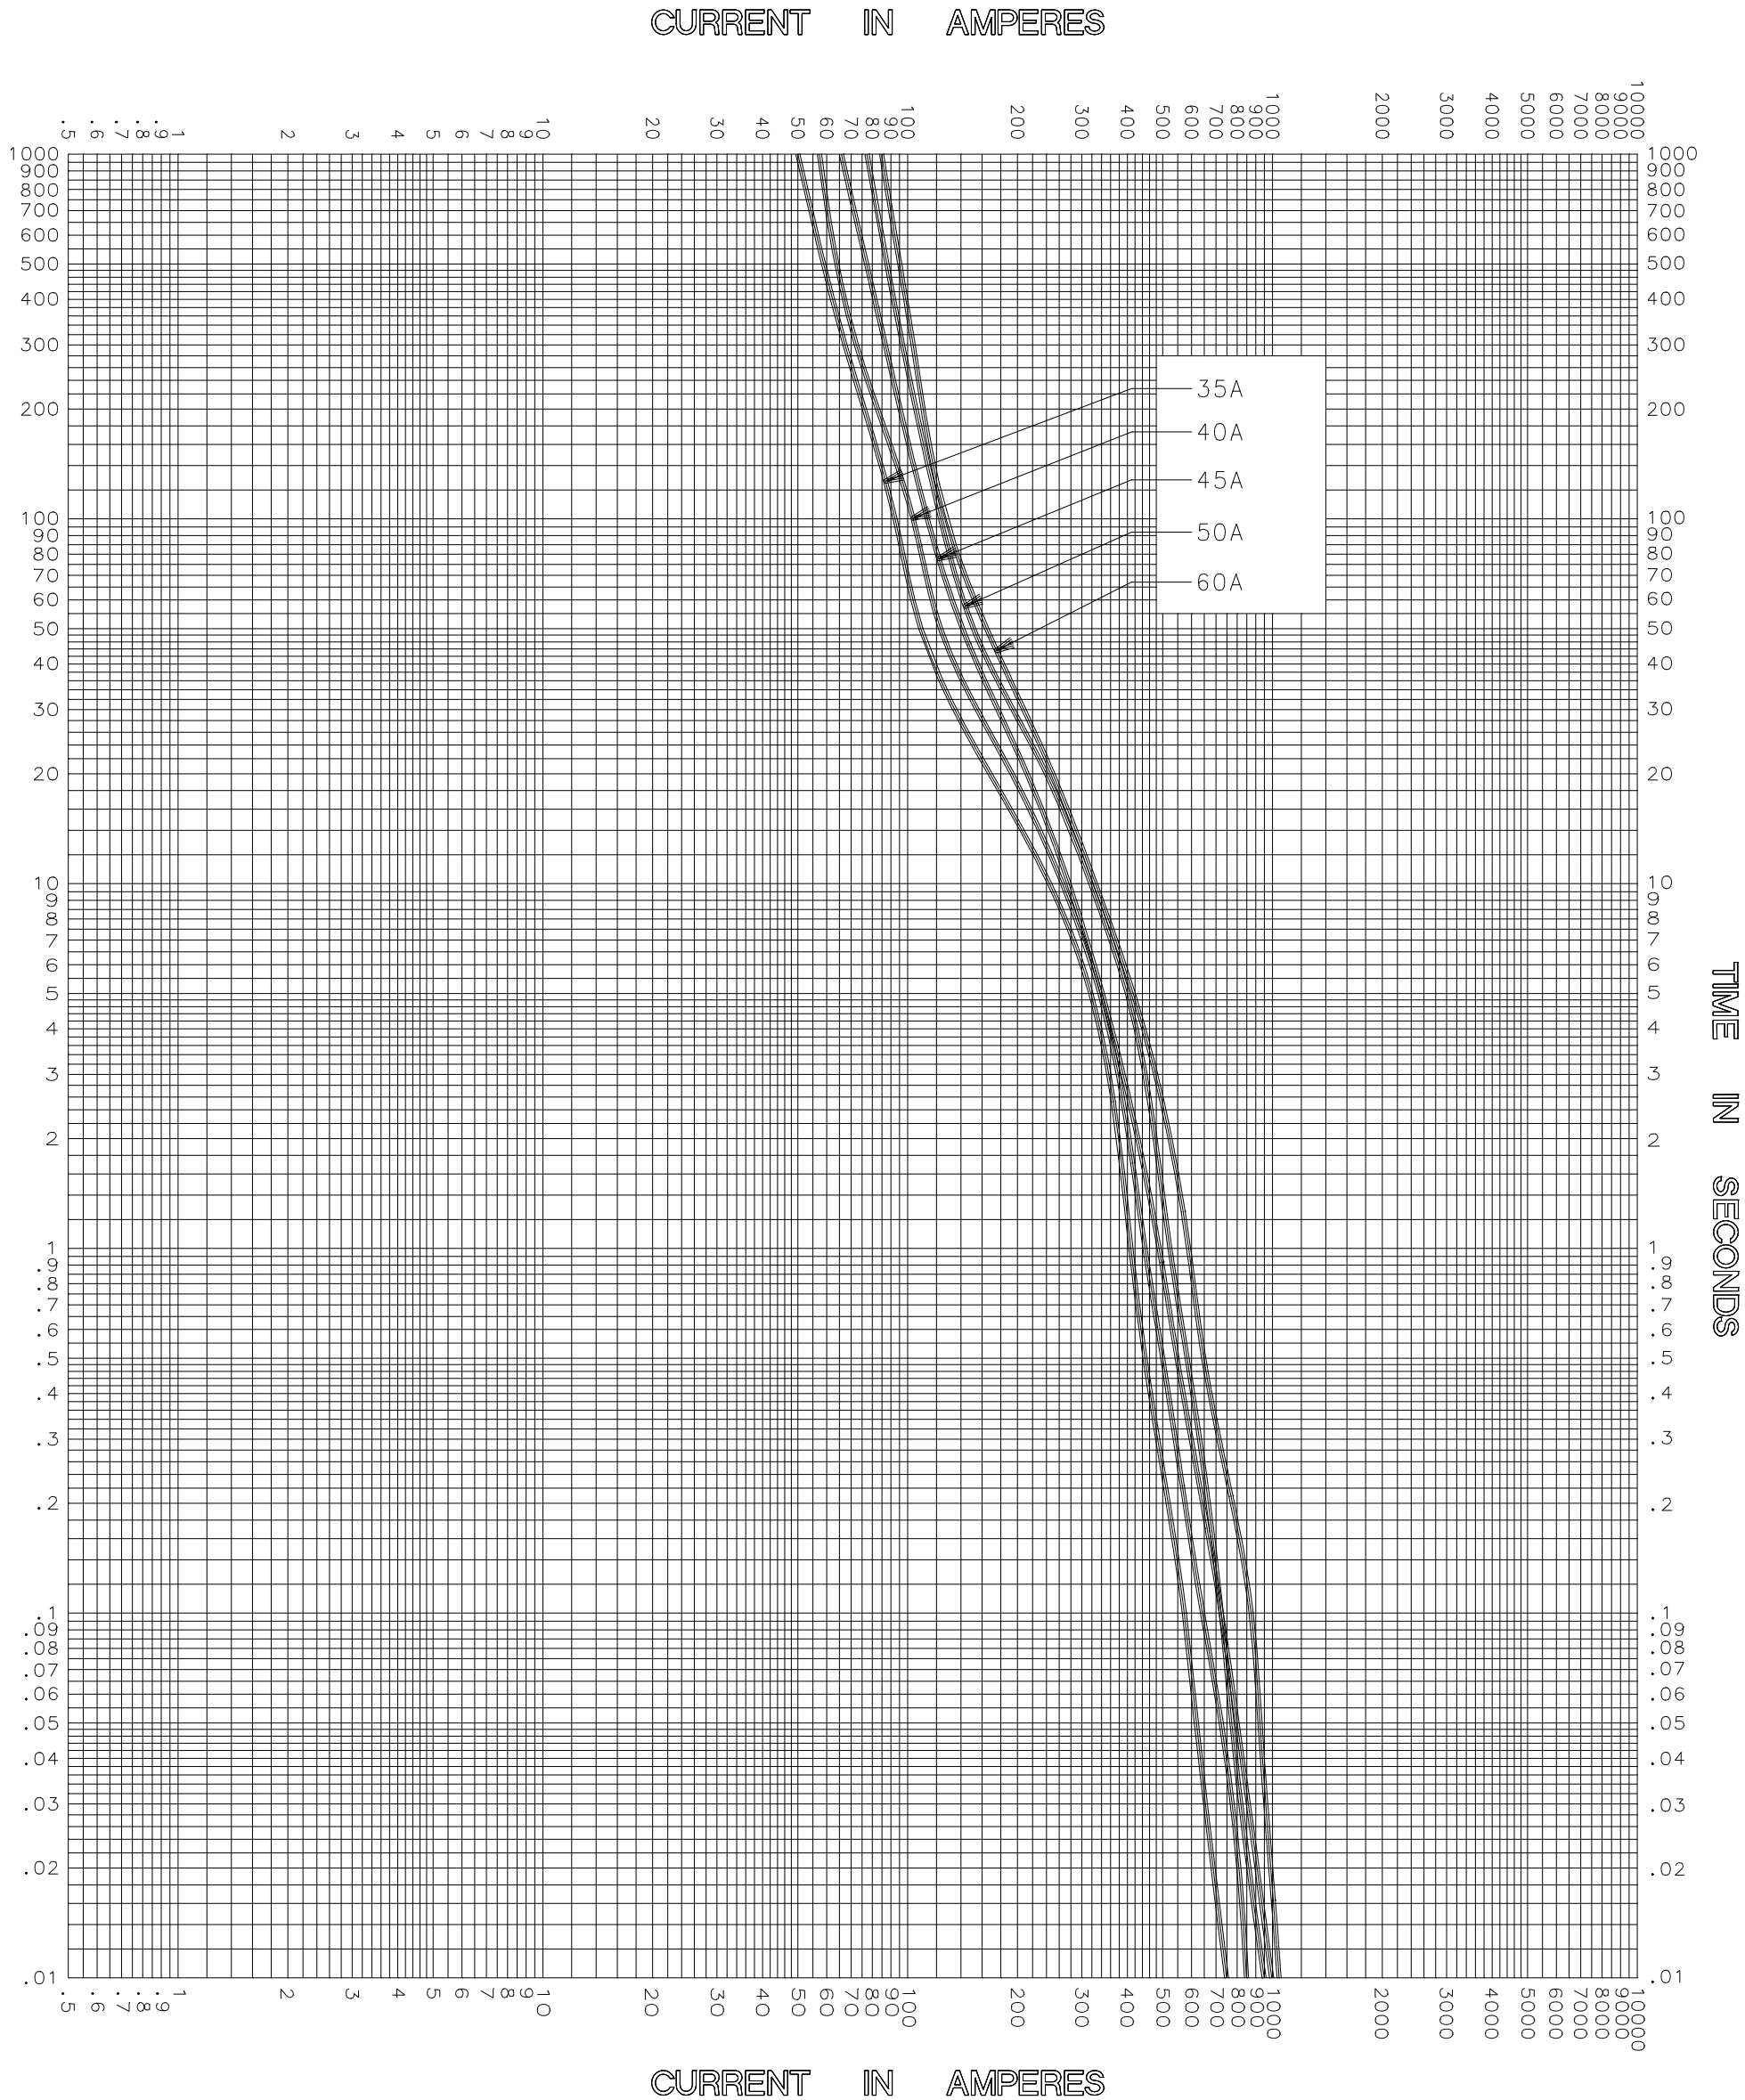


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER JTD (35A - 60A) ID _____
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>01/07/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. A-FCC01-JTDID-005

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

TIME IN SECONDS

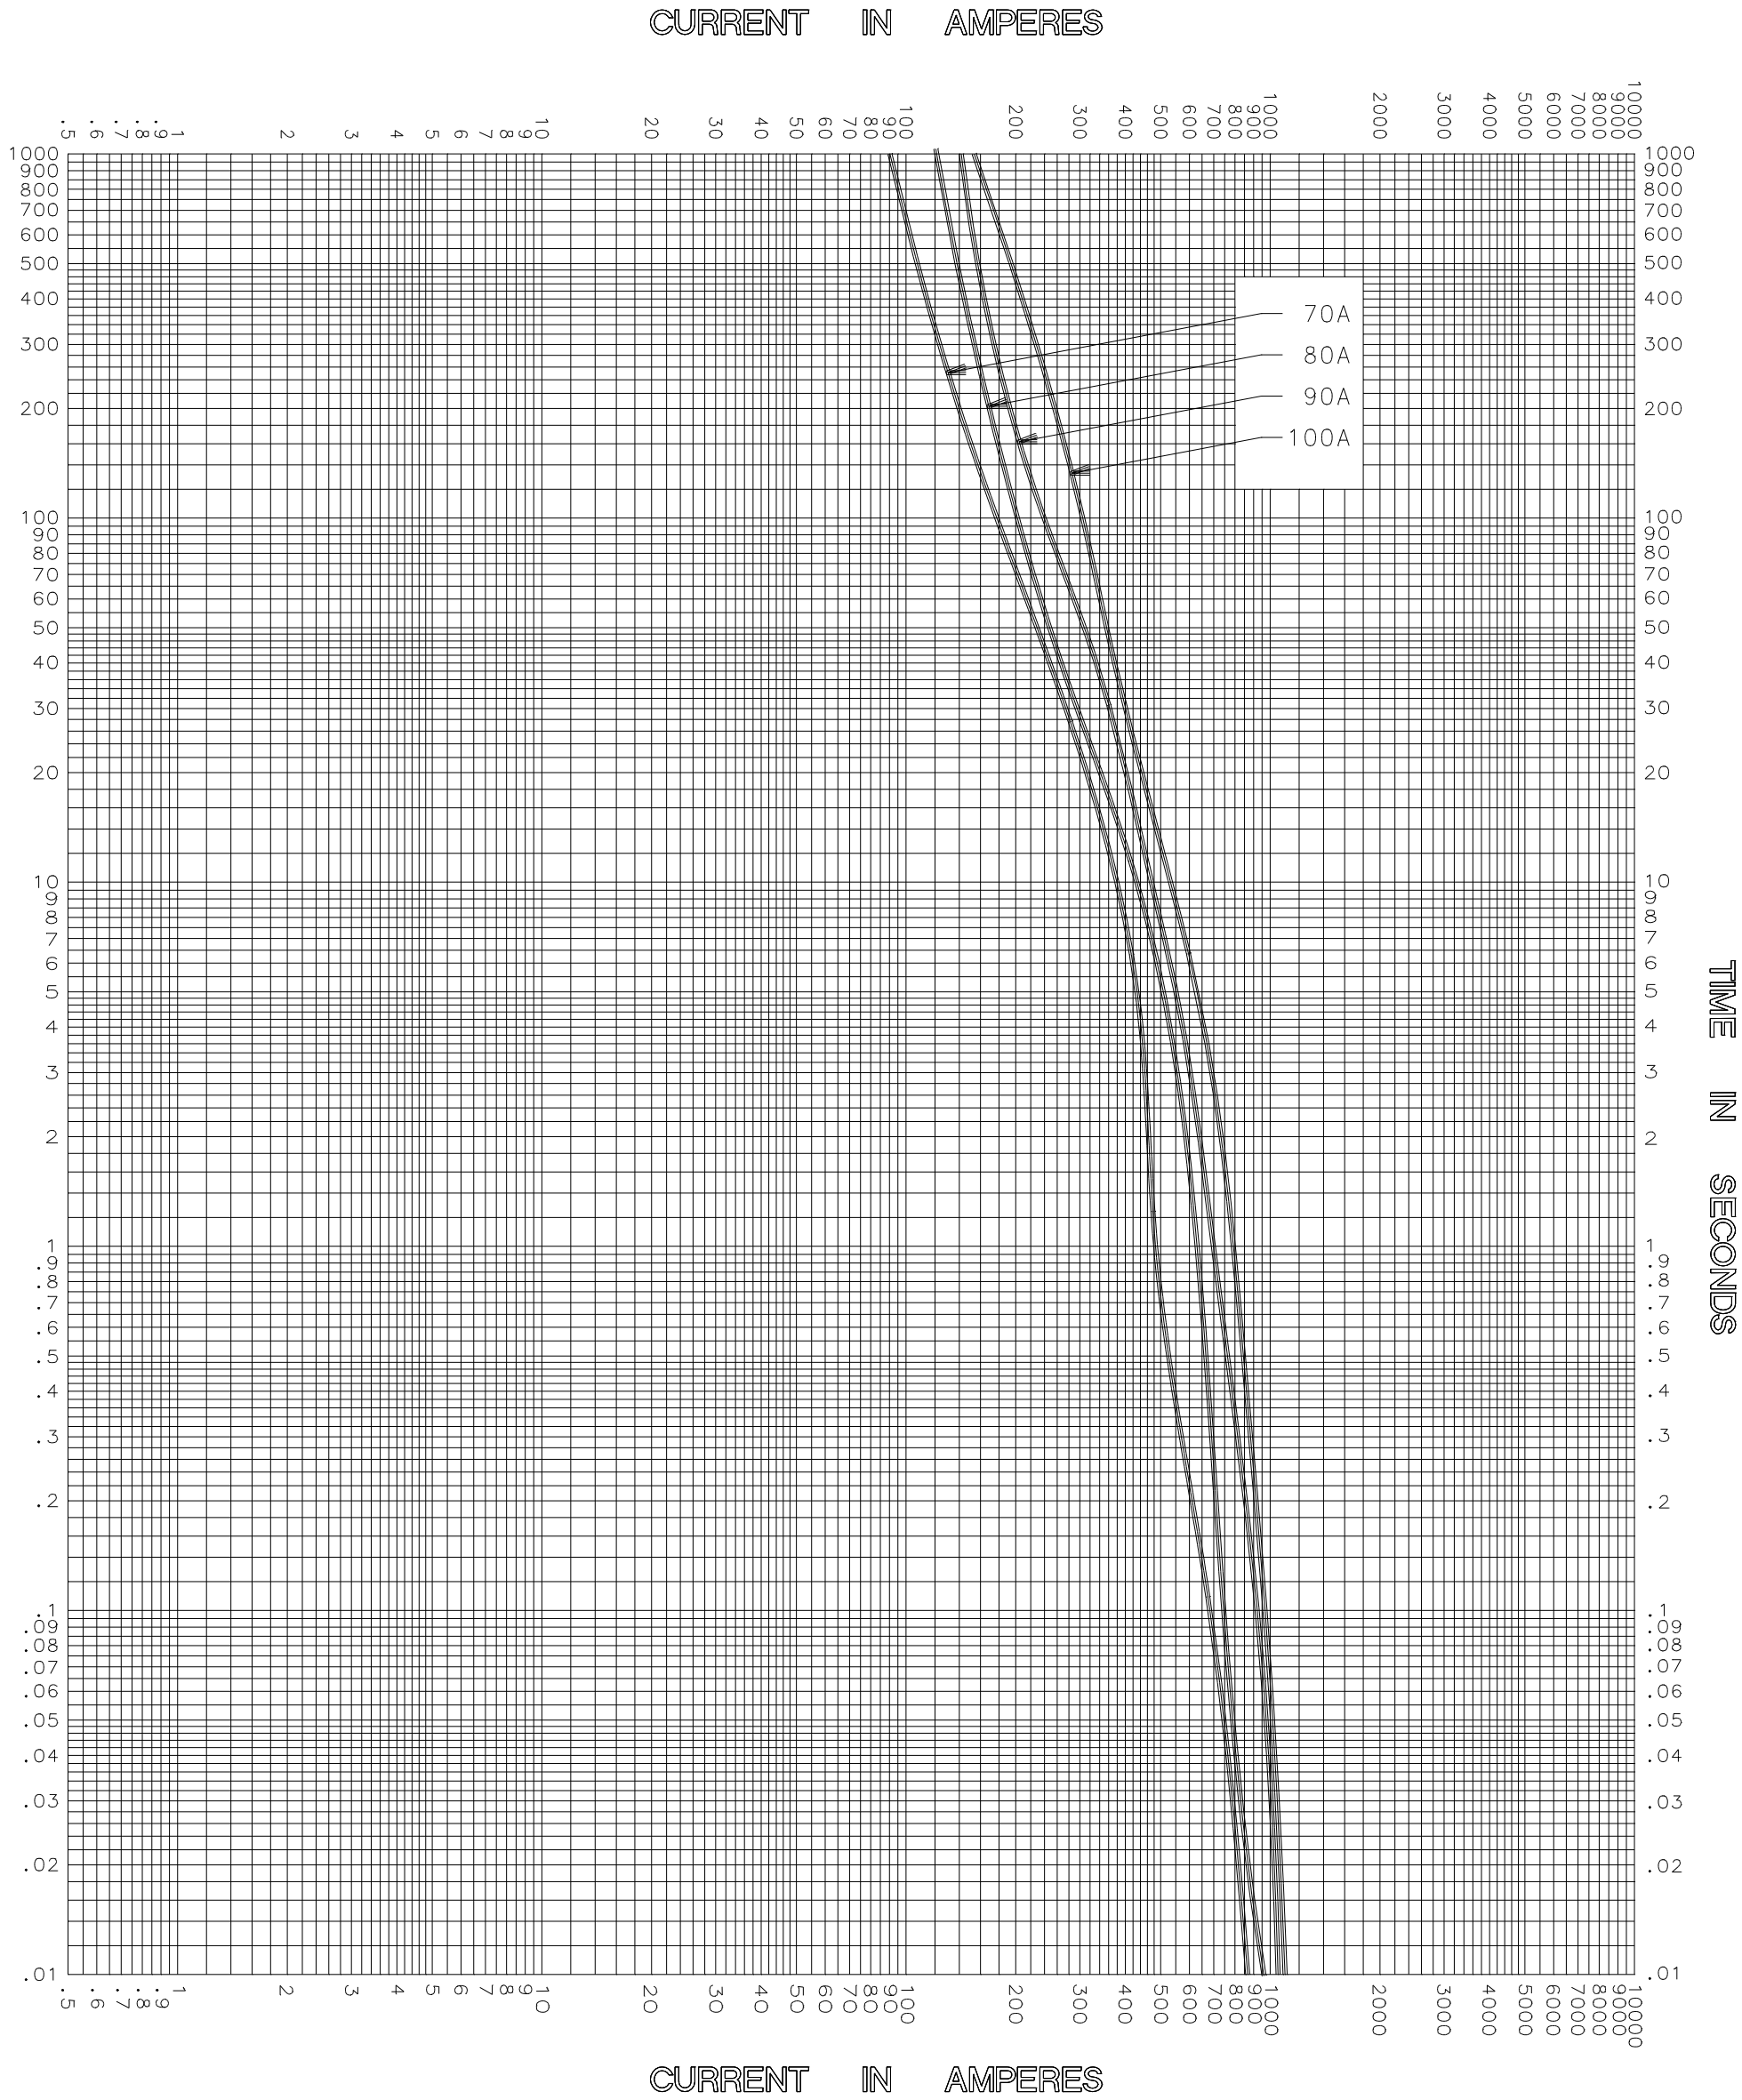

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
JTD (70A - 100A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01 01/06

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

TIME IN SECONDS

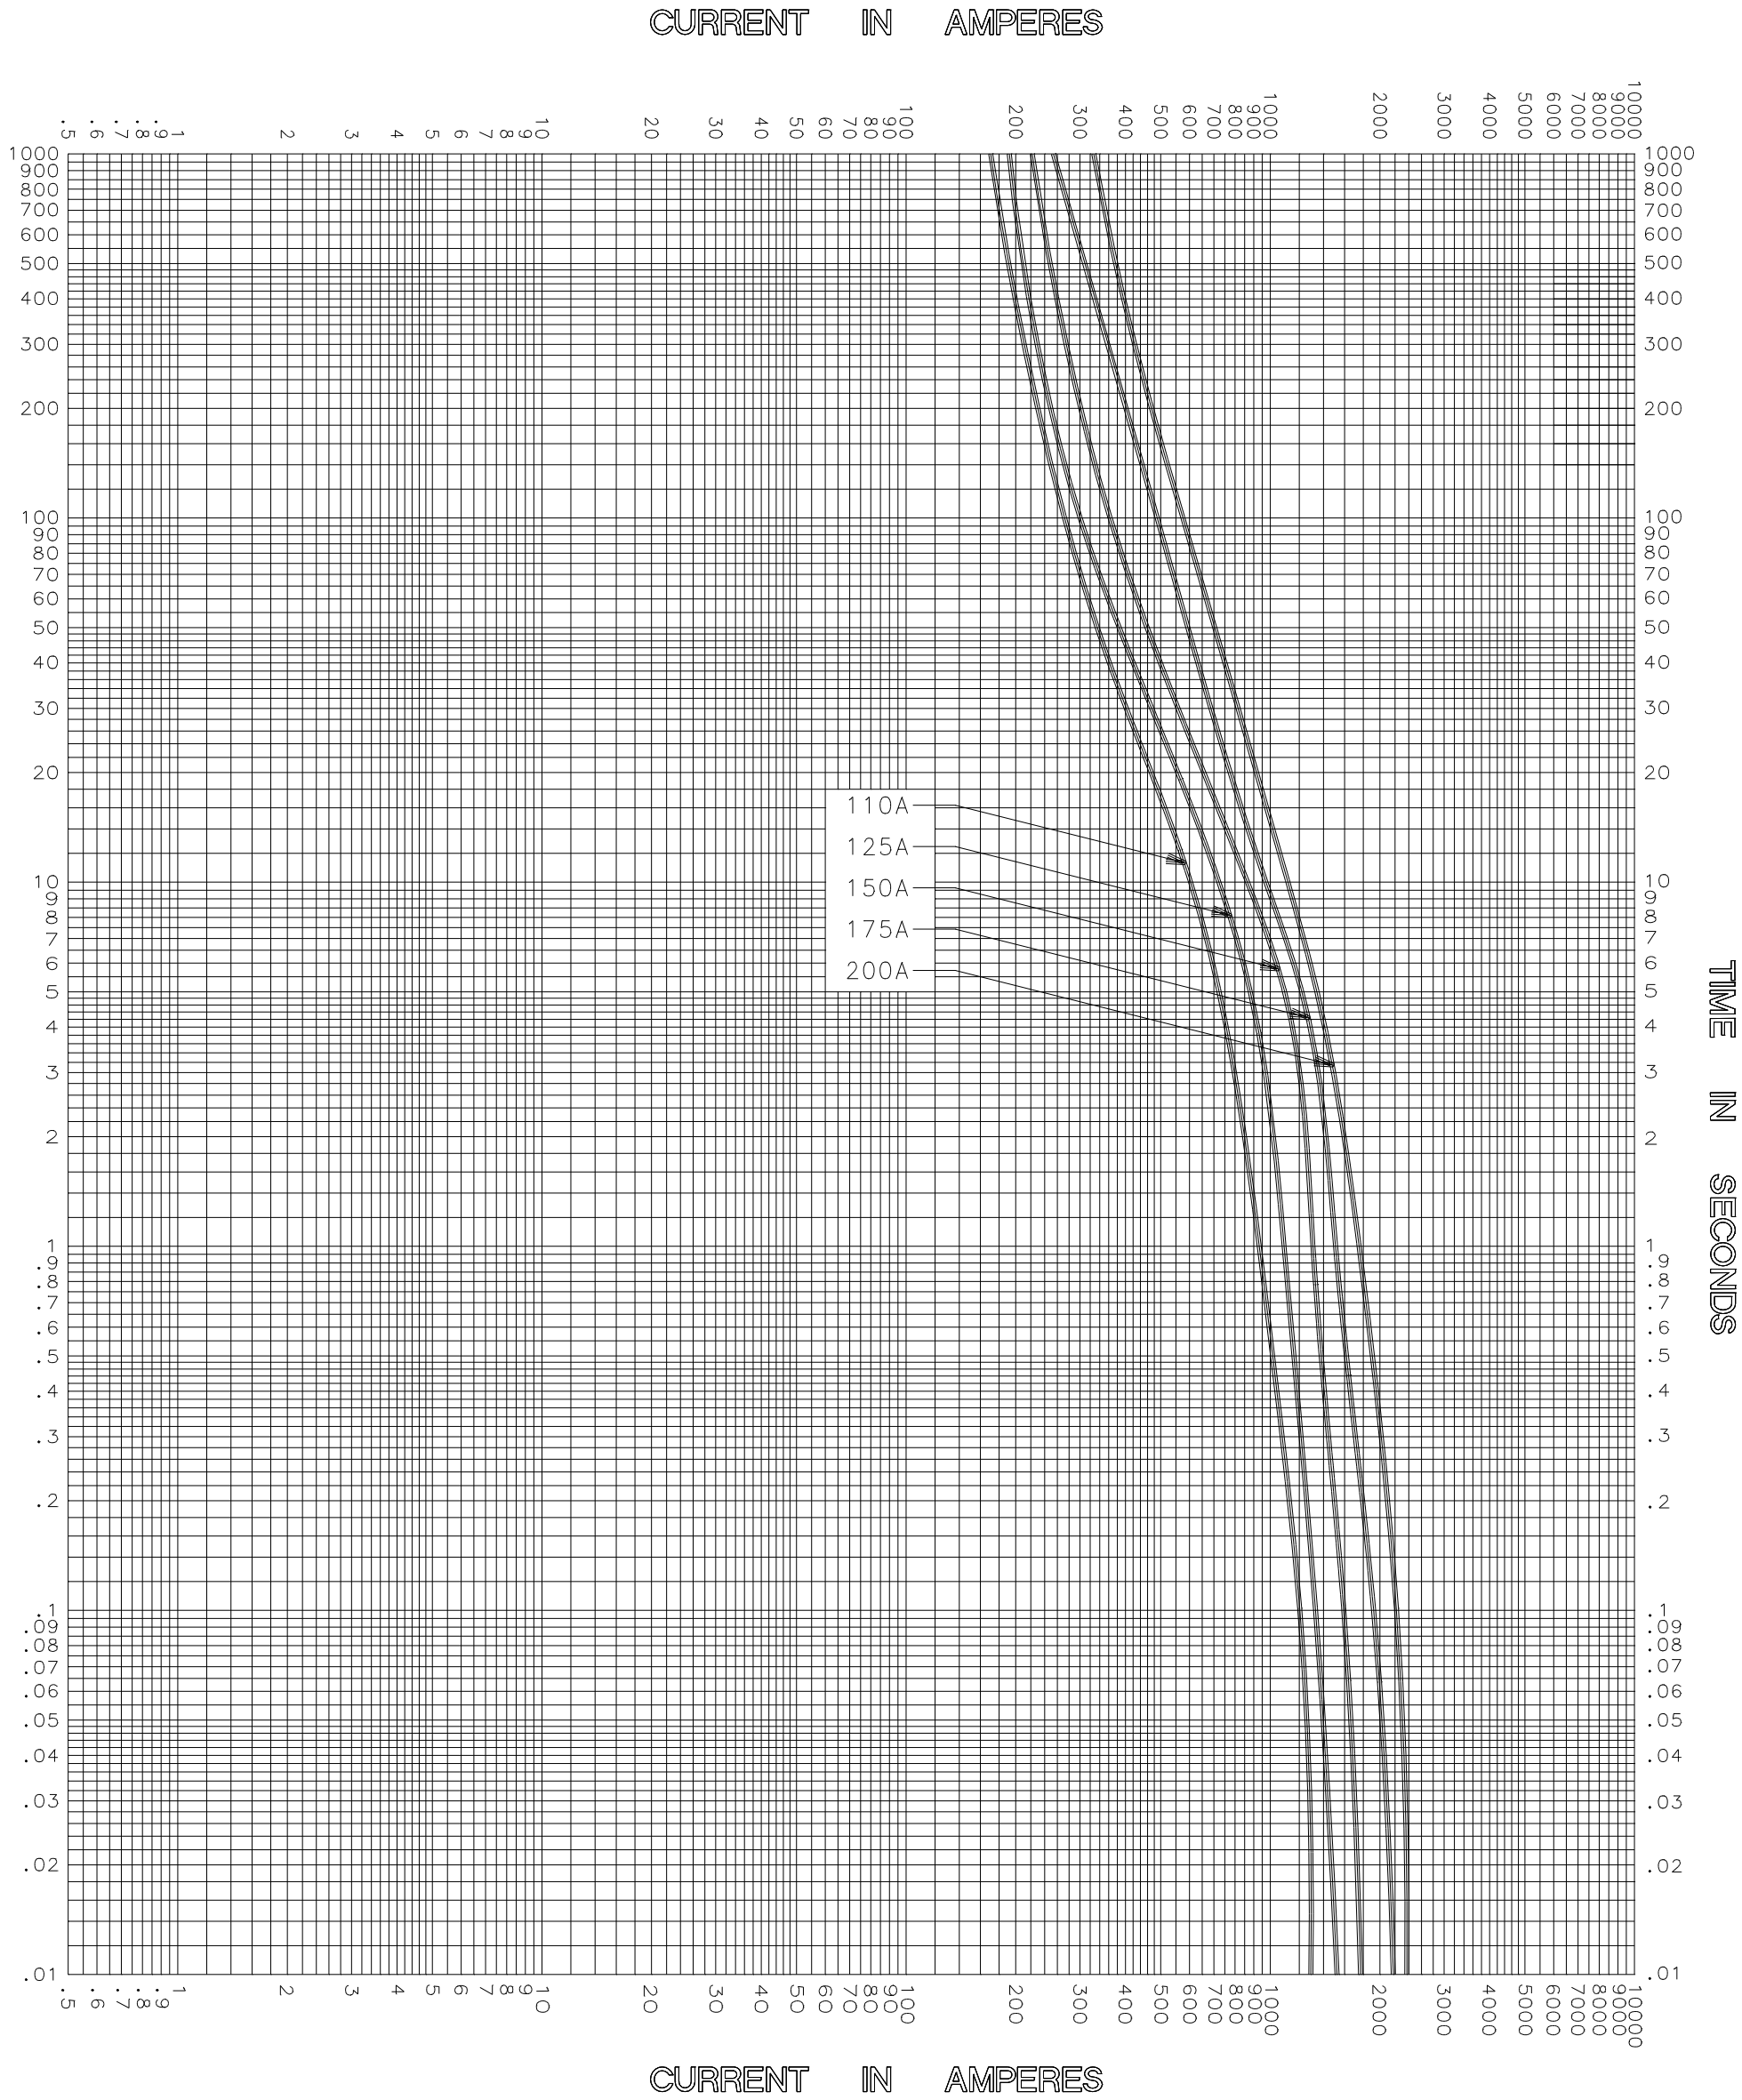

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
JTD (110A -200A) ID



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-JTDID-007

-THIS DATA GENERATED ON CAD-


TIME IN SECONDS

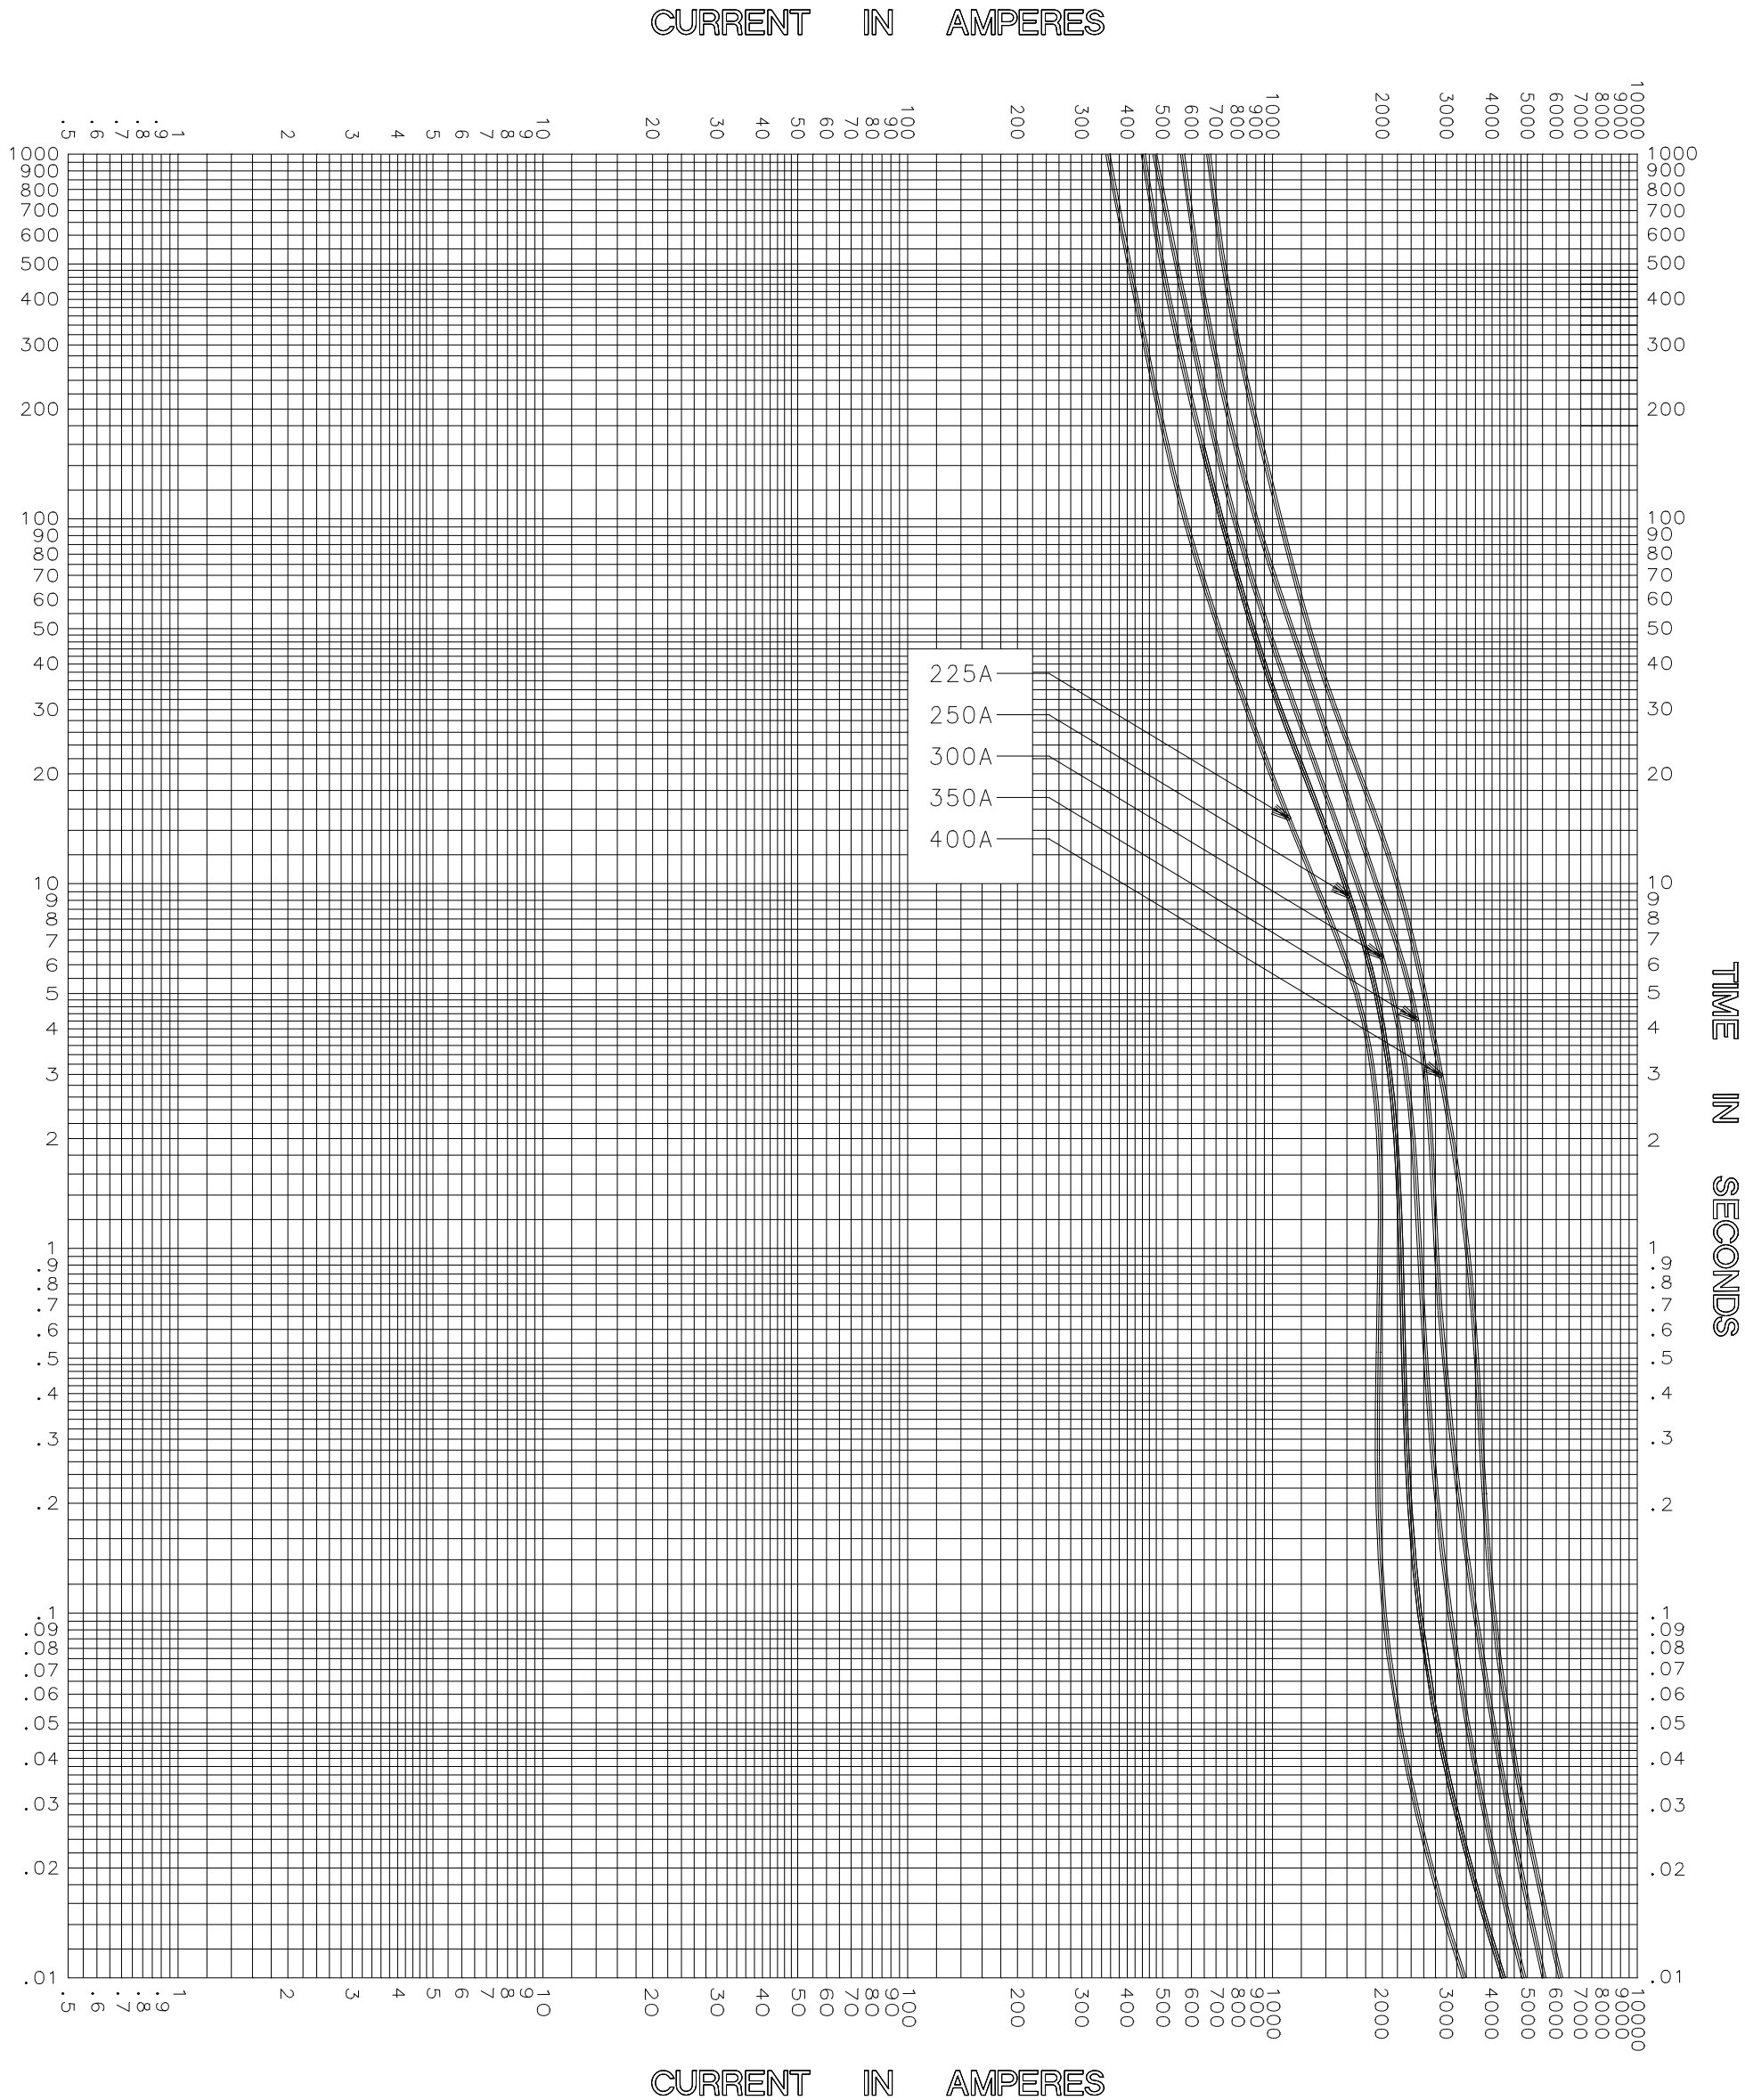

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER JTD (225A - 400A) ID _____
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>01/07/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. A-FCC01-JTDID-008

TIME CURRENT CHARACTERISTIC CURVES

TIME IN SECONDS

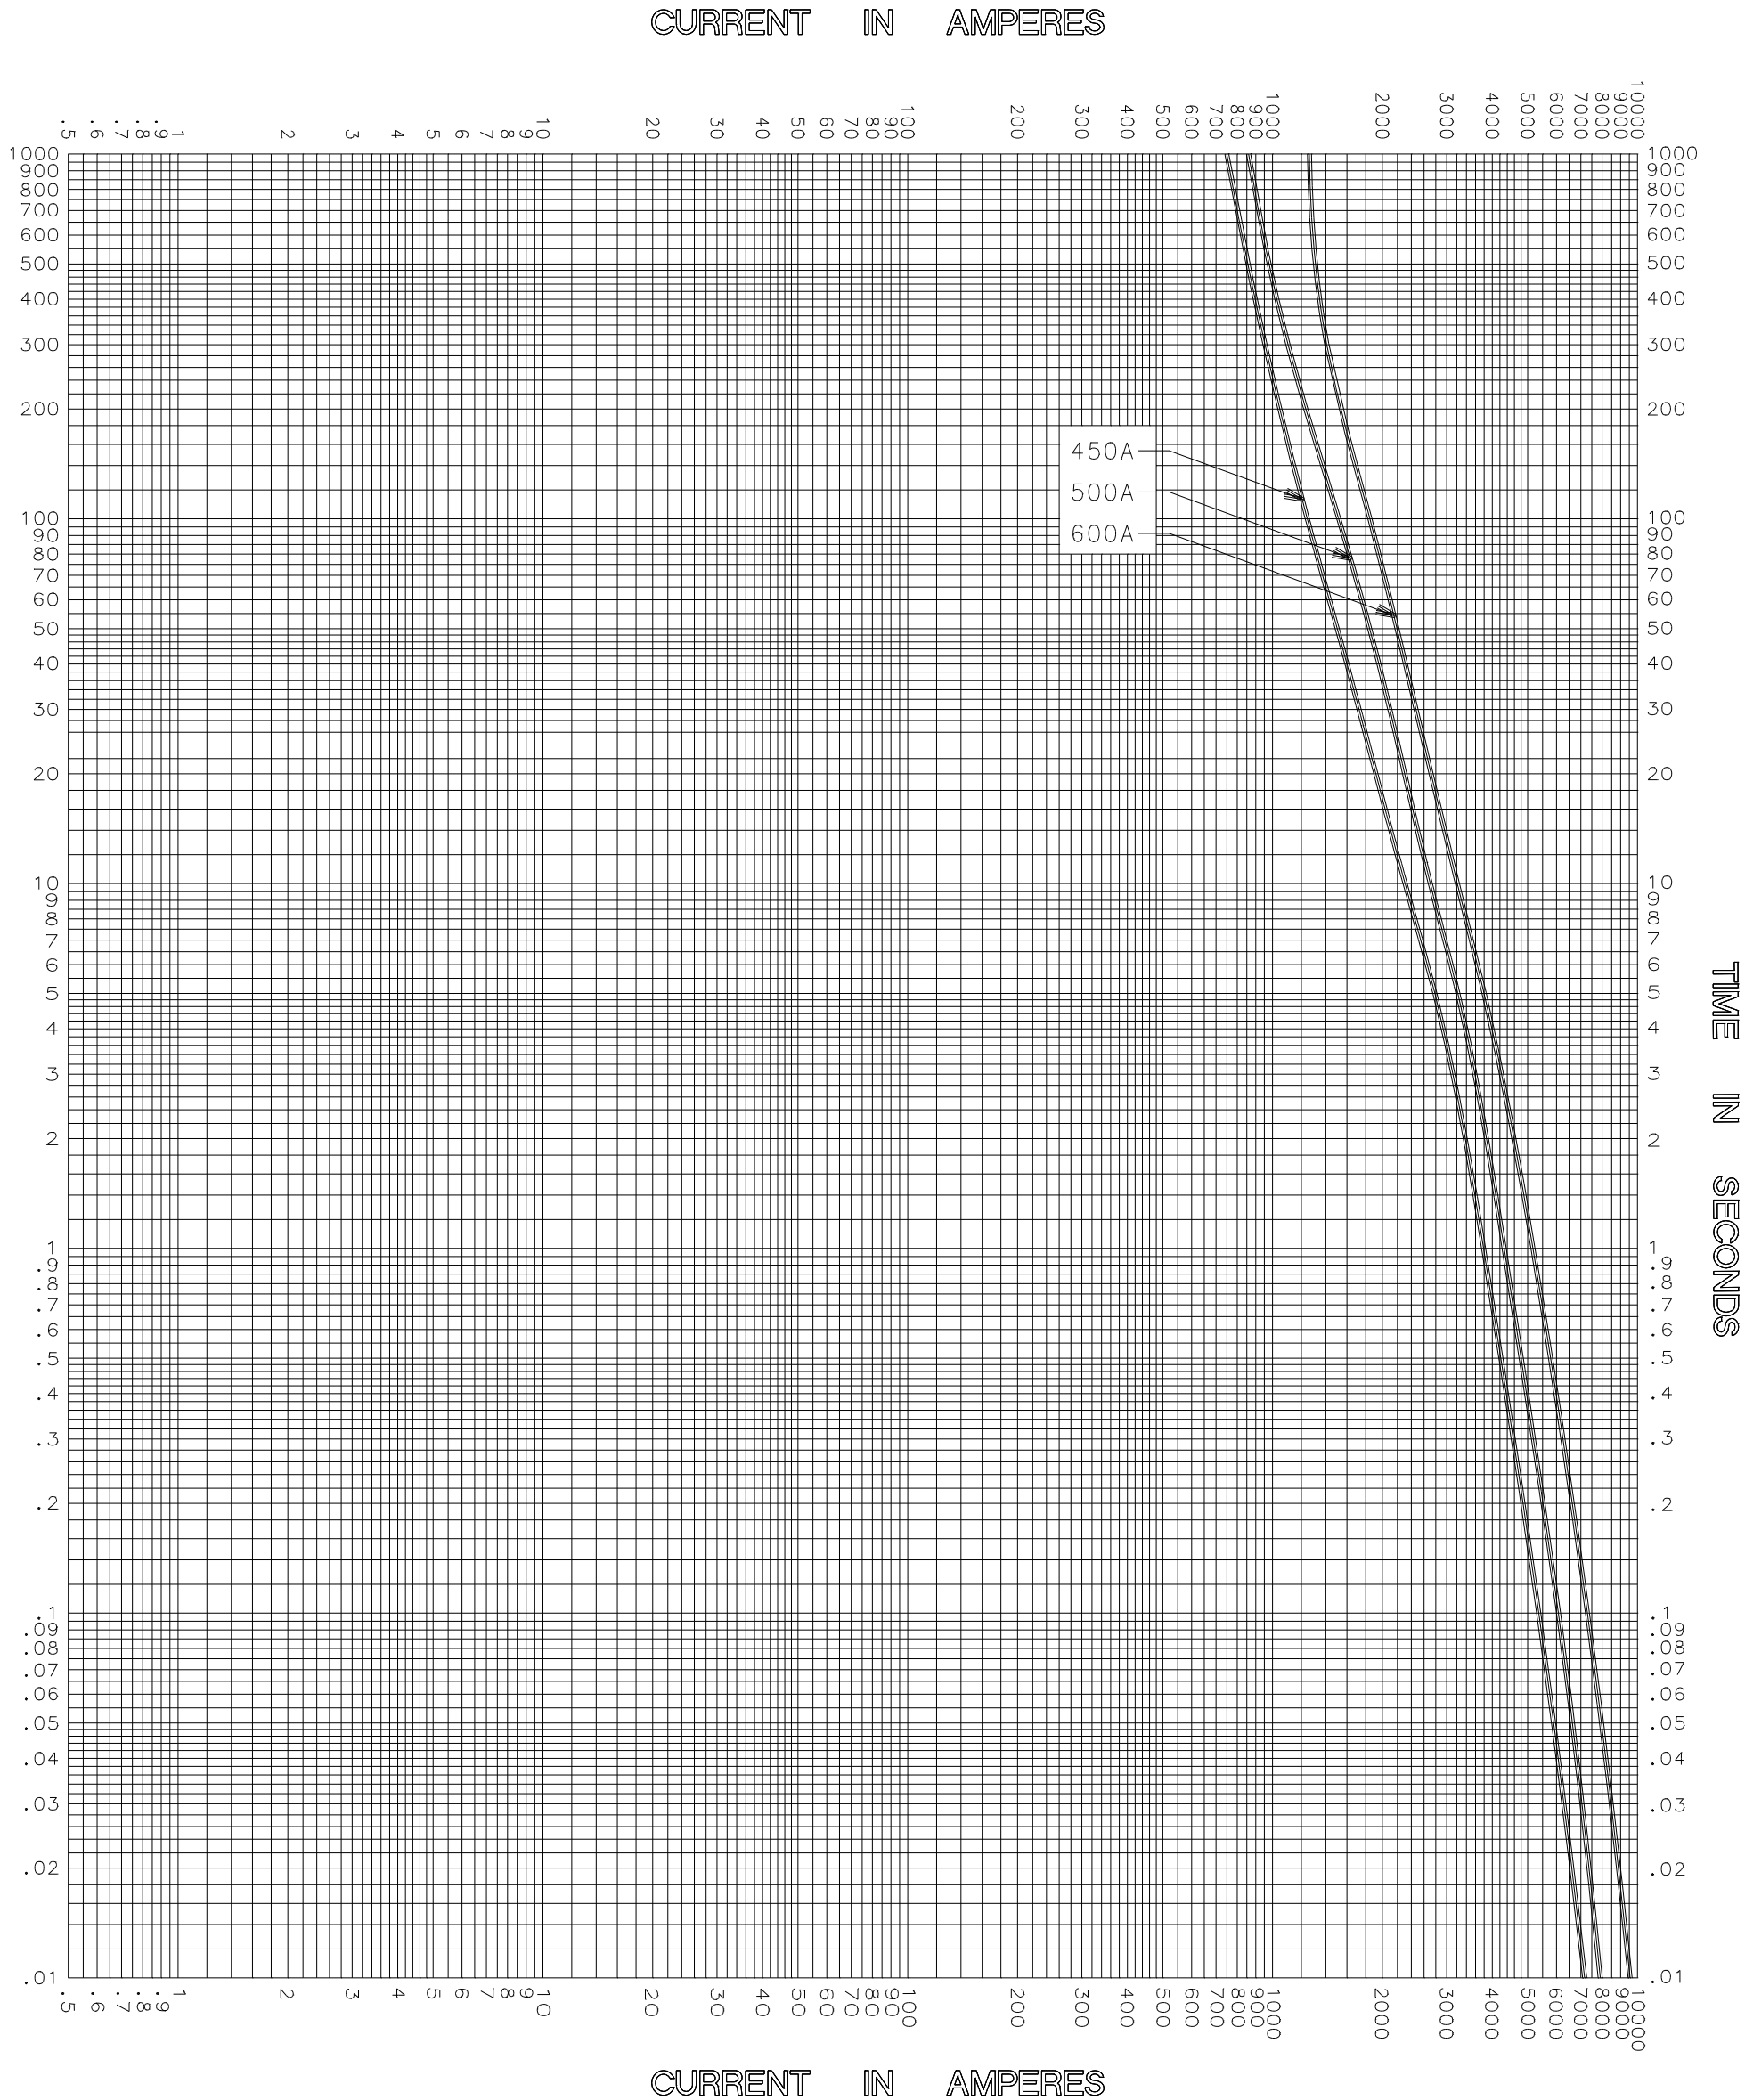

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
JTD (450A - 600A) ID



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-JTDID-009

-THIS DATA GENERATED ON CAD-