


CURRENT IN AMPERES

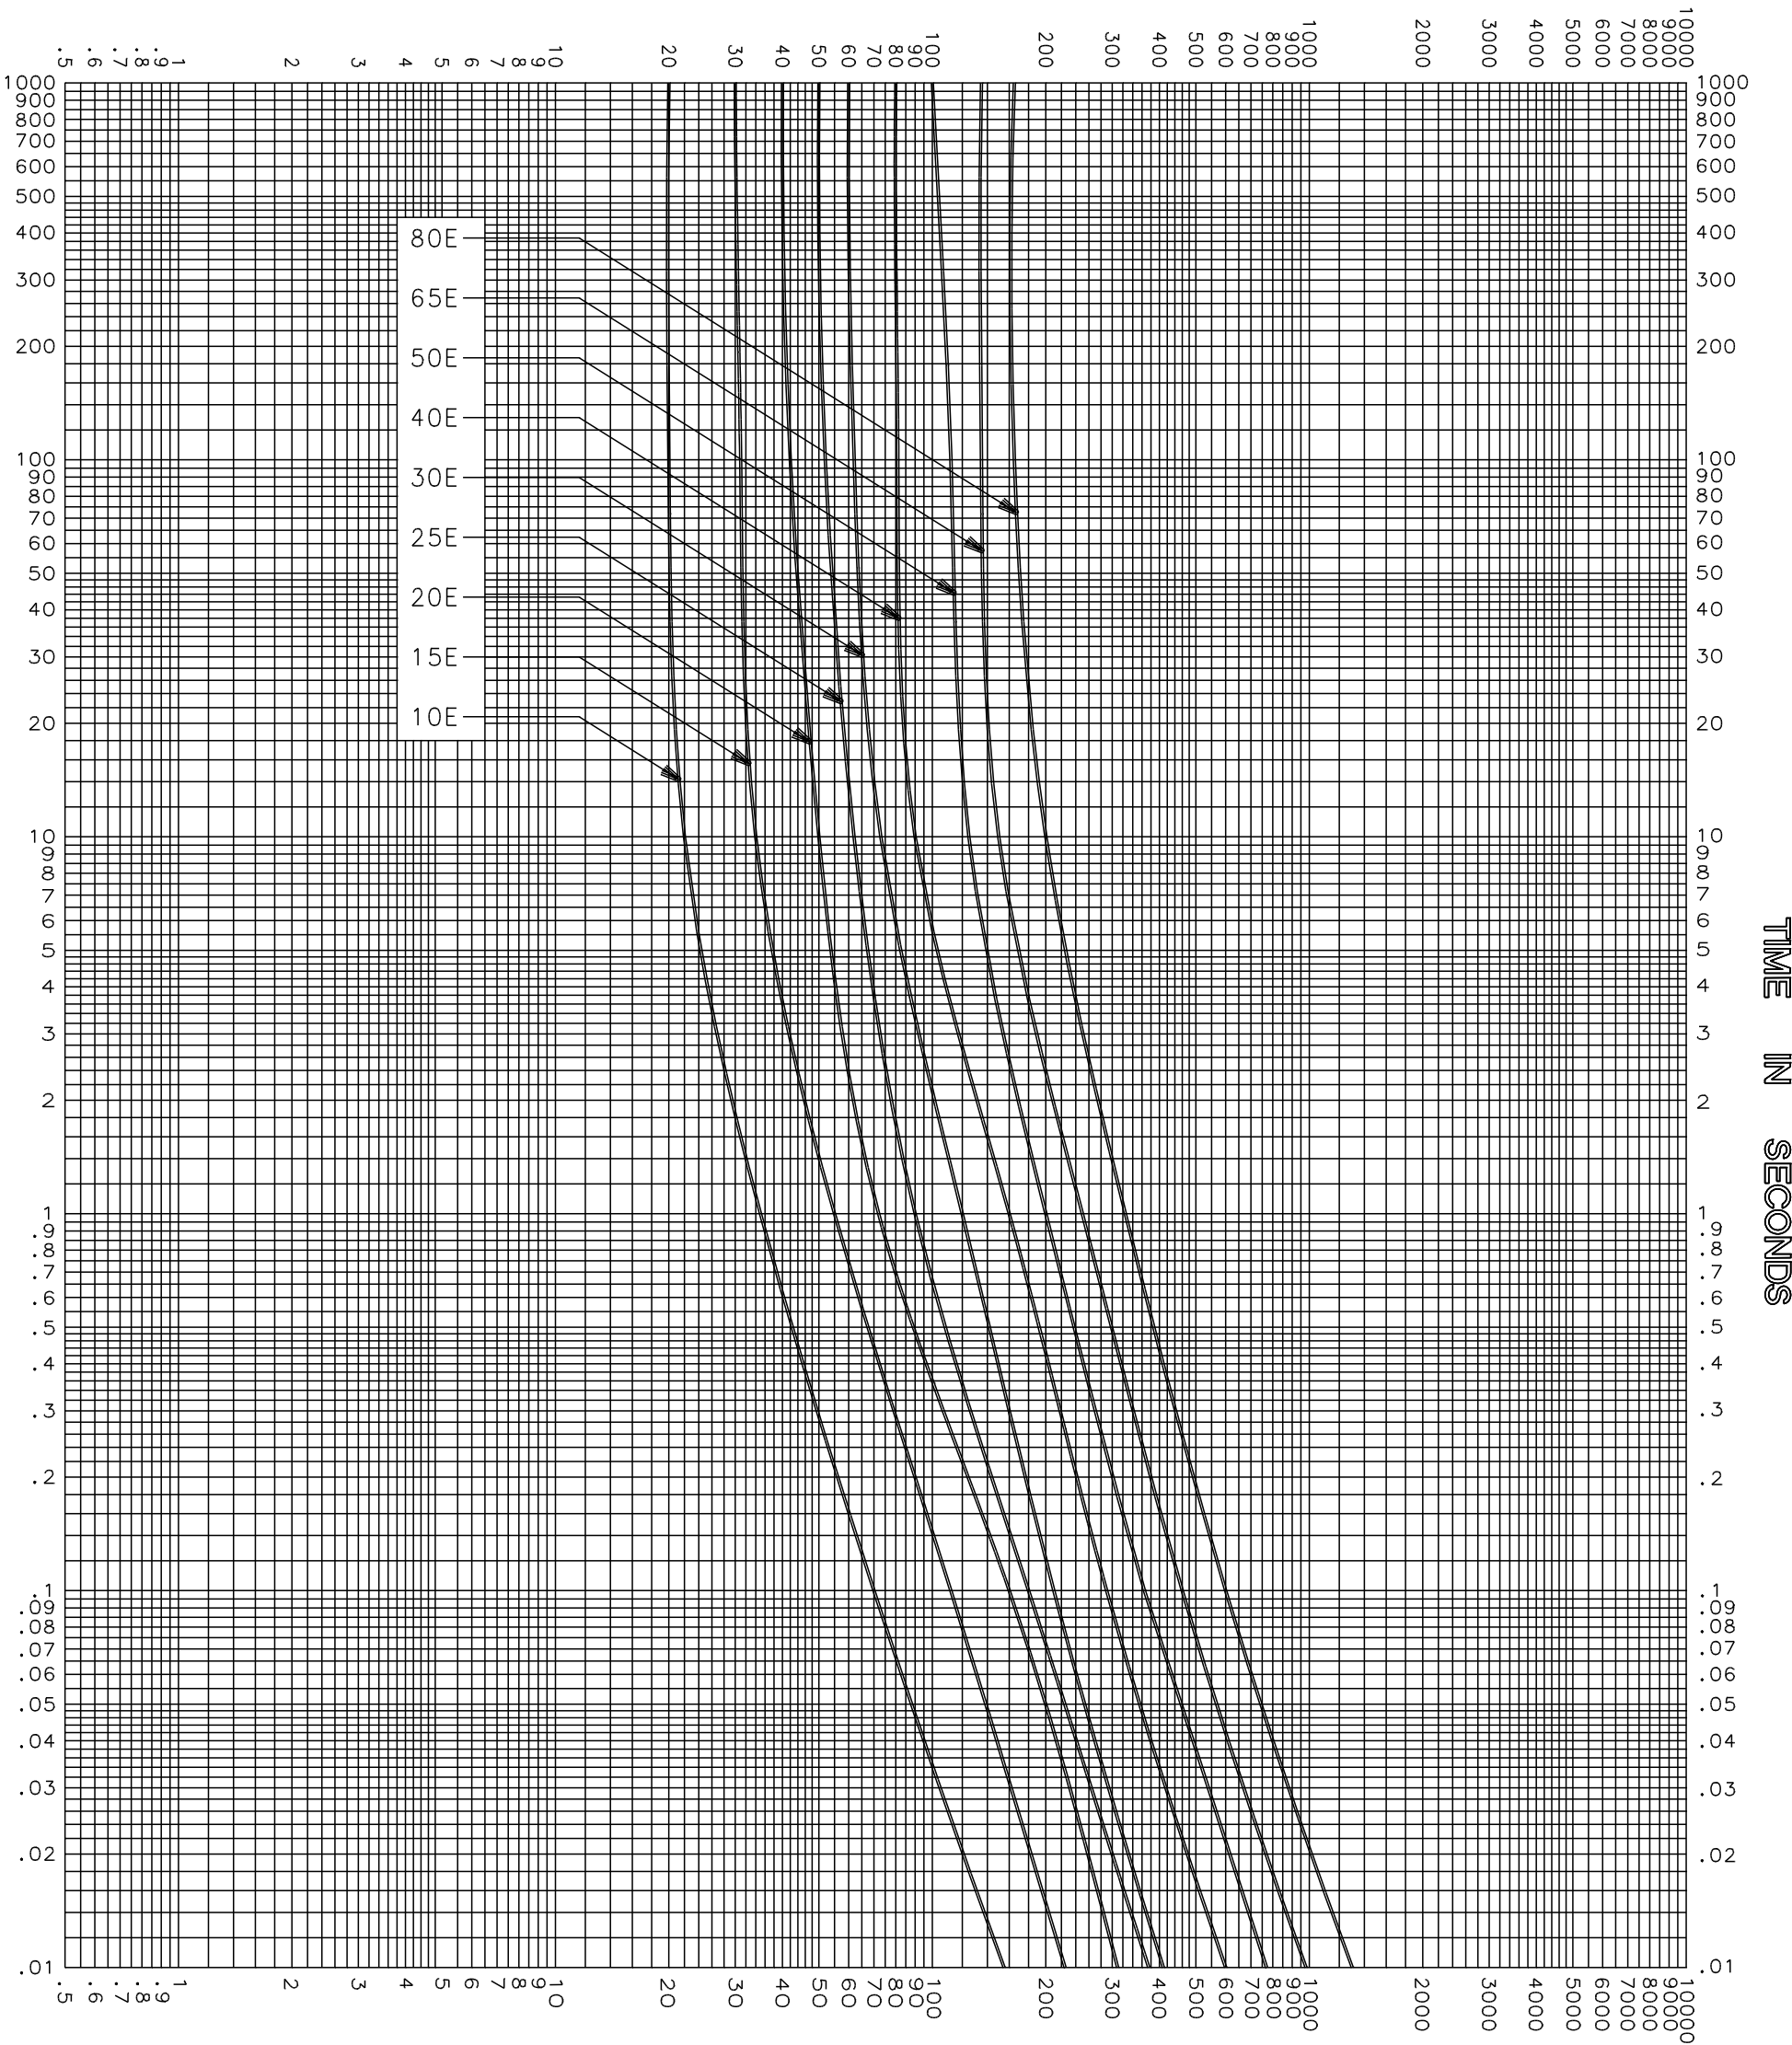

CURRENT IN AMPERES

MELTING TIME CHARACTERISTICS

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 15.5kV E-RATED 10E-80E
BASIS FOR DATA _____		

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 04/26/04
	CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC03 5001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT