


CURRENT IN AMPERES



CURRENT IN AMPERES

| | |
|---|---------------------|
| TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER |
| BASIS FOR DATA _____ | SLC (1/2A - 8A) |

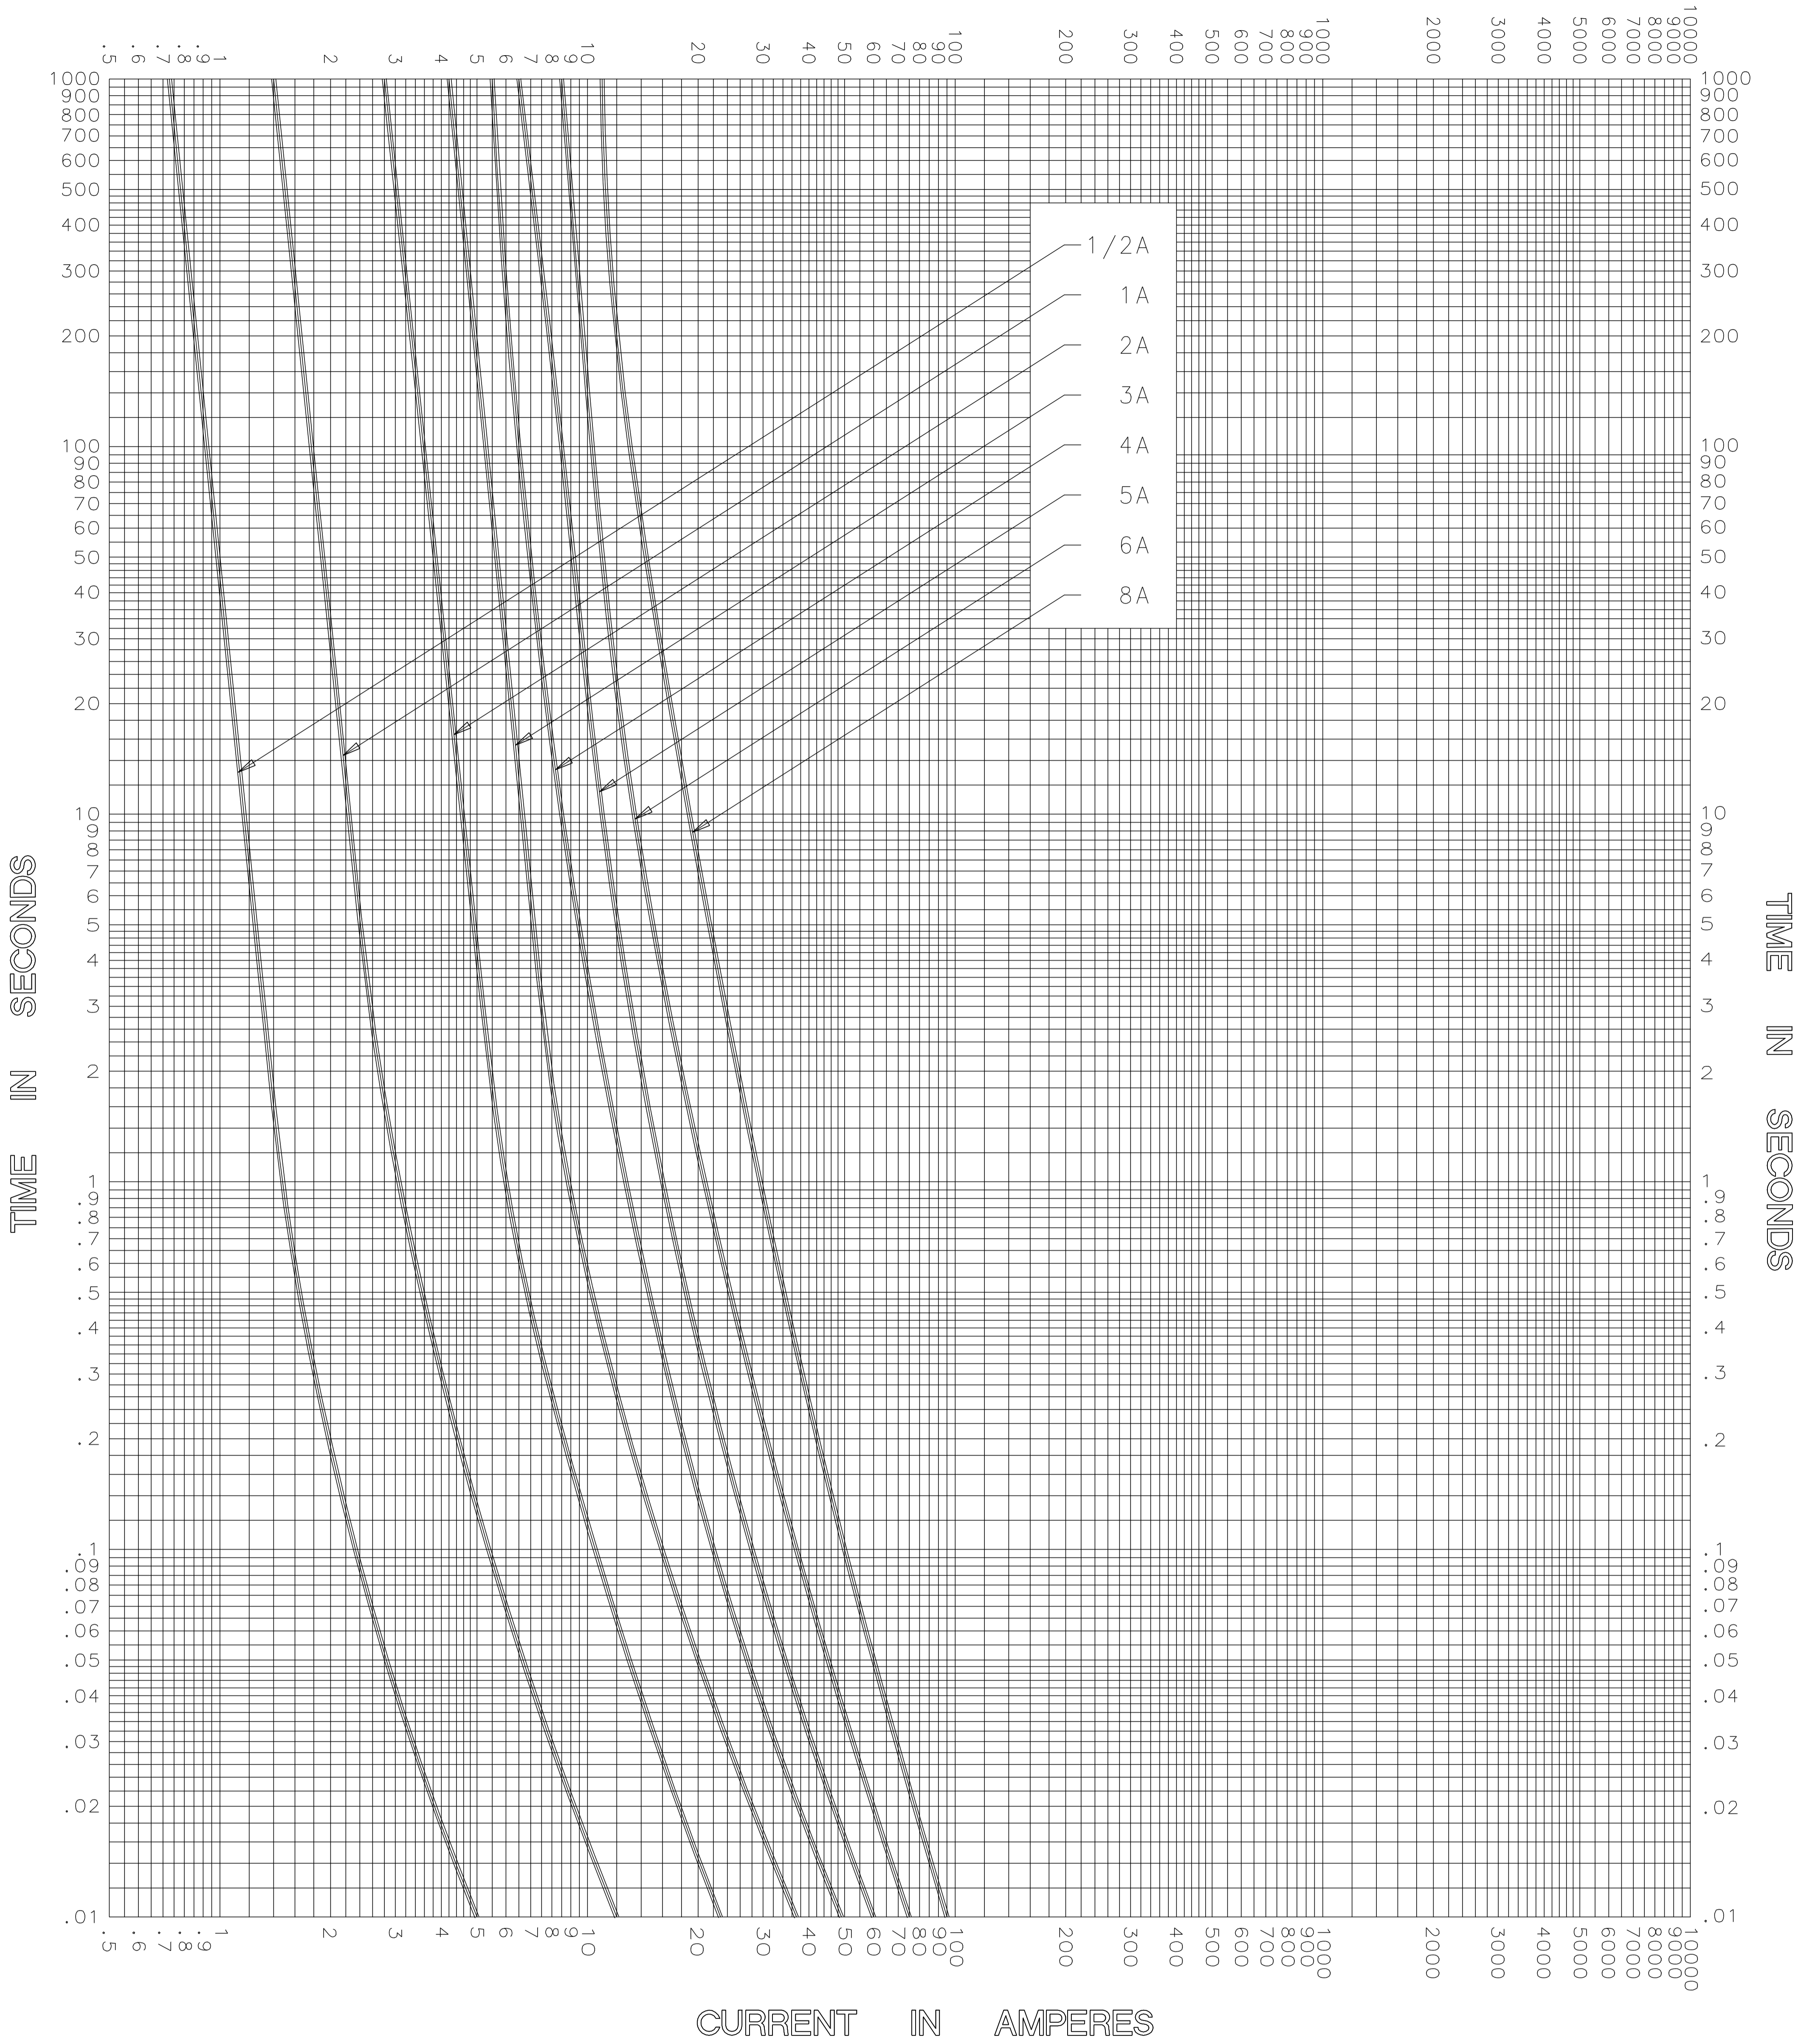

LITTELFUSE, INC.
DES PLAINES, ILL. USA


| | |
|-------------|-------------|
| DRAWN BY | MRD |
| DATE | 02/17/03 |
| CHECKED BY | TN |
| DRAWING NO. | B-FCC03-001 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

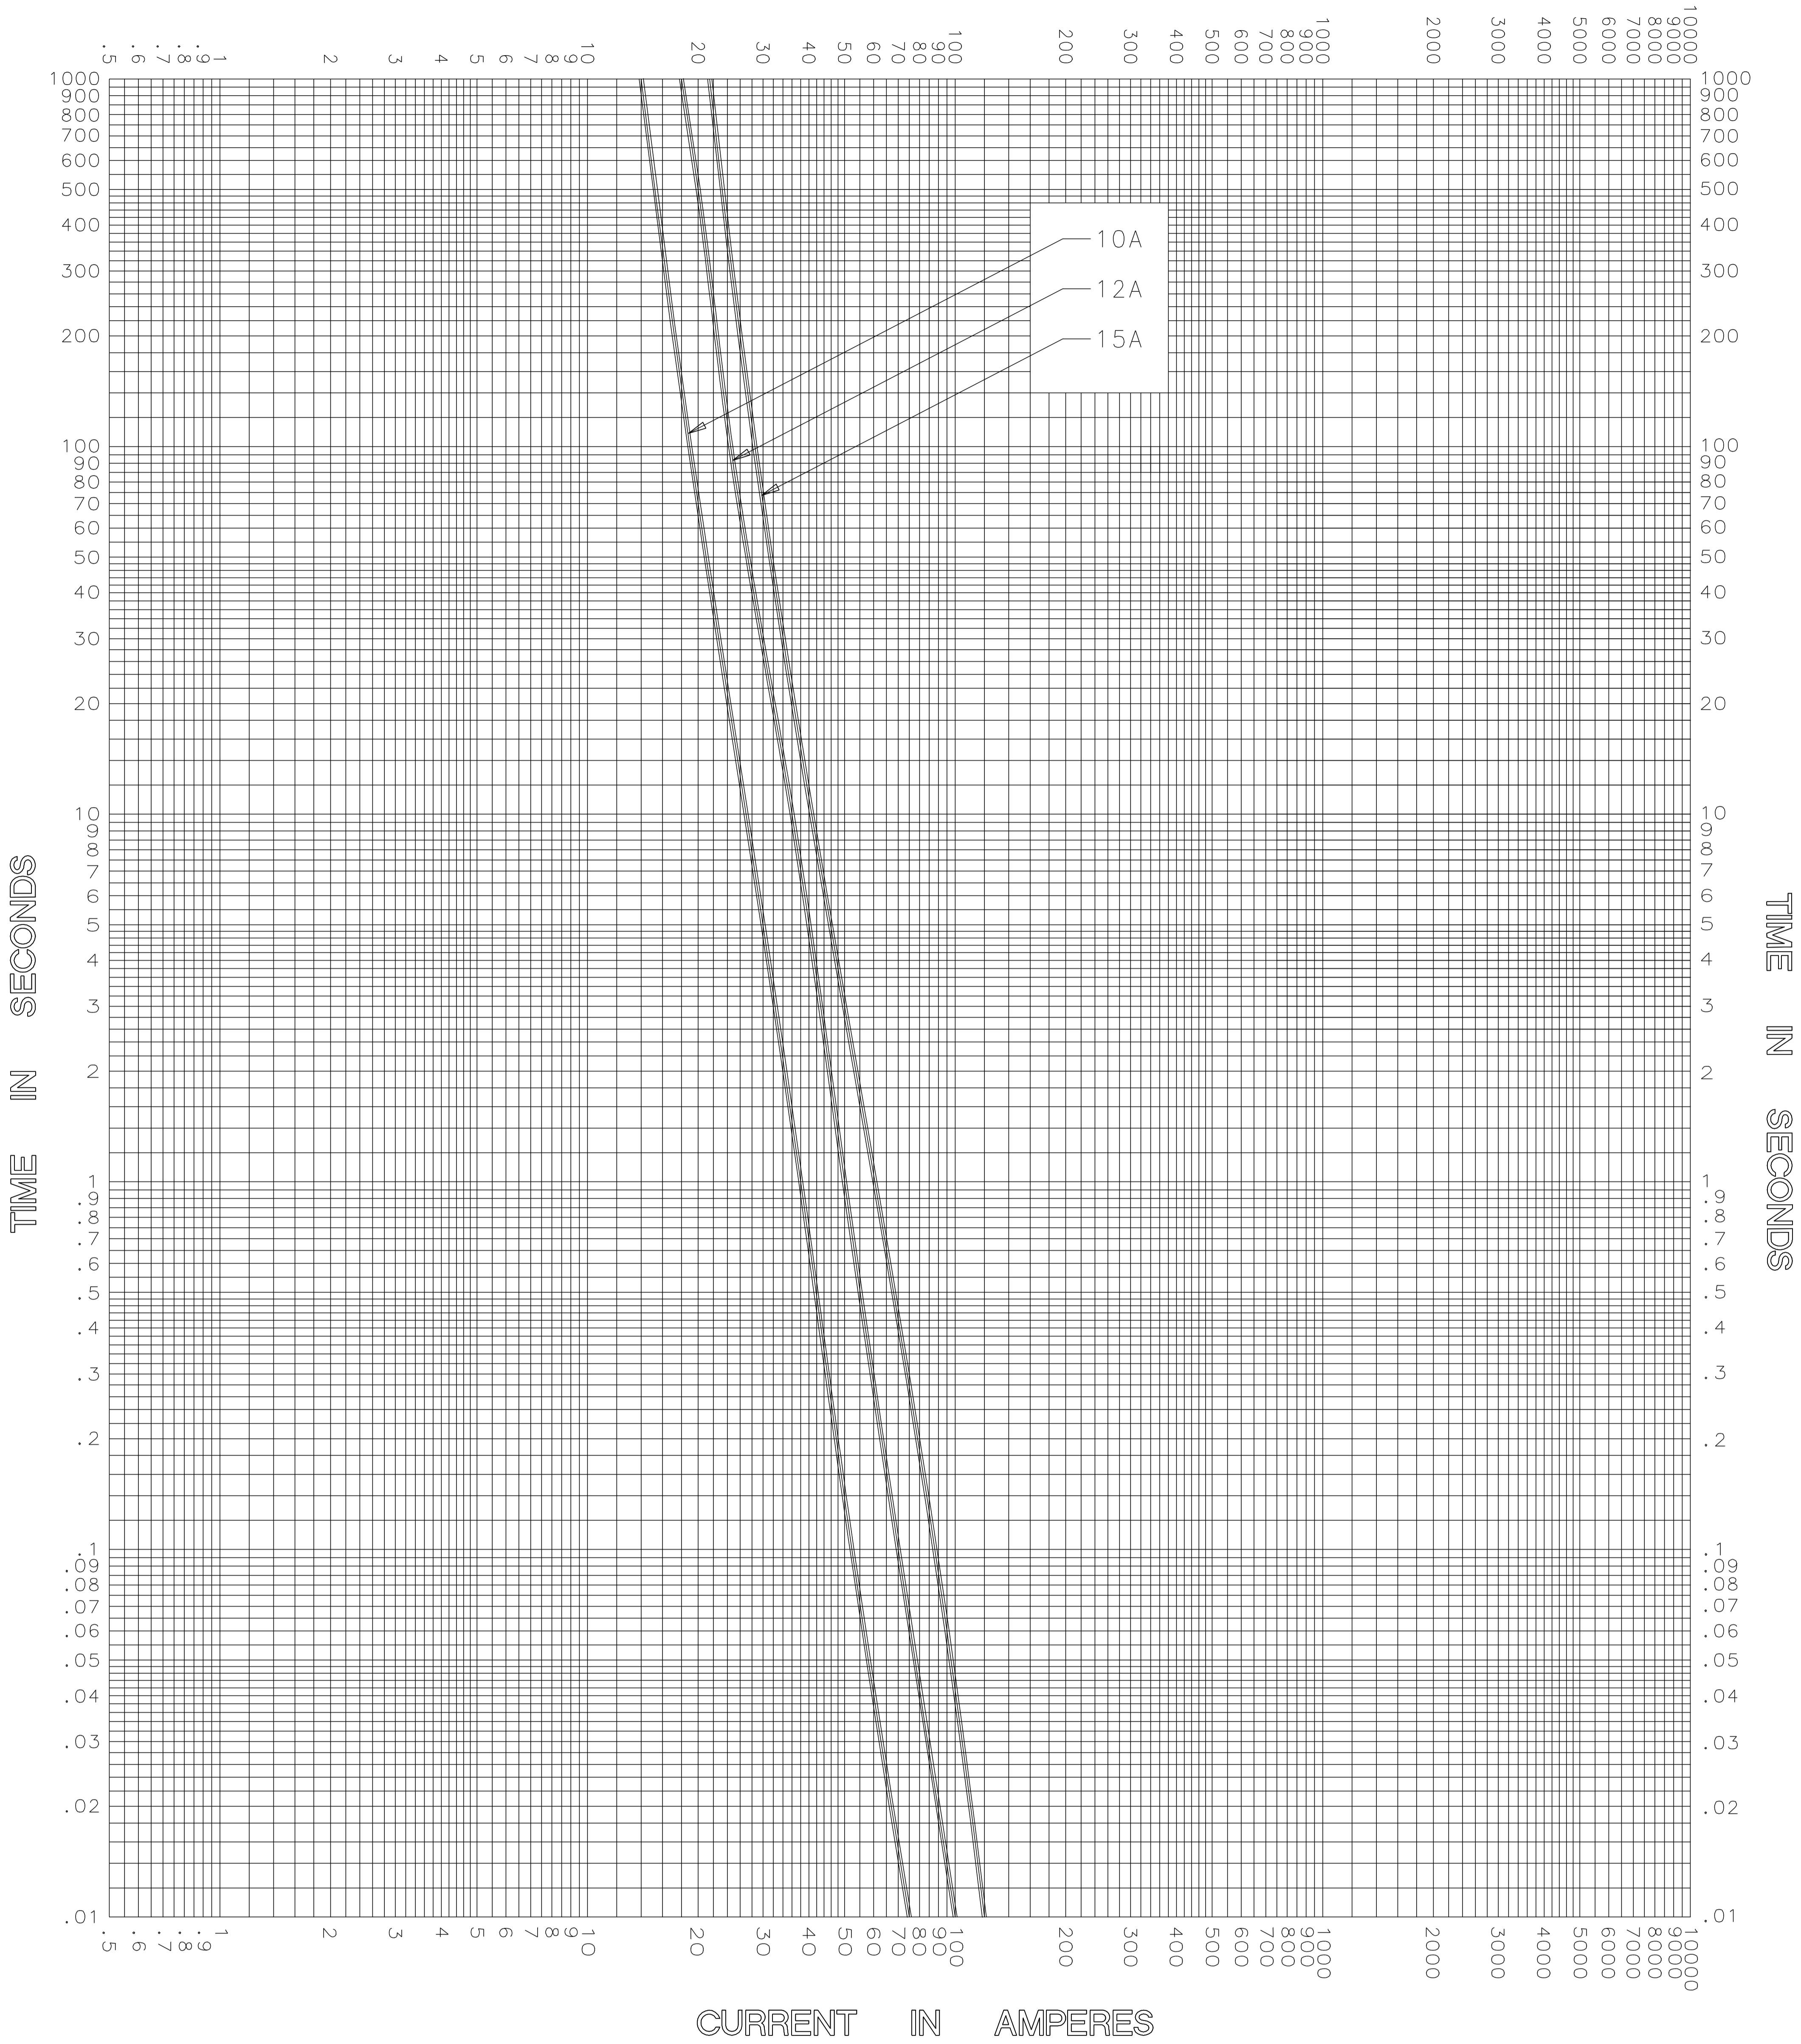

CURRENT IN AMPERES

| | |
|---|--|
| TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER SLC (10A - 15A) |
| BASIS FOR DATA _____ | |



LITTELFUSE, INC.
DES PLAINES, ILL. USA


| | |
|-------------|------------|
| DRAWN BY | LLL |
| DATE | 04/28/05 |
| CHECKED BY | MP |
| DRAWING NO. | A-FCC03-02 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

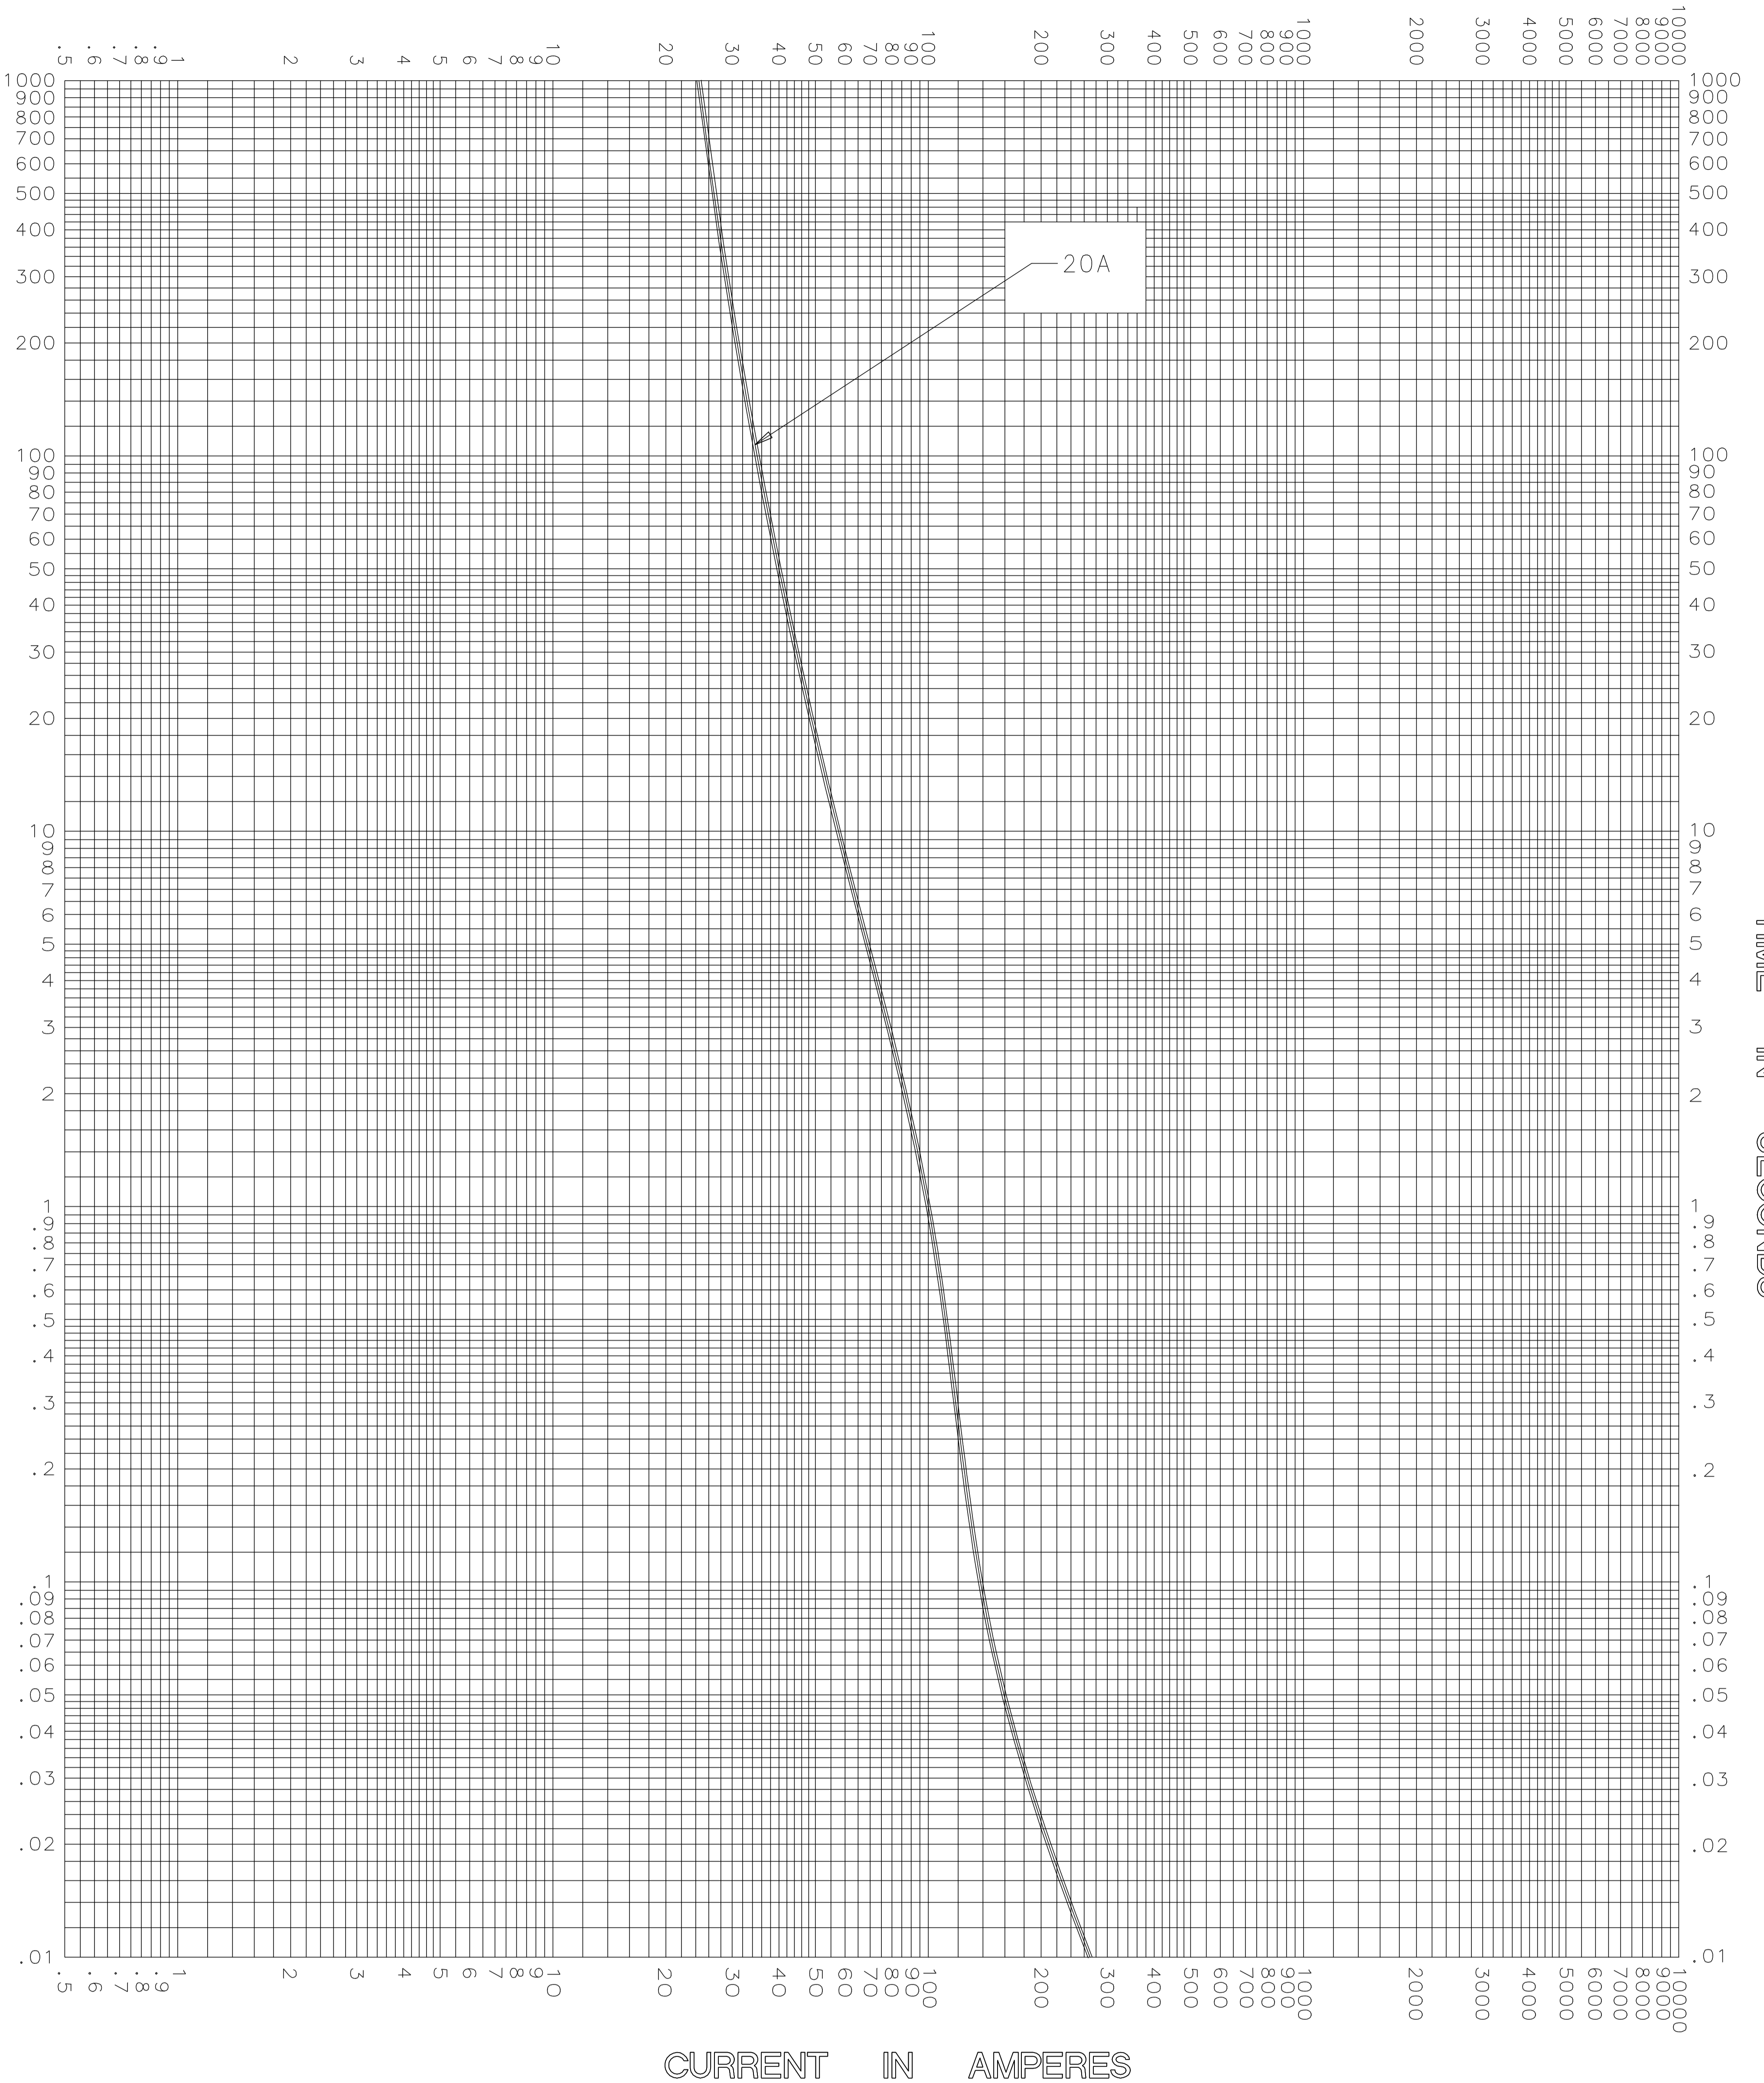

CURRENT IN AMPERES

| | |
|---|----------------------------------|
| TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER SLC (20A) |
| BASIS FOR DATA _____ | |



LITTELFUSE, INC.
DES PLAINES, ILL. USA


| | |
|-------------|----------|
| DRAWN BY | LLL |
| DATE | 04/28/05 |
| CHECKED BY | MP |
| DRAWING NO. | A-FCC03 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

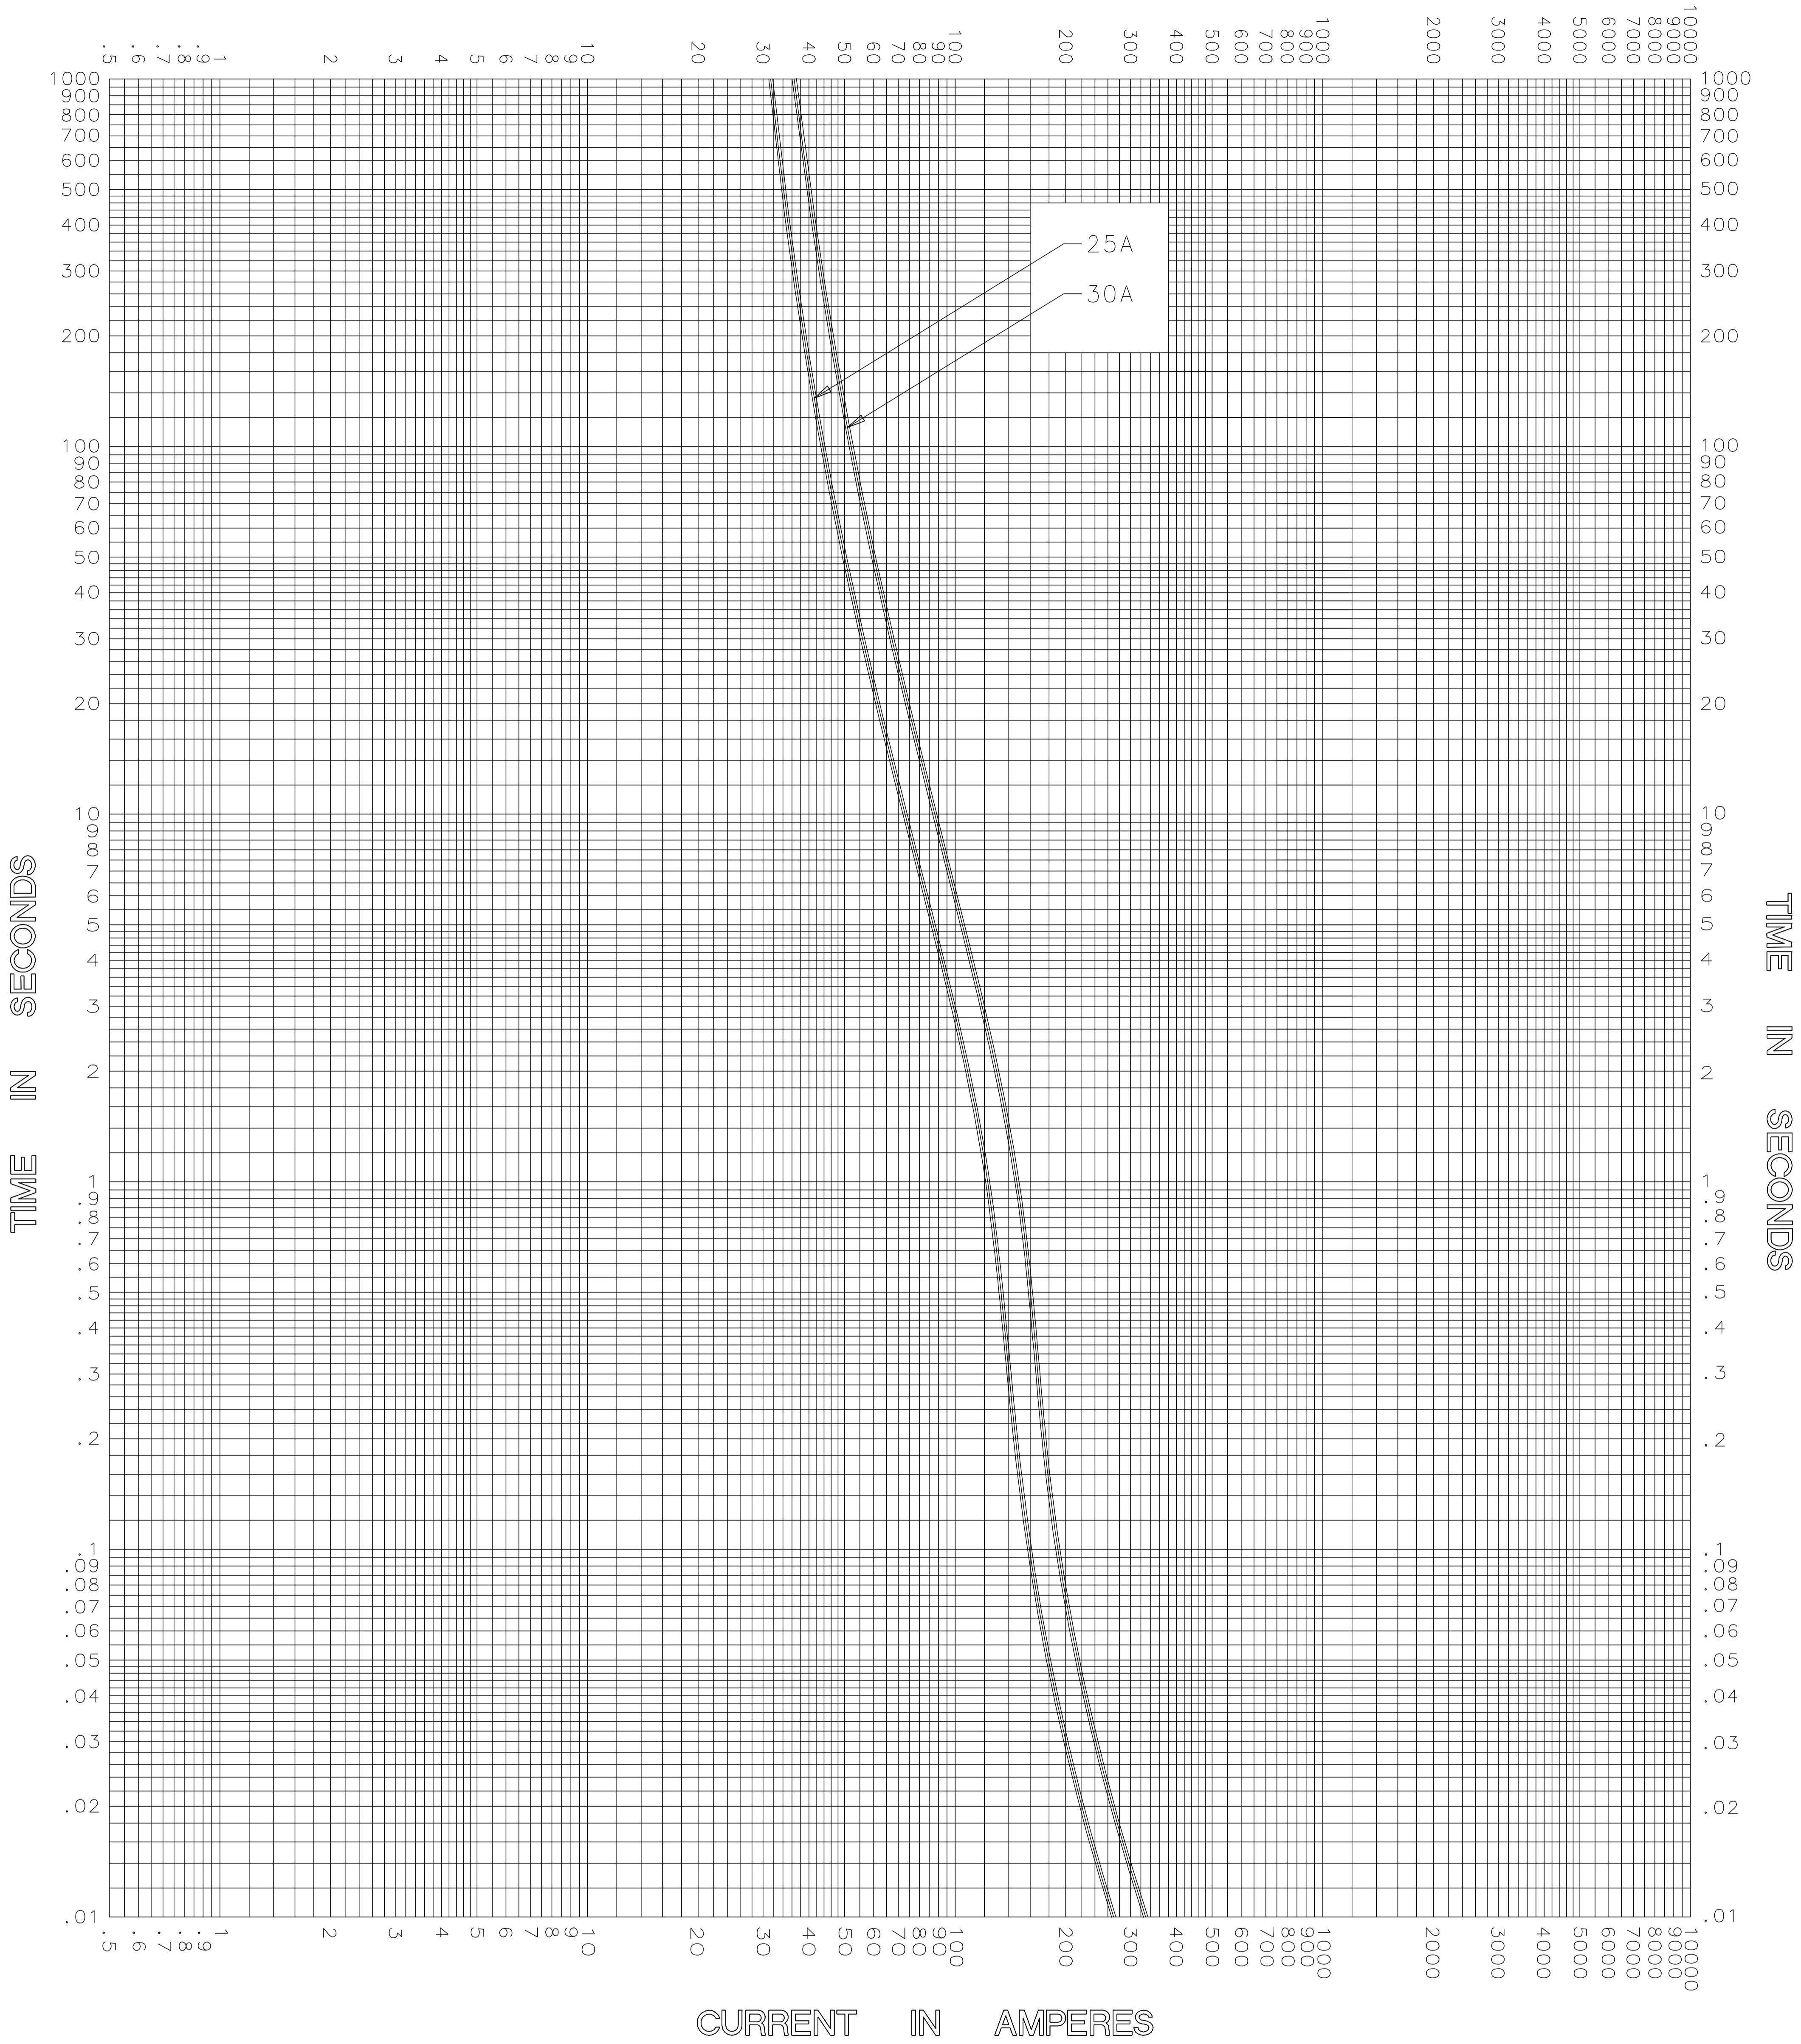

CURRENT IN AMPERES

| | | |
|----------------------|------------------------------------|--|
| TEST VOLTAGE _____ | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER SLC (25A - 30A) |
| BASIS FOR DATA _____ | | |



LITTELFUSE, INC.
DES PLAINES, ILL. USA


| | |
|-------------|------------|
| DRAWN BY | LLL |
| DATE | 04/28/05 |
| CHECKED BY | MP |
| DRAWING NO. | A-FCC03-04 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

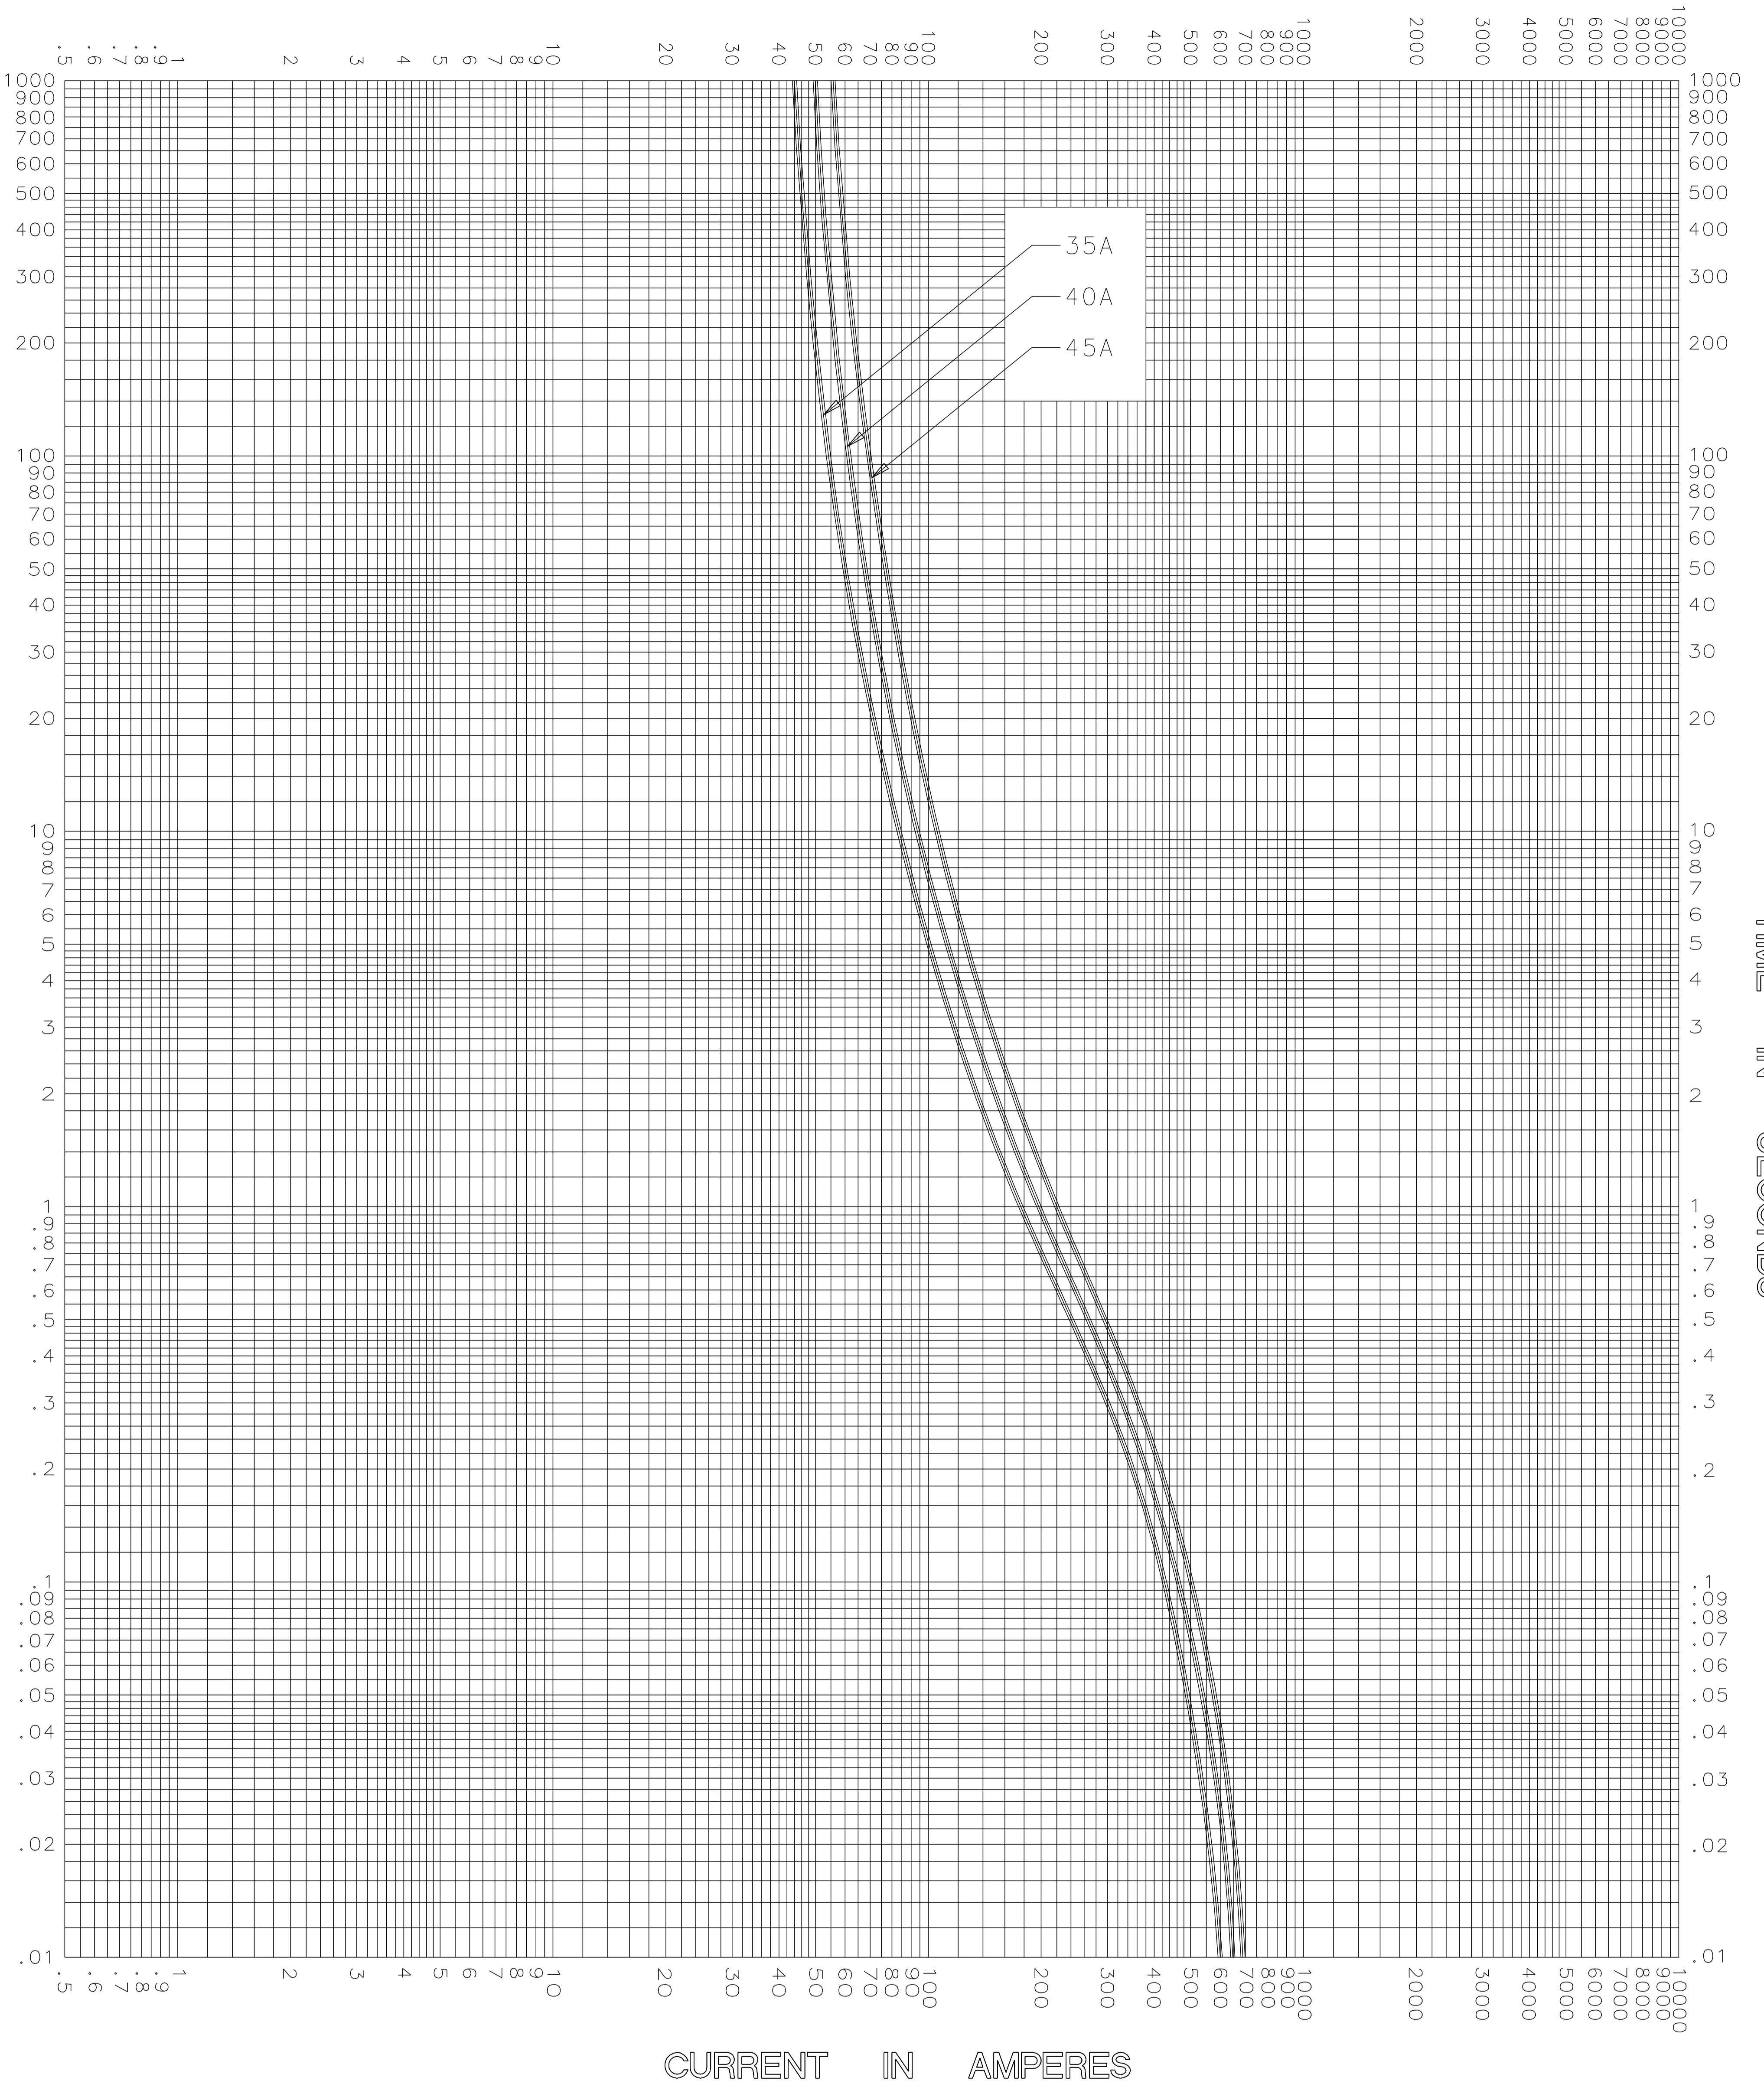

CURRENT IN AMPERES

| | | |
|----------------------|------------------------------------|--|
| TEST VOLTAGE _____ | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER SLC (35A - 45A) |
| BASIS FOR DATA _____ | | |



LITTELFUSE, INC.
DES PLAINES, ILL. USA


| | |
|-------------|------------|
| DRAWN BY | LLL |
| DATE | 04/28/05 |
| CHECKED BY | MP |
| DRAWING NO. | A-FCC03-05 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

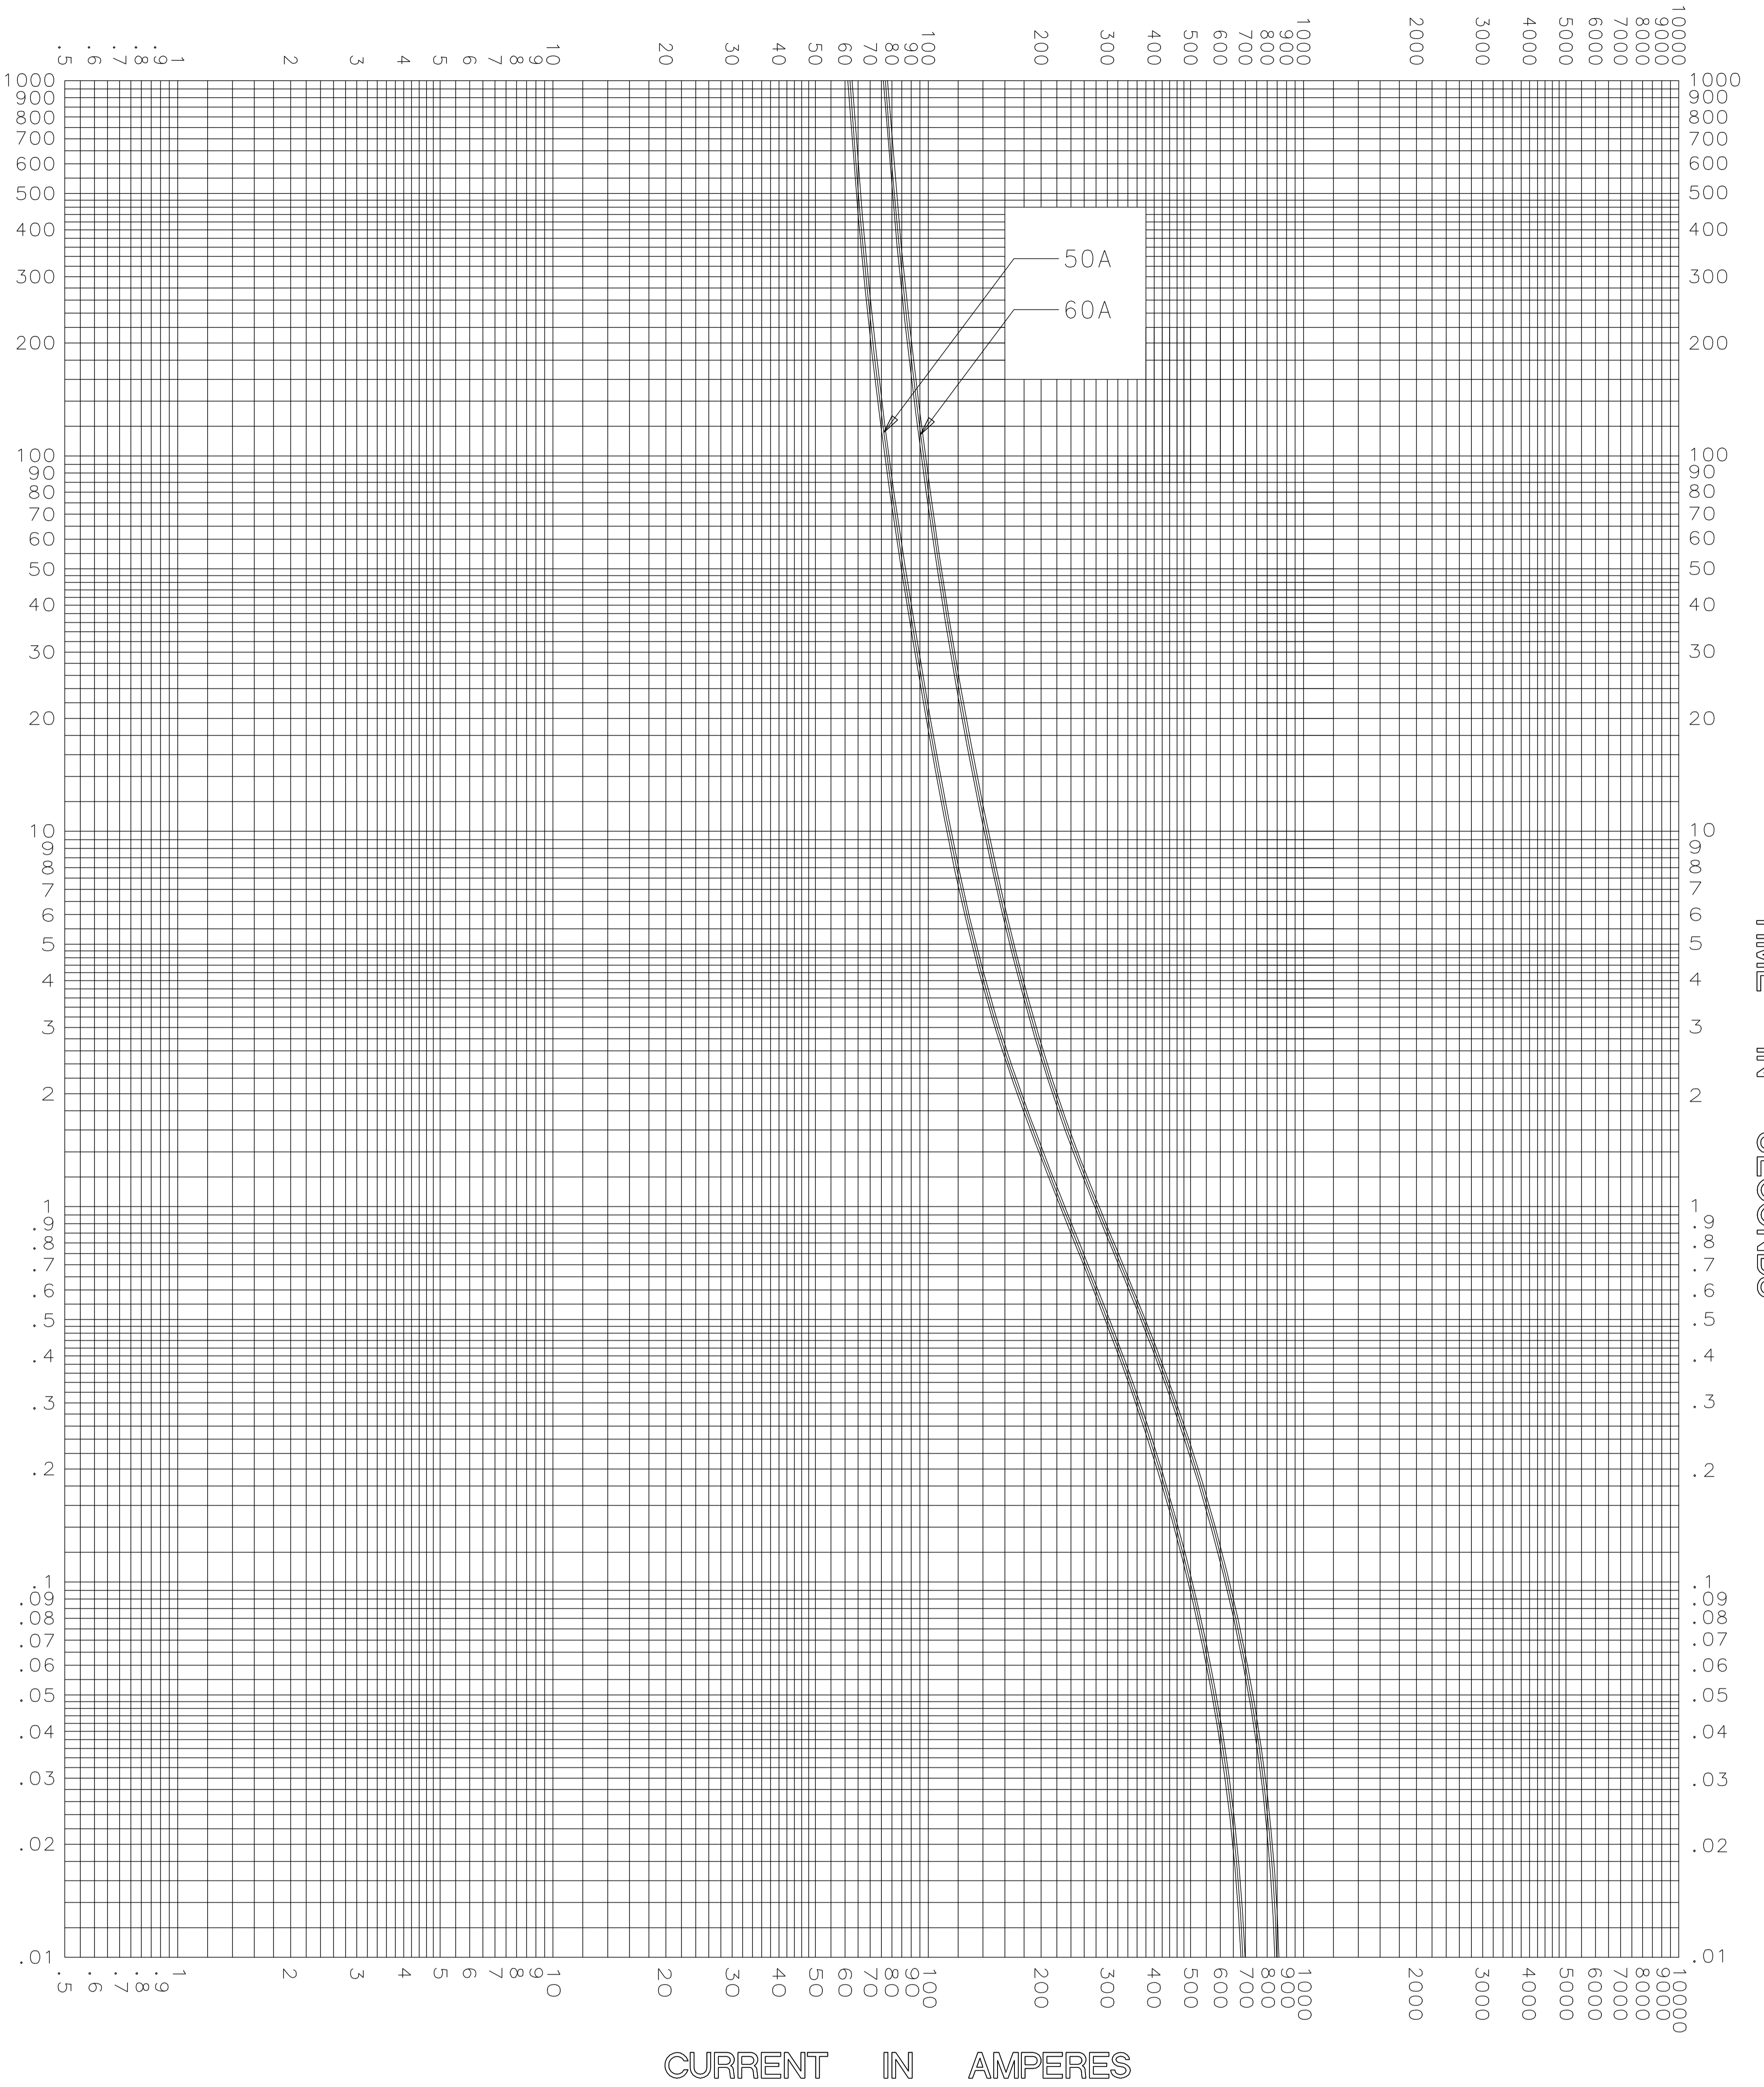

CURRENT IN AMPERES

| | | |
|----------------------|------------------------------------|--|
| TEST VOLTAGE _____ | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER SLC (50A - 60A) |
| BASIS FOR DATA _____ | | |



LITTELFUSE, INC.
DES PLAINES, ILL. USA


| | |
|-------------|------------|
| DRAWN BY | LLL |
| DATE | 04/28/05 |
| CHECKED BY | MP |
| DRAWING NO. | A-FCC03-06 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

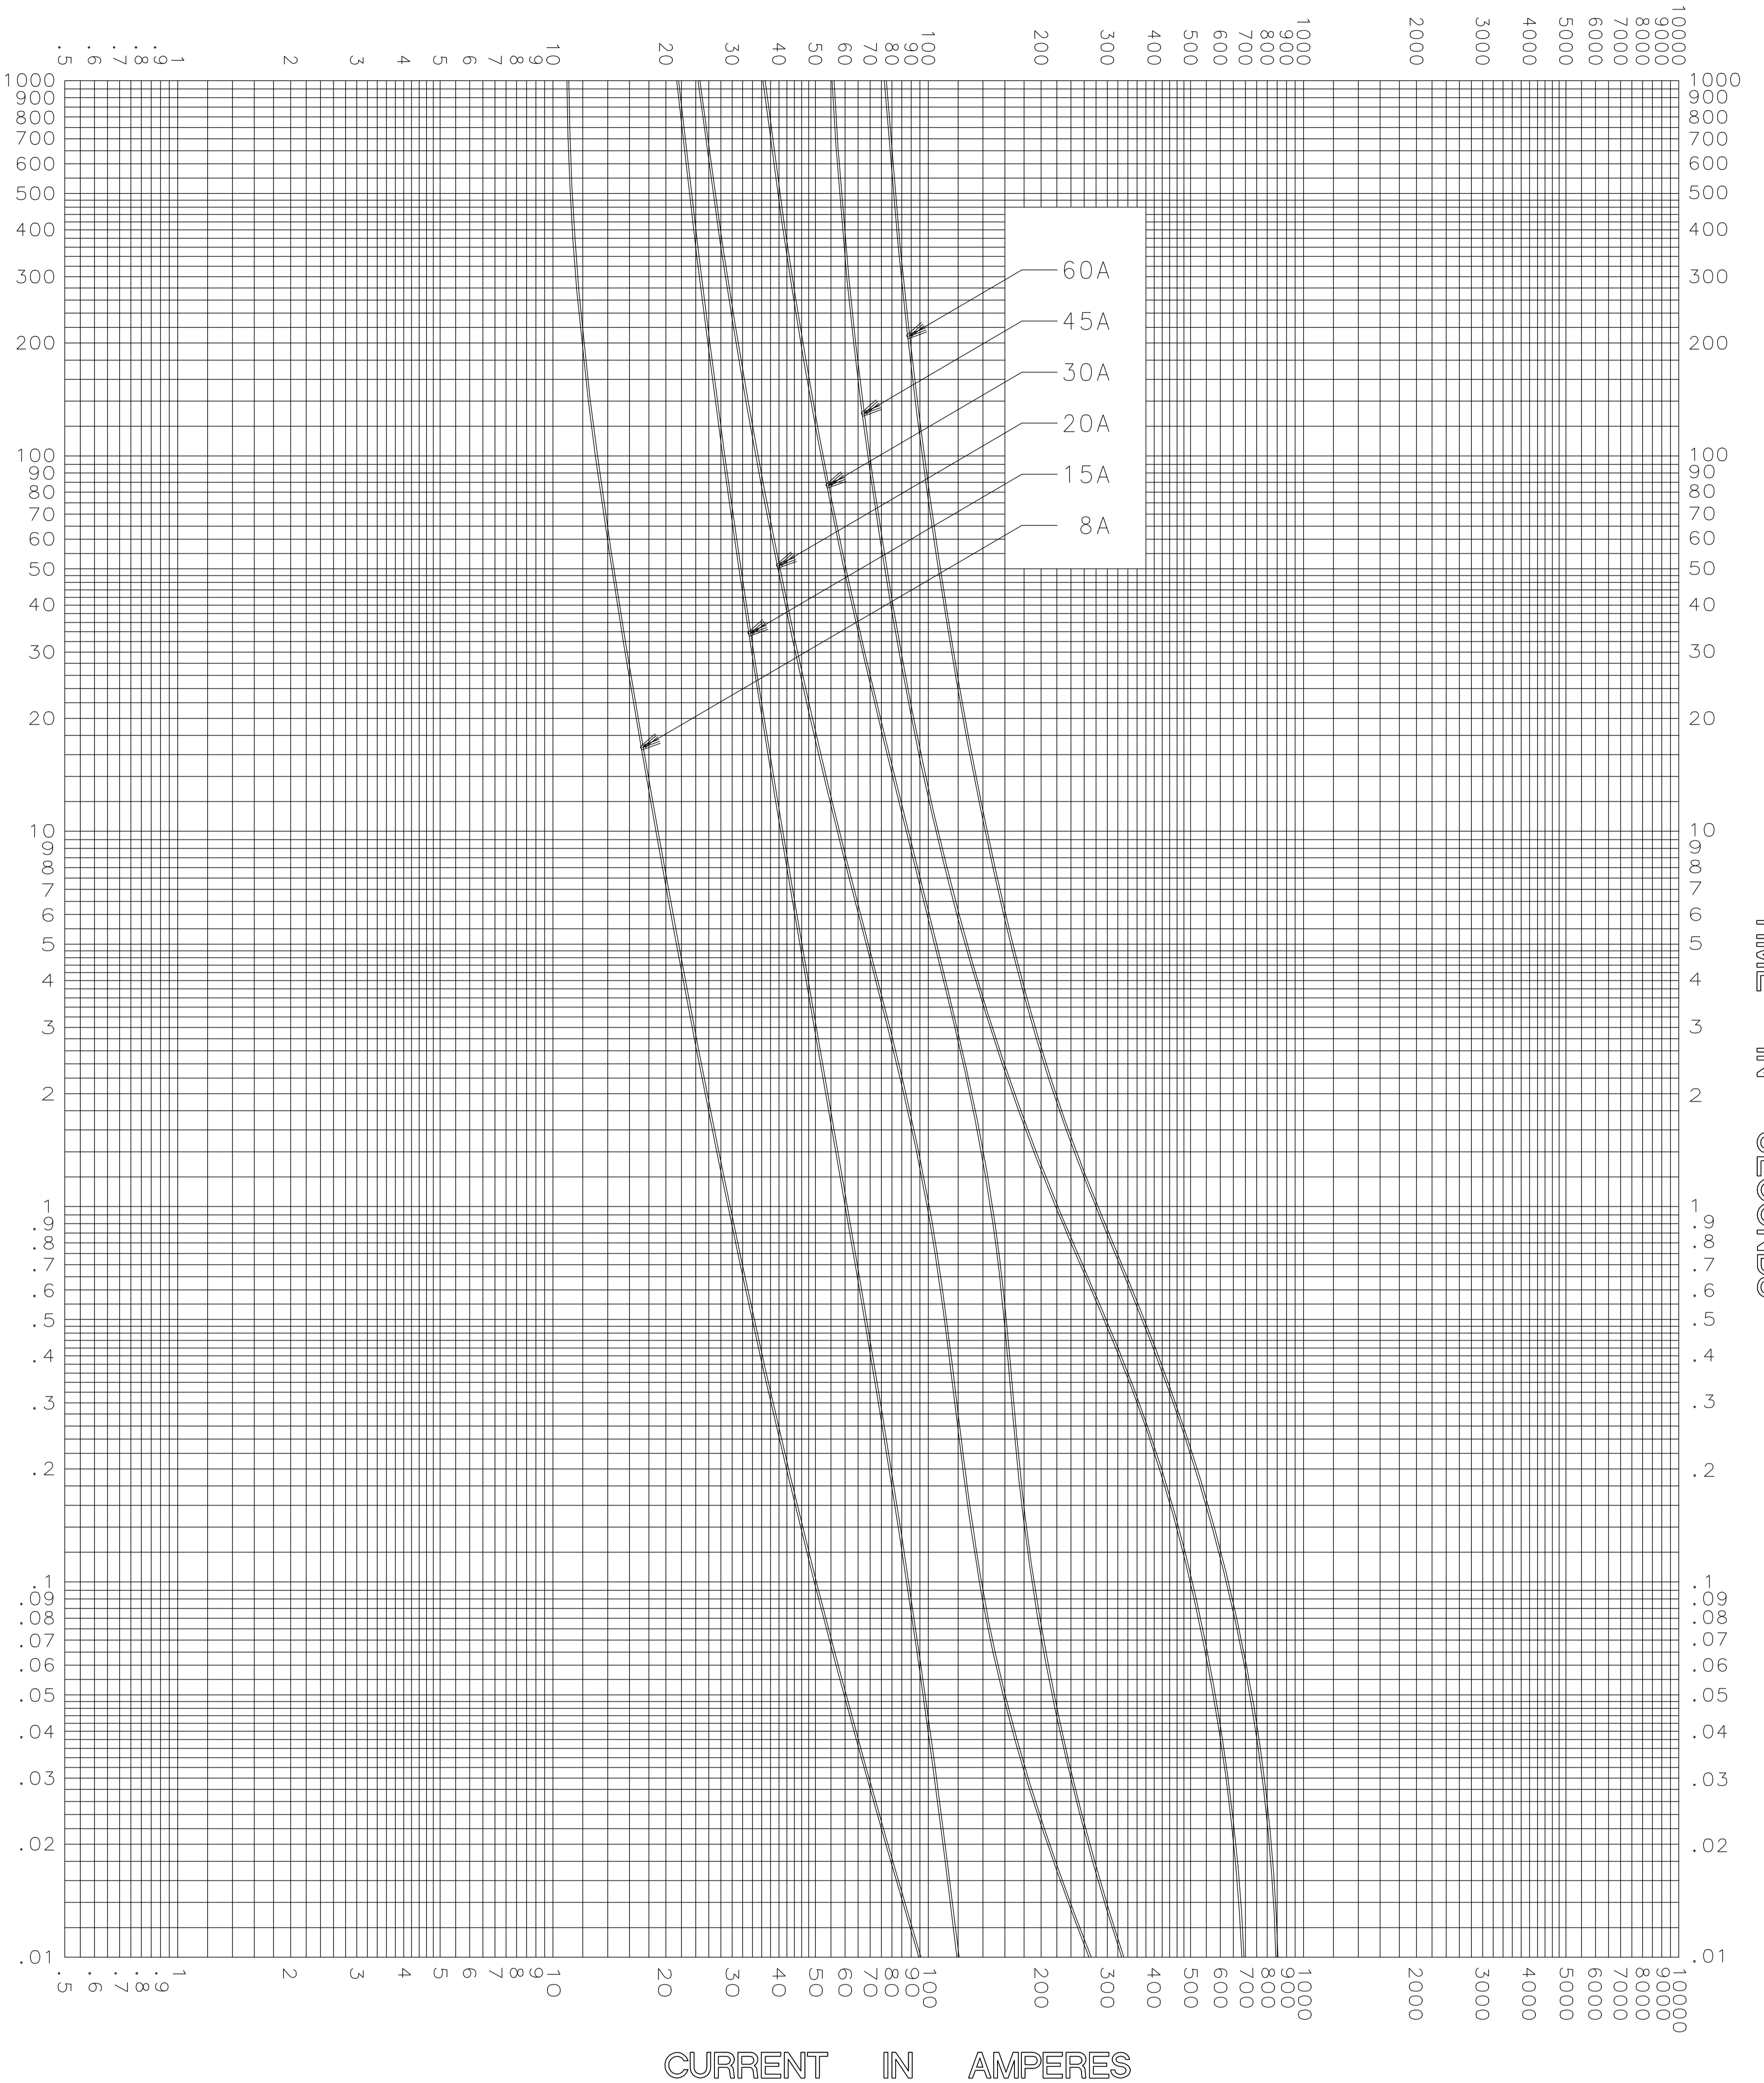

CURRENT IN AMPERES

| | | |
|----------------------|------------------------------------|---------------------------------------|
| TEST VOLTAGE _____ | TIME CONSTANT / POWER FACTOR _____ | FUSE CATALOG NUMBER SLC (8A - 60A) |
| BASIS FOR DATA _____ | | |



LITTELFUSE, INC.
DES PLAINES, ILL. USA

| | |
|-------------|----------|
| DRAWN BY | LLL |
| DATE | 04/28/05 |
| CHECKED BY | MP |
| DRAWING NO. | A-FCC007 |

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT