



CURRENT IN AMPERES

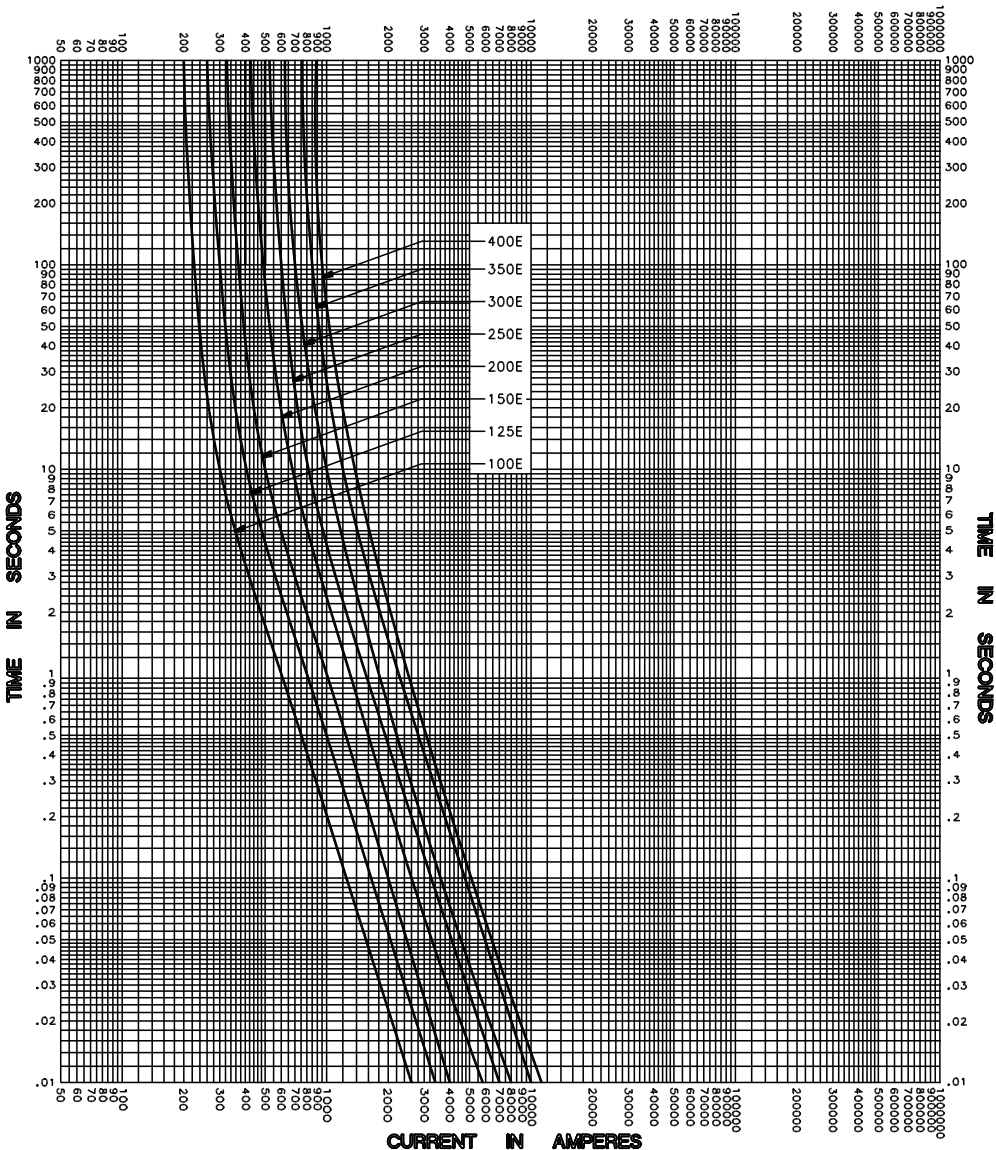

MELTING TIME CHARACTERISTIC

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 8.25kV E-RATED 100E-400E
BASIS FOR DATA _____		
 DES PLAINES, ILLINOIS 60016		DRAWN BY <u>LLL</u>
		DATE <u>07/26/04</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		CHECKED BY <u>MP</u>
		DRAWING NO. <u>A-FCC002</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT