




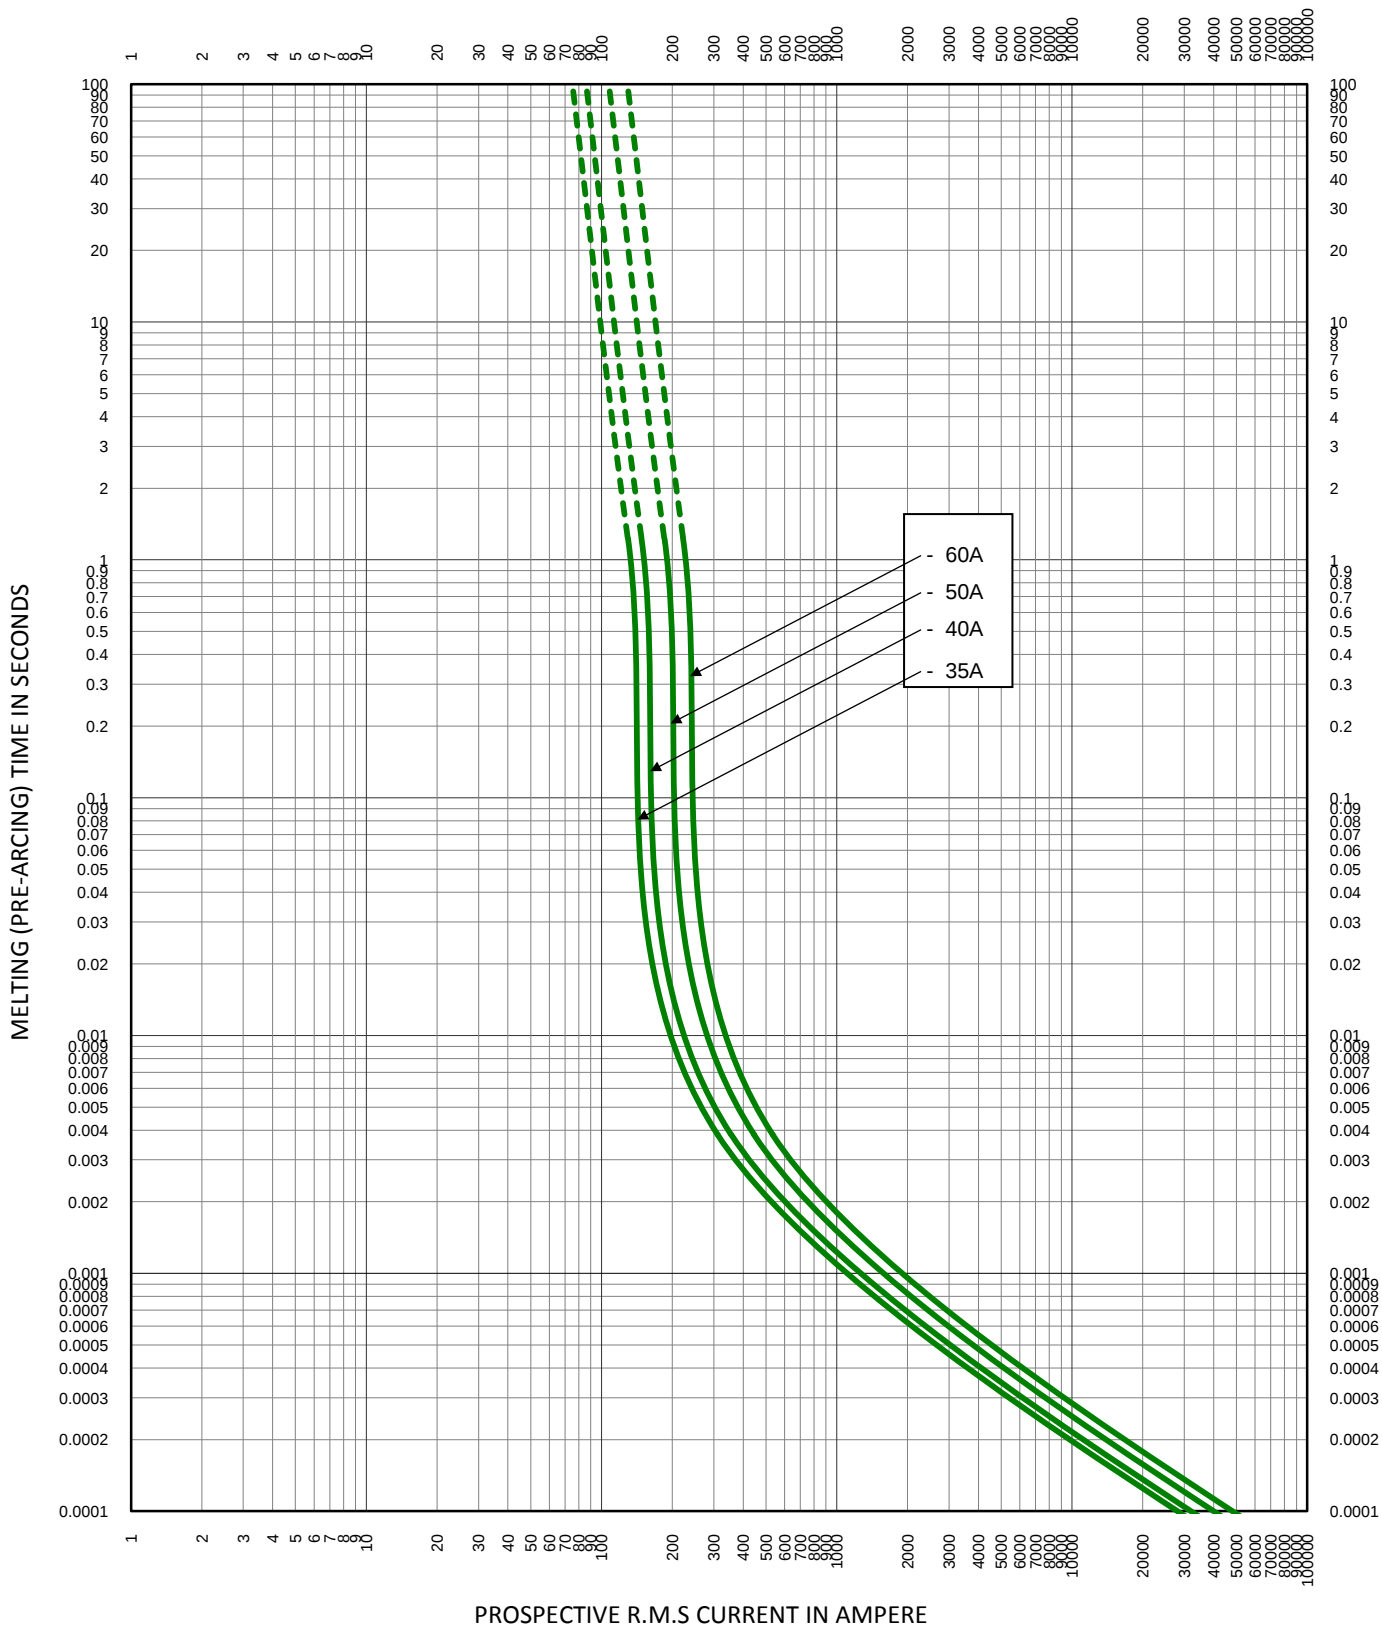

TEST VOLTAGE: 500V		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50QS 35A - 800A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/14/2015	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: B	
		DRAWING NO.: FCC01-L50QS	SHEET 2 OF 4

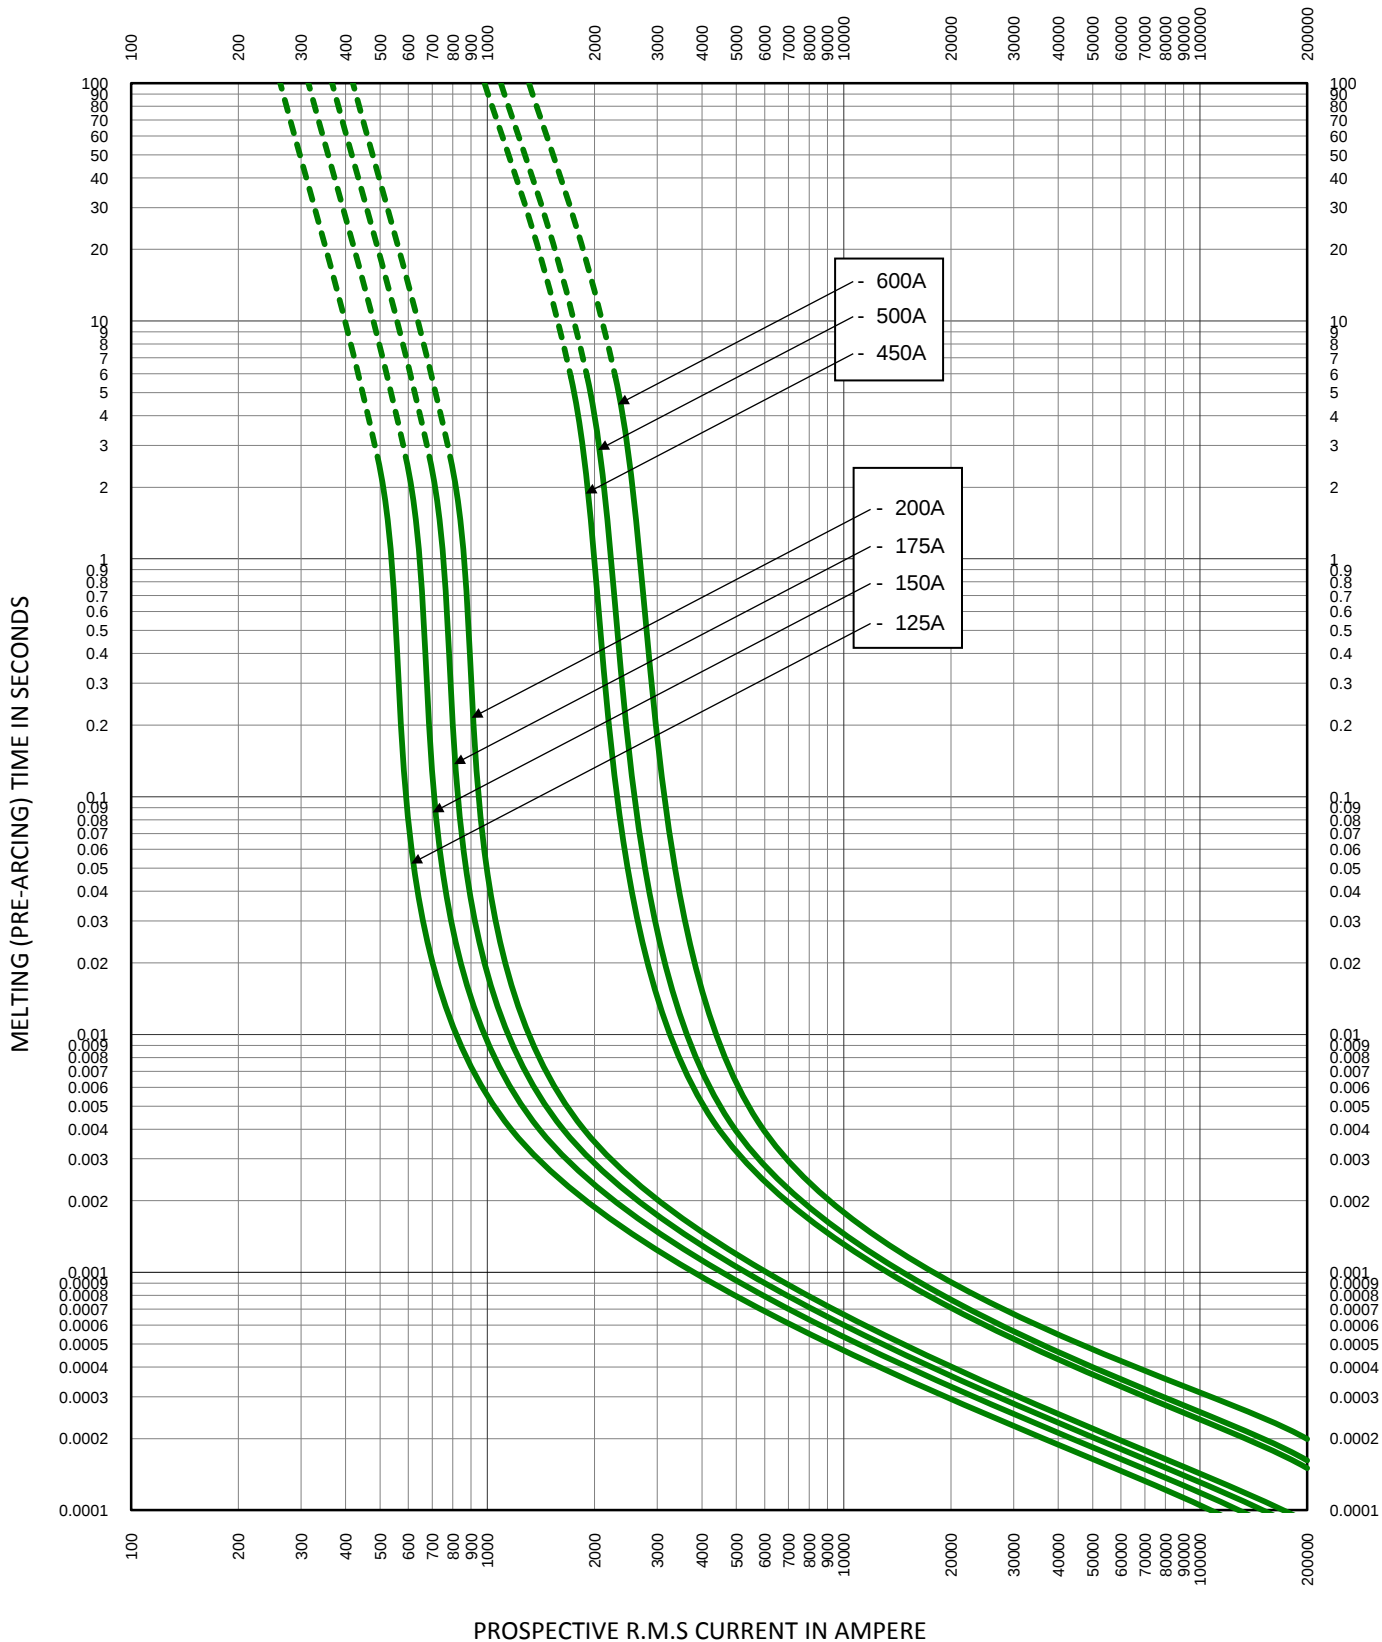

TEST VOLTAGE: 500V		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50QS 35A - 800A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/14/2015	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: B	
		DRAWING NO.: FCC01-L50QS	
		SHEET 3 OF 4	

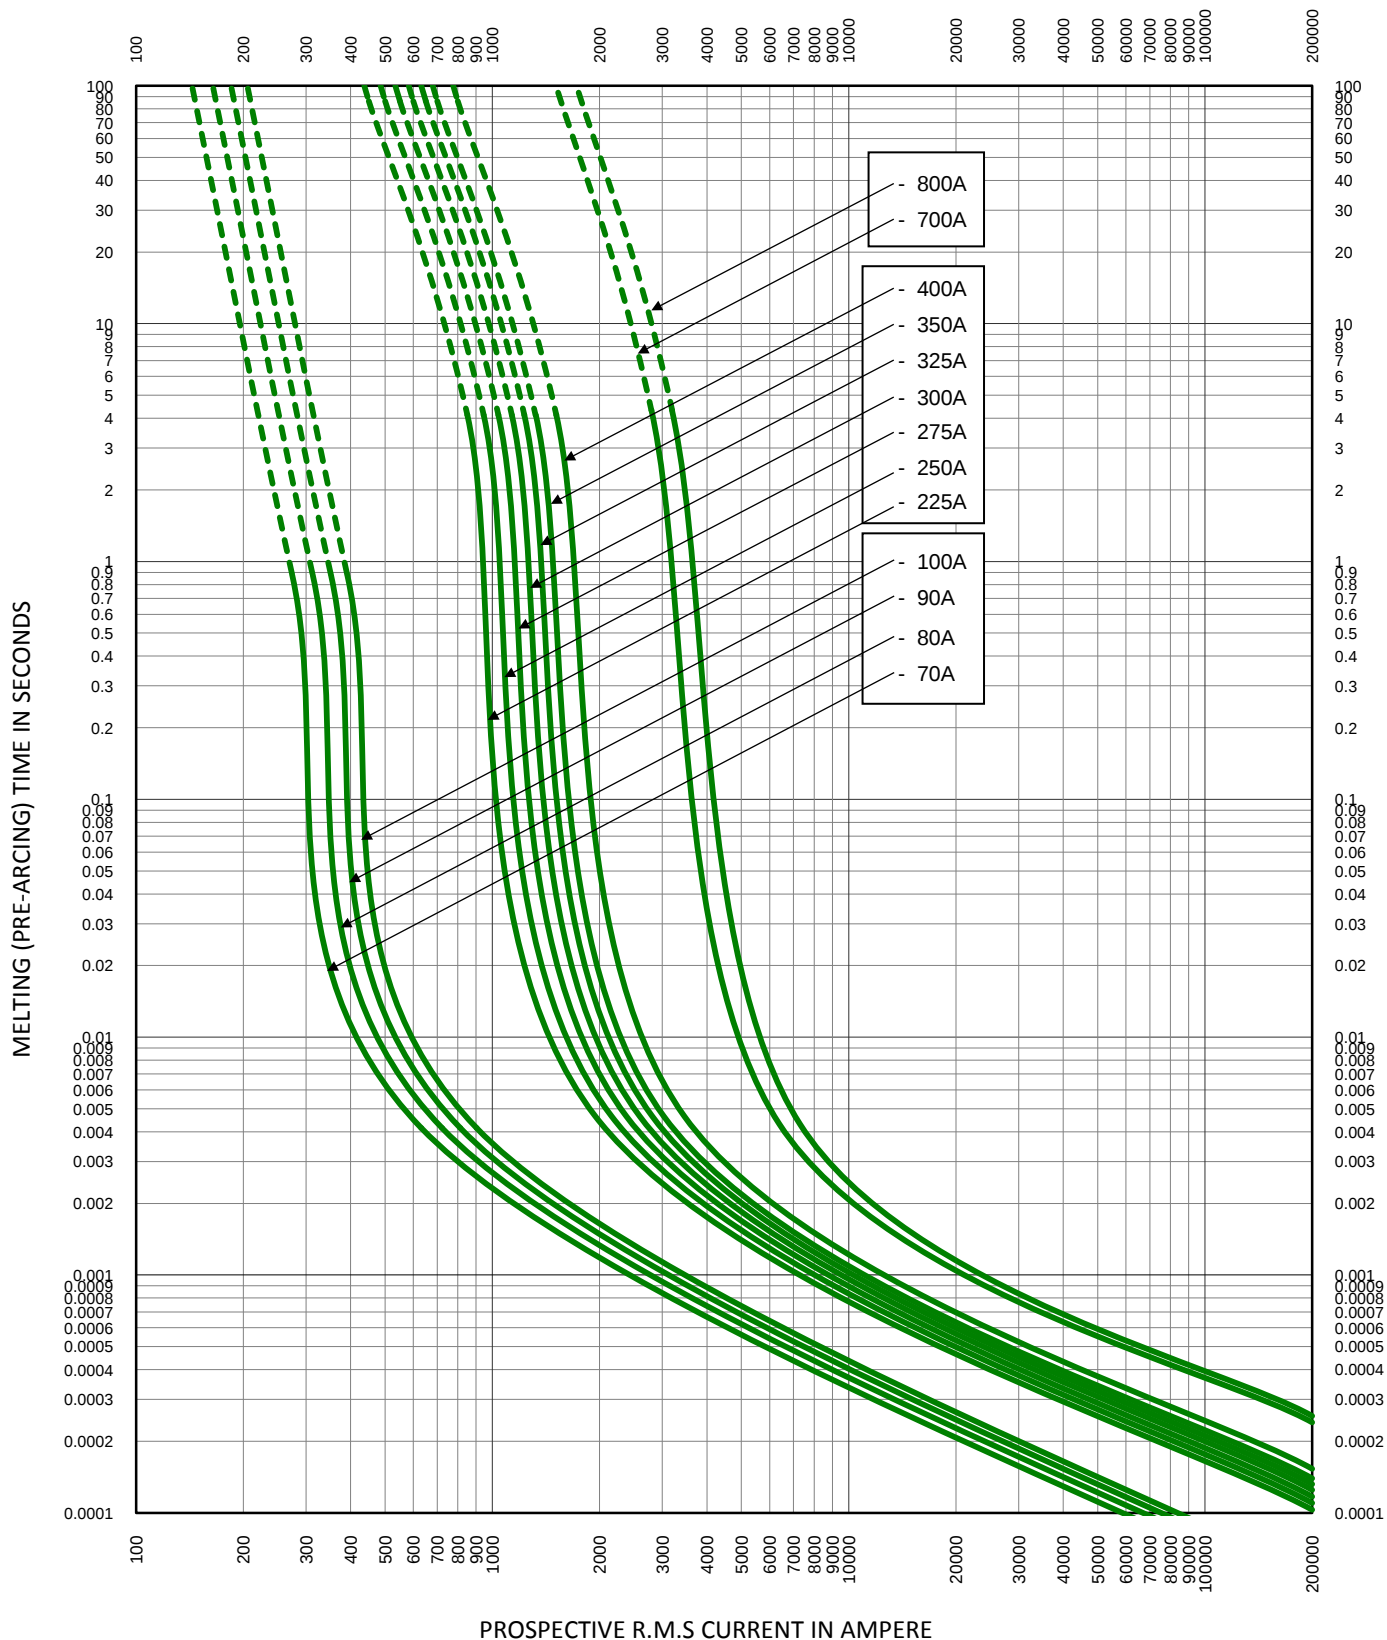

TEST VOLTAGE: 500V		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50QS 35A - 800A	
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 10/14/2015	
TIME CURRENT CHARACTERISTIC CURVES		REVISION: B	
		DRAWING NO.: FCC01-L50QS	
		SHEET 4 OF 4	