
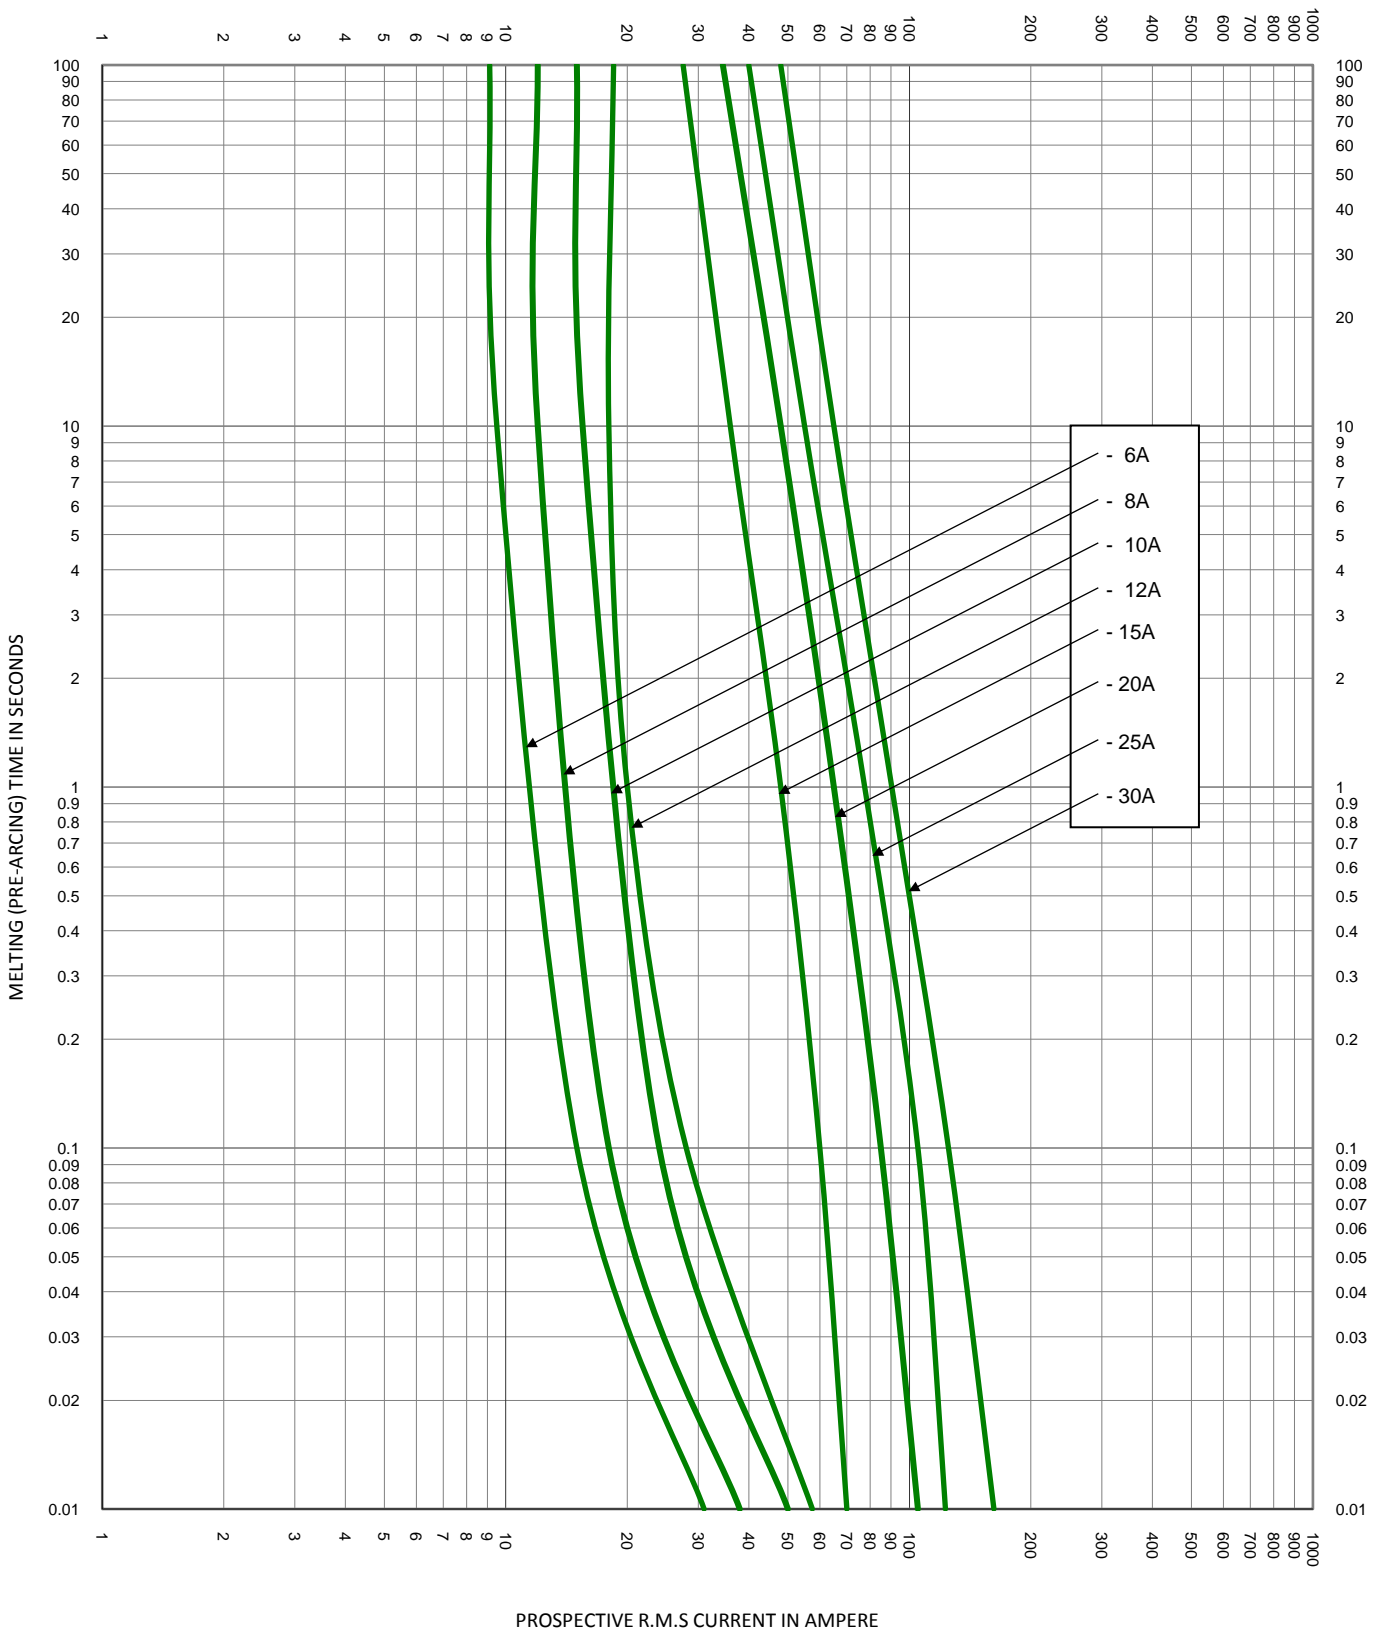

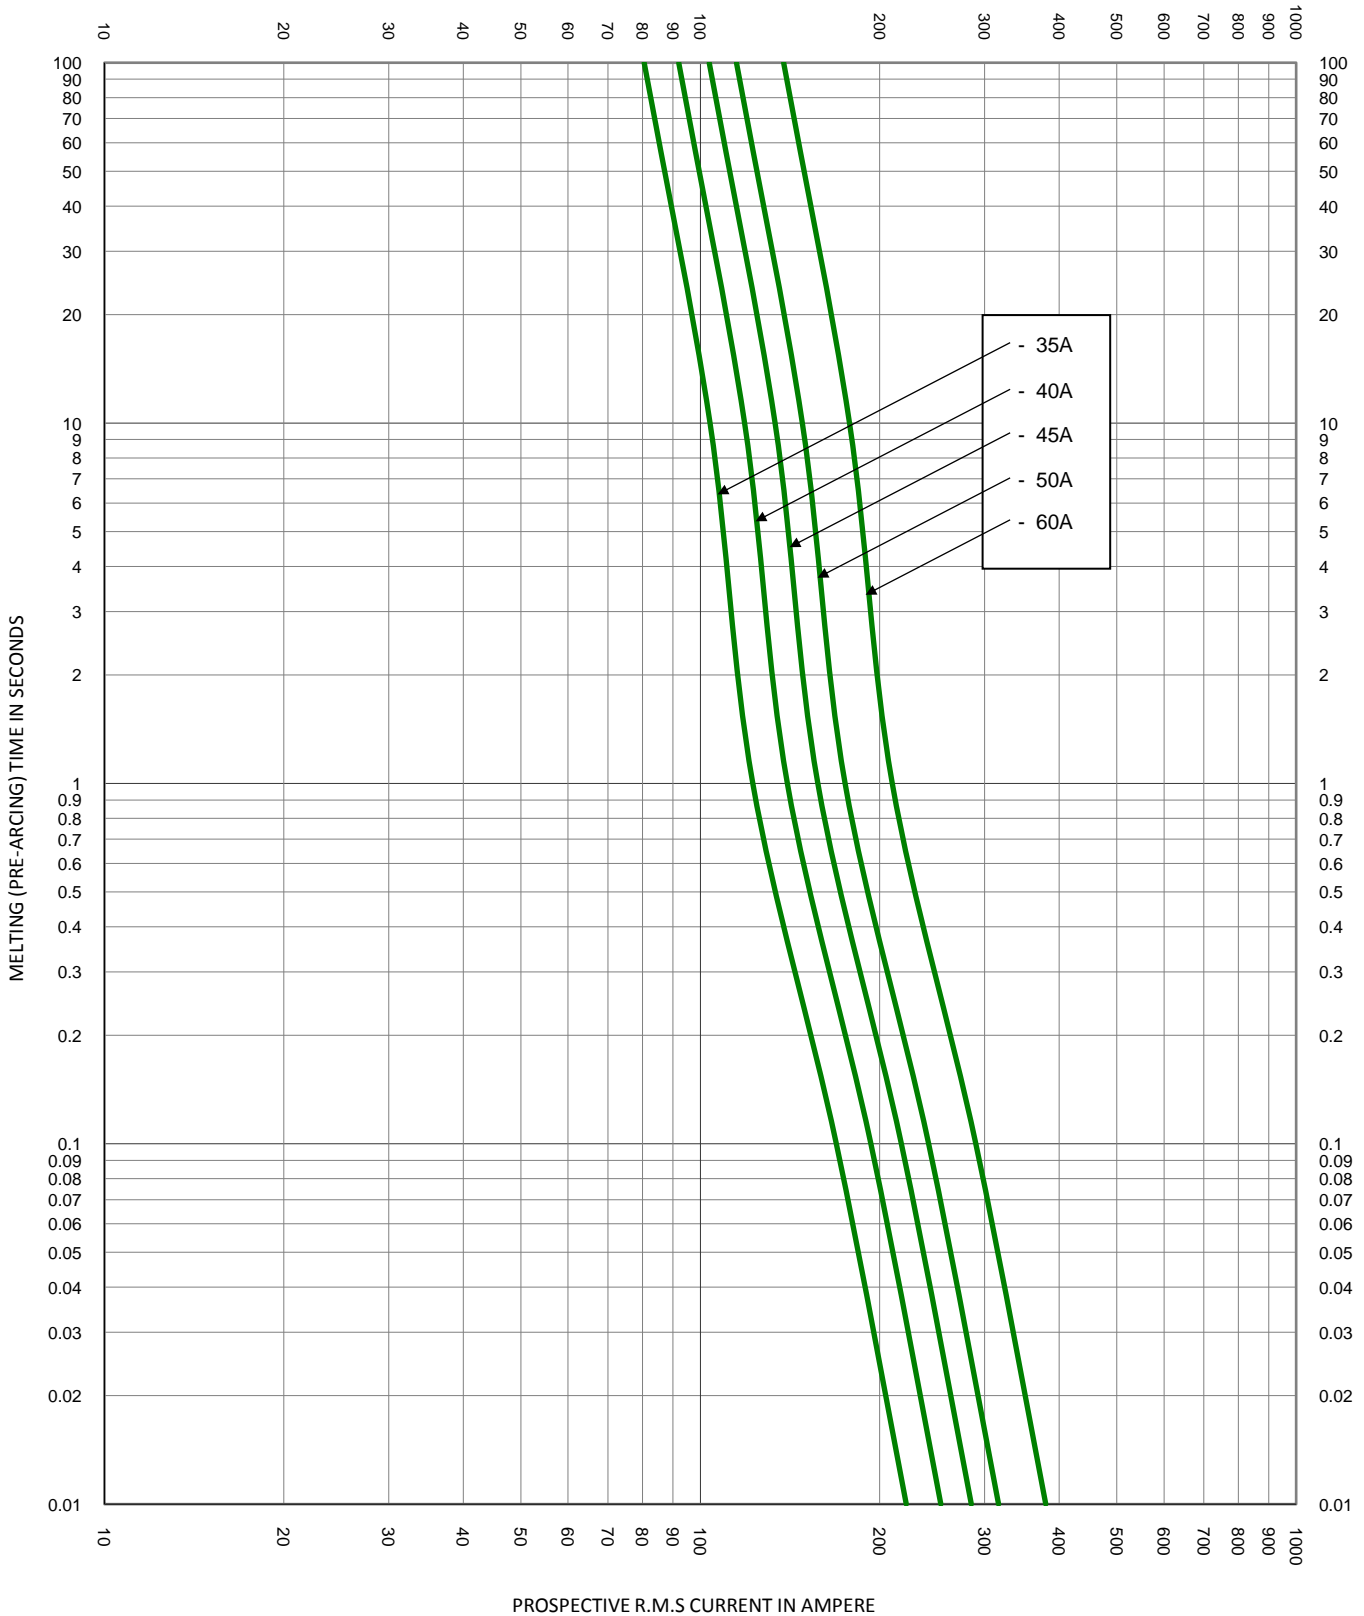



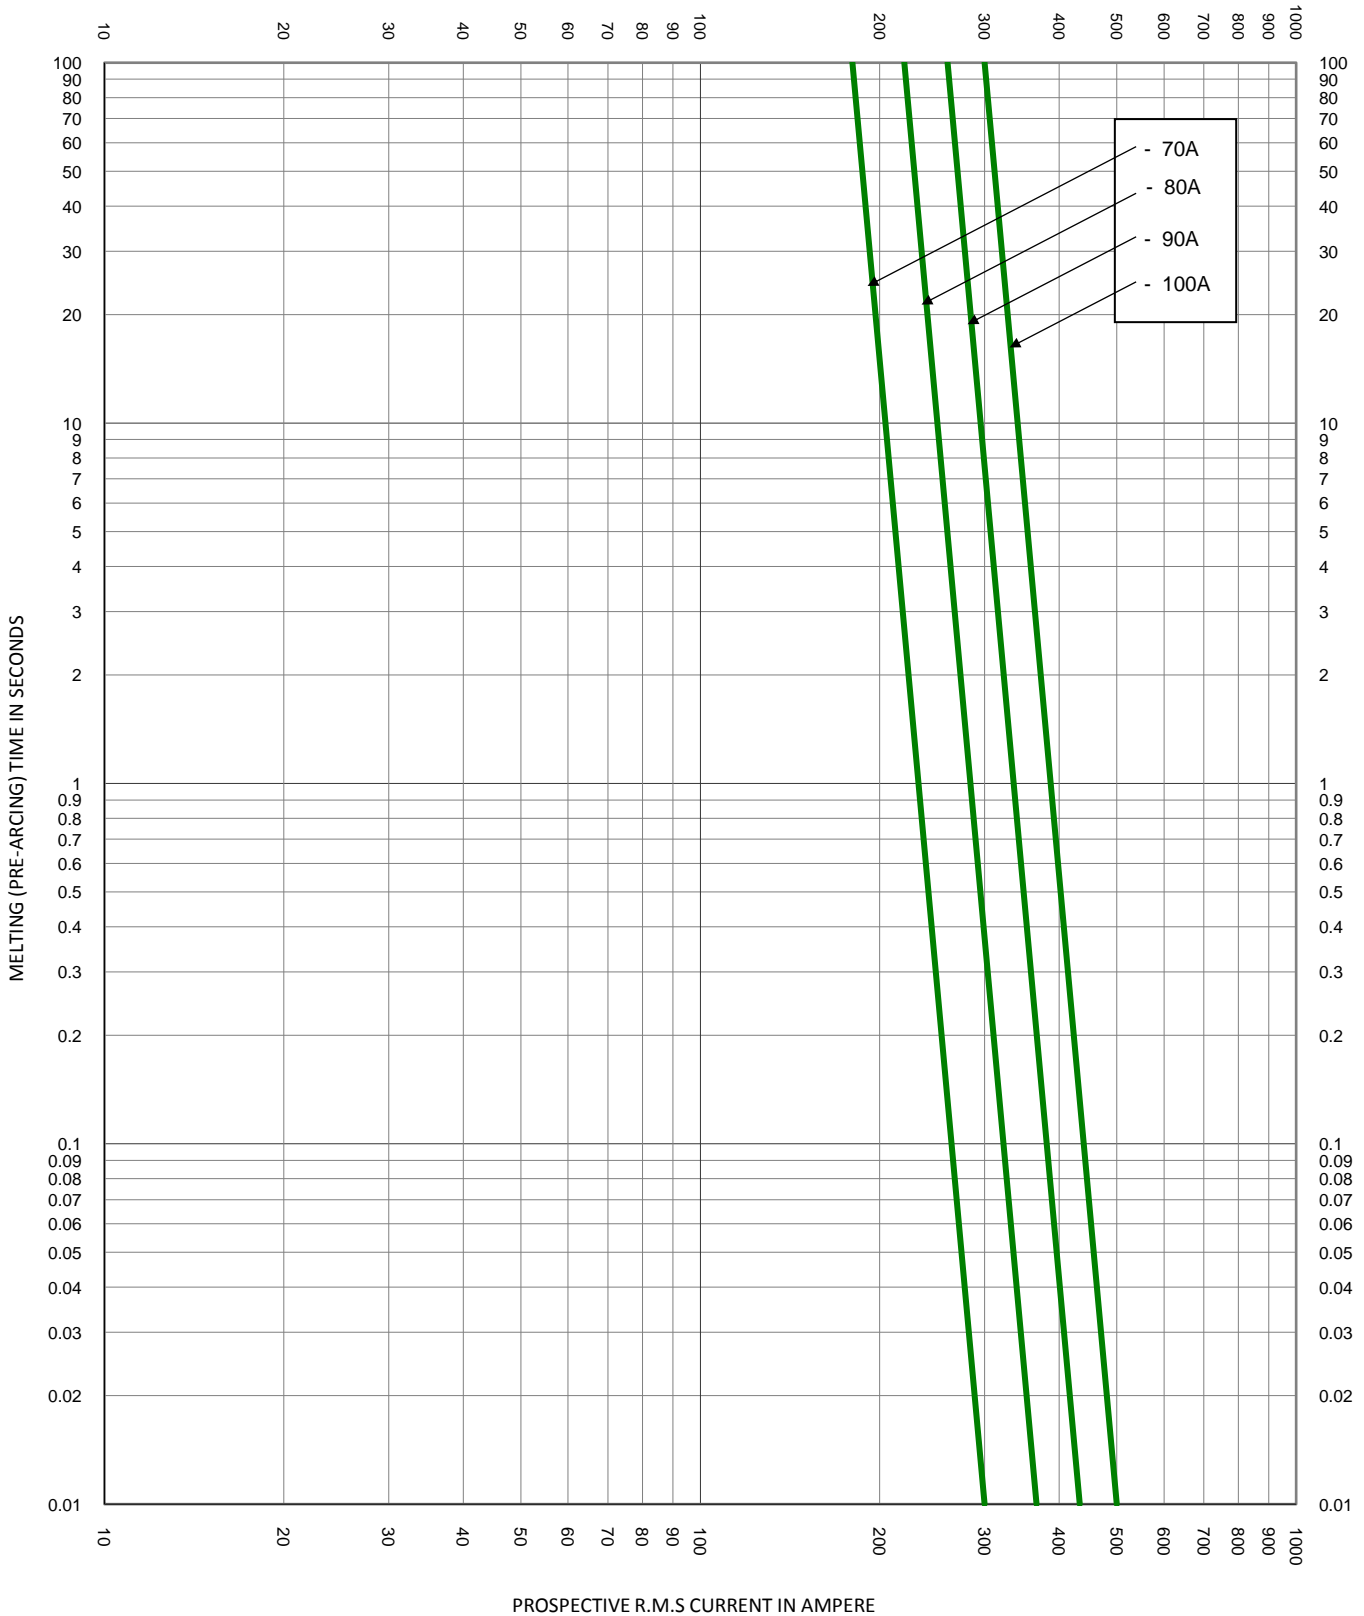
| | | |
|---|-----------------------------|--|
| TEST VOLTAGE: | TIME CONSTANT/POWER FACTOR: | FUSE CATALOG NUMBER: |
| BASIS FOR DATA: | | L25S 1A - 800A |
|  | | DRAWN BY: LLL DATE: 11/08/2017 REVISION: A |
| TIME CURRENT CHARACTERISTIC CURVES | | DRAWING NO.: FCC01-L25S SHEET 2 OF 7 |




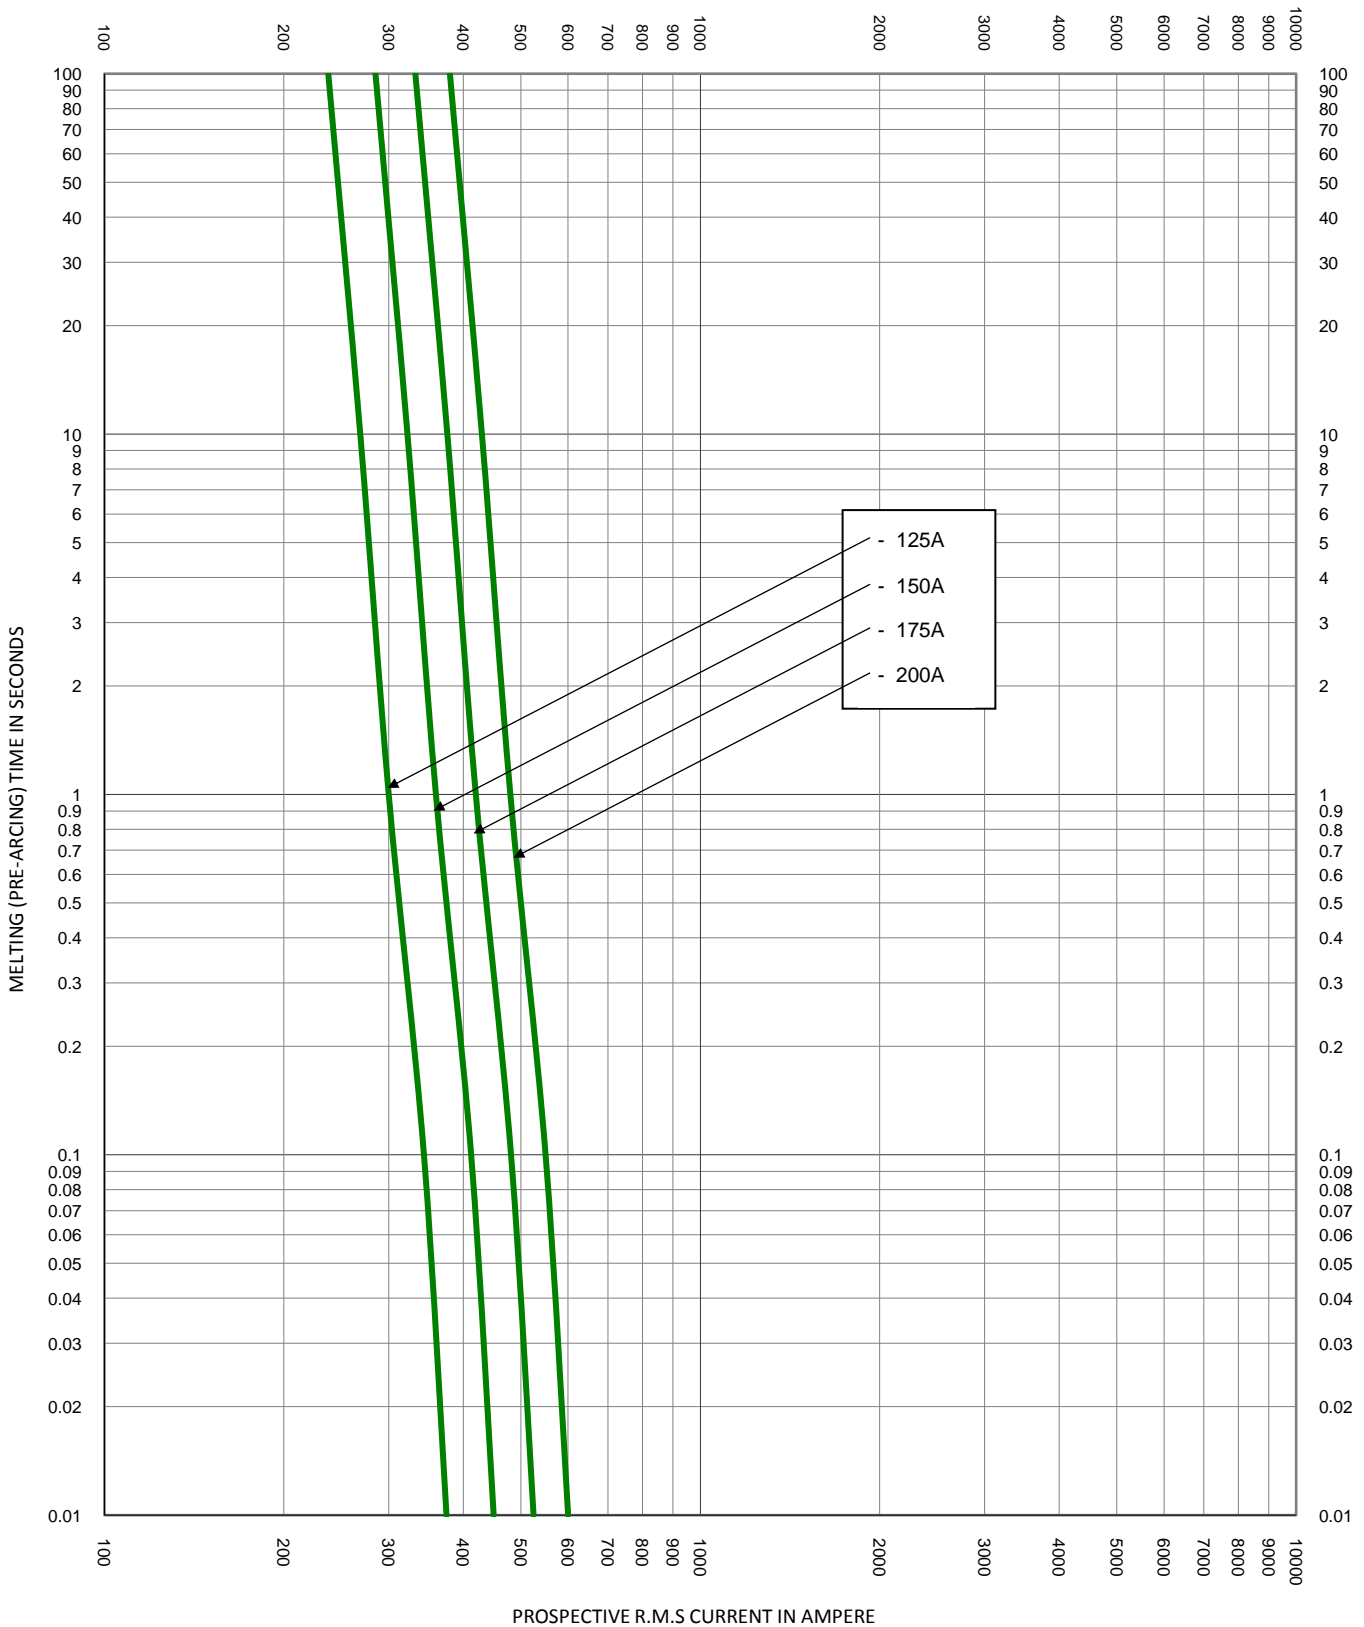
| | | |
|---|-----------------------------|--|
| TEST VOLTAGE: | TIME CONSTANT/POWER FACTOR: | FUSE CATALOG NUMBER: |
| BASIS FOR DATA: | | L25S 1A - 800A |
|  | | DRAWN BY: LLL DATE: 11/08/2017 REVISION: A |
| TIME CURRENT CHARACTERISTIC CURVES | | DRAWING NO.: FCC01-L25S SHEET 3 OF 7 |




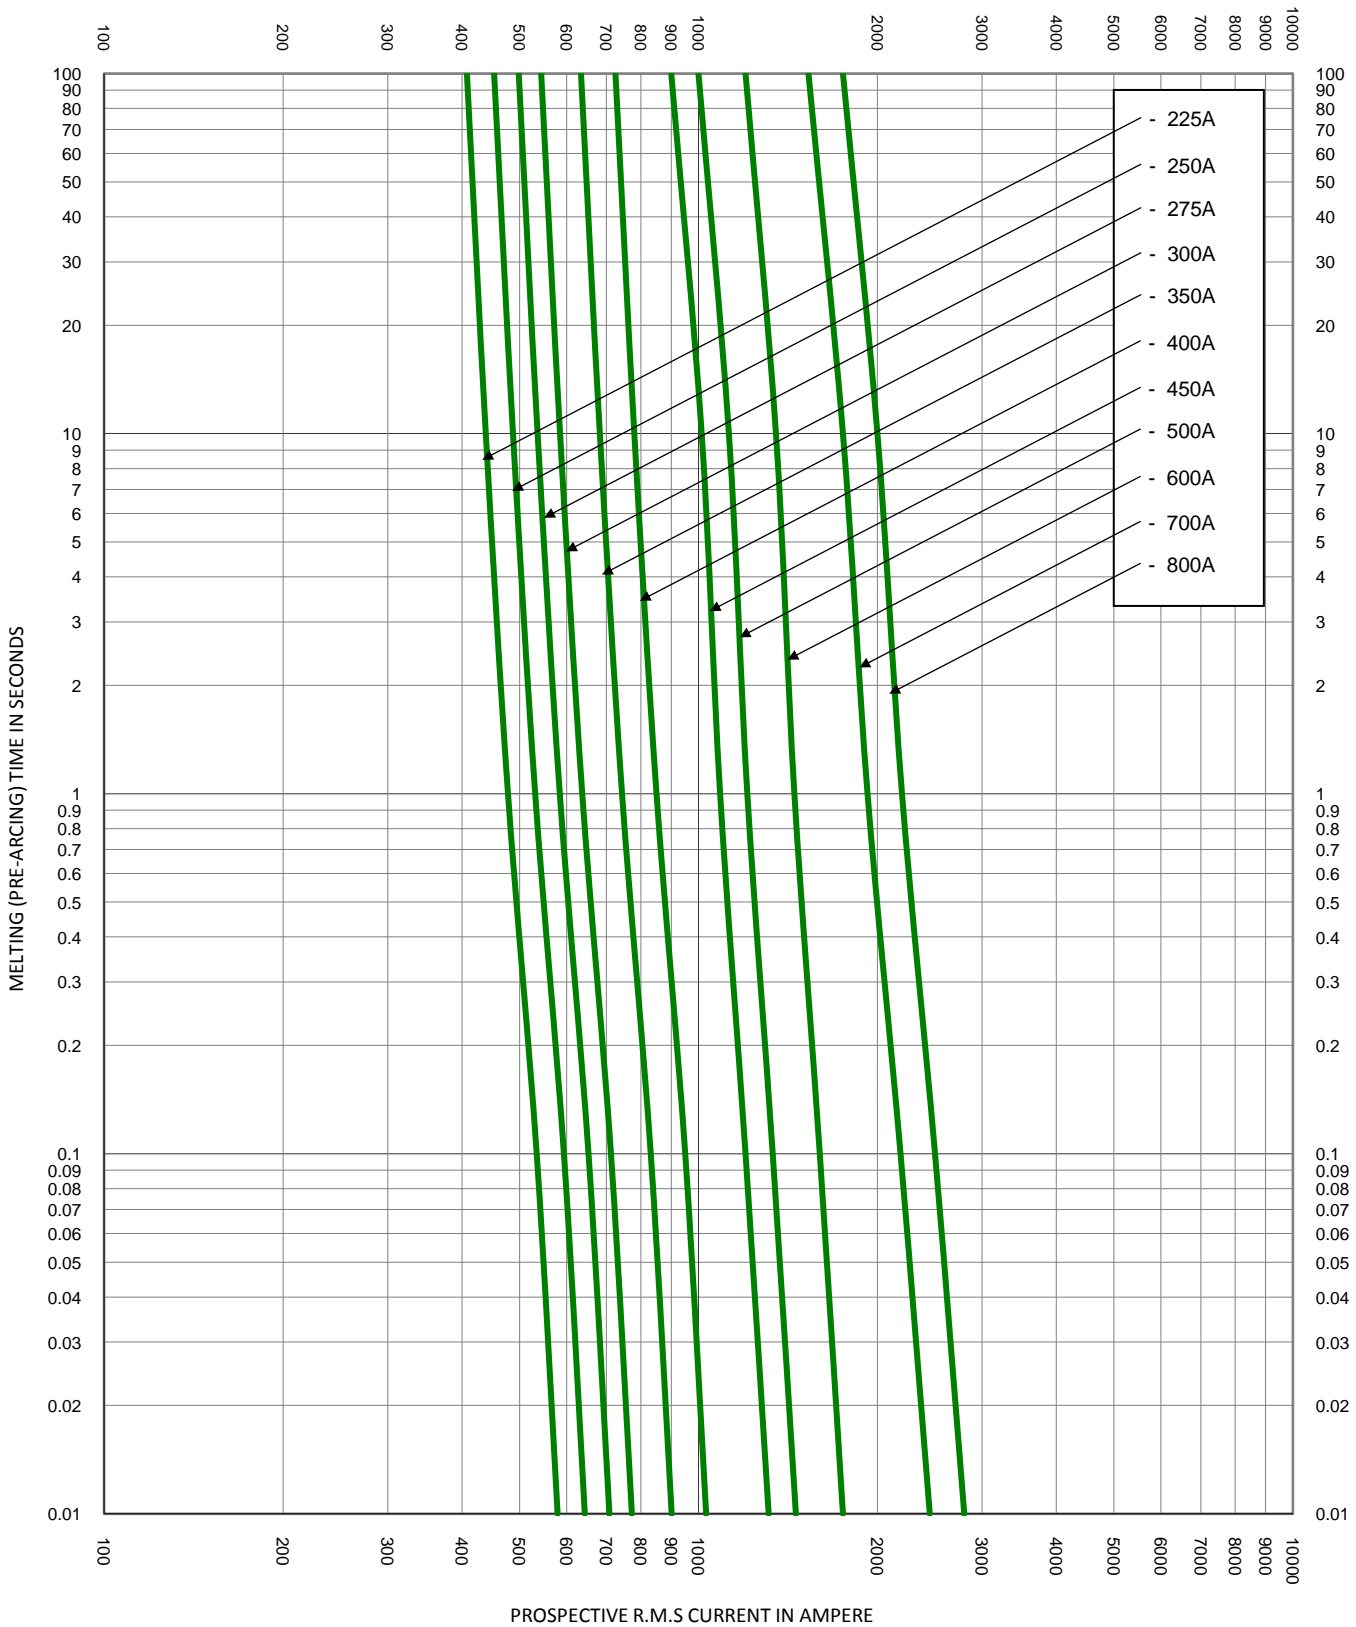
| | | |
|---|-----------------------------|--|
| TEST VOLTAGE: | TIME CONSTANT/POWER FACTOR: | FUSE CATALOG NUMBER: |
| BASIS FOR DATA: | | L25S 1A - 800A |
|  | | DRAWN BY: LLL DATE: 11*08/2017 REVISION: A |
| TIME CURRENT CHARACTERISTIC CURVES | | DRAWING NO.: FCC01-L25S SHEET 4 OF 7 |




| | | |
|---|-----------------------------|--|
| TEST VOLTAGE: | TIME CONSTANT/POWER FACTOR: | FUSE CATALOG NUMBER: |
| BASIS FOR DATA: | | L25S 1A - 800A |
|  | | DRAWN BY: LLL DATE: 11/08/2017 REVISION: A |
| TIME CURRENT CHARACTERISTIC CURVES | | DRAWING NO.: FCC01-L25S SHEET 5 OF 7 |



| | | |
|---|-----------------------------|--|
| TEST VOLTAGE: | TIME CONSTANT/POWER FACTOR: | FUSE CATALOG NUMBER: |
| BASIS FOR DATA: | | L25S 1A - 800A |
|  | | DRAWN BY: LLL DATE: 11/08/2017 REVISION: A |
| TIME CURRENT CHARACTERISTIC CURVES | | DRAWING NO.: FCC01-L25S SHEET 6 OF 7 |



| | | |
|---|-----------------------------|--|
| TEST VOLTAGE: | TIME CONSTANT/POWER FACTOR: | FUSE CATALOG NUMBER: |
| BASIS FOR DATA: | | L25S 1A - 800A |
|  LITTELFUSE, INC. CHICAGO, IL. USA | | DRAWN BY: LLL DATE: 11/08/2017 REVISION: A |
| TIME CURRENT CHARACTERISTIC CURVES | | DRAWING NO.: FCC01-L25S SHEET 7 OF 7 |