


CURRENT IN AMPERES

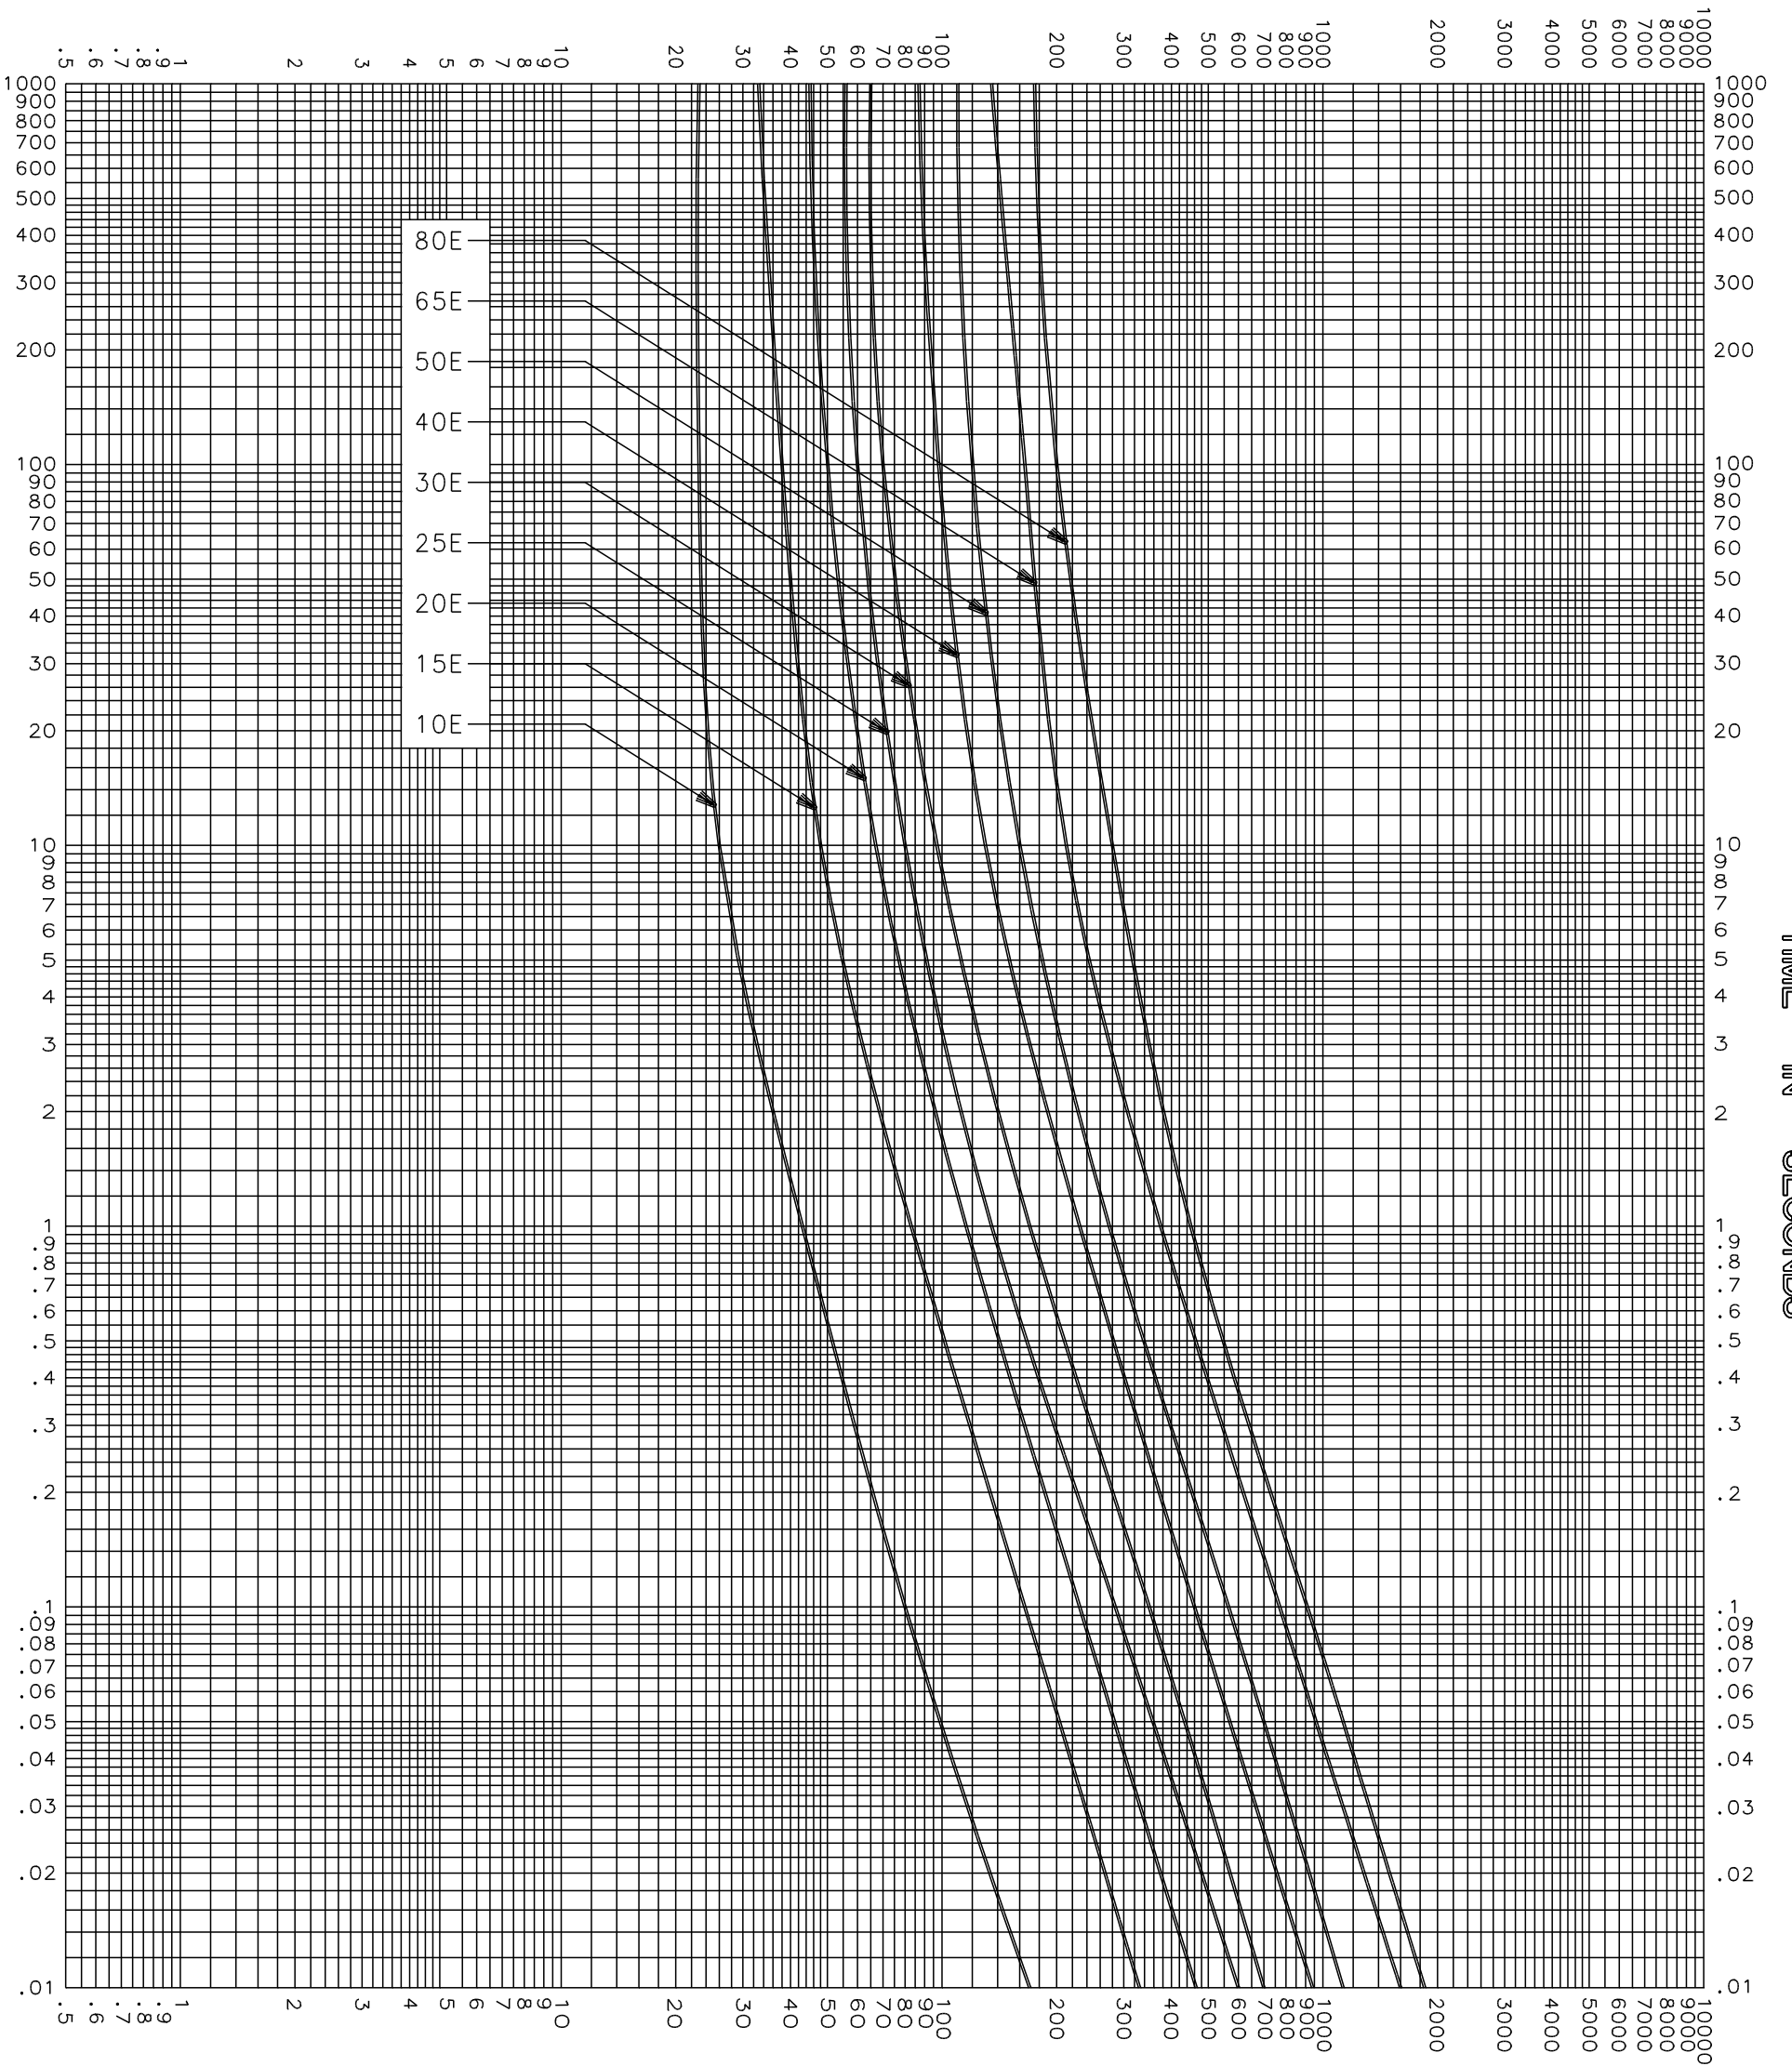

CURRENT IN AMPERES

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 8.25kV E-RATED 10E-80E
BASIS FOR DATA _____		

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 07/26/04
	CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC04 251001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT