


CURRENT IN AMPERES

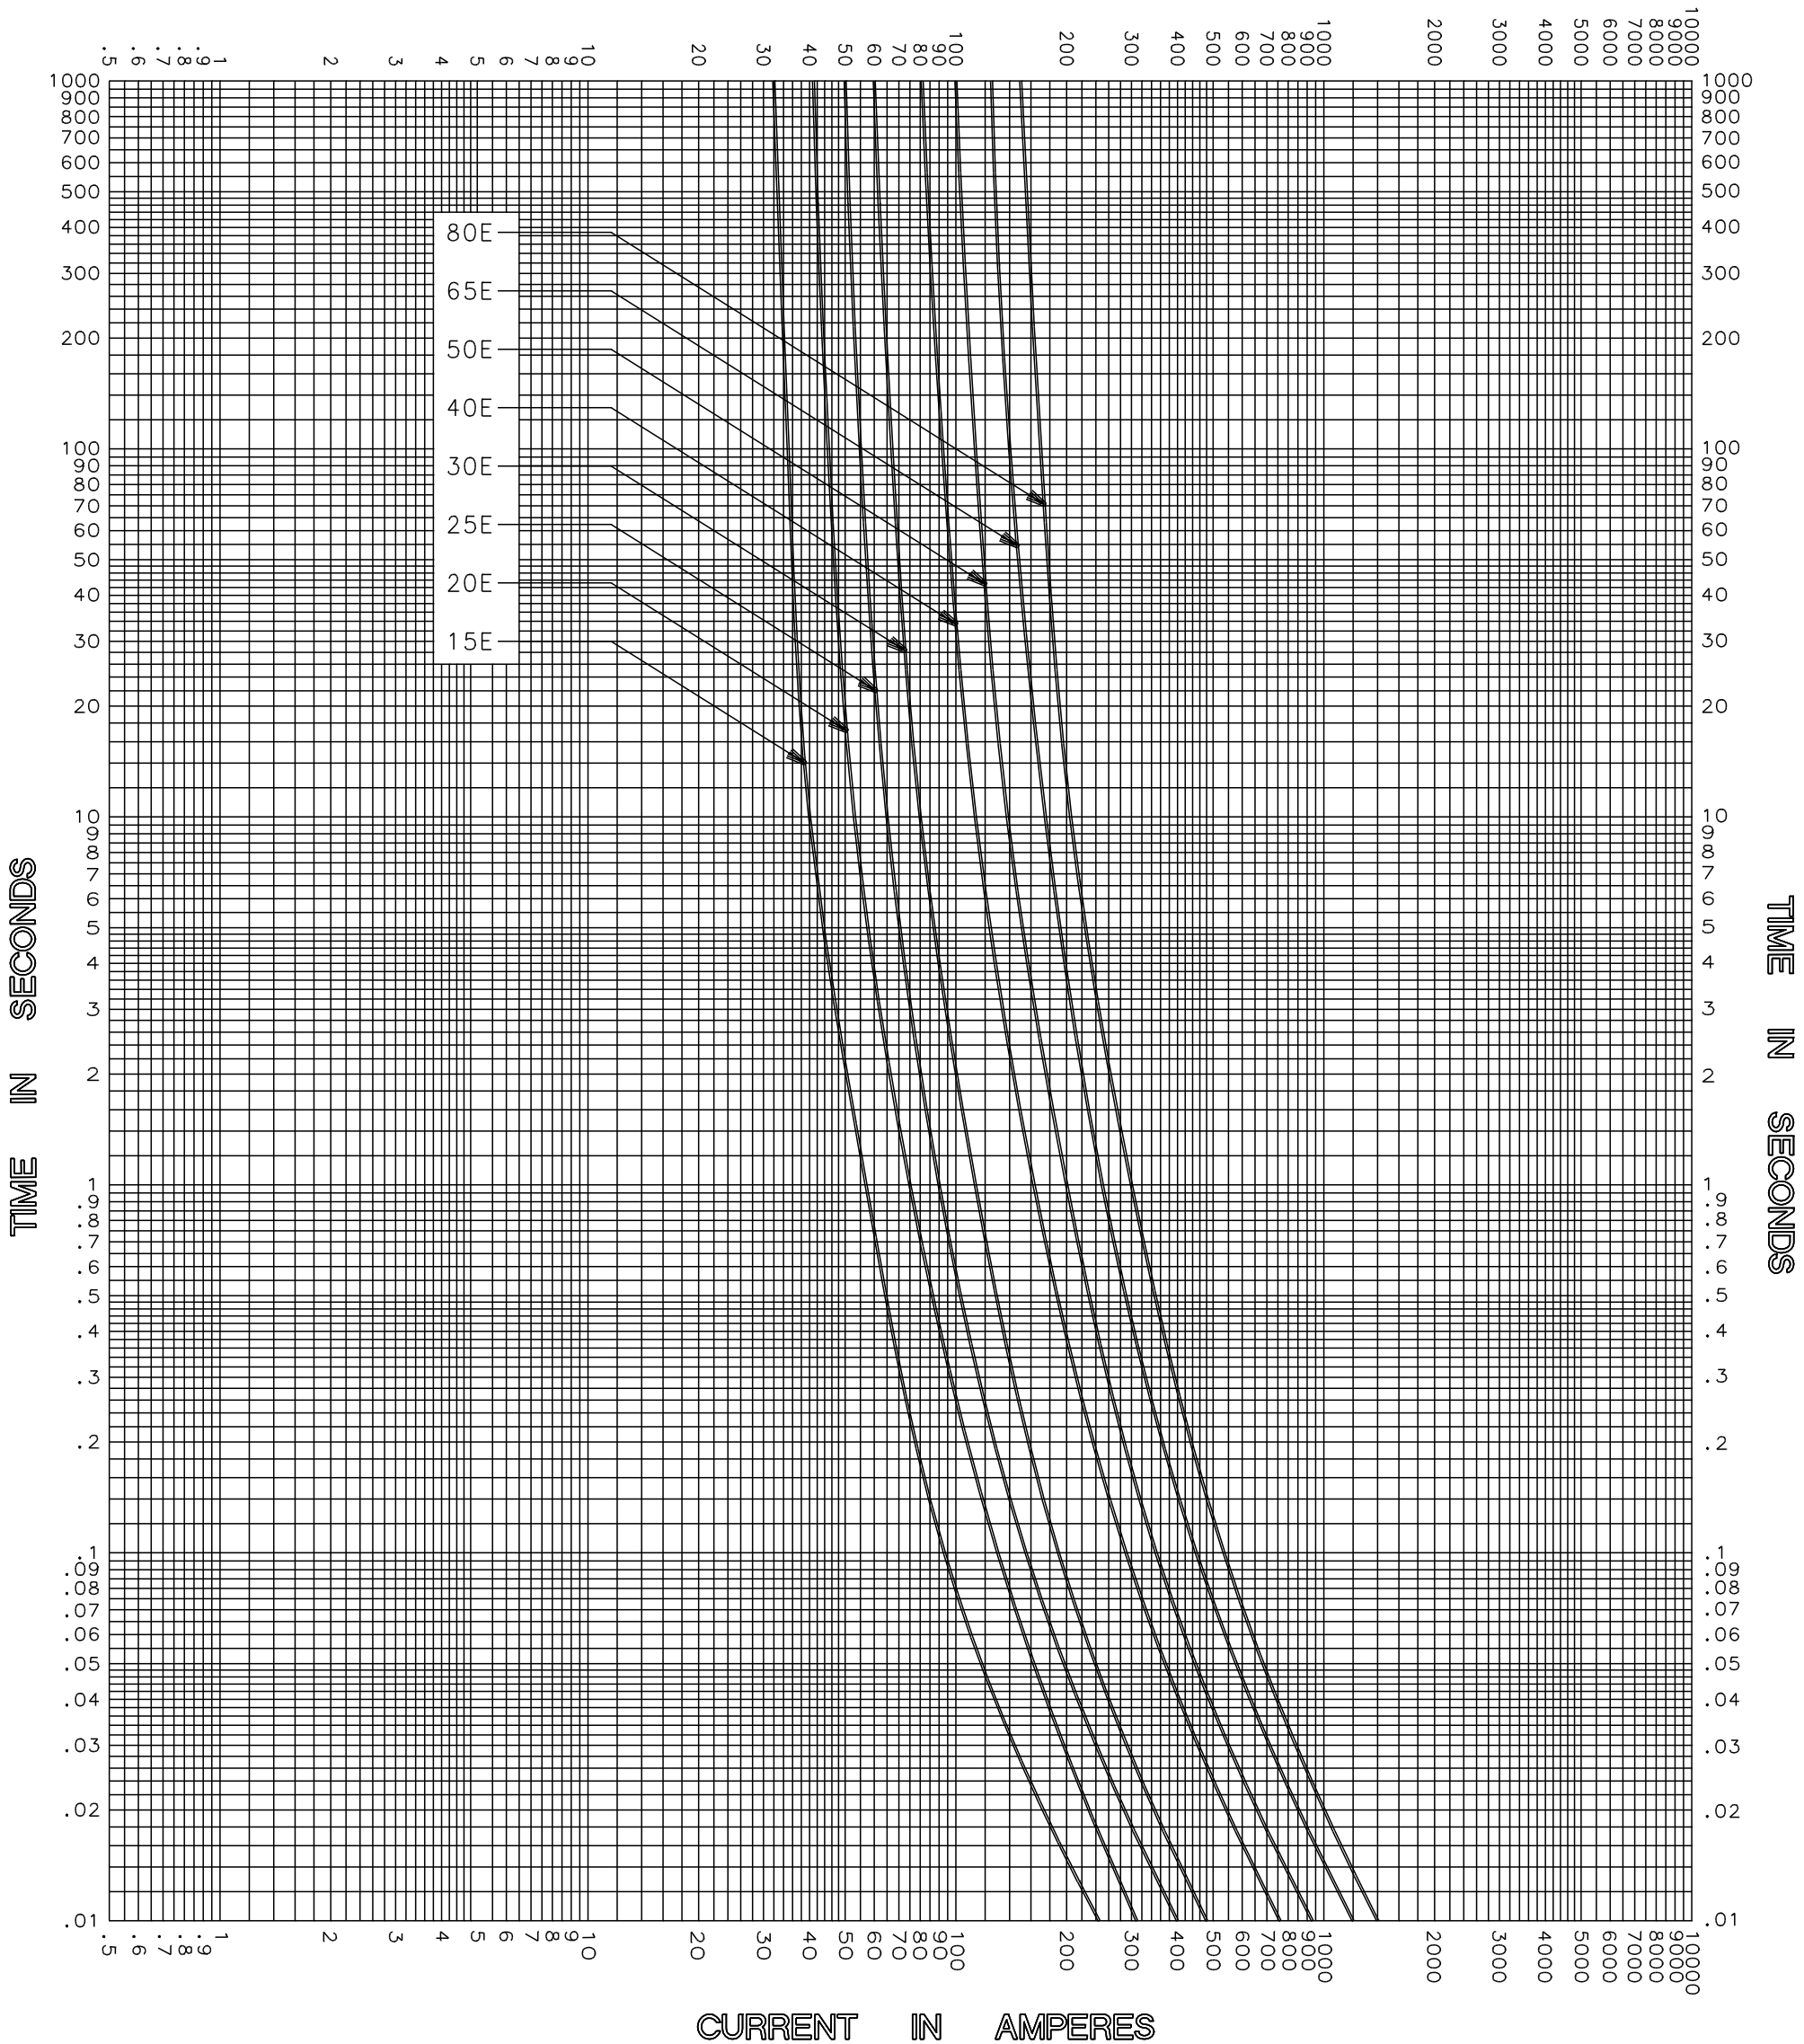

CURRENT IN AMPERES

MELTING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	38.0kV E-RATED 15E-80E

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 05/21/04
	CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC03

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT