



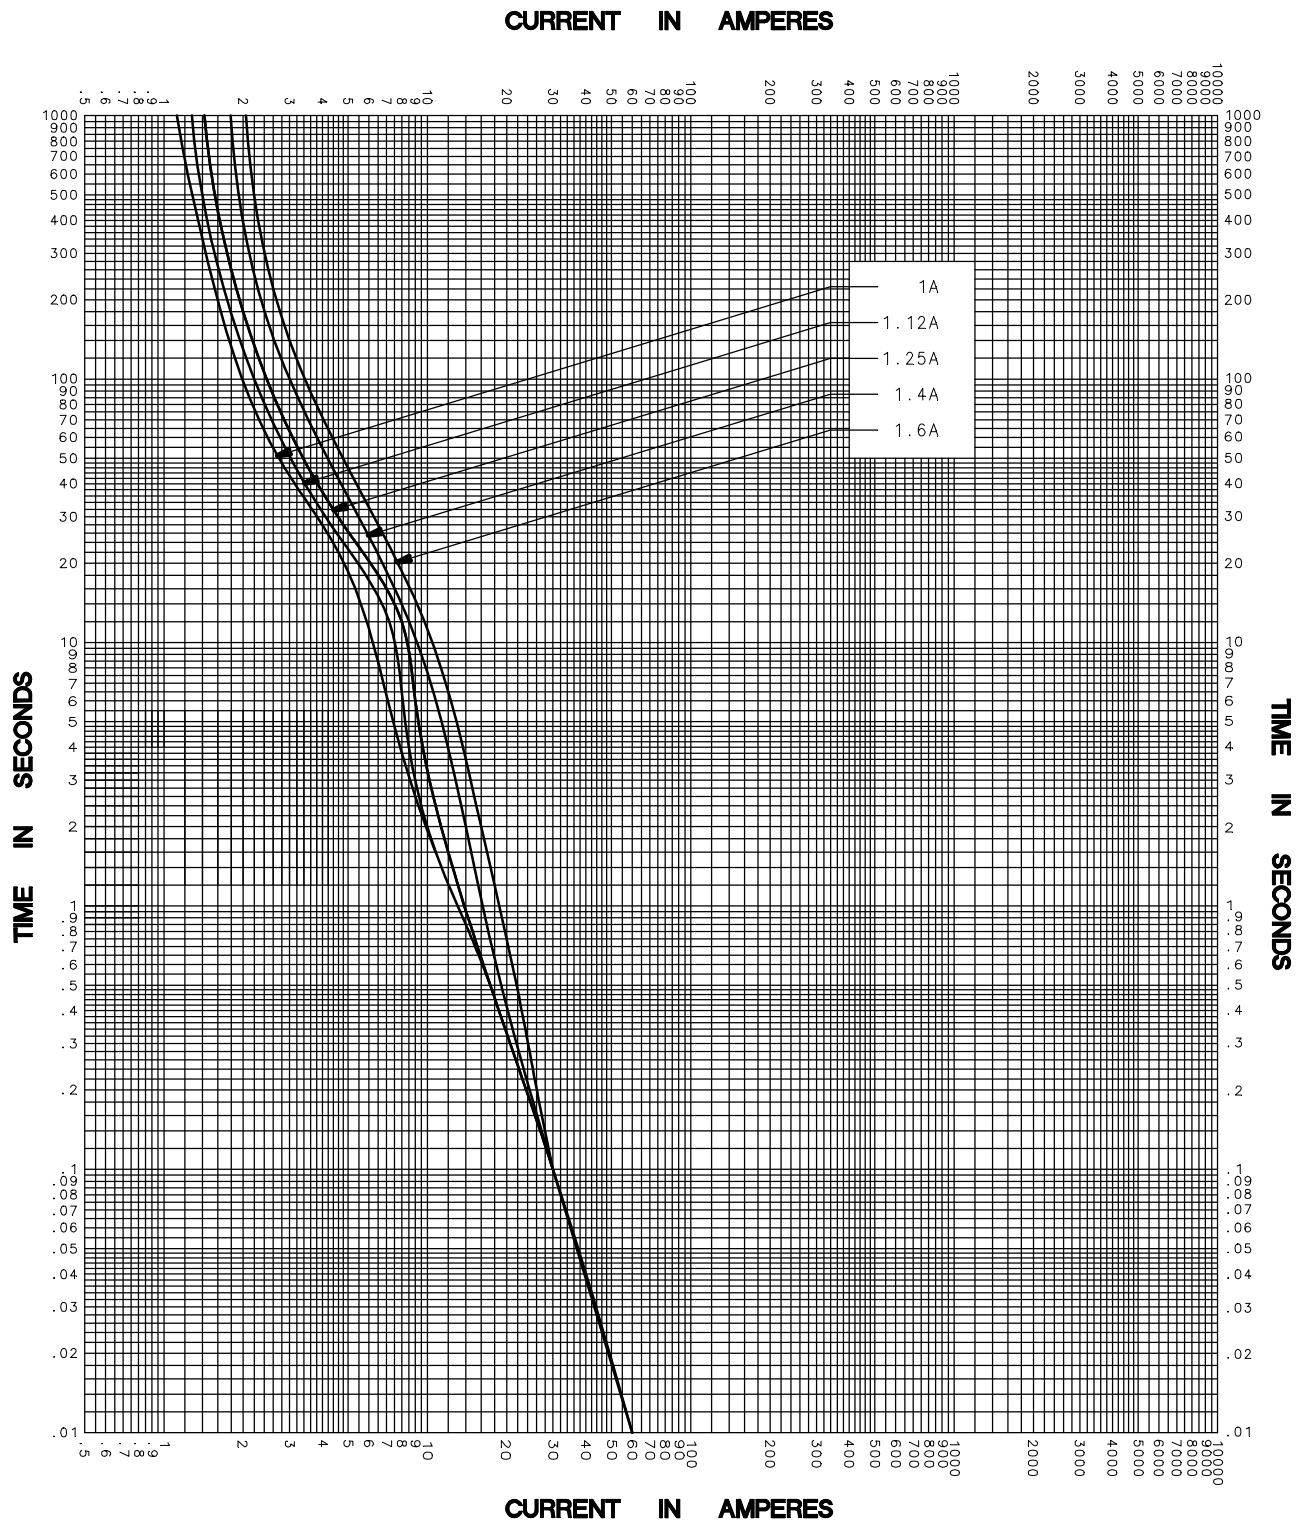

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER LLSRK (1A - 1.6A)
 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL DATE 12/03/04 CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC01-LSRK-002

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

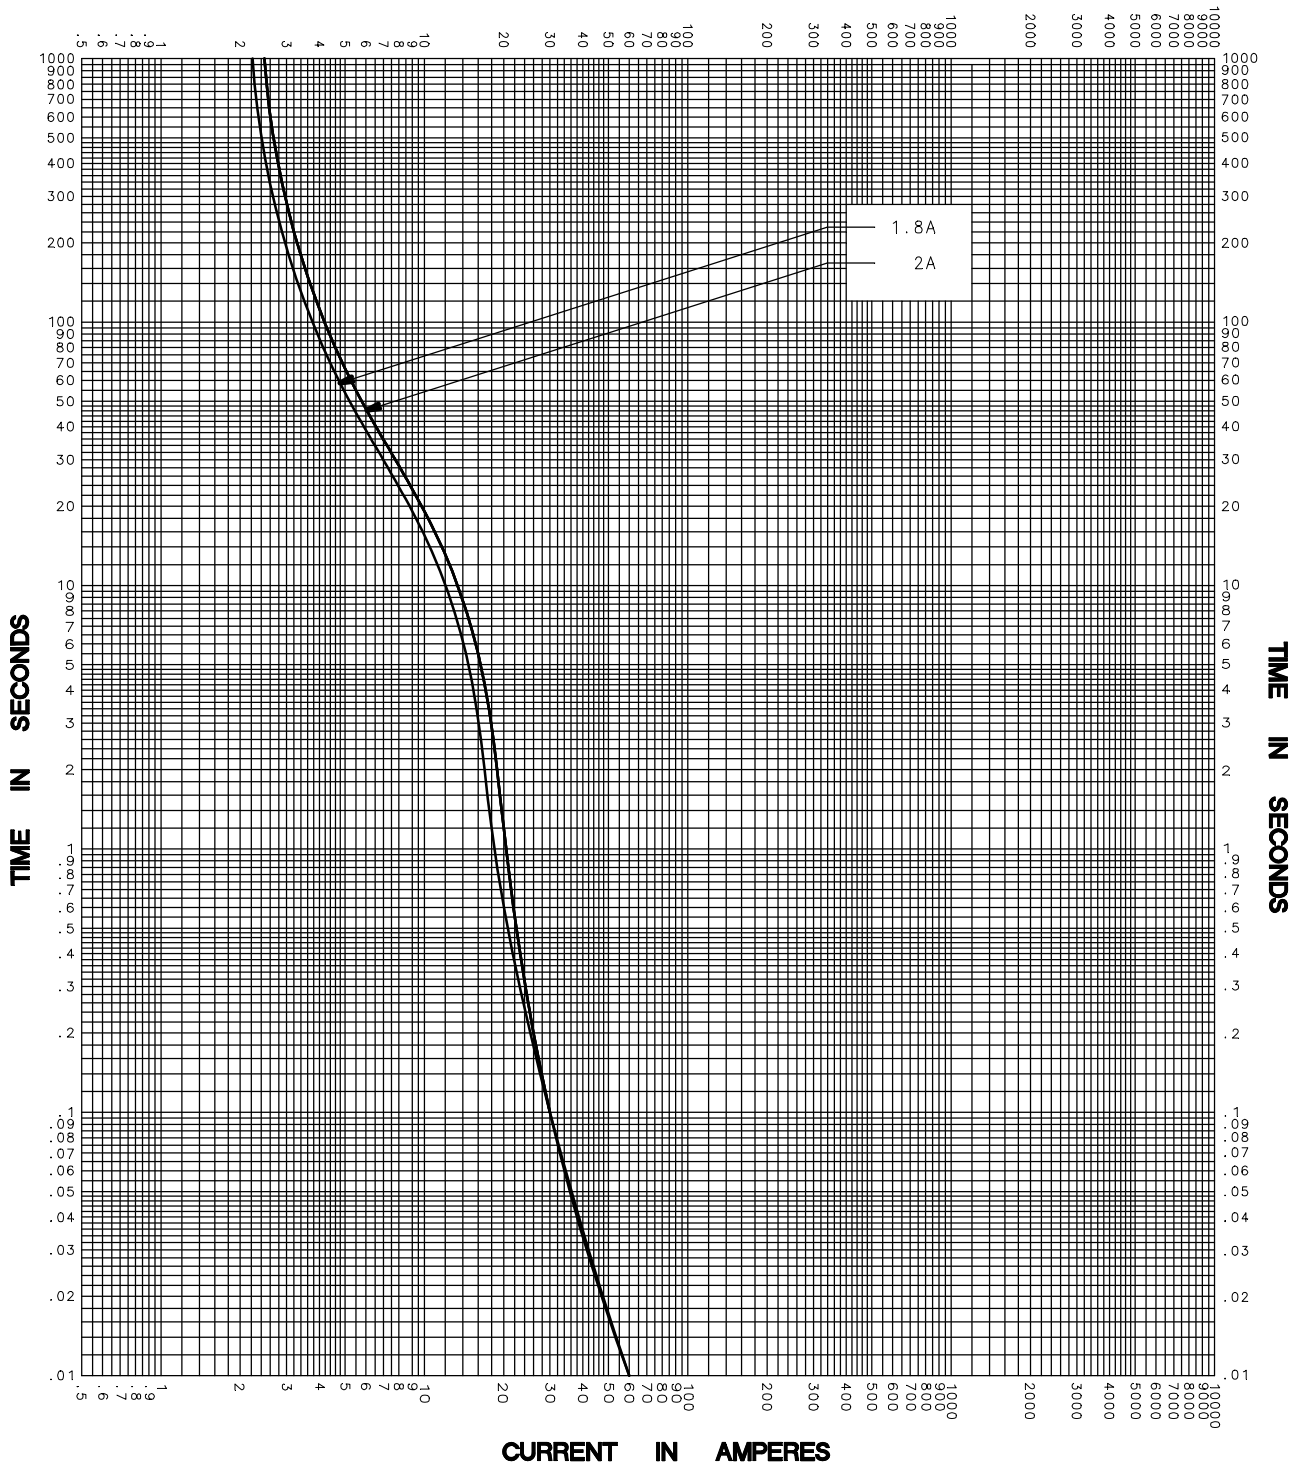

TIME IN SECONDS

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER

LLSRK (1.8A - 2A)


Littelfuse®
DES PLAINES, ILLINOIS 60016

DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-003


-THIS DATA GENERATED ON CAD-

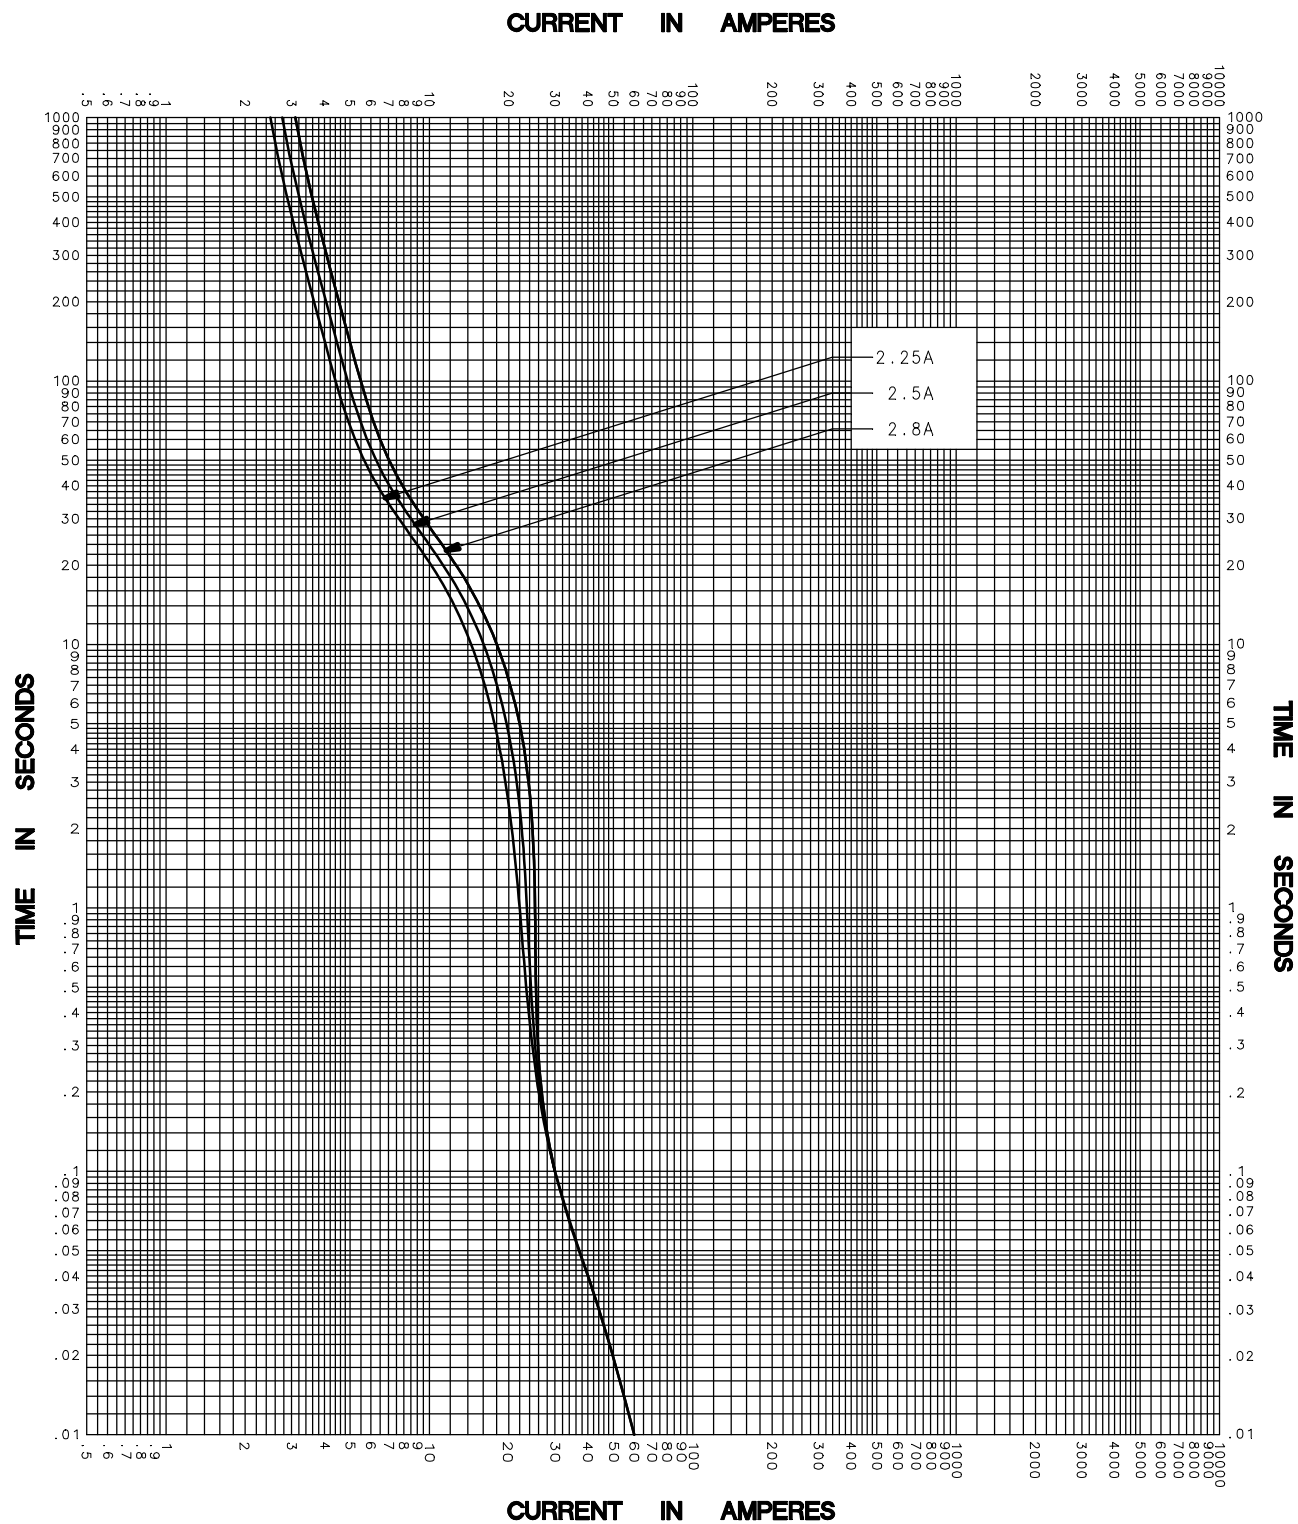

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER LLSRK (2.25A - 2.8A)
 Littelfuse® DES PLAINES, ILLINOIS 60016	
TIME CURRENT CHARACTERISTIC CURVES	DRAWN BY <u>LLL</u> DATE <u>12/03/04</u> CHECKED BY <u>MP</u> DRAWING NO. <u>B-FCC01-LSRK-004</u>

-THIS DATA GENERATED ON CAD-


CURRENT IN AMPERES

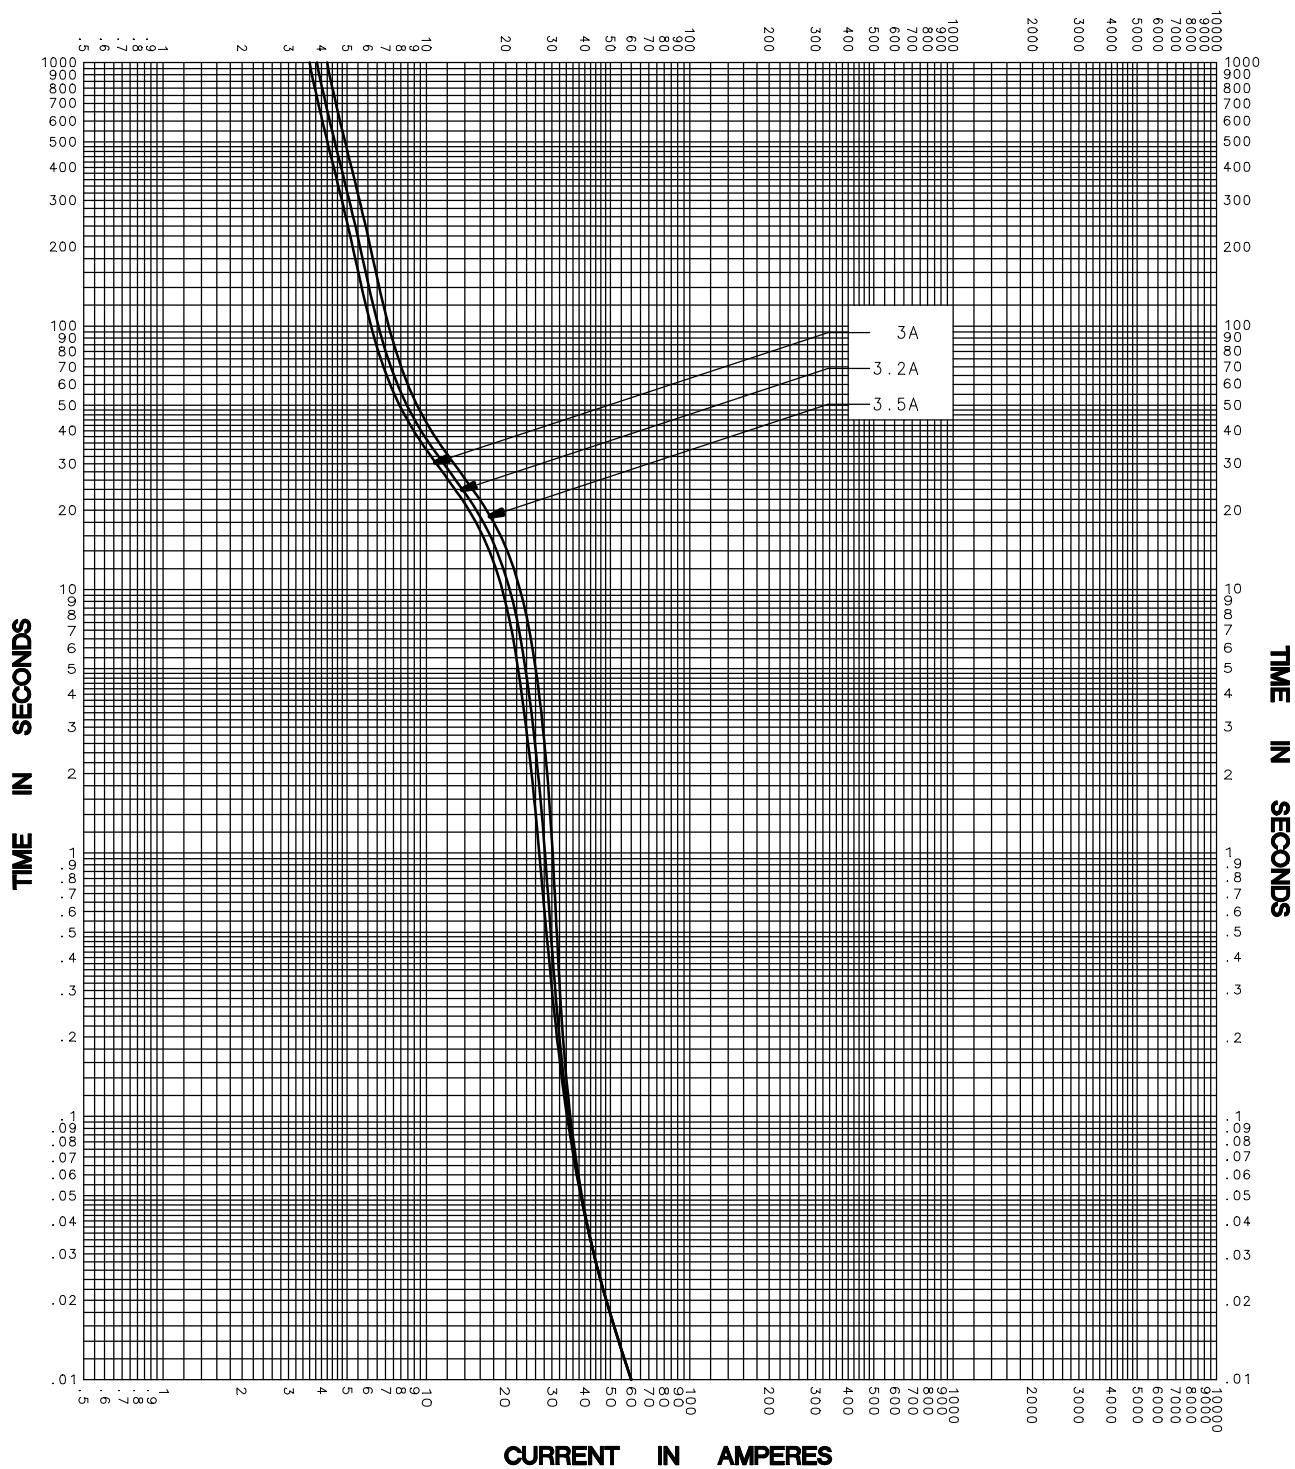

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK(3A - 3.5A)
 DES PLAINES, ILLINOIS 60016		DRAWN BY <u>LLL</u>
		DATE <u>12/03/04</u>
TIME CURRENT CHARACTERISTIC CURVES		CHECKED BY <u>MP</u>
		DRAWING NO. <u>B-FCC01-LSRK-005</u>

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

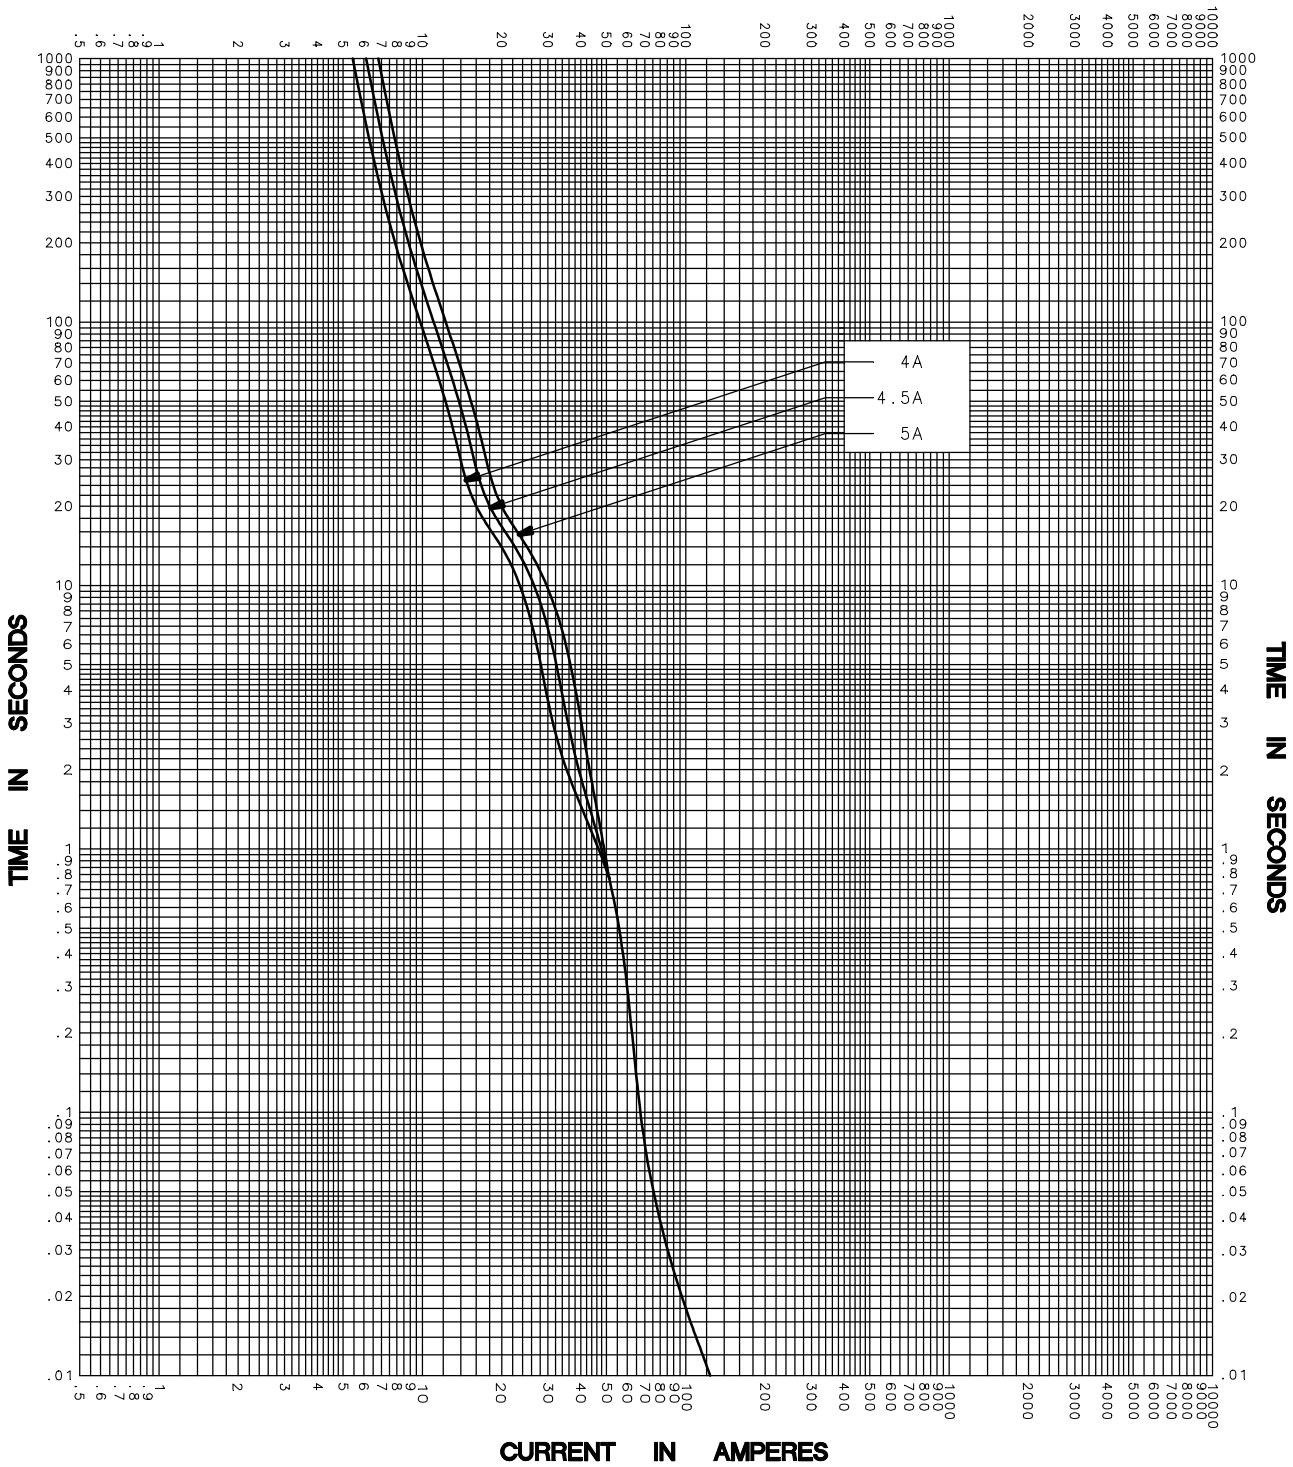

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER

LLSRK (4A - 5A)



DES PLAINES, ILLINOIS 60016


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-006

-THIS DATA GENERATED ON CAD-


CURRENT IN AMPERES

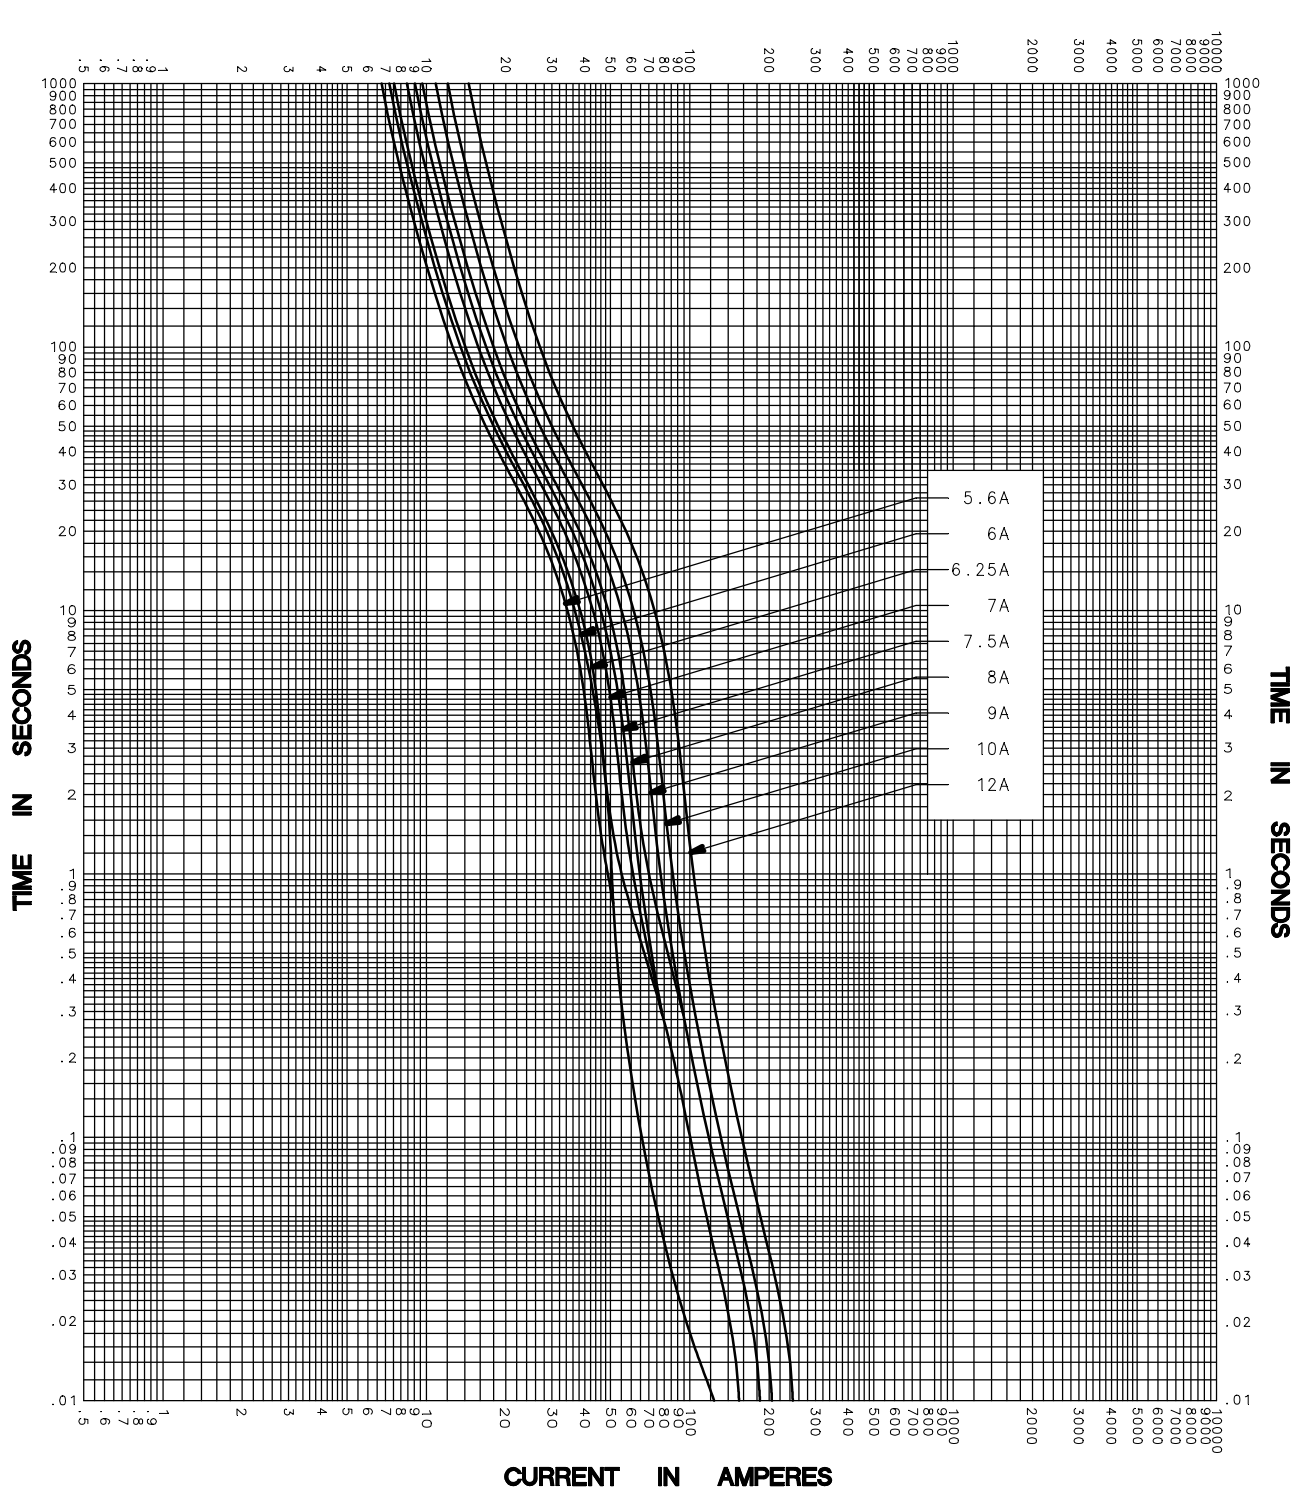

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		LLSRK (5.6A - 12A)
 DES PLAINES, ILLINOIS 60016		DRAWN BY LLL
		DATE 12/03/04
TIME CURRENT CHARACTERISTIC CURVES		CHECKED BY MP
		DRAWING NO. B-FCC01-LSRK-007

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

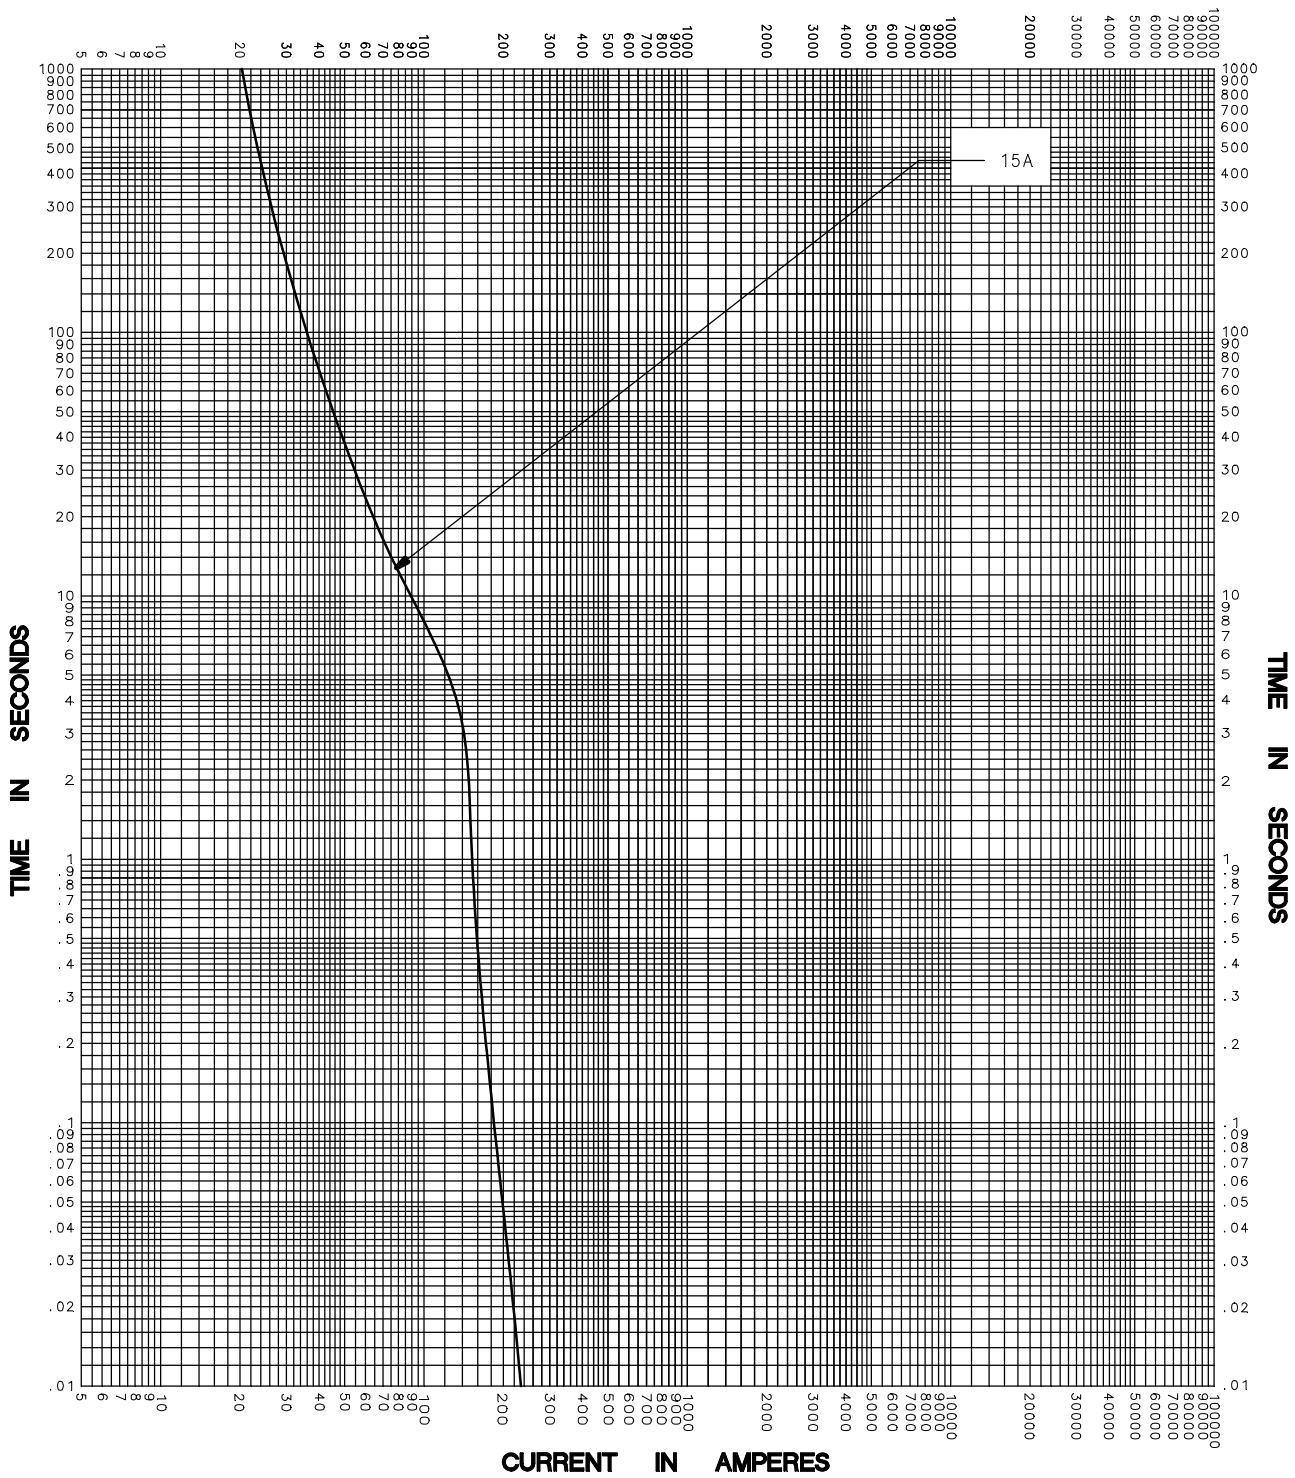

TIME IN SECONDS

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (15A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-008

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

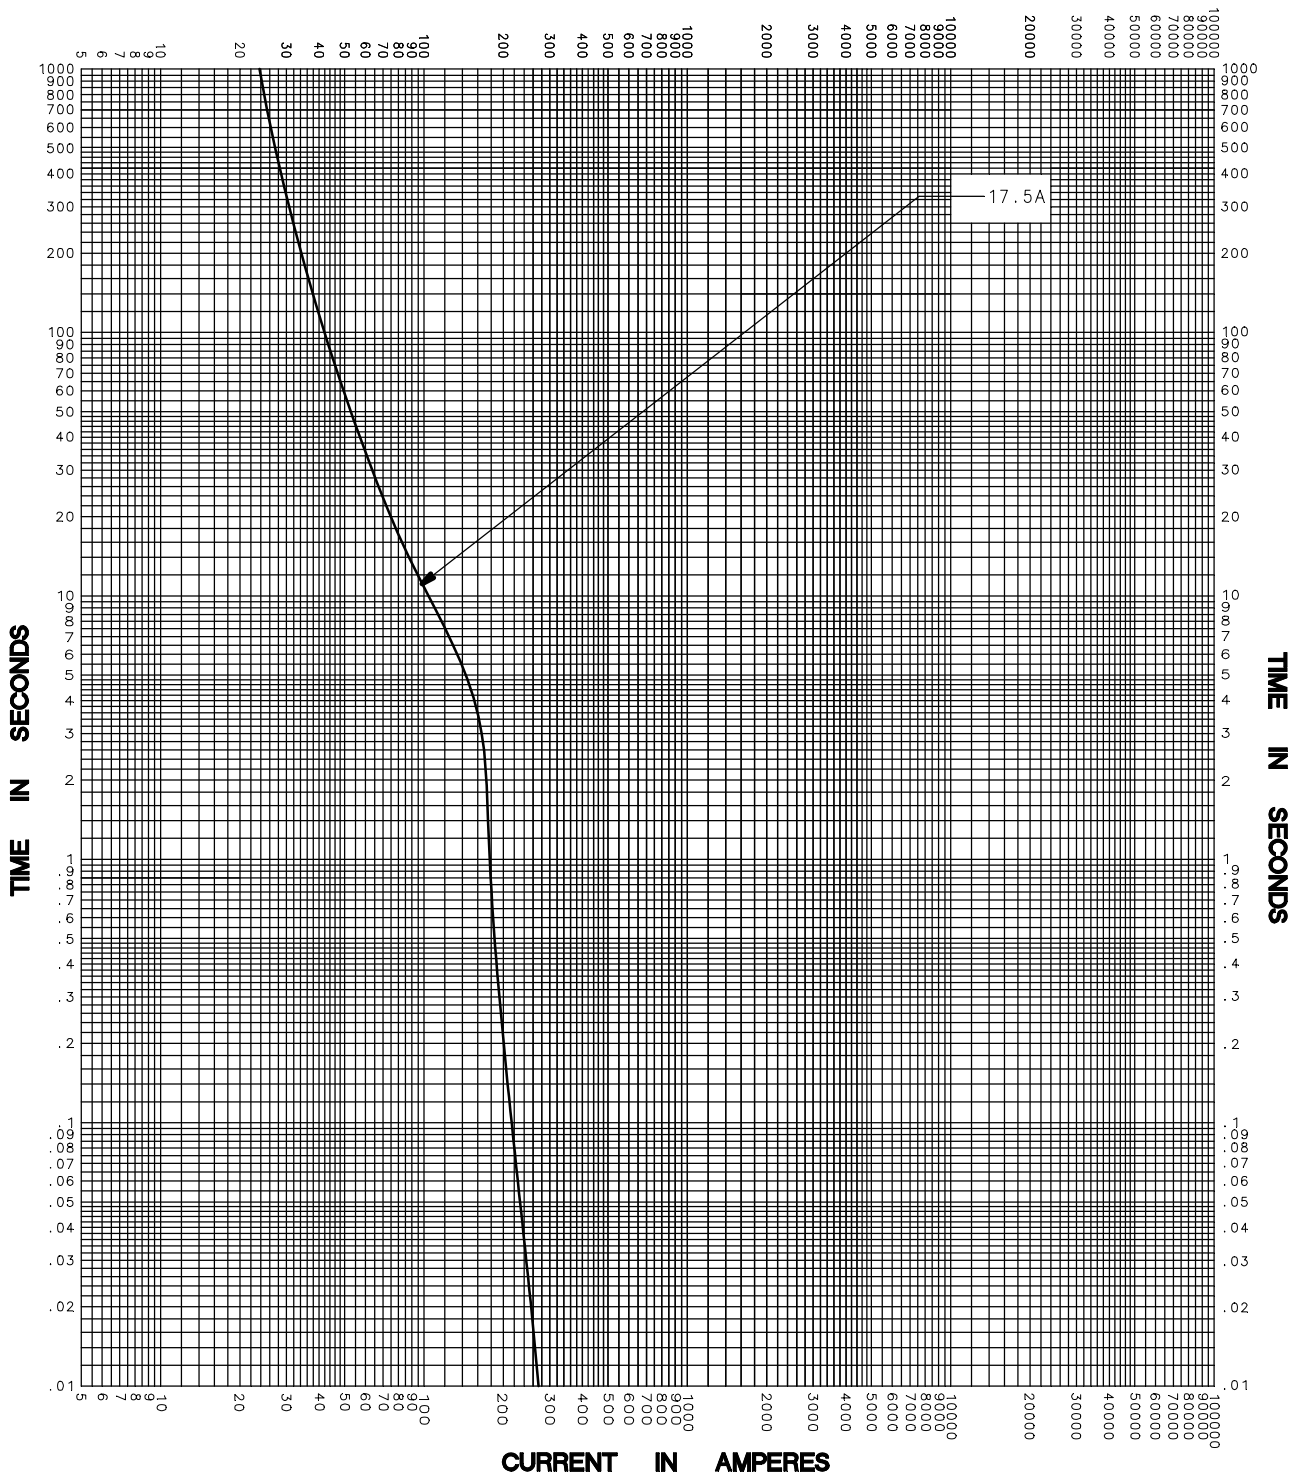

TIME IN SECONDS

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (17.5A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-009

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

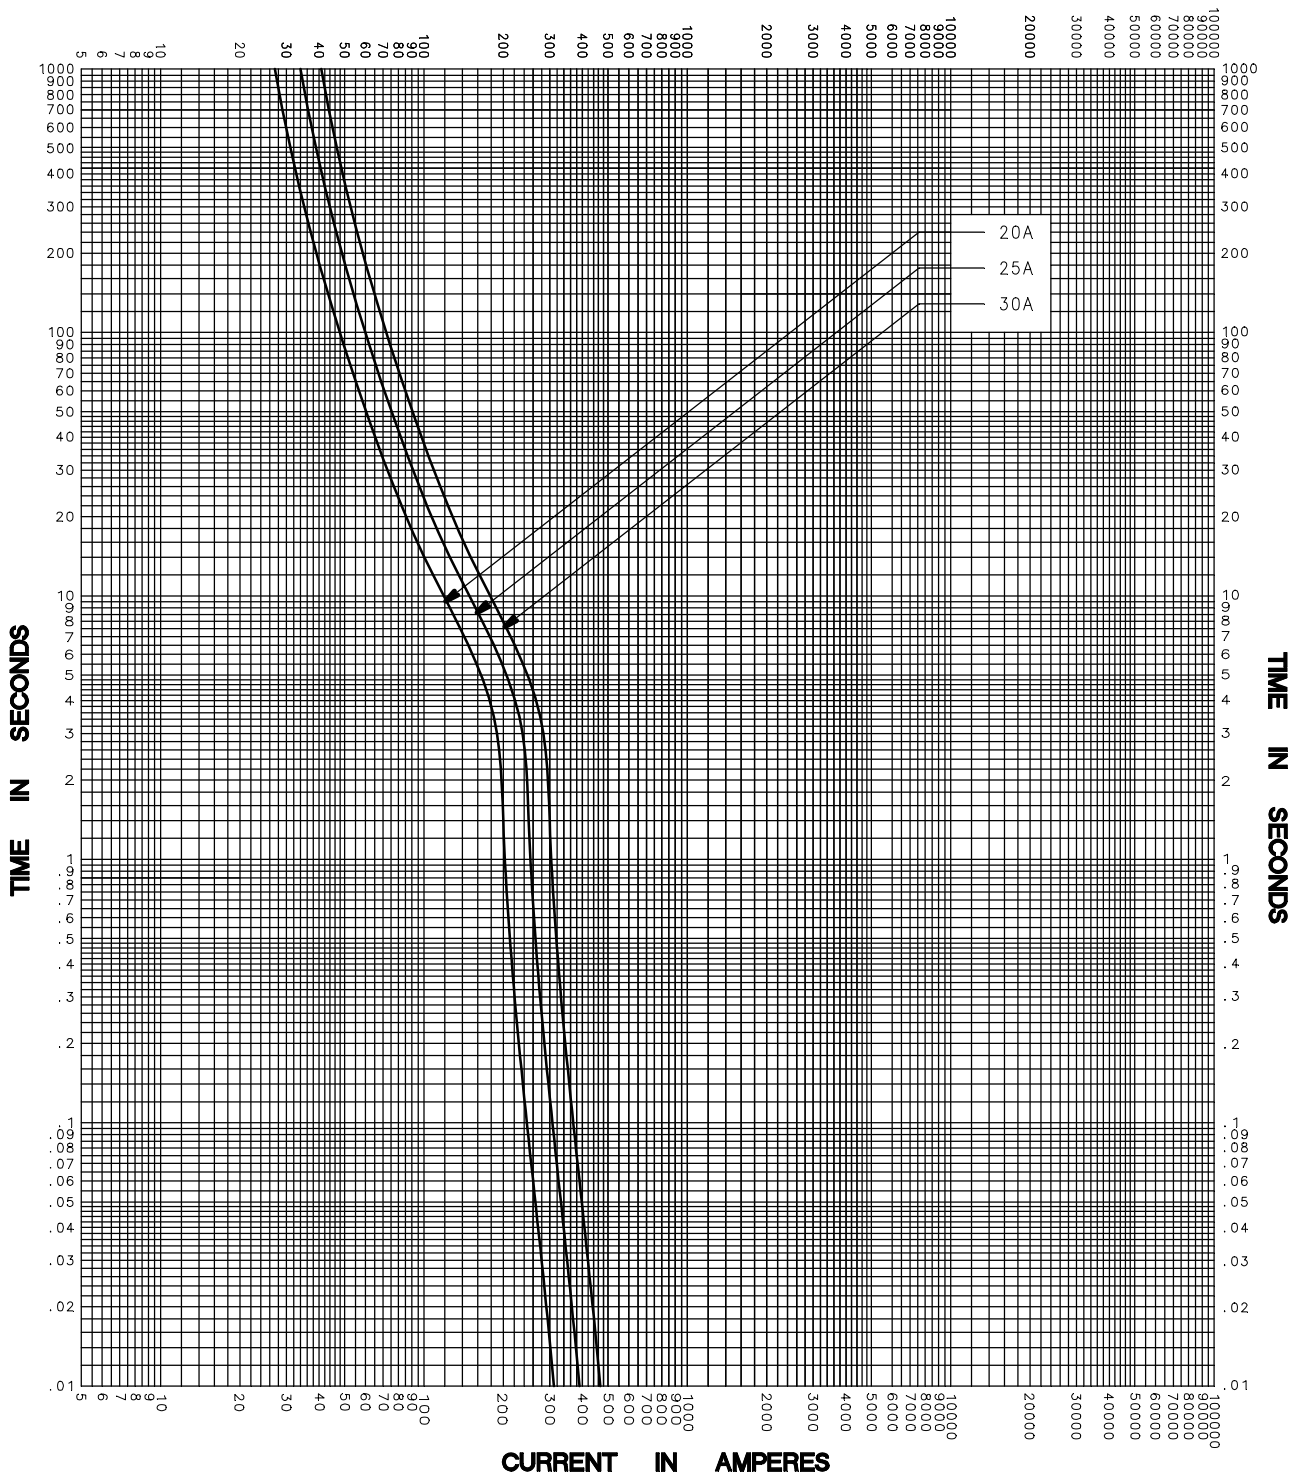

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (20A - 30A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-010

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

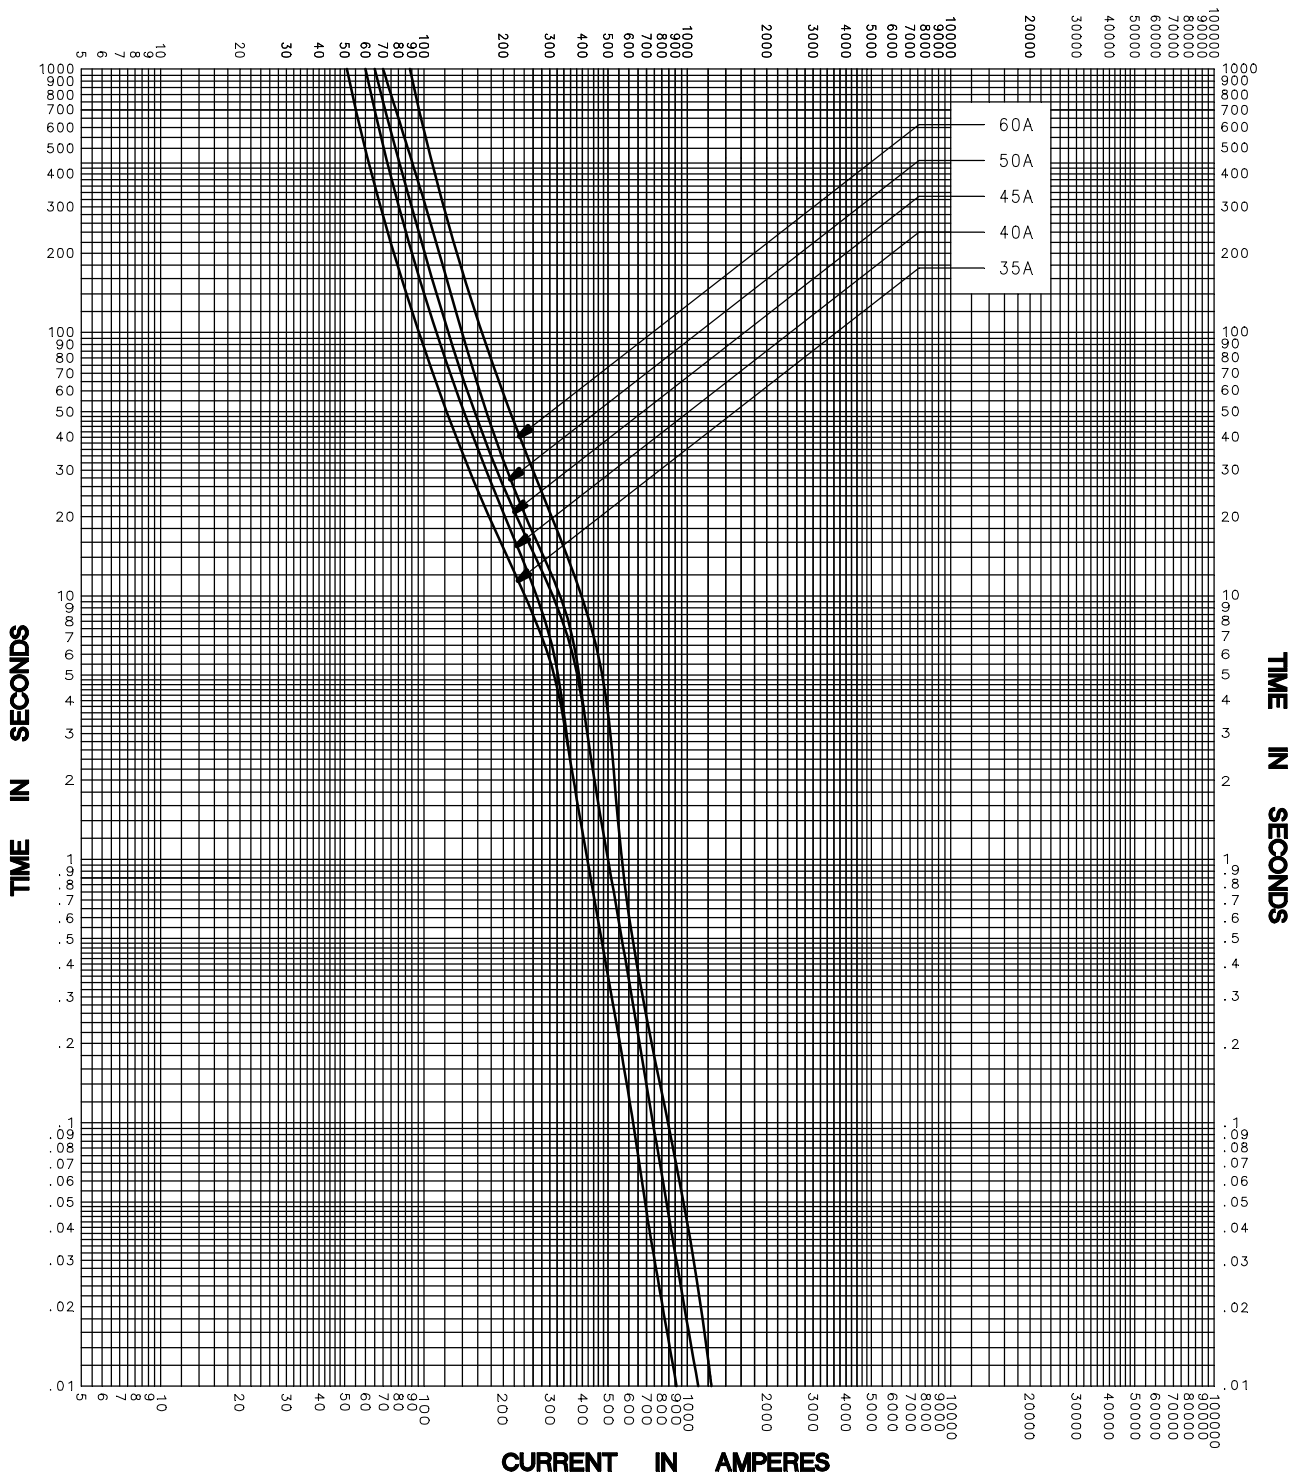

TIME IN SECONDS

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (35A - 60A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-011

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

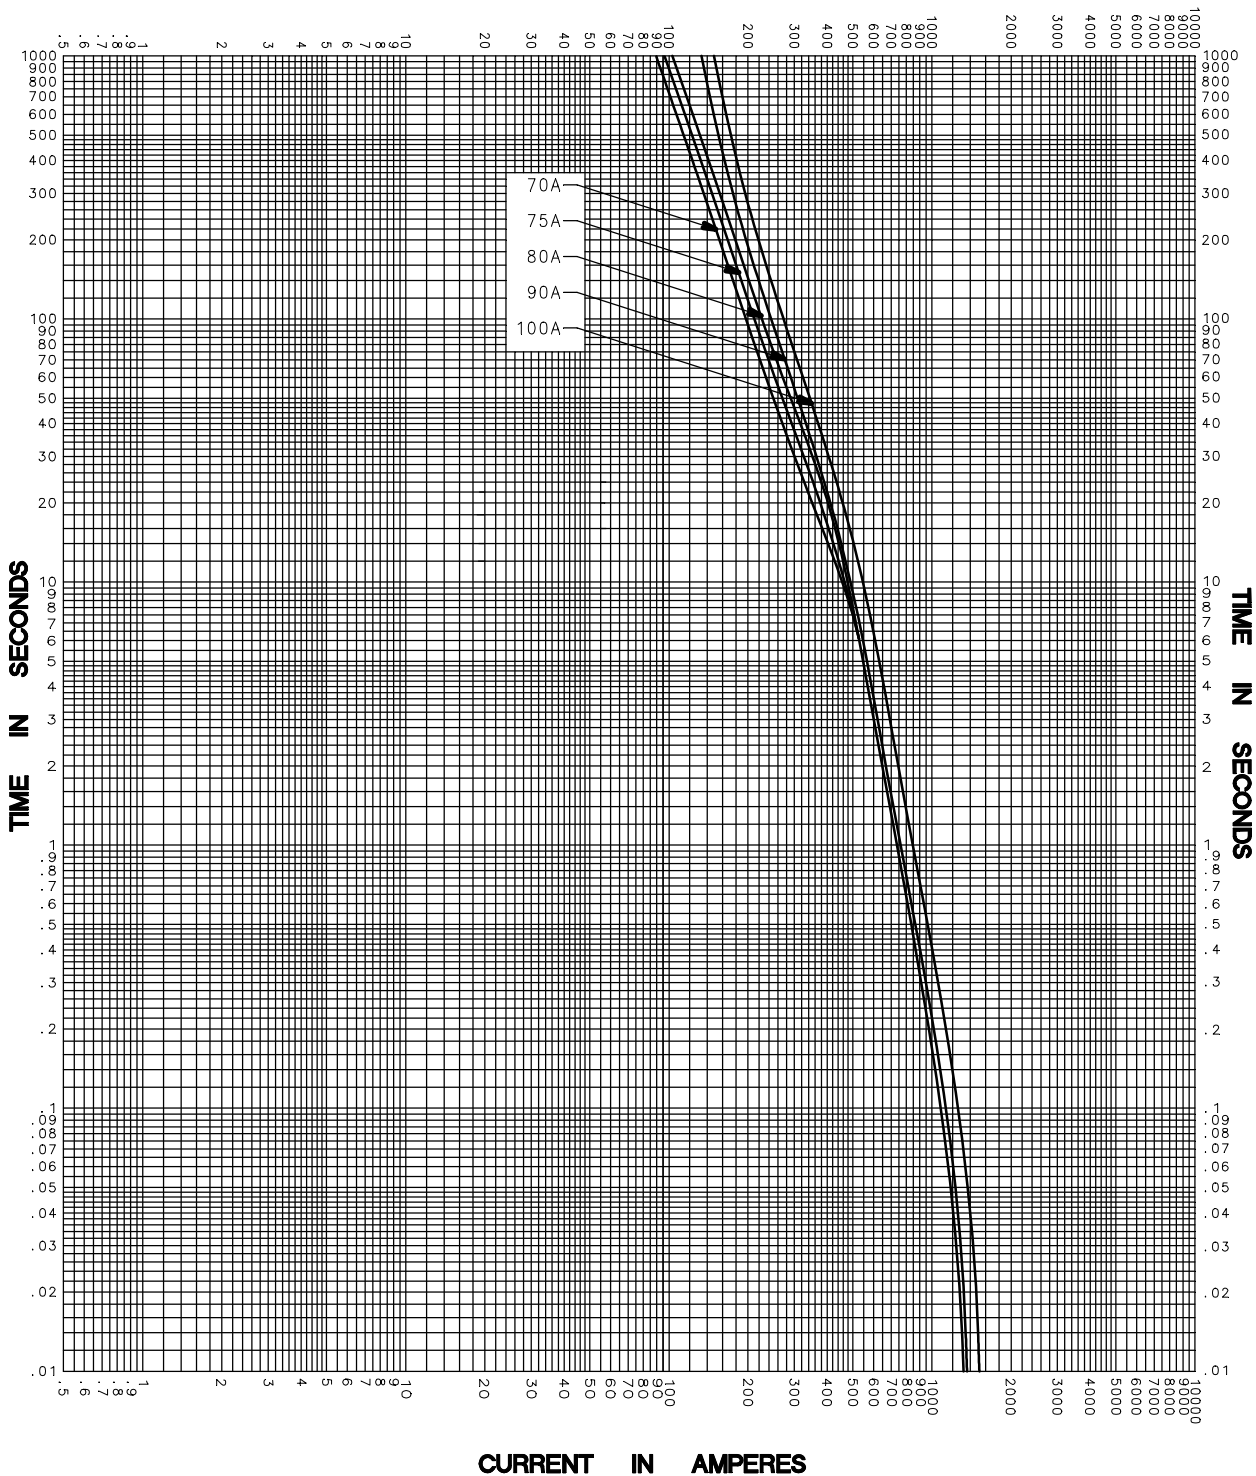

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (70A - 100A)




DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-012

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

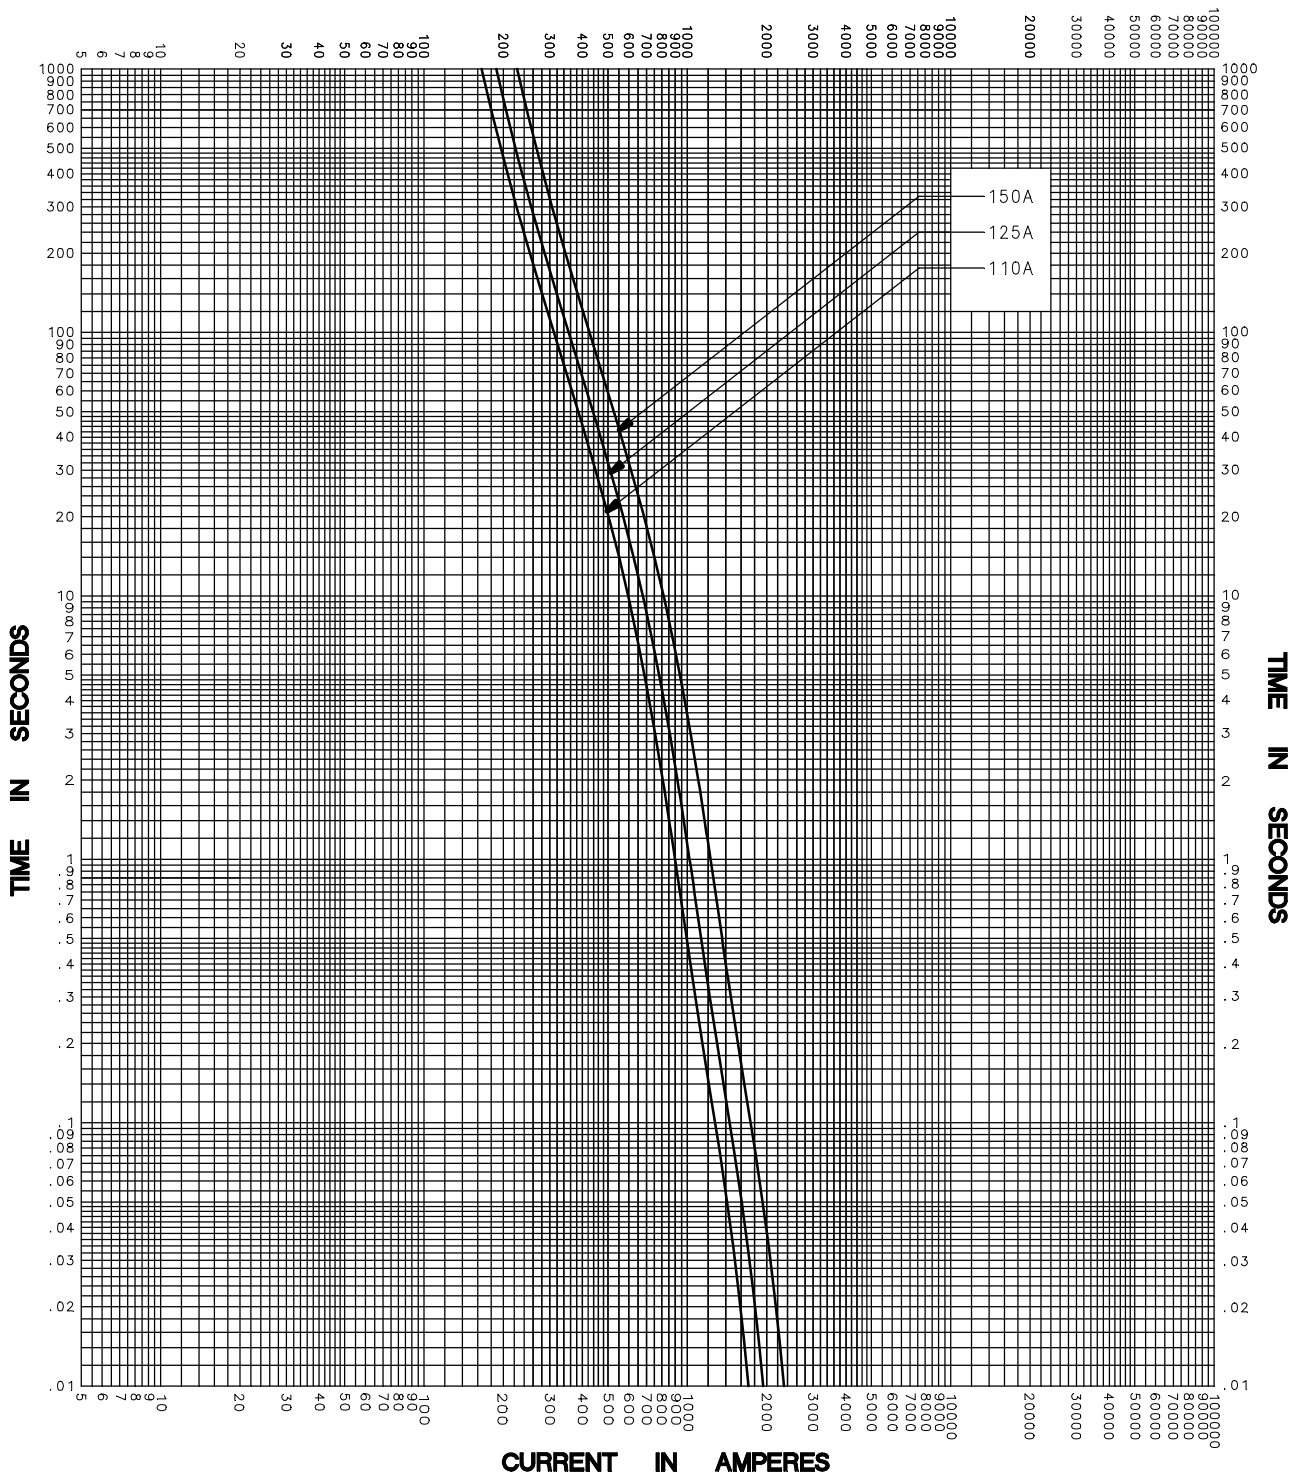

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (110A - 150A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-013

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

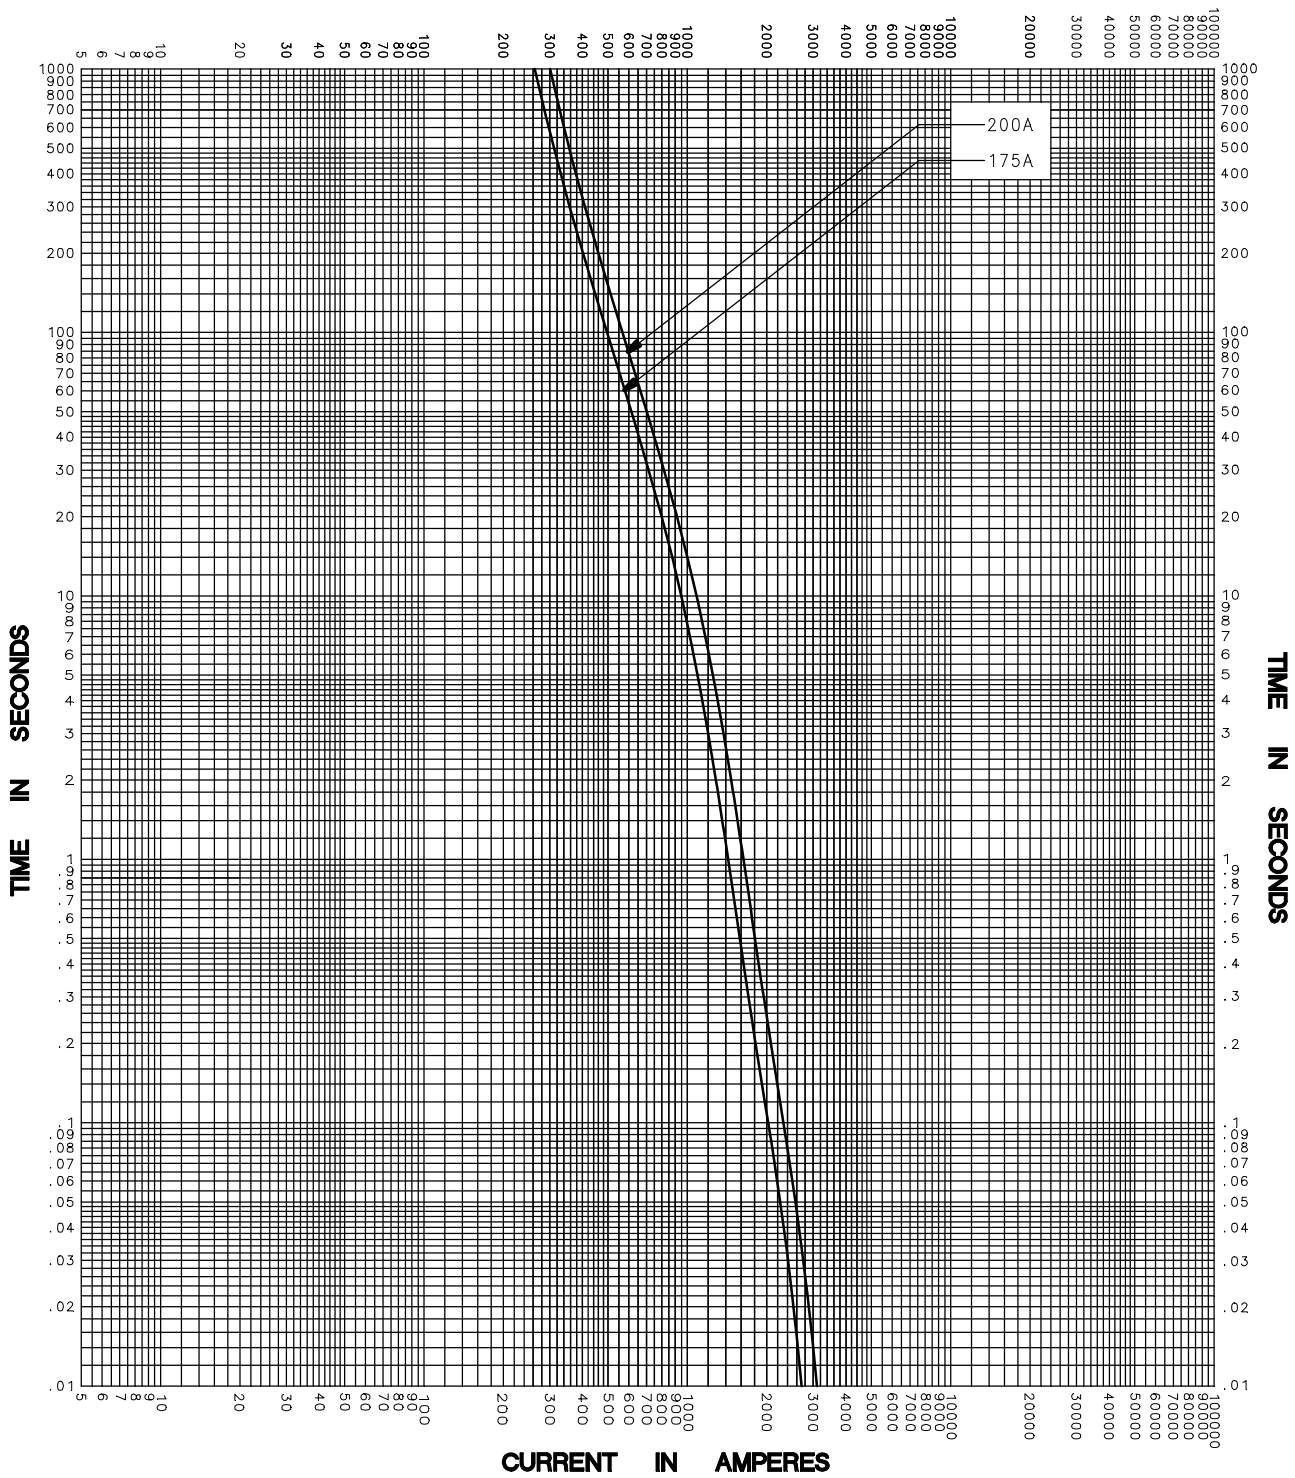

TIME IN SECONDS

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
 BASIS FOR DATA _____

FUSE CATALOG NUMBER
 LLSRK (175A - 200A)




LITTELFUSE, INC.
 DES PLAINES, ILL. USA

DRAWN BY LLL
 DATE 12/03/04
 CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
 B-FCC01-LSRK-014

-THIS DATA GENERATED ON CAD-

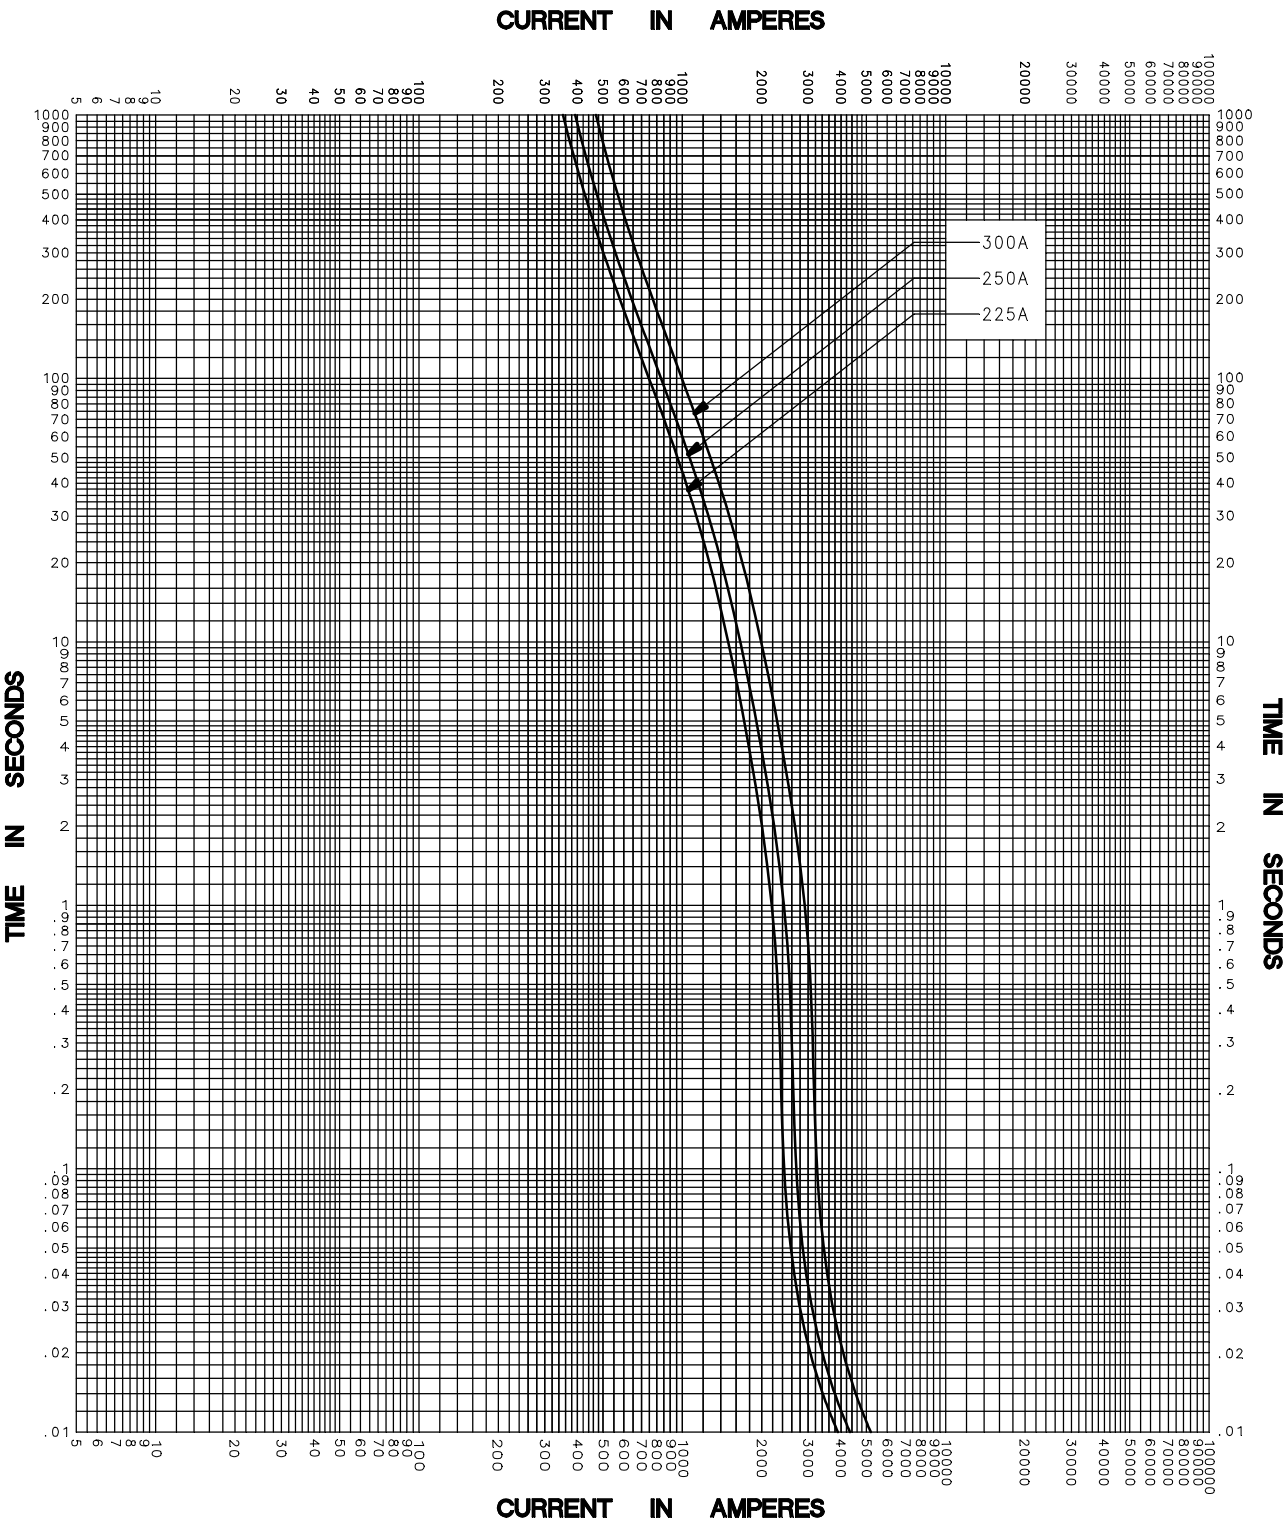

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (225A - 300A)




LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-015

-THIS DATA GENERATED ON CAD-

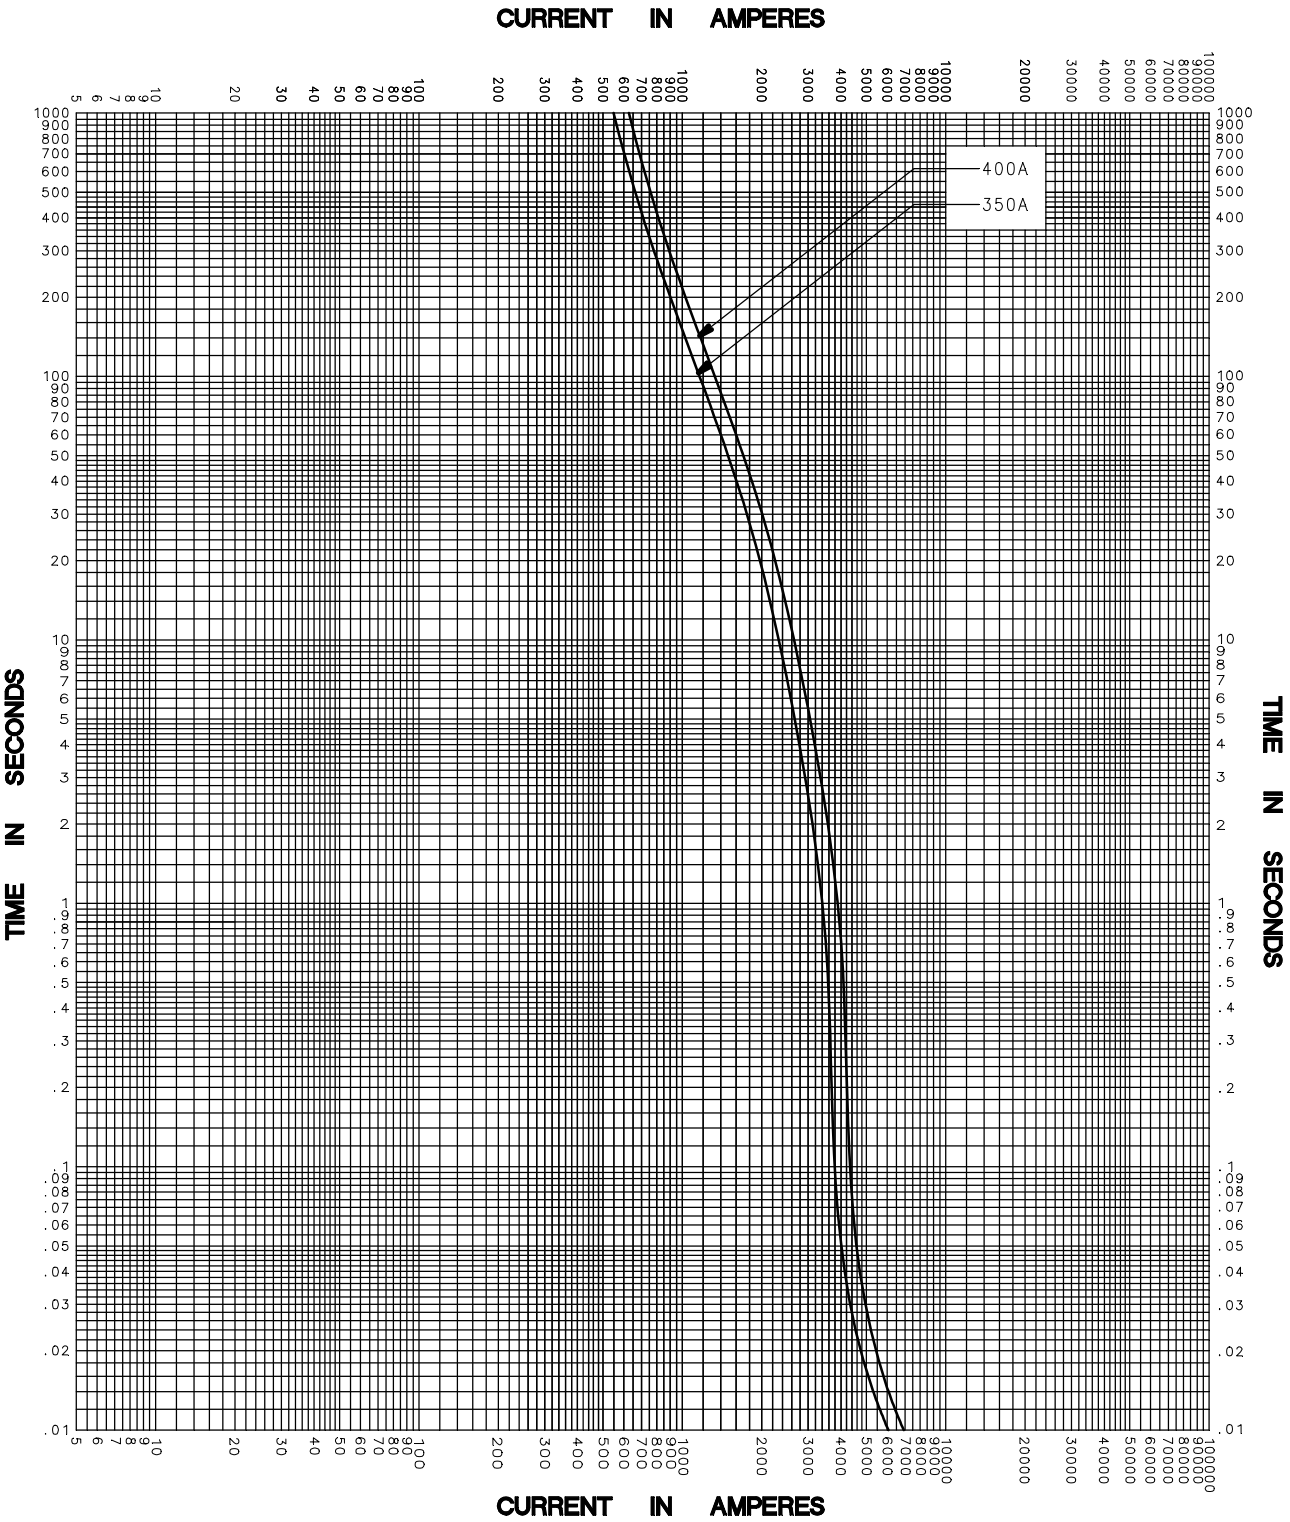

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (350A - 400A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-016

-THIS DATA GENERATED ON CAD-

CURRENT IN AMPERES

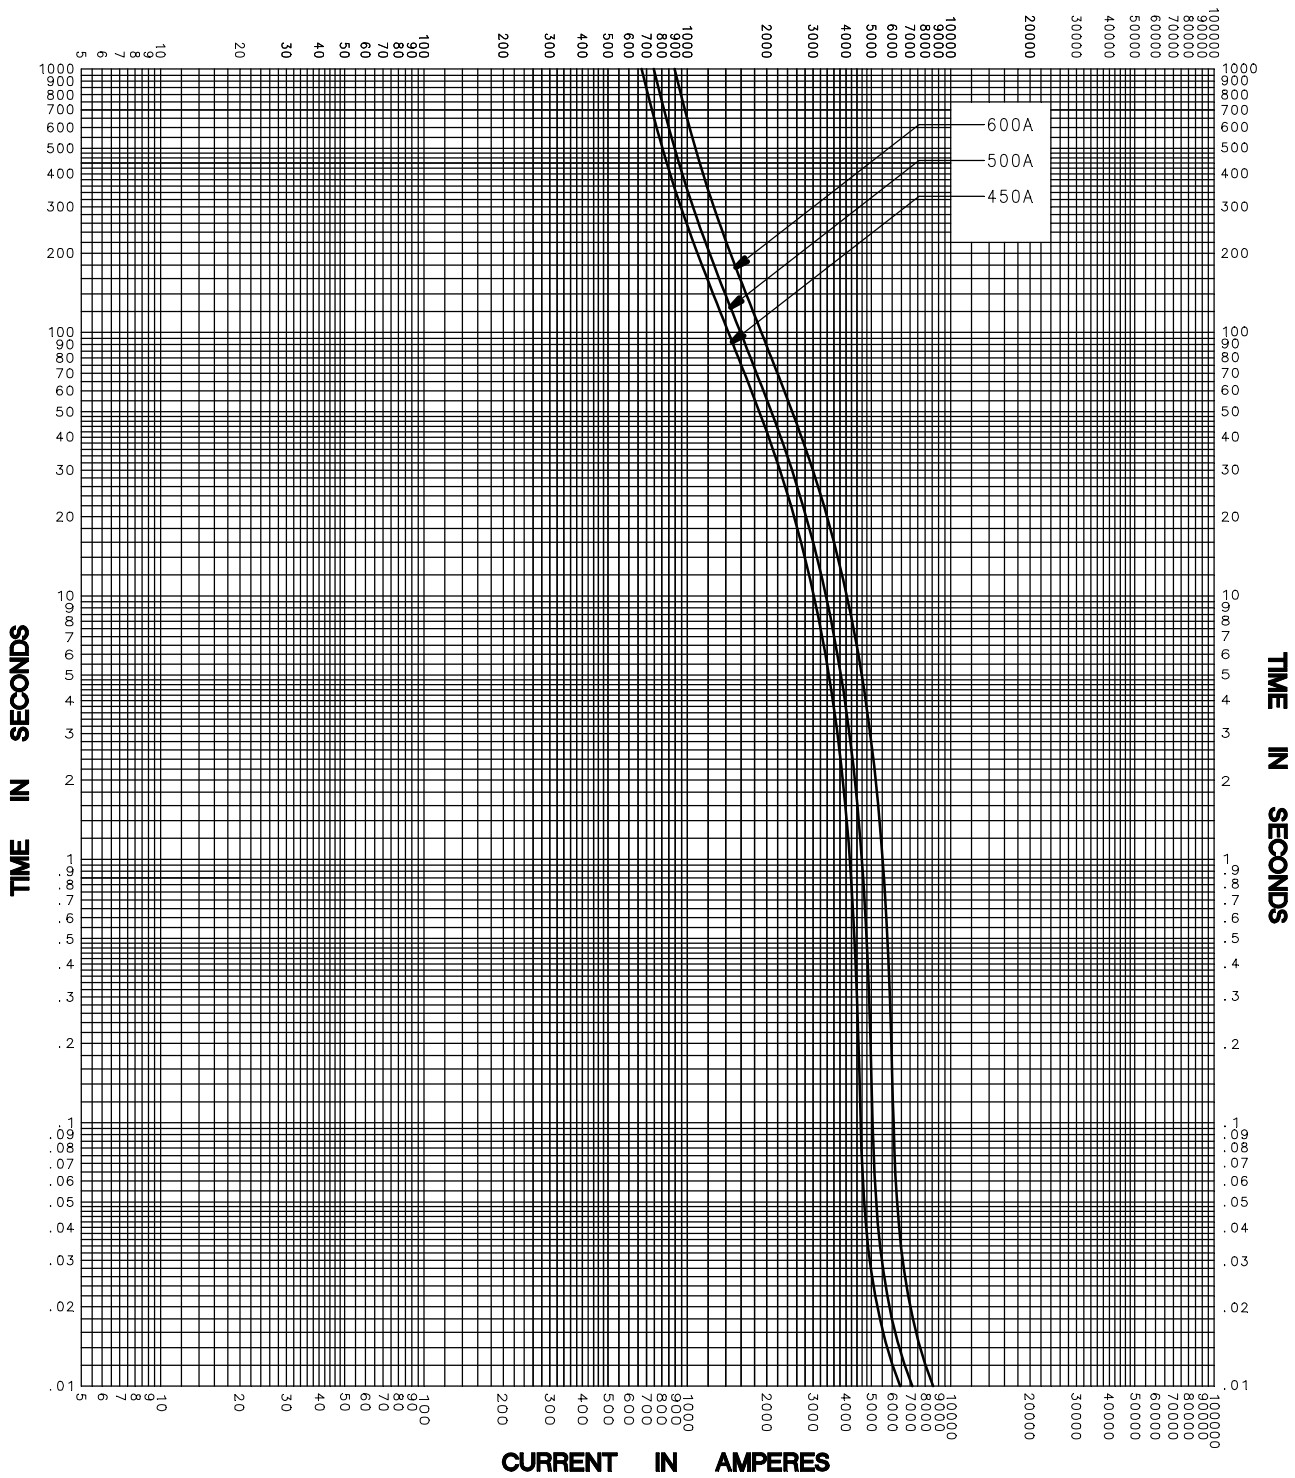

TIME IN SECONDS

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
LLSRK (450A - 600A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 12/03/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
B-FCC01-LSRK-017

-THIS DATA GENERATED ON CAD-