



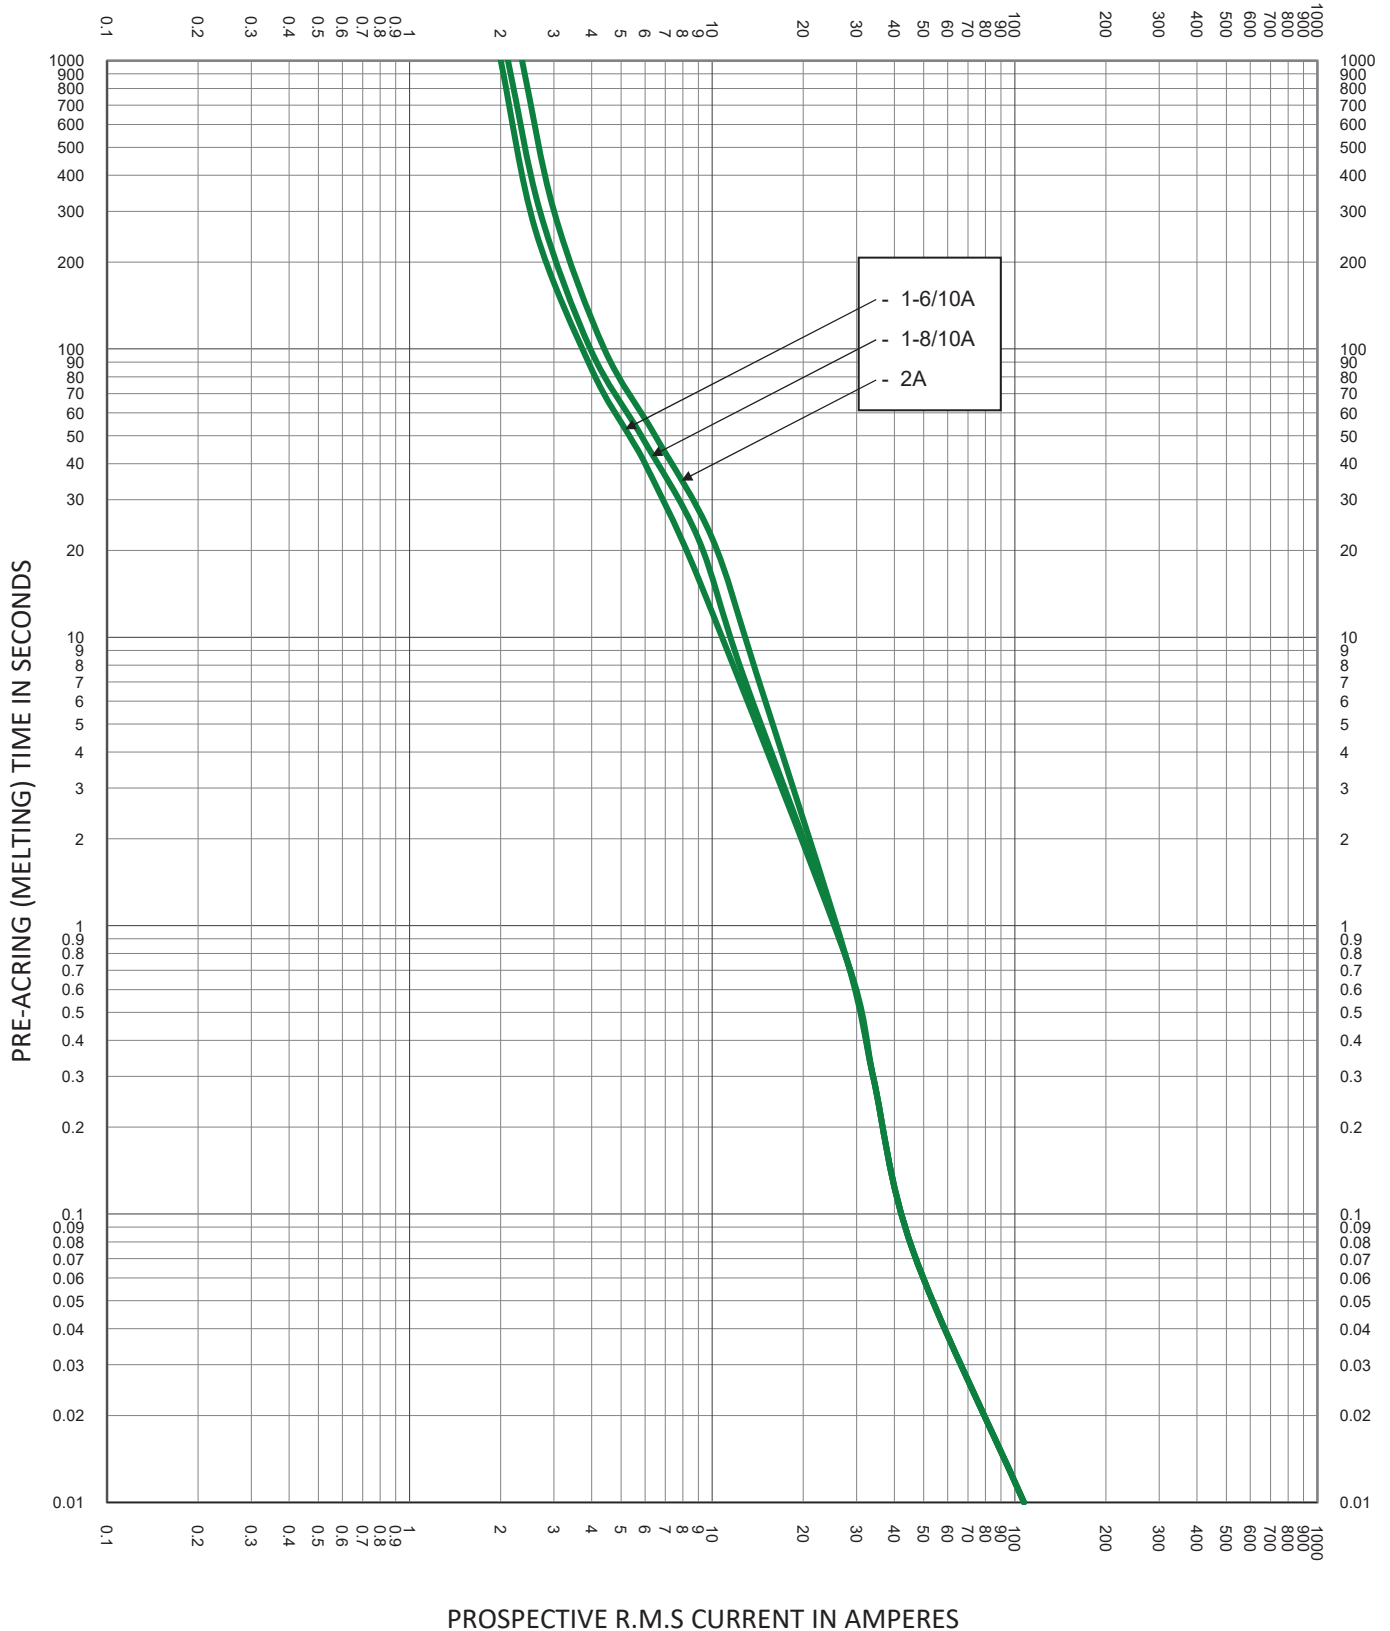
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
		DRAWN BY: LLL
		DATE: 05/25/2021
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: SHEET 2 OF 17
		FCC01-IDSR

- THIS DATA IS GENERATED IN EXCEL -

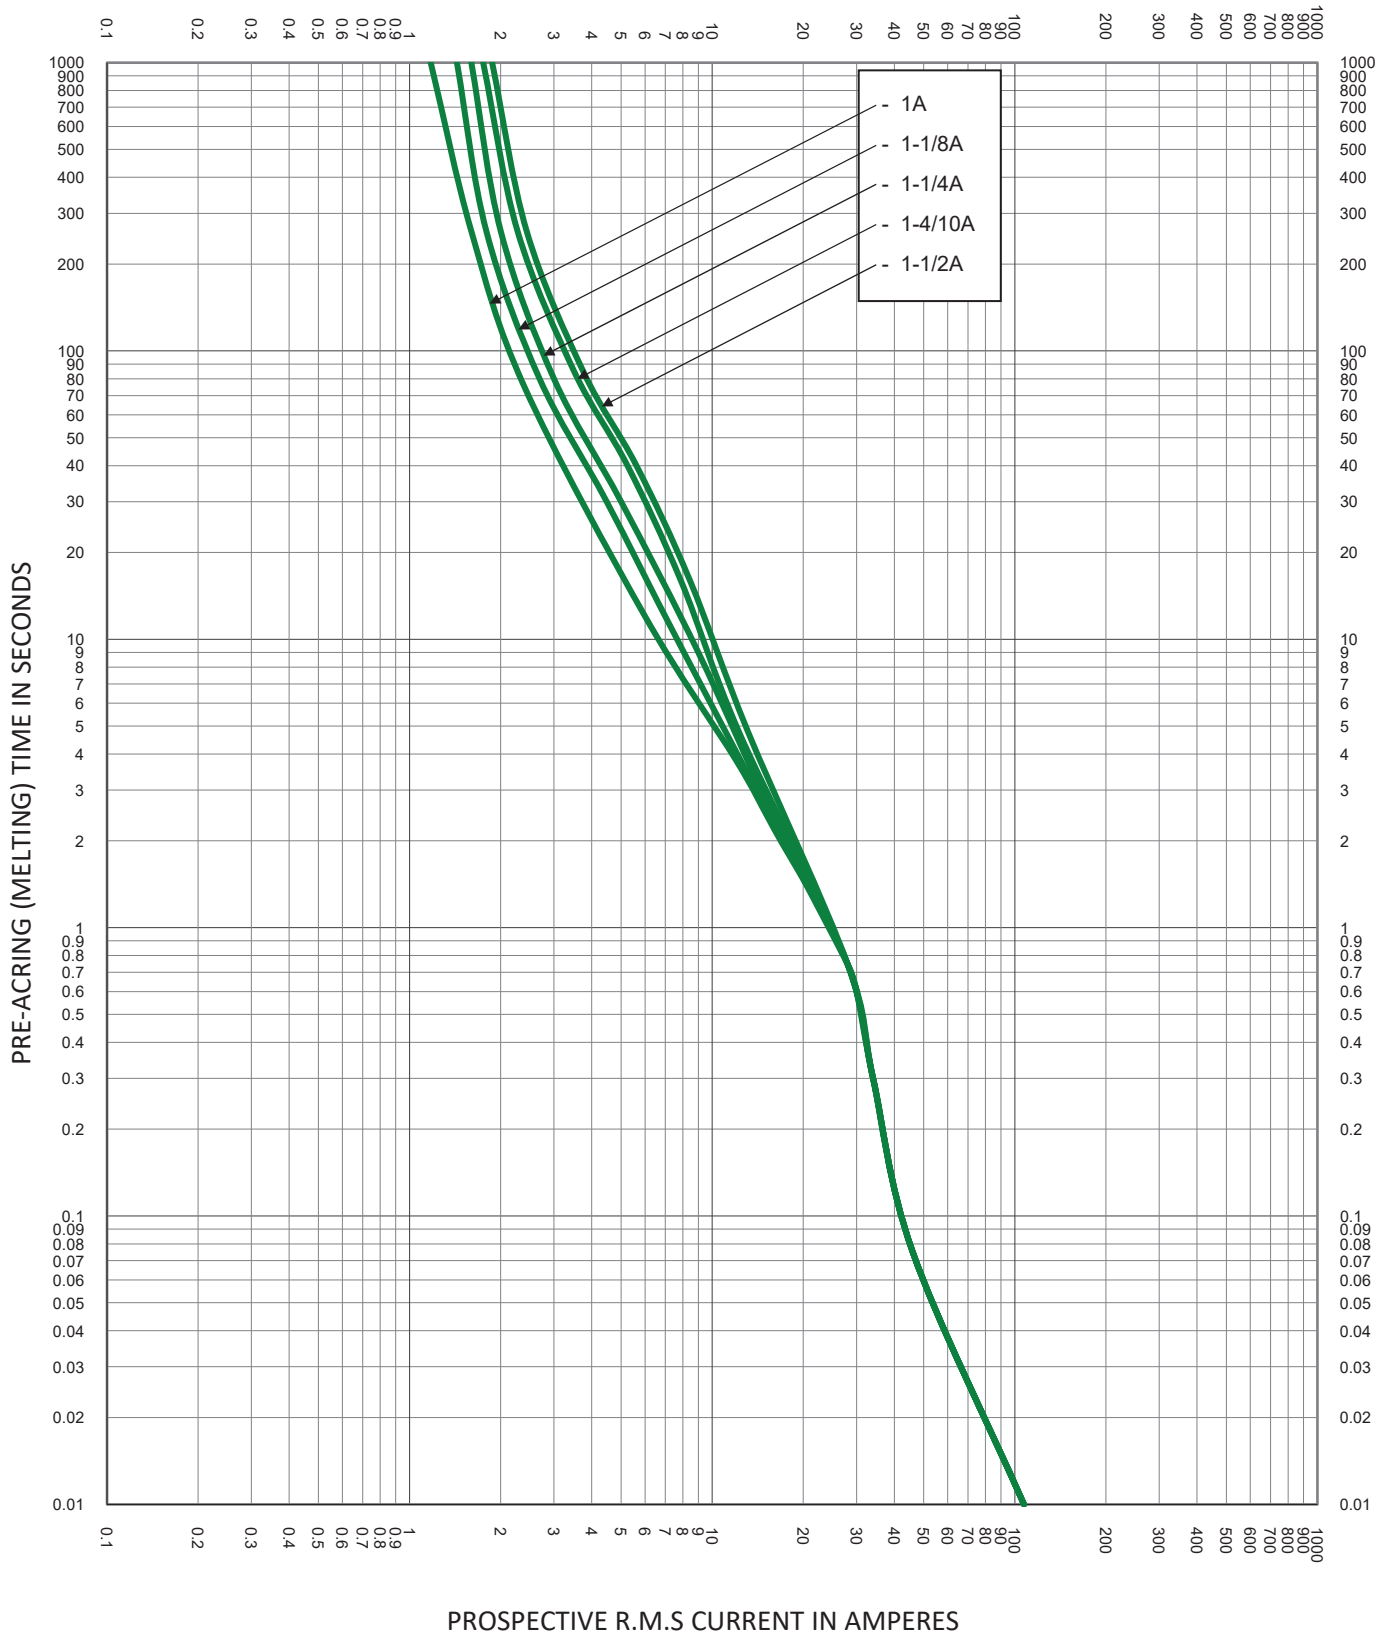


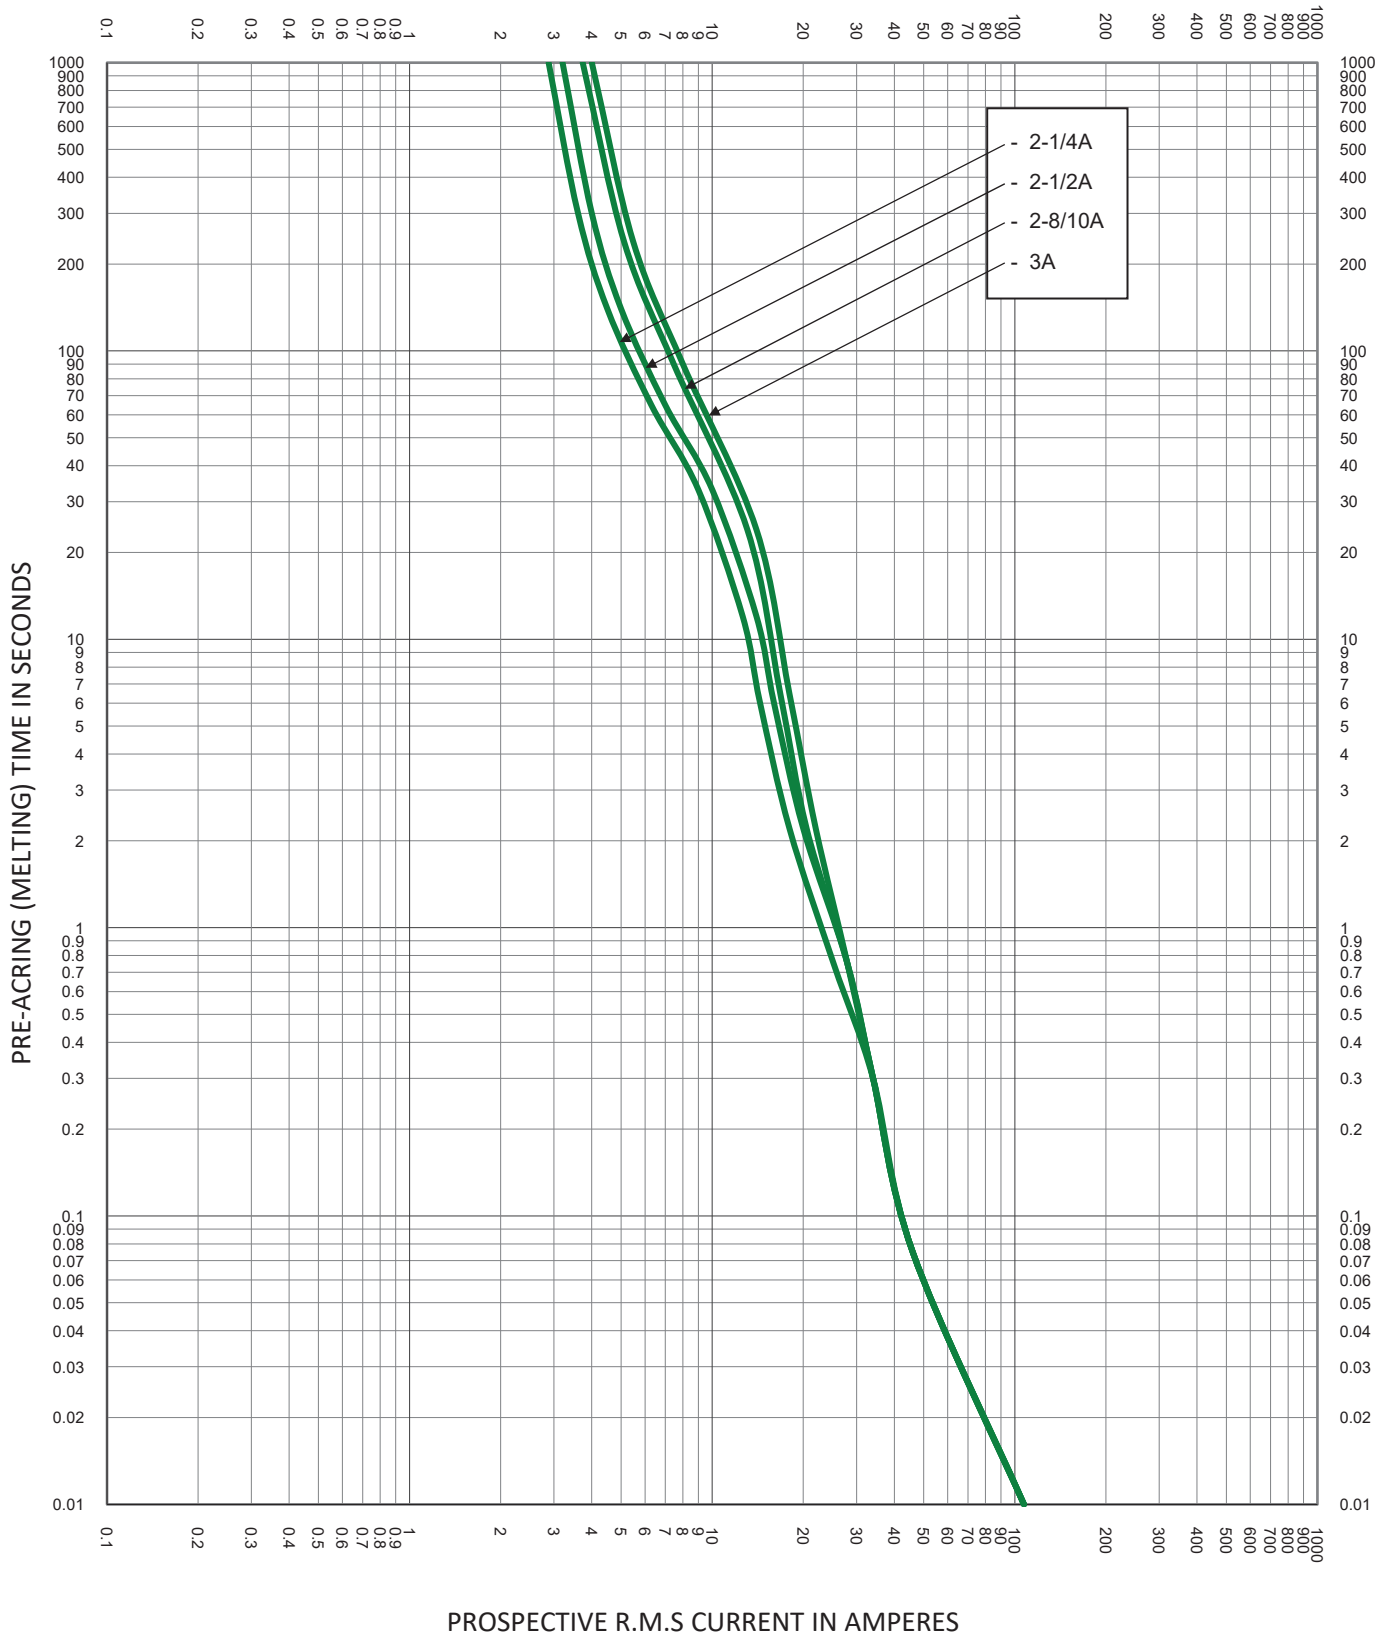
PROSPECTIVE R.M.S CURRENT IN AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL
		DATE: 05/25/2021
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: SHEET 3 OF 17
		FCC01-IDSR




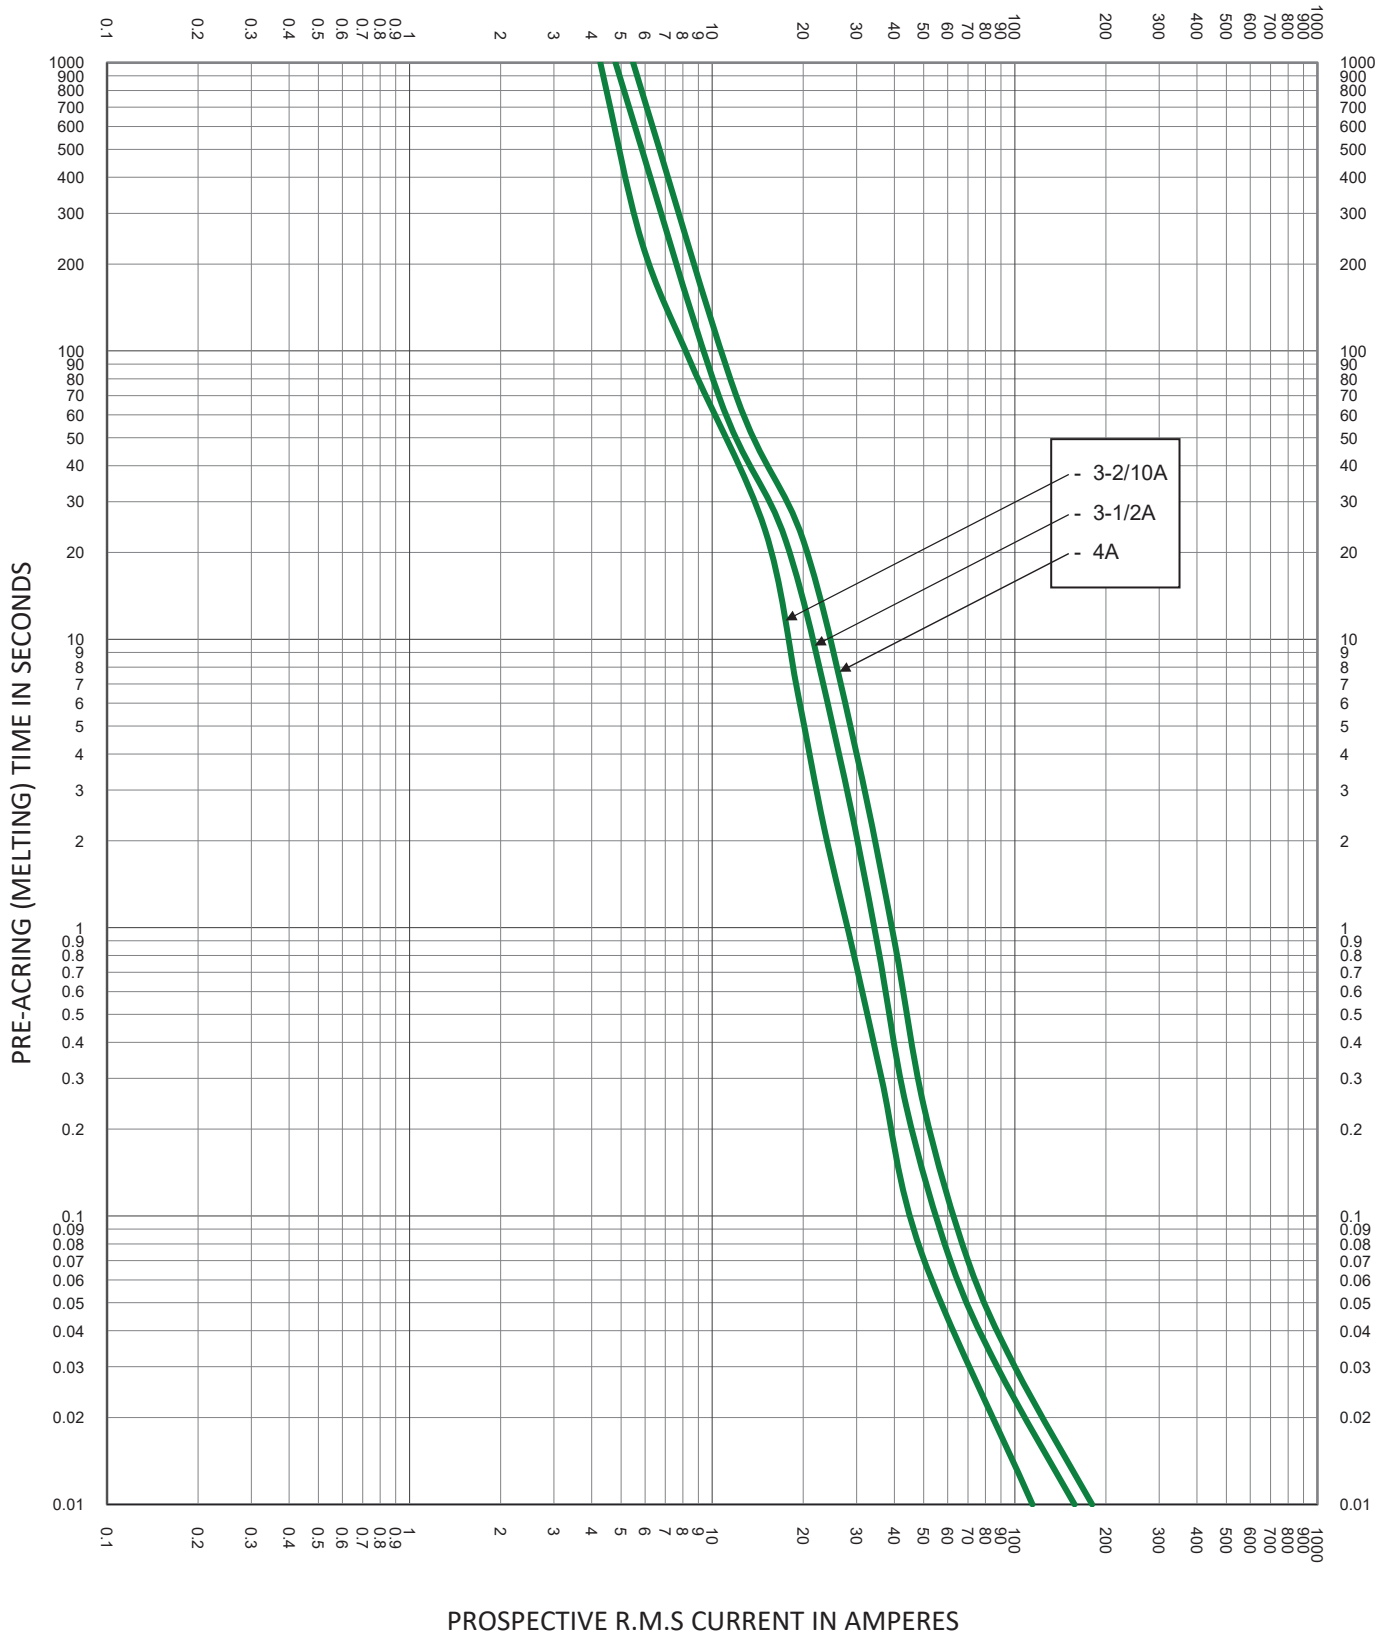
PROSPECTIVE R.M.S CURRENT IN AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 4 OF 17
		<b>FCC01-IDSR</b>




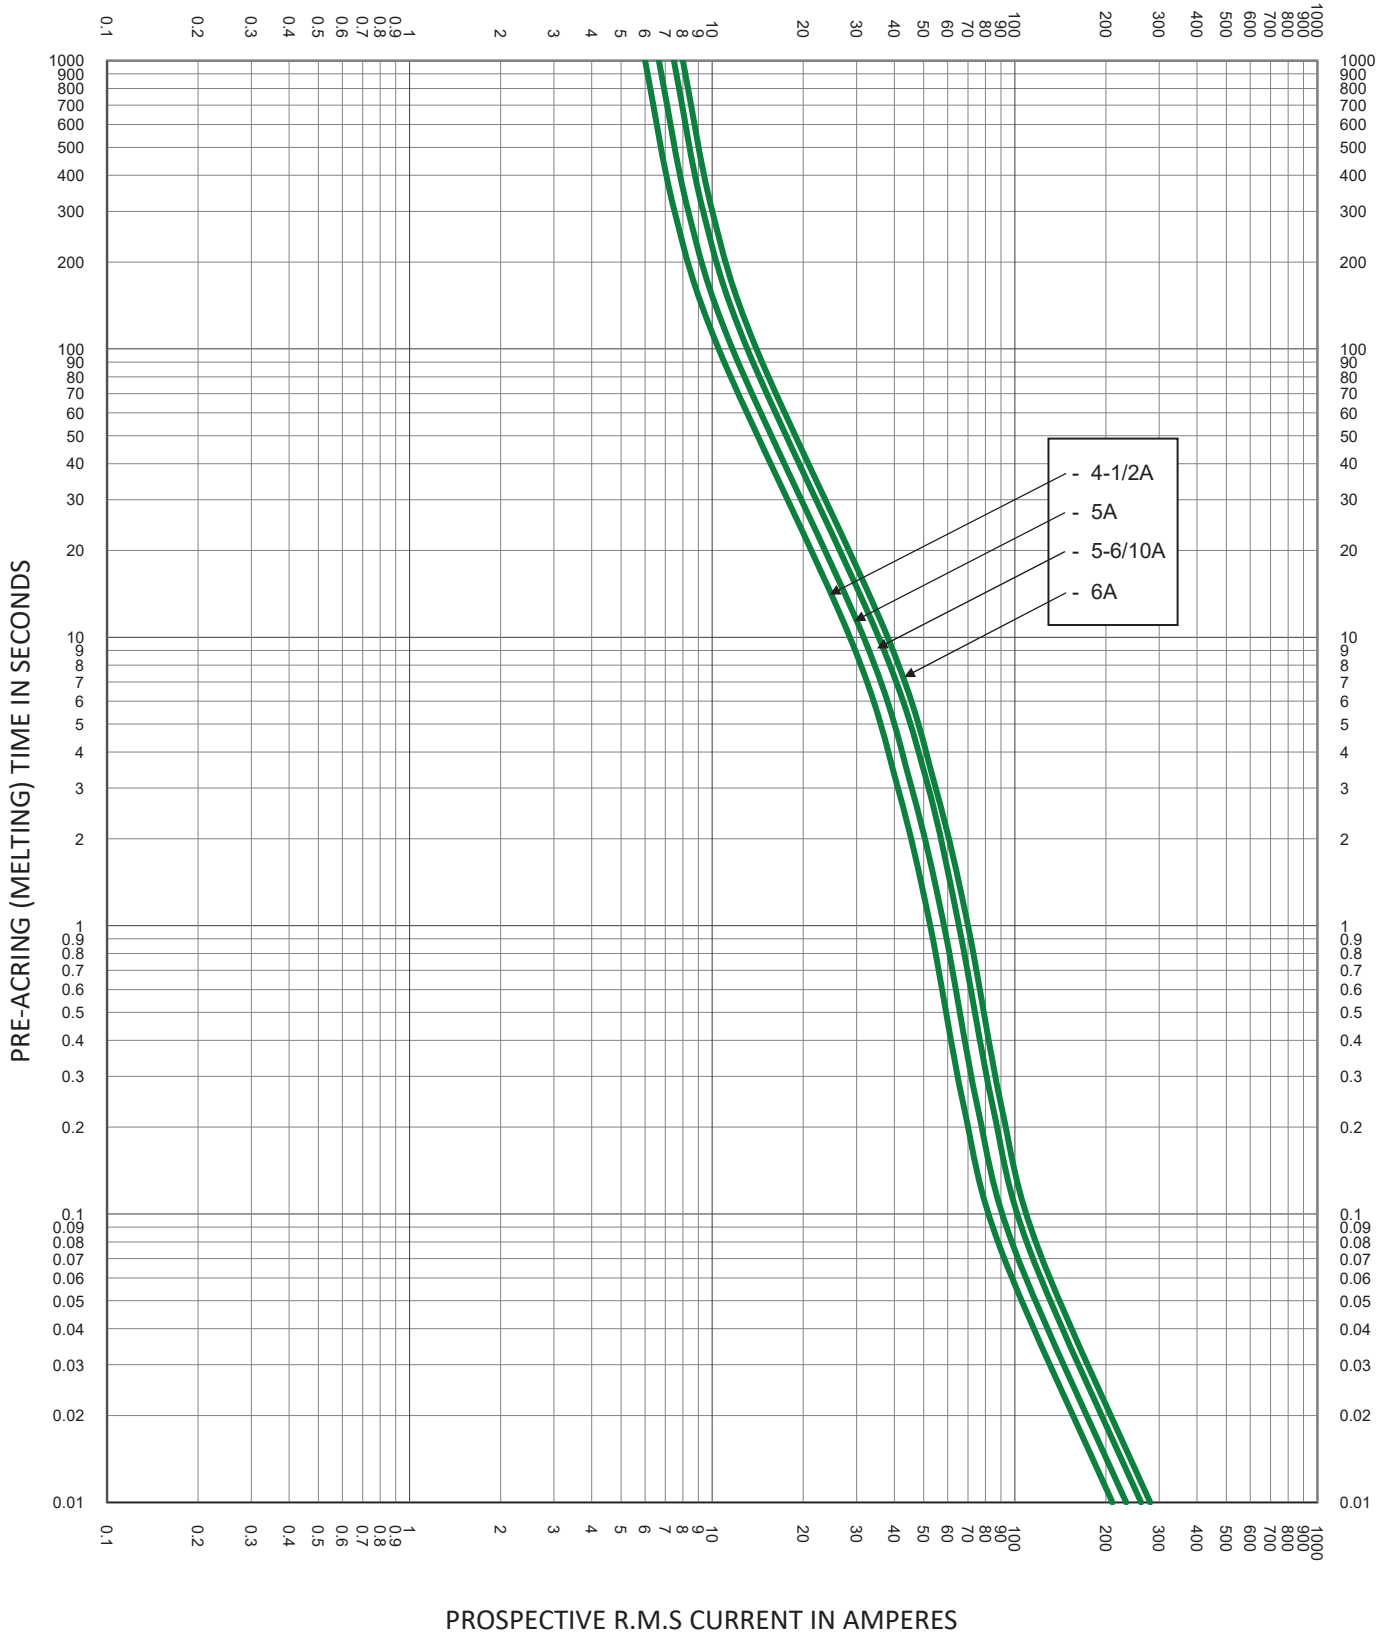
PROSPECTIVE R.M.S CURRENT IN AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 5 OF 17
		<b>FCC01-IDSR</b>




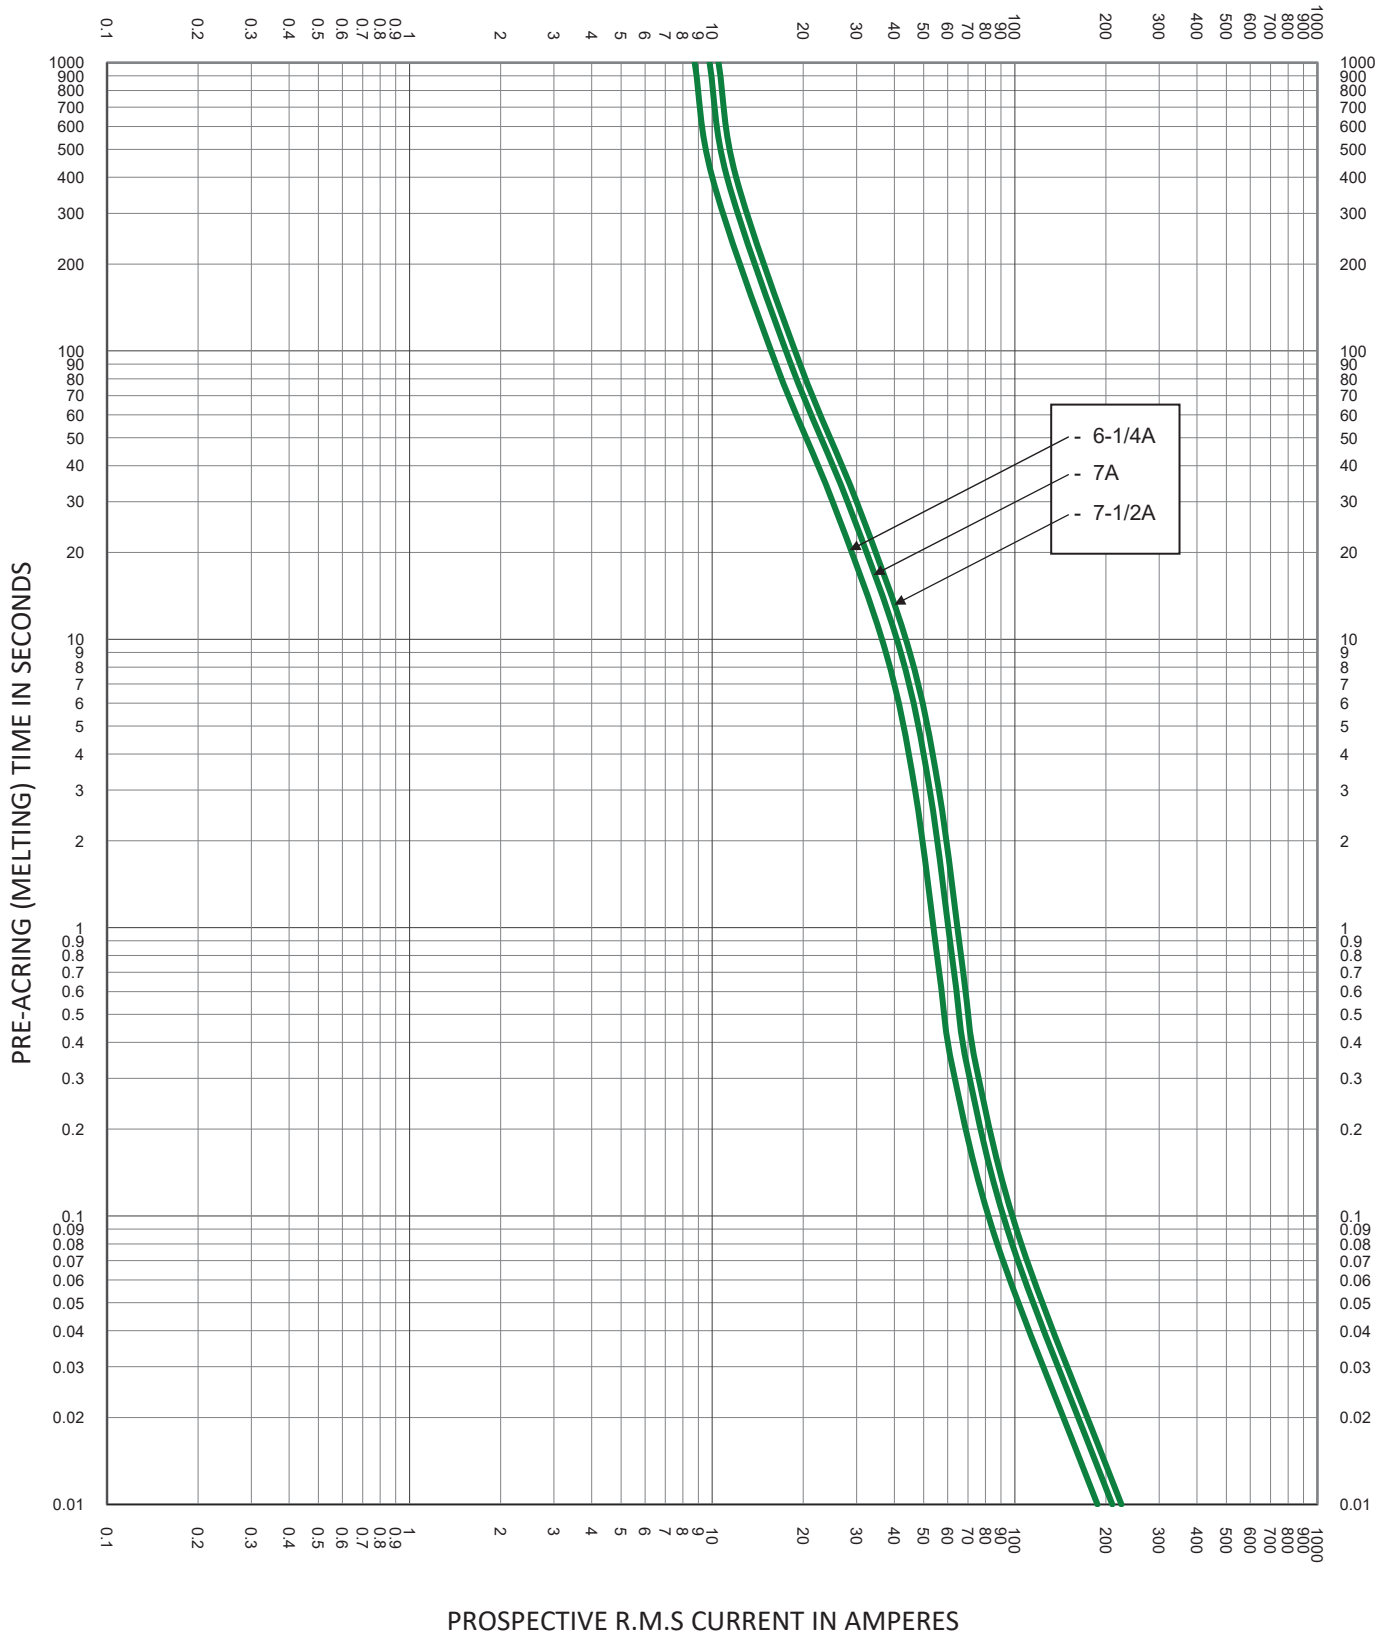
PROSPECTIVE R.M.S CURRENT IN AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL
		DATE: 05/25/2021
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: SHEET 6 OF 17
		FCC01-IDSR




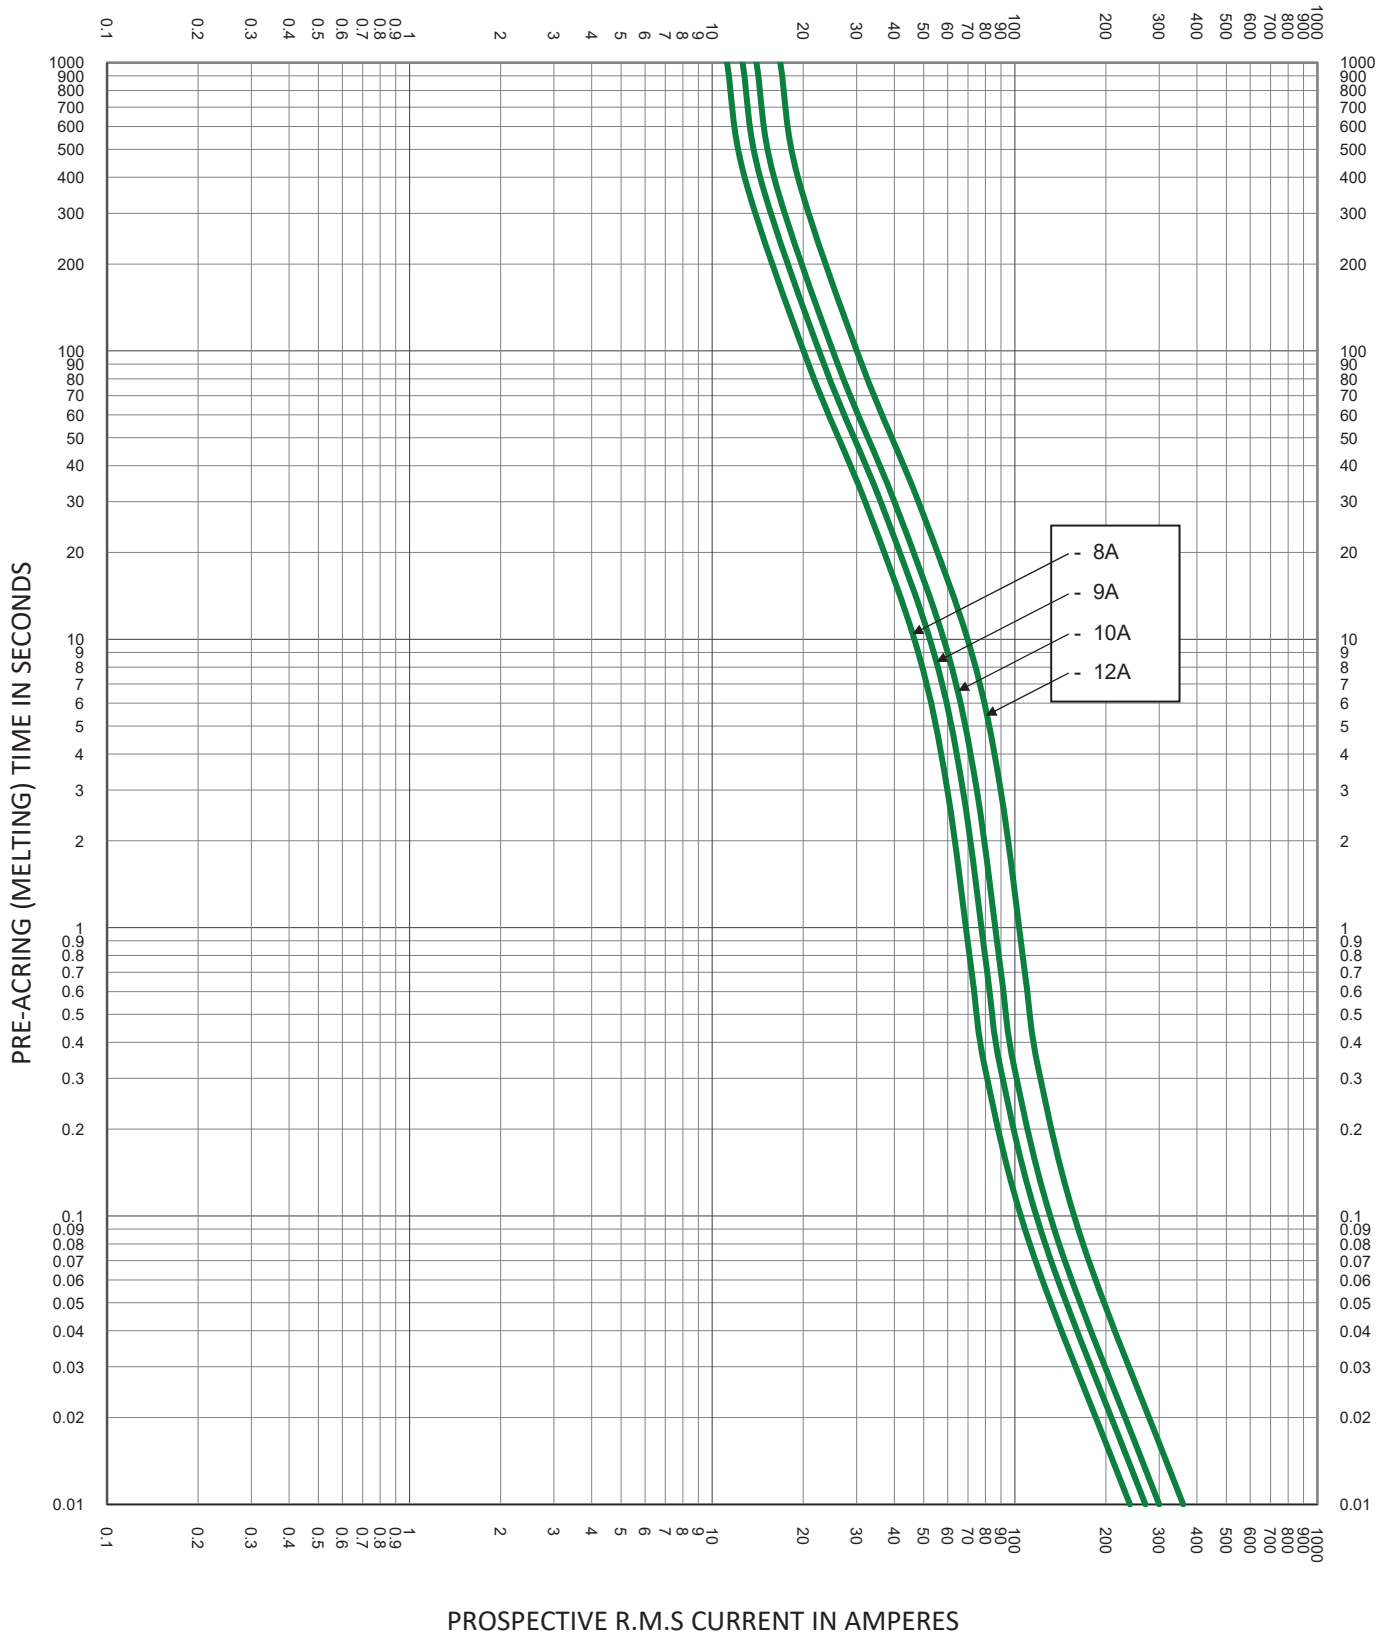
PROSPECTIVE R.M.S CURRENT IN AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 7 OF 17
		<b>FCC01-IDSR</b>




PROSPECTIVE R.M.S CURRENT IN AMPERES


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 8 OF 17
		<b>FCC01-IDSR</b>




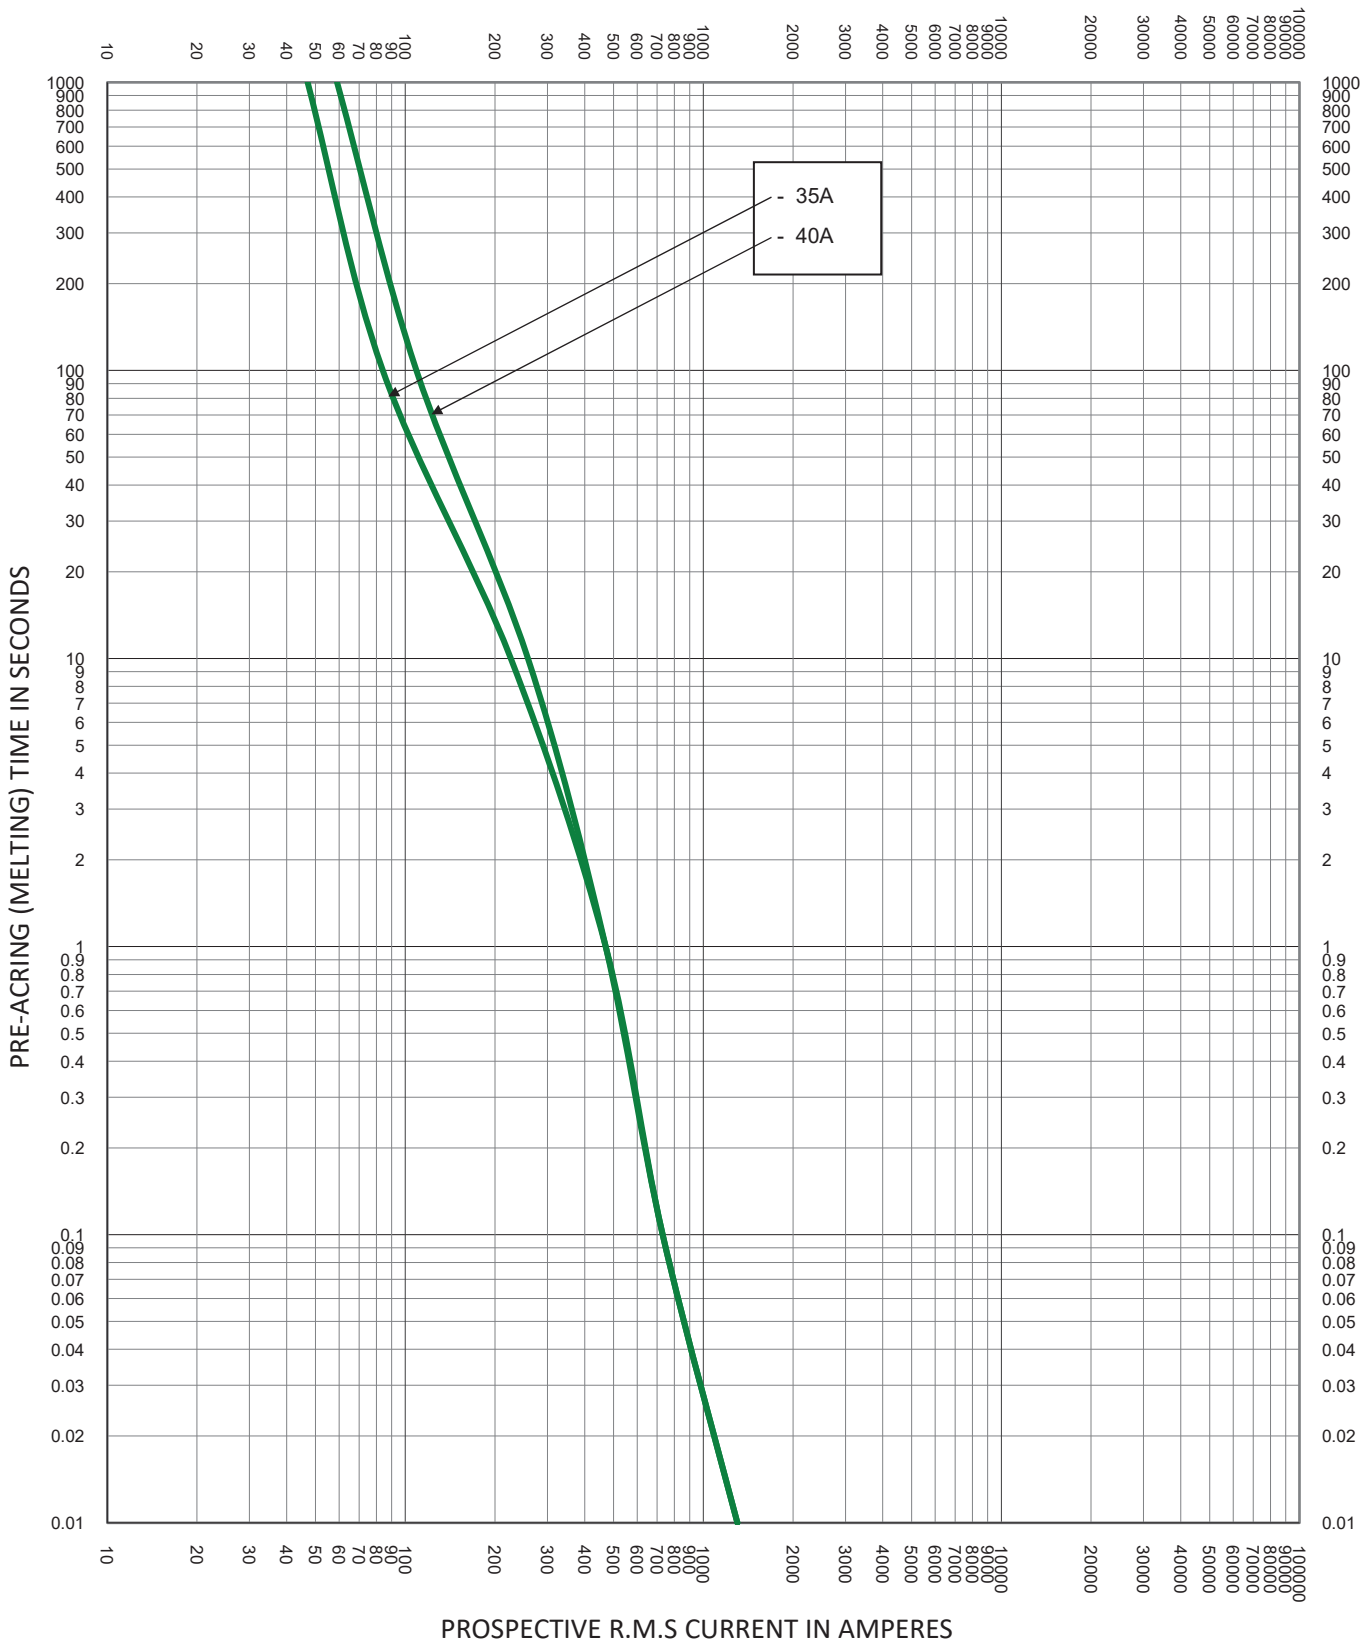
PROSPECTIVE R.M.S CURRENT IN AMPERES


TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL, USA		DRAWN BY: LLL
		DATE: 05/25/2021
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: SHEET 9 OF 17
		FCC01-IDSR




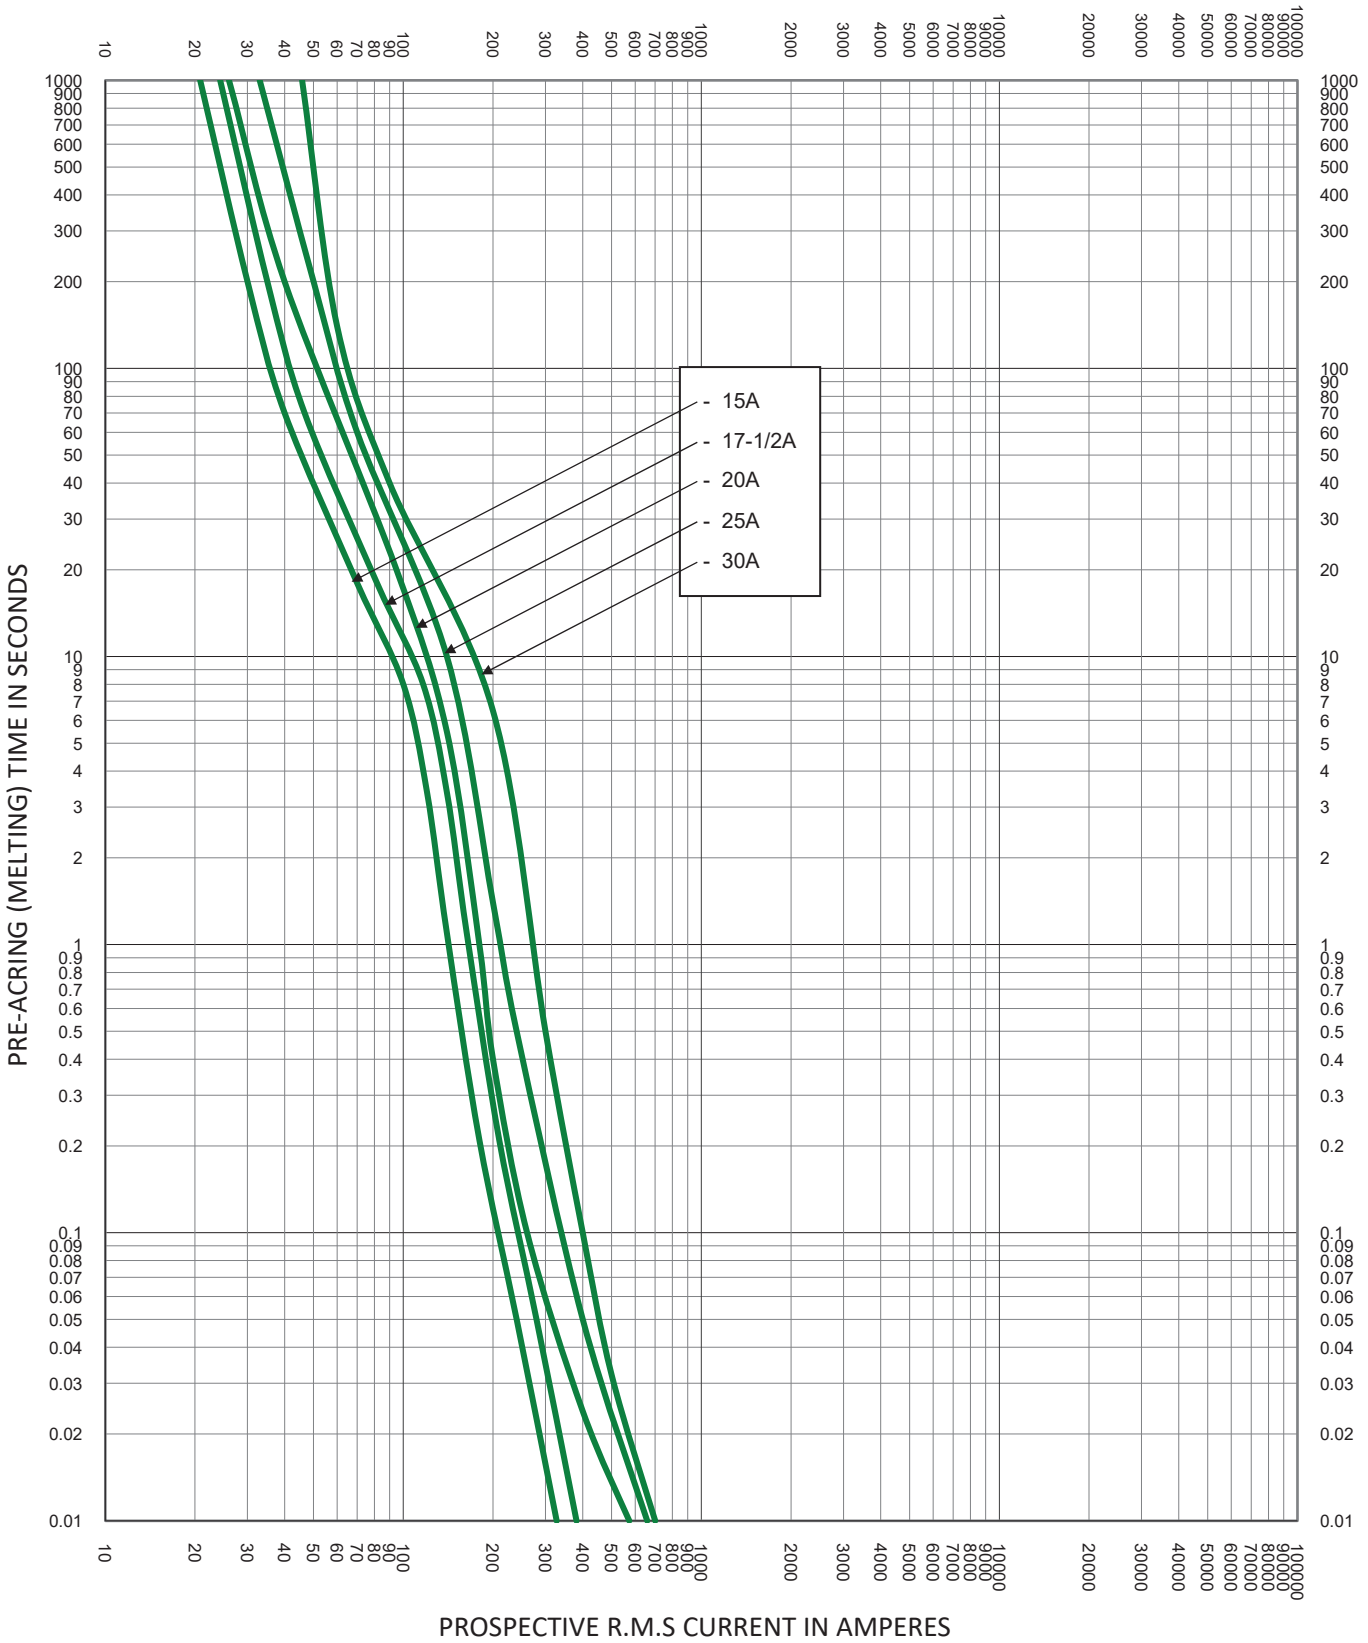


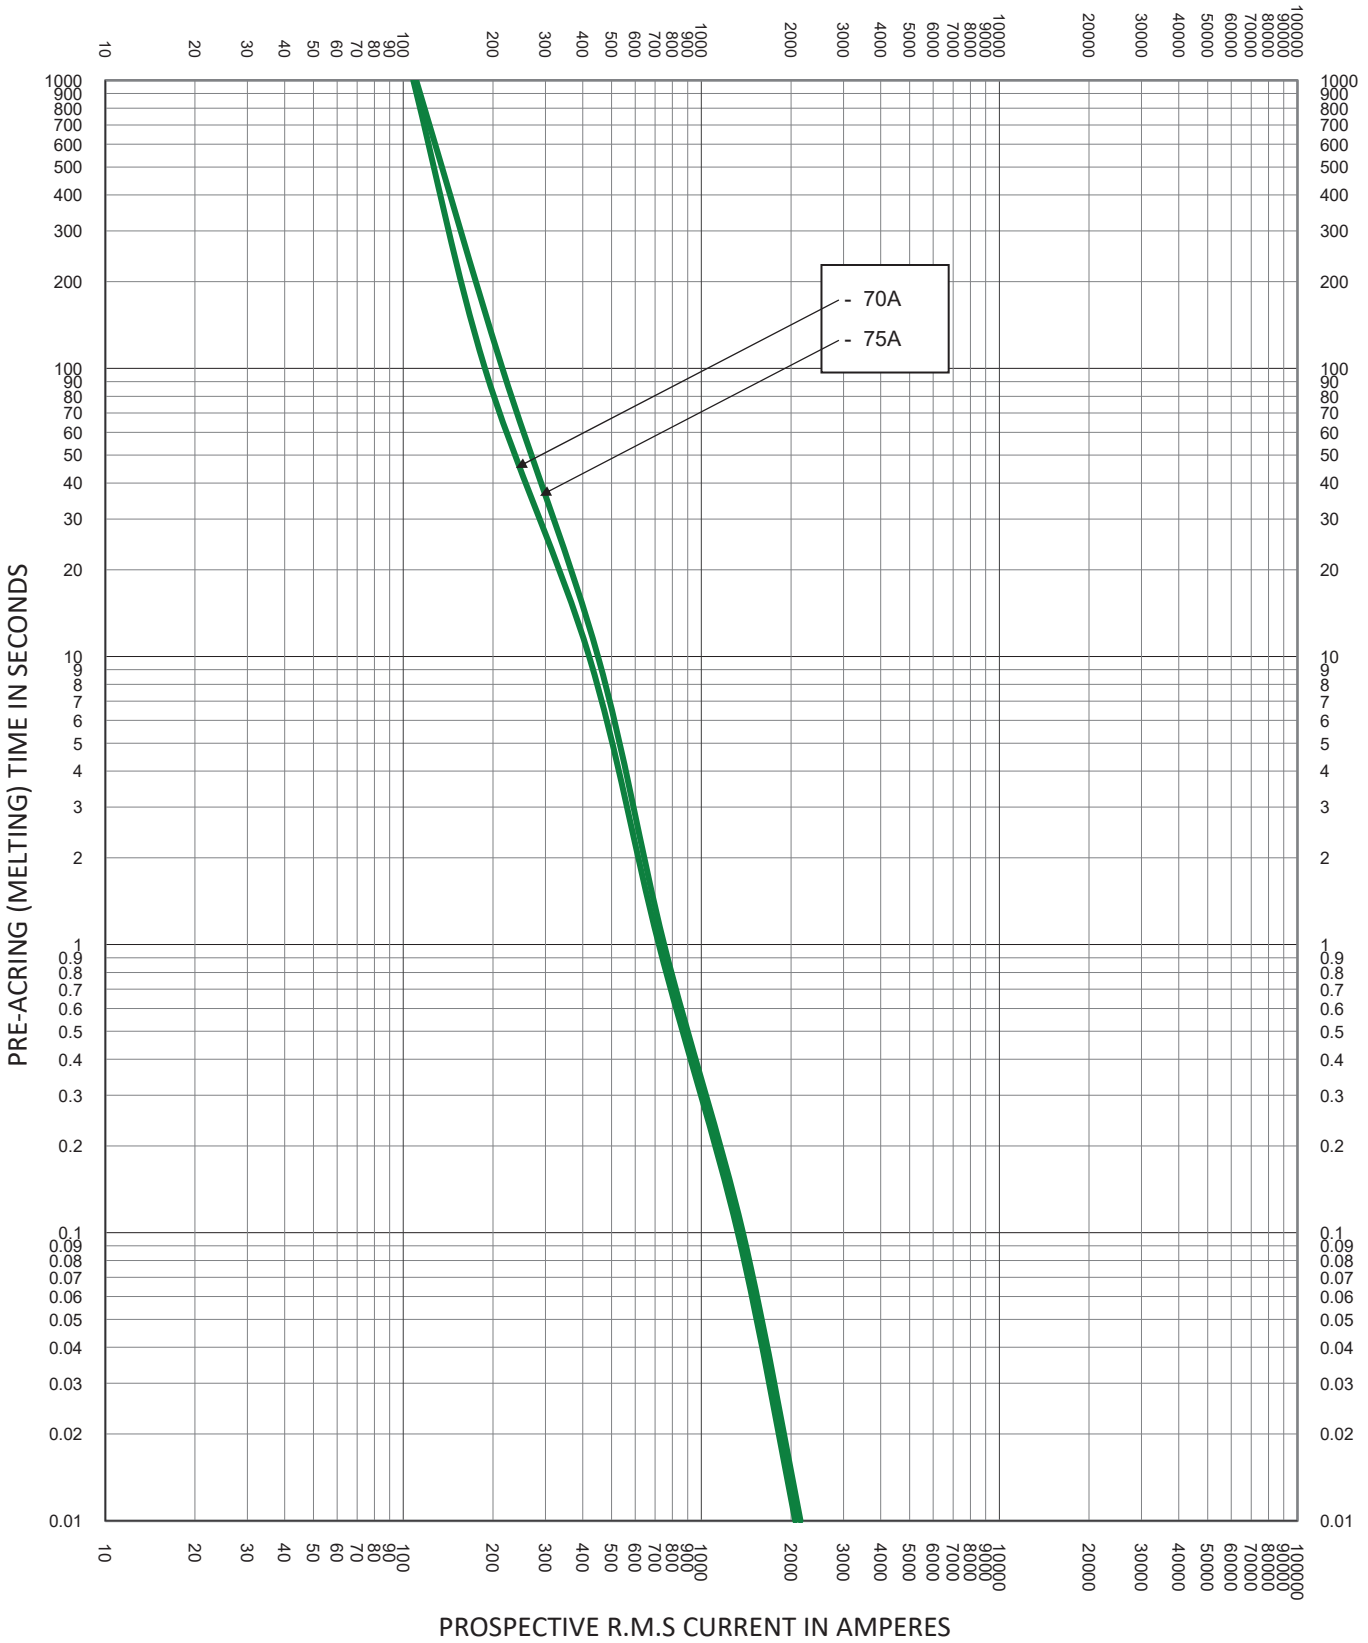
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 10 OF 17 <b>FCC01-IDSR</b>




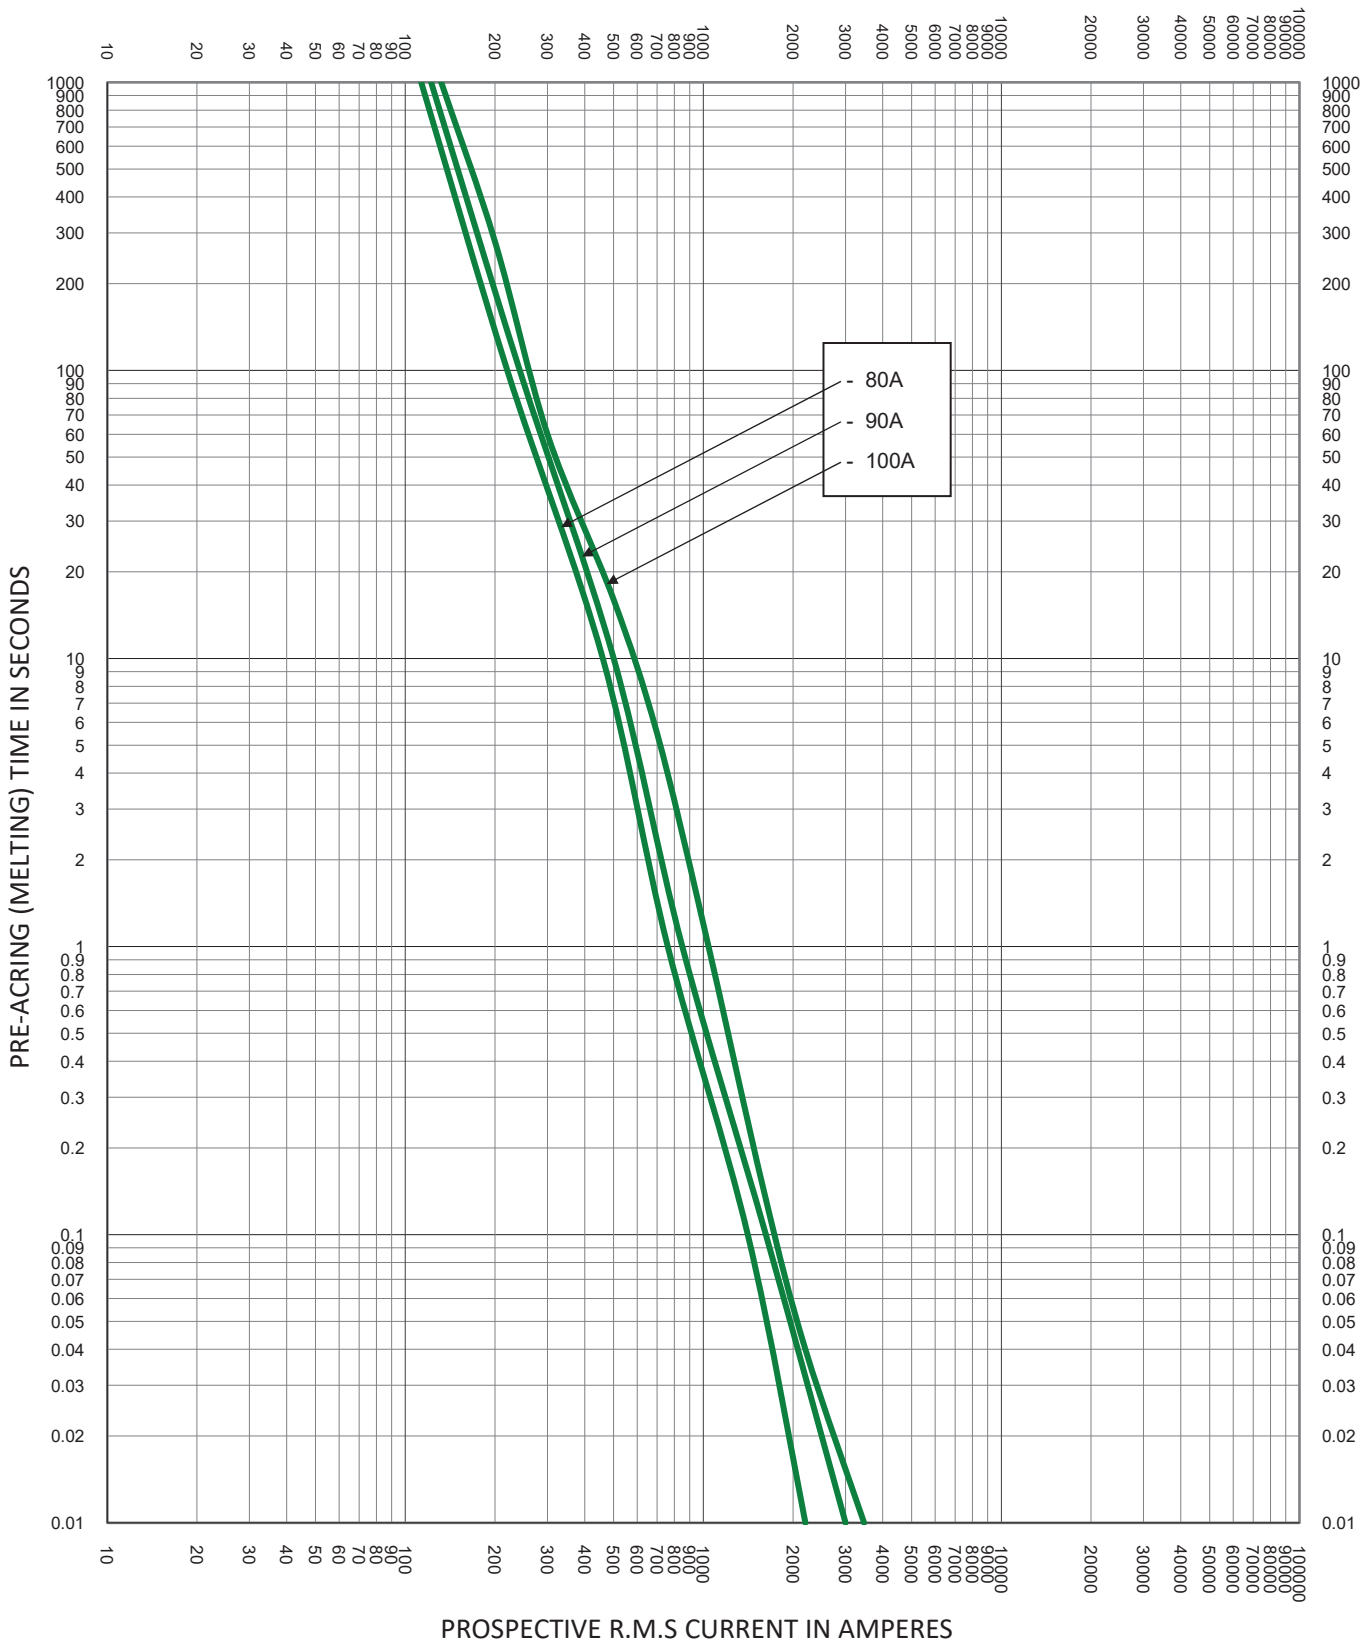
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 11 OF 17 <b>FCC01-IDSR</b>

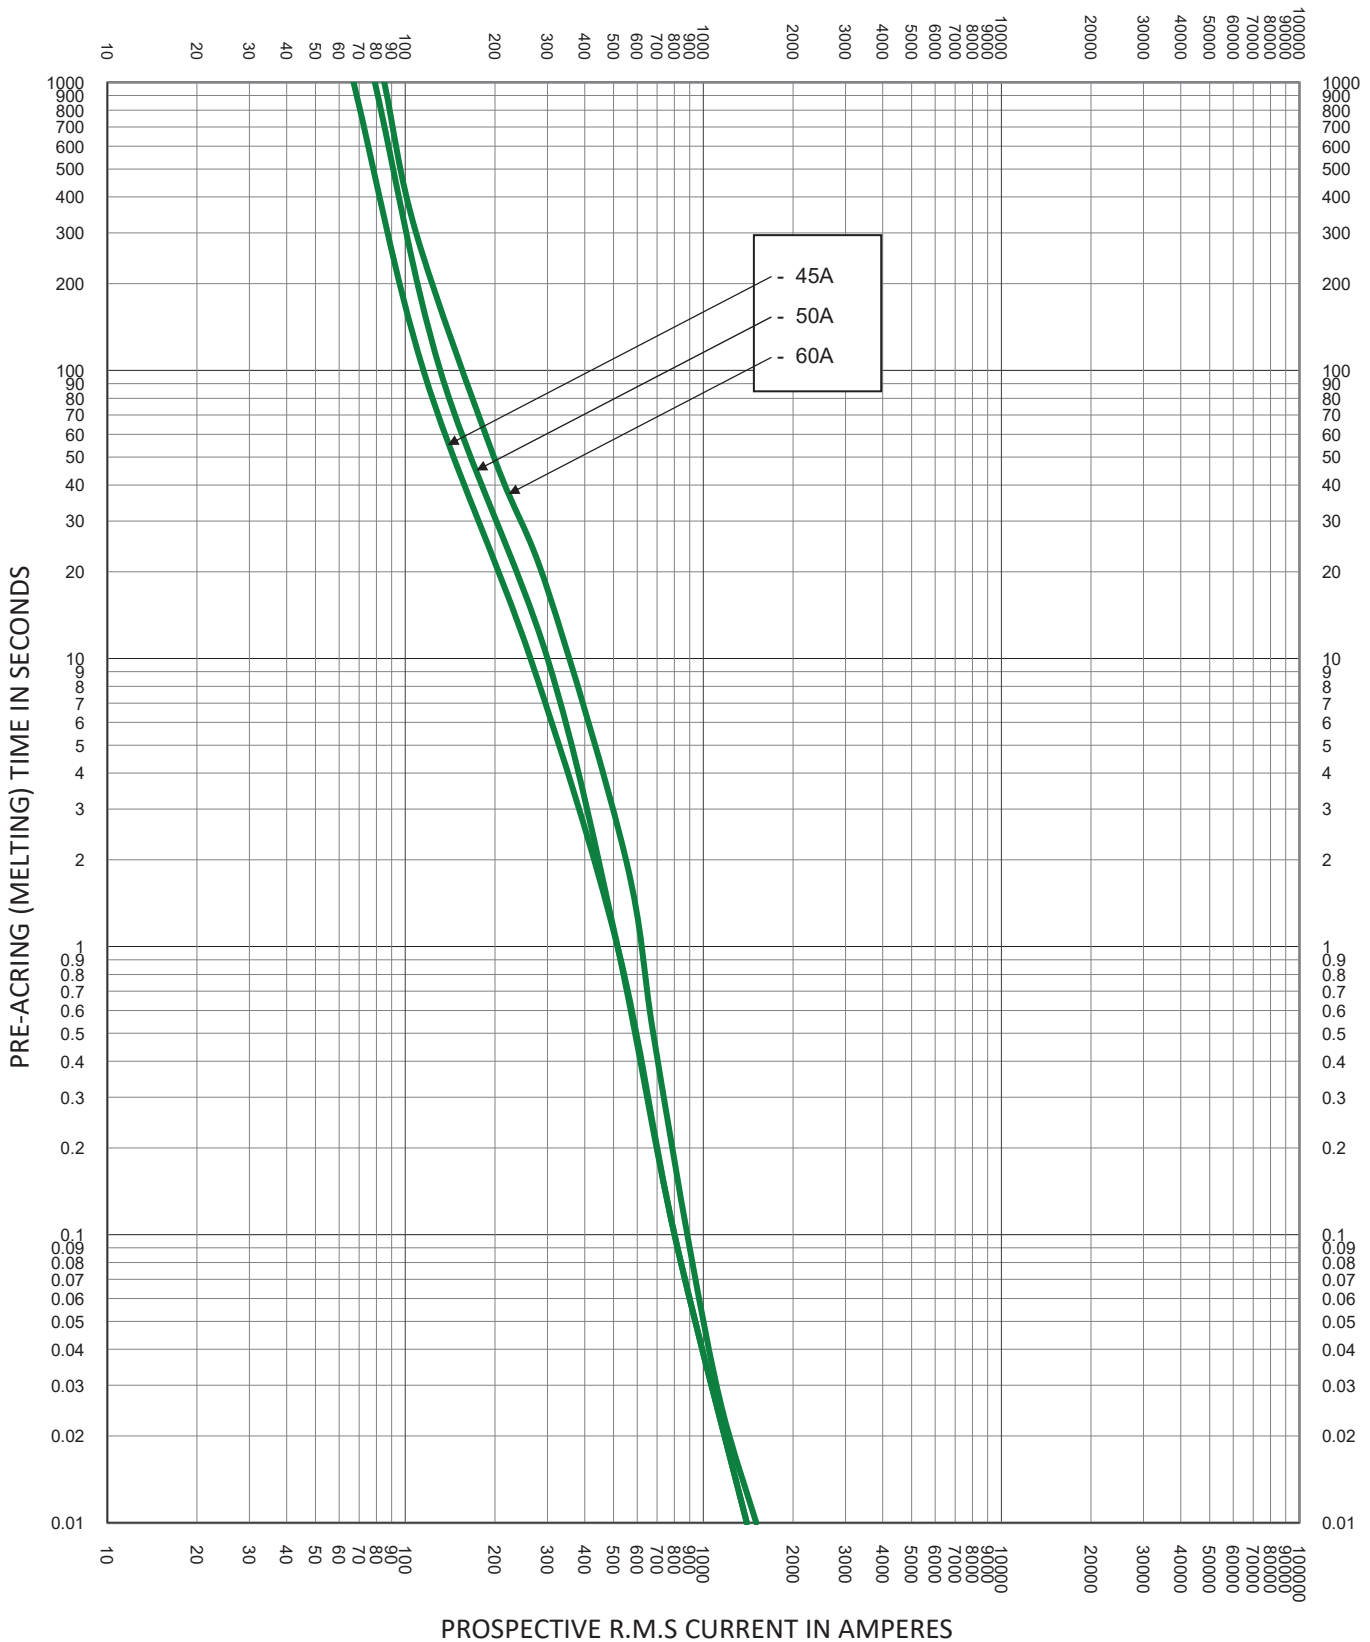


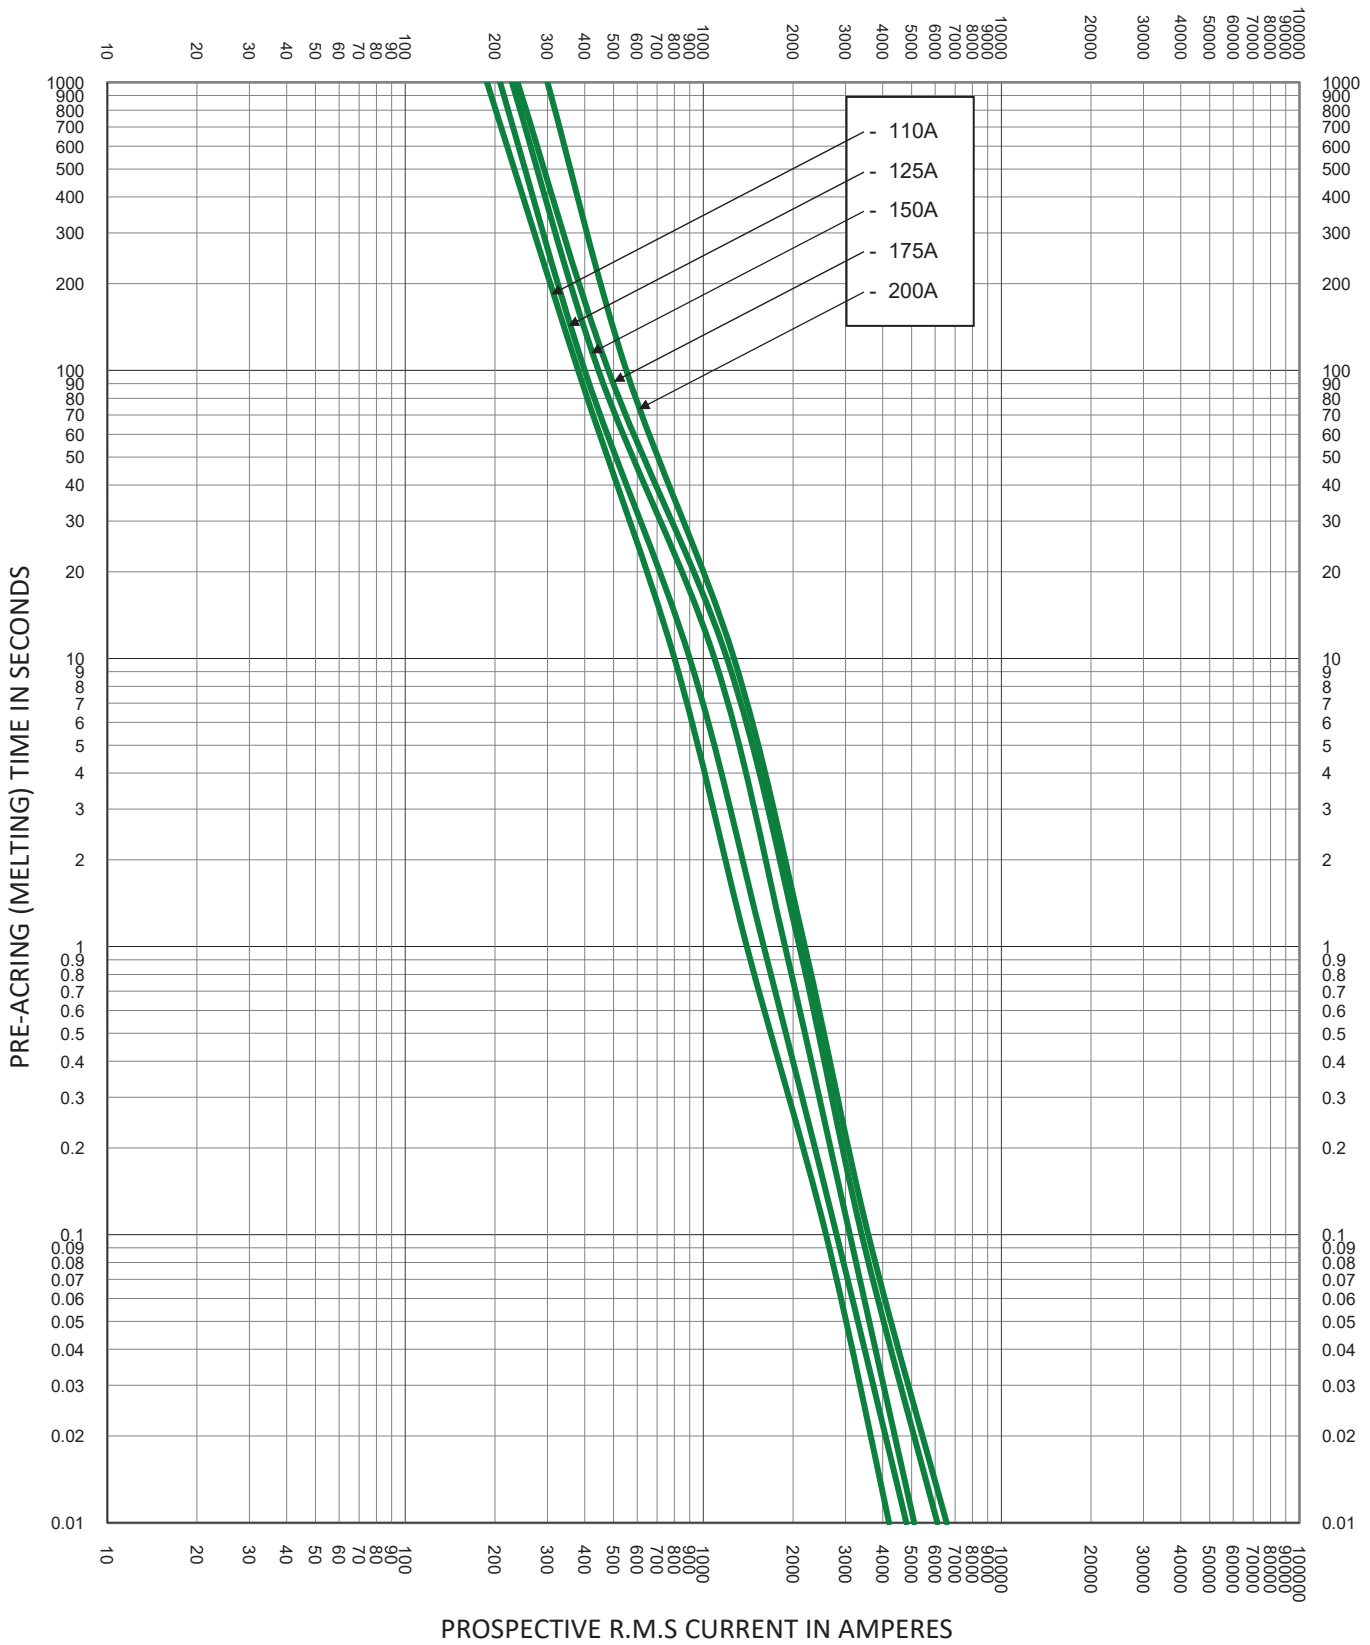
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 12 OF 17 <b>FCC01-IDSR</b>




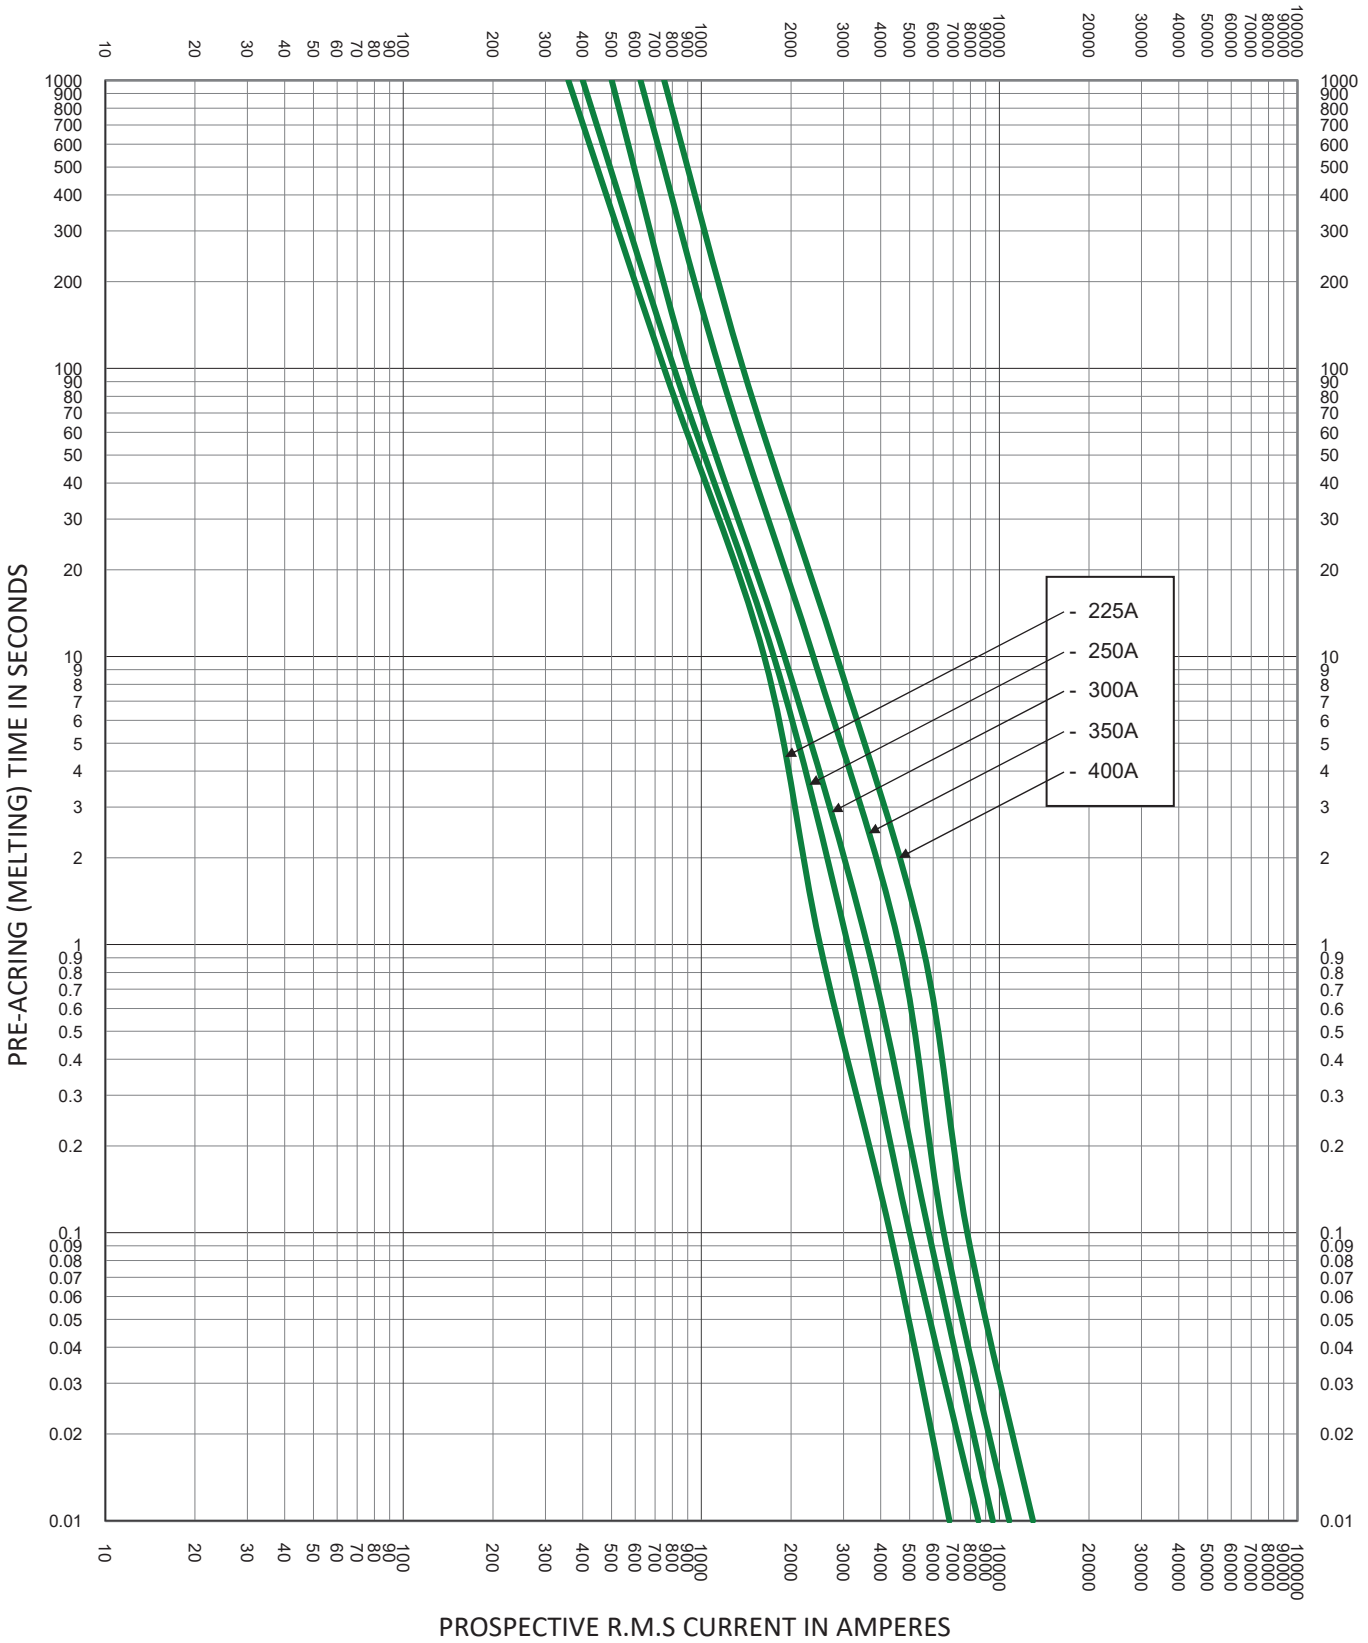
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 13 OF 17 <b>FCC01-IDSR</b>




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 14 OF 17 <b>FCC01-IDSR</b>





TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 15 OF 17 <b>FCC01-IDSR</b>



PROSPECTIVE R.M.S CURRENT IN AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-IDSR SHEET 16 OF 17

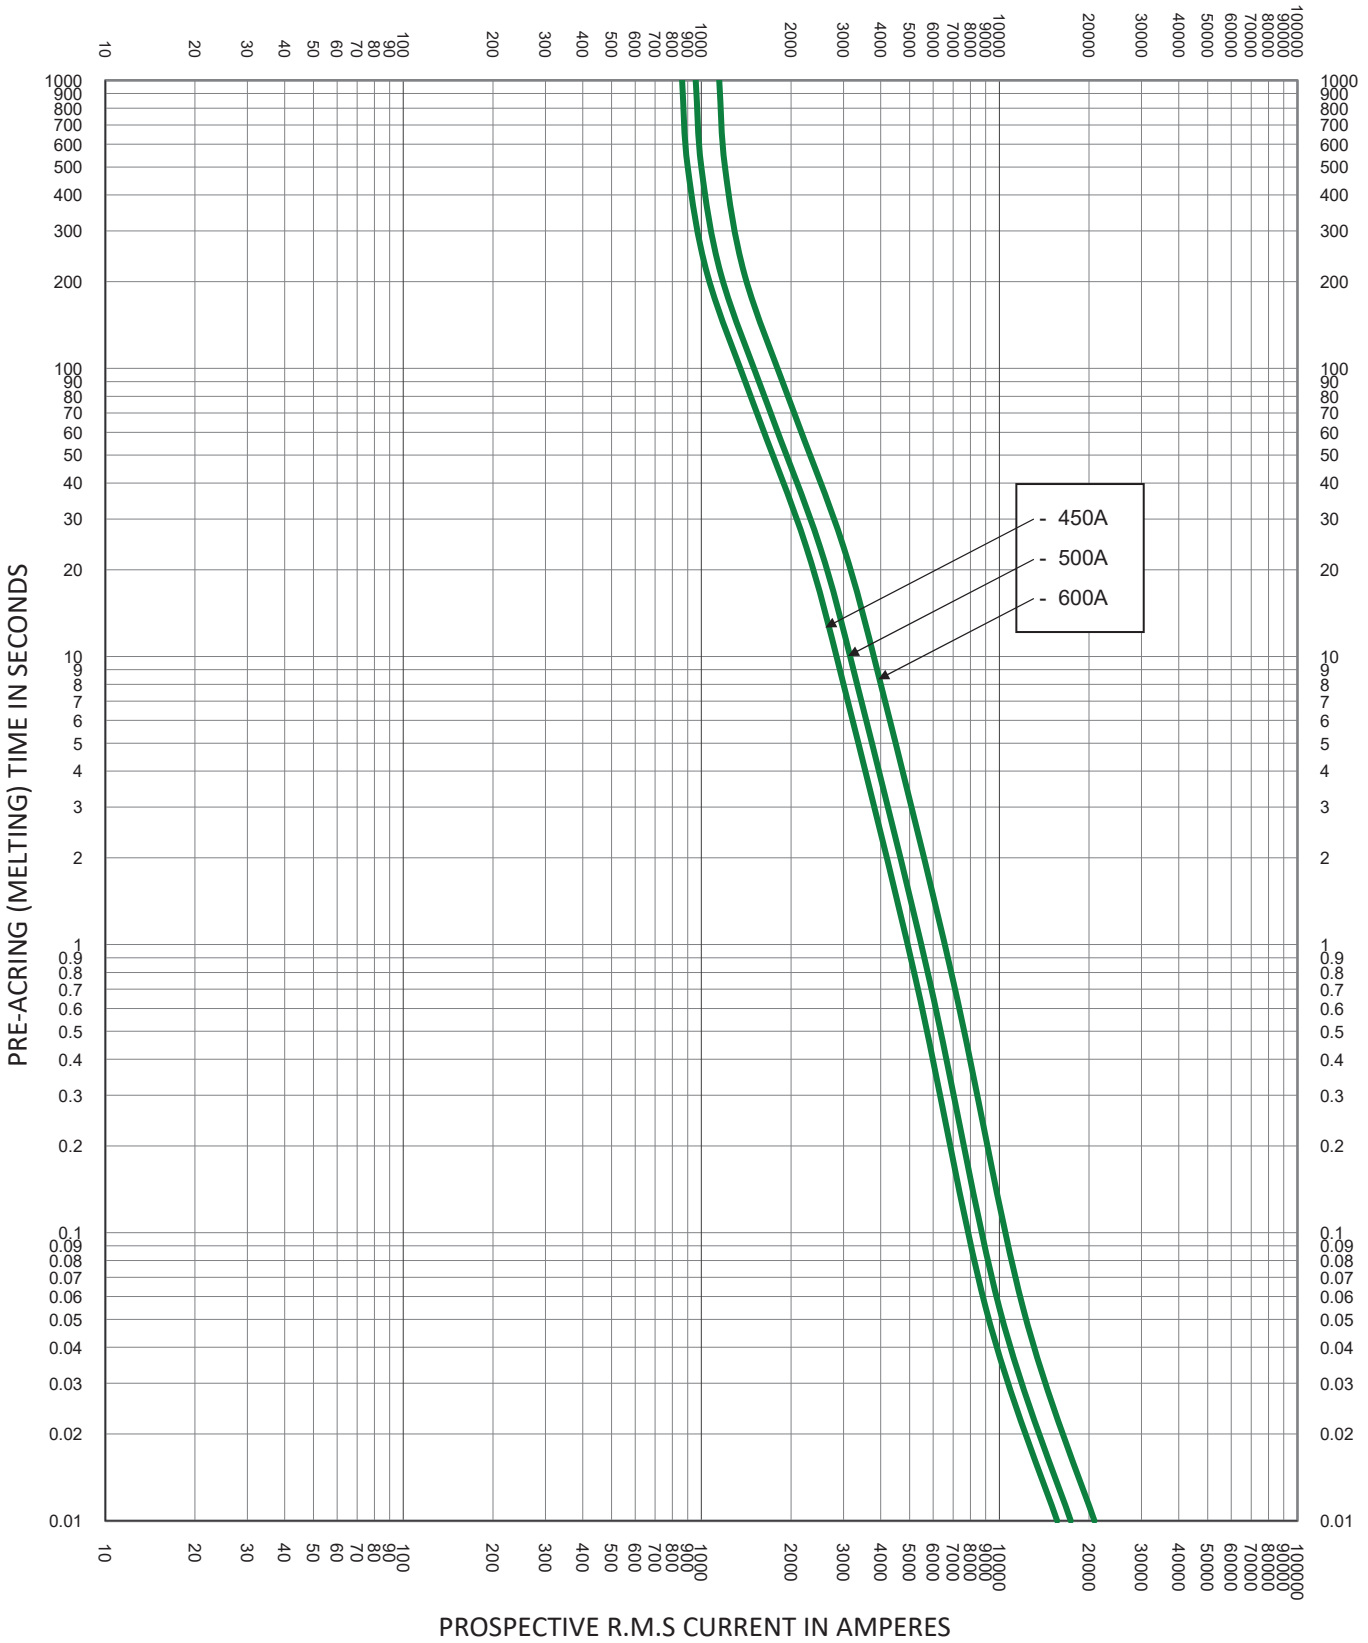

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		IDSR 1/10 - 600 A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 05/25/2021 REVISION: A
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: SHEET 17 OF 17 <b>FCC01-IDSR</b>