
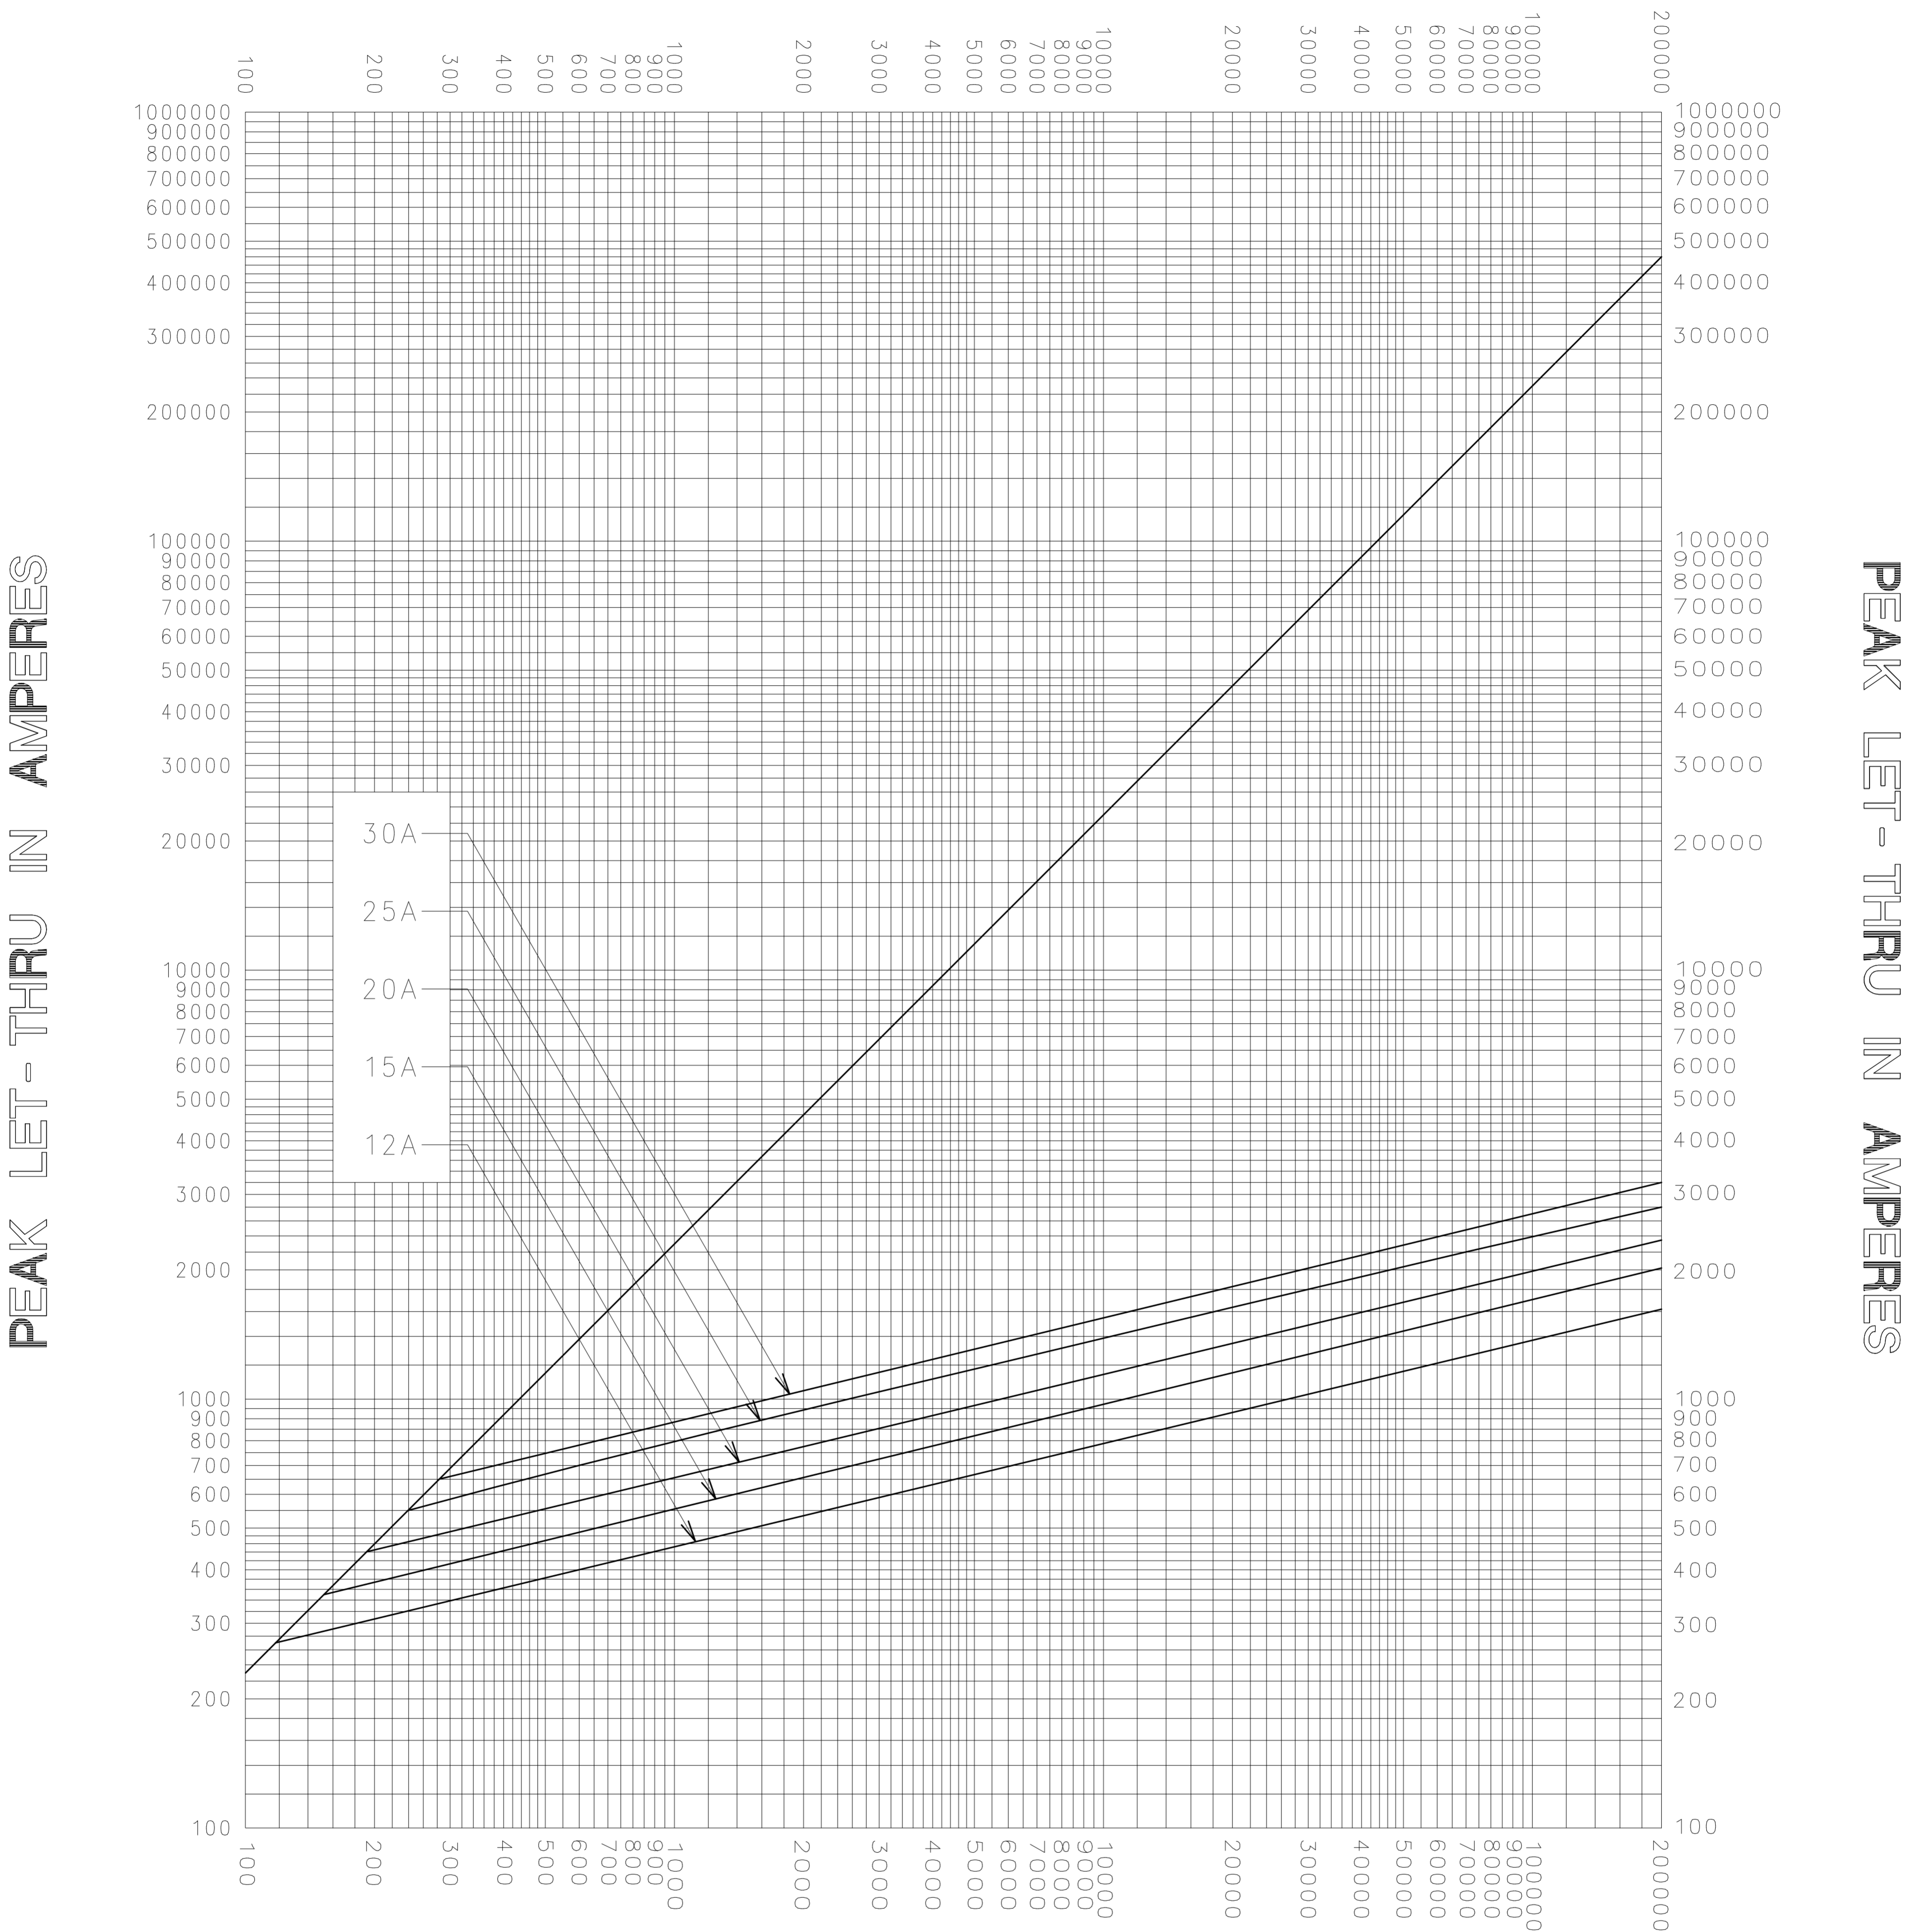


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**



**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLKR (12A - 30A)
BASIS FOR DATA _____	

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>09/06/06</u> CHECKED BY <u>MP</u>
	PEAK LET-THRU CHARACTERISTIC CURVES DRAWING NO. <u>A-FCC05</u>

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**